



# COM600 series, version 4.1 IEC 61850 Master (OPC) User's Manual



**Contents:**

<b>1. About this manual .....</b>	<b>7</b>
1.1. Copyright .....	7
1.2. Disclaimer .....	7
1.3. Conformity .....	8
1.4. Trademarks .....	8
1.5. General .....	8
1.6. Document conventions .....	9
1.7. Use of symbols .....	10
1.8. Terminology .....	10
1.9. Abbreviations .....	12
1.10. Related documents .....	13
1.11. Document revisions .....	13
<b>2. Introduction .....</b>	<b>14</b>
2.1. General about the COM600 series .....	14
2.2. Functional overview .....	14
2.3. IEC 61850 OPC Server features .....	16
<b>3. Configuration .....</b>	<b>17</b>
3.1. Building object tree .....	17
3.1.1. General about building object tree .....	17
3.1.2. Adding Gateway or Computer Node object .....	18
3.1.3. Adding IEC 61850 OPC Server object .....	19
3.1.4. Adding IEC 61850 Subnetwork objects .....	20
3.1.5. Adding IEC 61850 IED objects .....	21
3.2. Configuring objects .....	22
3.2.1. Configuring object properties .....	22
3.2.2. Configuring IEC 61850 OPC Server properties .....	23
3.2.3. Configuring IEC 61850 Subnetwork properties .....	25
3.2.4. Configuring IEC 61850 Device properties .....	26
3.2.5. Configuring Logical Device properties .....	32
3.2.6. Measurement limit supervision .....	33
3.2.6.1. Configuring OPC-based measurement limit supervision and units .....	33
3.2.6.2. Configuring MV properties .....	34
3.2.6.3. Configuring CMV properties .....	34
3.2.6.4. Configuring SAV properties .....	35
3.2.6.5. Configuring SEQ properties .....	35
3.2.6.6. Configuring DEL properties .....	36
3.2.6.7. Configuring WYE properties .....	36
3.2.7. Viewing data object configuration .....	38
3.2.8. Configuring report control blocks .....	39
3.3. IEC 61850 data publishing .....	40
3.3.1. About data sets .....	40

3.3.2.	Configuring data sets .....	40
3.3.2.1.	Dataset Editor .....	40
3.3.2.2.	About data reporting .....	41
3.3.2.3.	Report control block .....	41
3.3.2.4.	Configuring reporting .....	44
3.4.	Configuring GOOSE Analyzer .....	45
3.4.1.	Configuring the GOOSE Analyzer using the Configuration Wizard .....	45
3.4.2.	Configuring GOOSE Analyzer properties .....	49
3.4.3.	Editing GOOSE connection .....	50
<b>4.</b>	<b>Operation .....</b>	<b>51</b>
4.1.	Activating COM600 with new configuration .....	51
4.2.	IEC 61850 OPC Server diagnostics .....	51
4.3.	Diagnostic AE Client .....	52
4.4.	Monitoring and controlling IEC 61850 subnetwork activity .....	53
4.5.	Monitoring and controlling IEC 61850 device communication .....	54
4.6.	Monitoring and controlling IEC 61850 data object communication .....	55
<b>5.</b>	<b>Technical reference .....</b>	<b>57</b>
5.1.	About this section .....	57
5.2.	IEC 61850 OPC server data object modeling .....	57
5.2.1.	Common data attribute types .....	57
5.2.2.	IEC 61850 quality .....	57
5.2.3.	Mapping quality value to OPC .....	58
5.2.4.	Mapping of DetailedQuality .....	59
5.2.5.	Analogue value (AnalogueValue) .....	59
5.2.6.	Configuration of analogue value (ScaledValueConfig) .....	60
5.2.7.	Range configuration (RangeConfig) .....	60
5.2.8.	Step position with transient indication (ValWithTrans) .....	61
5.2.9.	Pulse configuration (PulseConfig) .....	61
5.2.10.	Originator .....	61
5.2.11.	Unit .....	62
5.2.12.	Vector .....	62
5.2.13.	TimeStamp .....	62
5.2.14.	AbbCommandBitmask .....	63
5.2.15.	Common data class specifications for status information .....	64
5.2.15.1.	Single point status (SPS) .....	64
5.2.15.2.	Double point status (DPS) .....	64
5.2.15.3.	Integer status (INS) .....	65
5.2.15.4.	Enumerated Status (ENS) .....	66
5.2.15.5.	Protection activation information (ACT) .....	66

	5.2.15.6.	Directional protection activation information (ACD) .....	67
	5.2.15.7.	Security violation counter (SEC) .....	68
	5.2.15.8.	Binary counter reading (BCR) .....	69
5.2.16.		Common data class specifications for measured information .....	70
	5.2.16.1.	Measured value (MV) .....	70
	5.2.16.2.	Complex measured value (CMV) .....	71
	5.2.16.3.	Sampled value (SAV) .....	72
	5.2.16.4.	WYE .....	73
	5.2.16.5.	Delta (DEL) .....	73
	5.2.16.6.	Sequence (SEQ) .....	74
5.2.17.		Common data class specifications for controllable status information .....	75
	5.2.17.1.	Controllable single point (SPC) .....	75
	5.2.17.2.	Controllable double point (DPC) .....	77
	5.2.17.3.	Controllable integer status (INC) .....	80
	5.2.17.4.	Controllable Enumerated Status (ENC) .....	81
	5.2.17.5.	Binary controlled step position information (BSC) .....	83
	5.2.17.6.	Integer controlled step position information (ISC) .....	85
5.2.18.		Common data class specifications for controllable analogue information .....	87
	5.2.18.1.	Analog set point (APC) .....	87
5.2.19.		Common data class specifications for status settings .....	89
	5.2.19.1.	Single point setting (SPG) .....	89
	5.2.19.2.	Integer status setting (ING) .....	89
5.2.20.		Common data class specifications for analogue settings .....	90
	5.2.20.1.	Analogue setting (ASG) .....	90
	5.2.20.2.	Setting curve (CURVE) .....	91
5.2.21.		Common data class specifications for description information .....	92
	5.2.21.1.	Device name plate (DPL) .....	92
	5.2.21.2.	Logical node name plate (LPL) .....	92
5.2.22.		Application error codes .....	93
5.3.		Attributes .....	94
	5.3.1.	General about attributes .....	94
	5.3.2.	Server attributes .....	94
	5.3.3.	IEC 61850 subnetwork attributes .....	96
	5.3.4.	IEC 61850 device attributes .....	99
	5.3.5.	Transparent XSAT .....	103
	5.3.6.	IEC 61850 logical device attributes .....	106
5.4.		IEC 61850 File transfer .....	106
	5.4.1.	General about IEC 61850 File Transfer .....	106
	5.4.2.	File Transfer attributes .....	107

5.4.3.	File Transfer services .....	108
5.4.4.	File Transfer service codes .....	113
5.5.	ACSI conformance statement .....	114
5.5.1.	General about ACSI conformance statement .....	114
5.5.2.	ACSI basic conformance statement .....	115
5.5.3.	ACSI models conformance statement .....	115
5.5.4.	ACSI service conformance statement .....	117
<b>Index</b>	.....	<b>123</b>

## 1. About this manual

### 1.1. Copyright

This document and parts thereof must not be reproduced or copied without written permission from ABB, and the contents thereof must not be imparted to a third party, nor used for any unauthorized purpose.

The software or hardware described in this document is furnished under a license and may be used, copied, or disclosed only in accordance with the terms of such license.

#### Warranty

Please inquire about the terms of warranty from your nearest ABB representative.

<http://www.abb.com/substationautomation>

### 1.2. Disclaimer

The data, examples and diagrams in this manual are included solely for the concept or product description and are not to be deemed as a statement of guaranteed properties. All persons responsible for applying the equipment addressed in this manual must satisfy themselves that each intended application is suitable and acceptable, including that any applicable safety or other operational requirements are complied with. In particular, any risks in applications where a system failure and/ or product failure would create a risk for harm to property or persons (including but not limited to personal injuries or death) shall be the sole responsibility of the person or entity applying the equipment, and those so responsible are hereby requested to ensure that all measures are taken to exclude or mitigate such risks.

This product is designed to be connected and to communicate information and data via a network interface, which should be connected to a secure network. It is sole responsibility of person or entity responsible for network administration to ensure a secure connection to the network and to establish and maintain any appropriate measures (such as but not limited to the installation of firewalls, application of authentication measures, encryption of data, installation of anti virus programs, etc) to protect the product, the network, its system and the interface against any kind of security breaches, unauthorized access, interference, intrusion, leakage and/or theft of data or information. ABB is not liable for damages and/or losses related to such security breaches, unauthorized access, interference, intrusion, leakage and/or theft of data or information.

This document has been carefully checked by ABB but deviations cannot be completely ruled out. In case any errors are detected, the reader is kindly requested to notify the manufacturer. Other than under explicit contractual commitments, in no event shall ABB

be responsible or liable for any loss or damage resulting from the use of this manual or the application of the equipment.

### **1.3. Conformity**

This product complies with the directive of the Council of the European Communities on the approximation of the laws of the Member States relating to electromagnetic compatibility (EMC Directive 2004/108/EC) and concerning electrical equipment for use within specified voltage limits (Low-voltage directive 2006/95/EC). This conformity is the result of tests conducted by ABB in accordance with the product standards EN 50263 and EN 60255-26 for the EMC directive, and with the product standards EN 60255-1 and EN 60255-27 for the low voltage directive. The product is designed in accordance with the international standards of the IEC 60255 series.

### **1.4. Trademarks**

ABB is a registered trademark of ABB Group. All other brand or product names mentioned in this document may be trademarks or registered trademarks of their respective holders.

### **1.5. General**

This manual provides thorough information on the IEC 61850 Master Protocol (OPC) 1.1 (later referred to as IEC 61850 OPC Server) and the central concepts related to it. You find instructions on how to configure IEC 61850 OPC Server related objects. The basic operation procedures are also discussed.

Information in this user's manual is intended for application engineers who configure the IEC 61850 OPC Server.

As a prerequisite, you should understand the basic principles and the IEC 61850 technology and standard.

This user's manual is divided into following sections:

#### **Introduction**

This section gives an overview of the IEC 61850 OPC Server and its features.

## Configuration

In this section you will find an overview of configuration. You are given instructions on how to configure IEC 61850 OPC Server related objects and the model of a sub-station or system.

## Operation

This section covers the basic operation procedures you can carry out when transferring or activating Grid Automation Controller COM600 (later referred to as COM600) with new configurations.

You are also given instructions on how to monitor and control the conditions of IEC 61850 network.

## Technical reference

This section describes the IEC 61850 data modeling. This section also contains attributes and a list of status codes.

## 1.6. Document conventions

The following conventions are used for the presentation of material:

- The words in names of screen elements (for example, the title in the title bar of a window, the label for a field of a dialog box) are initially capitalized.
- Capital letters are used for the name of a keyboard key if it is labeled on the keyboard. For example, press the ENTER key.
- Lowercase letters are used for the name of a keyboard key that is not labeled on the keyboard. For example, the space bar, comma key, and so on.
- Press CTRL+C indicates that you must hold down the CTRL key while pressing the C key (to copy a selected object in this case).
- Press ESC E C indicates that you press and release each key in sequence (to copy a selected object in this case).
- The names of push and toggle buttons are boldfaced. For example, click **OK**.
- The names of menus and menu items are boldfaced. For example, the **File** menu.
  - The following convention is used for menu operations: **MenuName > MenuItem > CascadedMenuItem**. For example: select **File > New > Type**.
  - The **Start** menu name always refers to the **Start** menu on the Windows taskbar.
- System prompts/messages and user responses/input are shown in the Courier font. For example, if you enter a value out of range, the following message is displayed:

```
Entered value is not valid. The value must be 0 - 30 .
```

- You can be asked to enter the string MIF349 in a field. The string is shown as follows in the procedure:

MIF349

- Variables are shown using lowercase letters:

sequence name

## 1.7. Use of symbols

This publication includes warning, caution, and information icons that point out safety-related conditions or other important information. It also includes tip icons to point out useful information to the reader. The corresponding icons should be interpreted as follows.



The electrical warning icon indicates the presence of a hazard which could result in electrical shock.



The warning icon indicates the presence of a hazard which could result in personal injury.



The caution icon indicates important information or warning related to the concept discussed in the text. It may indicate the presence of a hazard which could result in corruption of software or damage to equipment or property.



The information icon alerts the reader to relevant facts and conditions.



The tip icon indicates advice on, for example, how to design your project or how to use a certain function.

## 1.8. Terminology

Term	Description
Alarm	An abnormal state of a condition.
Alarms and Events; AE	An OPC service for providing information about alarms and events to OPC clients.
Data Access; DA	An OPC service for providing information about process data to OPC clients.

Term	Description
Data Object; DO	Part of a logical node object representing specific information, for example, status, or measurement. From an object-oriented point of view, a data object is an instance of a class data object. DOs are normally used as transaction objects; that is, they are data structures.
Data Set	The data set is the content basis for reporting and logging. The data set contains references to the data and data attribute values.
Device	A physical device that behaves as its own communication node in the network, for example, protection relay.
Event	Change of process data or an OPC internal value. Normally, an event consists of value, quality, and timestamp.
Intelligent Electronic Device	A physical IEC 61850 device that behaves as its own communication node in the IEC 61850 protocol.
Logical Device; LD	Representation of a group of functions. Each function is defined as a logical node. A physical device consists of one or several LDs.
Logical Node; LN	The smallest part of a function that exchanges data. An LN is an object defined by its data and methods.
LON	A communication protocol developed by Echelon.
LON Application Guideline for substation automation; LAG	A proprietary method of ABB on top of the standard LON protocol.
OPC	Series of standards specifications aiming at open connectivity in industrial automation and the enterprise systems that support industry.
OPC item	Representation of a connection to the data source within the OPC server. An OPC item is identified by a string <object path>:<property name>. Associated with each OPC item are Value, Quality, and Time Stamp.
Property	Named data item.
Report Control Block	The report control block controls the reporting processes for event data as they occur. The reporting process continues as long as the communication is available.
SPA	ABB proprietary communication protocol used in substation automation.
SPA device	Protection and/or Control Product supporting the SPA protocol version 2.5 or earlier.
Substation Configuration Language; SCL	XML-based description language for configurations of electrical substation IEDs. Defined in IEC 61850 standard.

## 1.9. Abbreviations

Abbreviation	Description
AE	Alarms and Events
ASDU	Application Service Data Unit
BRCB	Buffered Report Control Block
DA	Data Access
DMCD	Data Message Code Definition
DO	Data Object
GW	Gateway, component connecting two communication networks together
HMI	Human Machine Interface
IEC	International Electrotechnical Commission
IED	Intelligent Electronic Device
LAG	LON Application Guideline for substation automation
LAN	Local Area Network
LD	Logical Device
LMK	LonMark interoperable device communicating in LonWorks network. In this document, the term is used for devices that do not support the ABB LON/LAG communication.
LN	Logical Node
LSG	LON SPA Gateway
NCC	Network Control Center
NUC	Norwegian User Convention
NV	Network Variable
OLE	Object Linking and Embedding
OPC	OLE for Process Control
P&C	Protection & Control
PLC	Programmable Logic Controller
POU	Program Organization Unit
RTS	Request To Send
SA	Substation Automation
SCD	Substation Configuration Description
SCL	Substation Configuration Language
SFC	Sequential Function Chart
SLD	Single Line Diagram
SNMP	Simple Network Management Protocol

Abbreviation	Description
SNTP	Simple Network Time Protocol
SOAP	Simple Object Access Protocol
RCB	Report Control Block
URCB	Unbuffered Report Control Block
XML	eXtended Markup Language

## 1.10. Related documents

Name of the manual	MRS number
COM600 User's Manual	1MRS756125

## 1.11. Document revisions

Document version/date	Product revision	History
A/30.6.2004	1.0	Document created
B/25.2.2005	1.1	File Transfer function additions
C/16.10.2006	3.0	Document revised
D/22.1.2007	3.0	Document revised
E/8.6.2007	3.0	Document revised
F/21.12.2007	3.1	Document revised
G/17.6.2008	3.2	Document revised
H/13.2.2009	3.3	Document revised
J/06.11.2009	3.4	Document revised
K/30.6.2011	3.5	Document revised
L/31.5.2012	4.0	Document revised
M/13.3.2015	4.1	Document revised

## 2. Introduction

### 2.1. General about the COM600 series

The COM600 series comprises of substation management units that are deployed together with protection and control relays and other communication devices, such as Relion® protection and control relays and Remote I/O units, to realize smart substation and grid automation solutions in utility and industrial medium voltage distribution networks. They are a unique combination of following features:


- Process visualization (HMI)
- Real-time and historical data handling
- Platform for executing industrial and utility substation applications
- Communication gateway

The COM600 series 4.1 release comprises of the following products:

- COM600S – COM600 for substation automation(for IEC and ANSI markets)
  - COM600S is a substation automation and data management unit that integrates devices, facilitates operations and manages communication in utility or industrial distribution substations.
- COM600F – COM600 for feeder automation (for ANSI/US markets only)
  - COM600F is a feeder automation and data management unit that runs distributed grid applications in ANSI standard-based utility power networks.

### 2.2. Functional overview

The IEC 61850 OPC Server enables OPC clients to access process data from IEC 61850 devices.

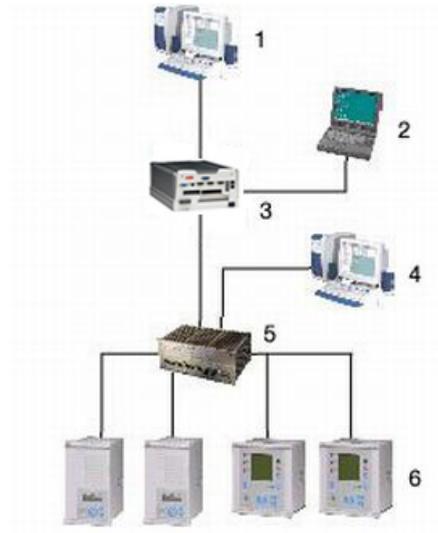

Introduction-1.jpg

*Figure 2.2-1 IEC 61850 OPC Server system overview*

- (1) Network Control Center (NCC)
- (2) Station Automation Builder 600 (SAB600)
- (3) COM600 with IEC 61850 OPC Server
- (4) MicroSCADA Pro with IEC 61850 OPC Server
- (5) Ethernet switch
- (6) Protection and control devices communicating through IEC 61850 protocol

The IEC 61850 OPC server can be used as a part of COM600 or as a part of the MicroSCADA Pro system (see Figure 2.2-1).

To create a common data interface between the OPC server and client, the process data is modeled using the IEC 61850 protocol. The IEC 61850 protocol is a set of specifications, which details layered substation communication architecture. The International Standard IEC 61850 has been prepared by IEC technical committee 57: Power system control and associated communications.

The IEC 61850 specifies usage of Manufacturing Message Specification (MMS, ISO 9506) over TCP/IP as communication between the IEC 61850 server and client (device/IEC 61850 OPC Server).

After the IEC 61850 OPC Server and other required components are installed, you can build and configure hierarchically structured models of a substation or a system for the IEC 61850 OPC Server using Station Automation Builder 600 (later referred to as SAB600) configuration files and device.

The configuration data is stored in SCL (XML-based) format. After the IEC 61850 OPC Server has been launched, it reads the configuration file and establishes communication with the IEC 61850 devices through the IEC 61850 protocol stack.

Configured IEC 61850 devices and their data are then exposed to OPC clients through an OPC Data Access (DA) server and device reported changes in data with DA subscription are reported to OPC clients.

## 2.3. IEC 61850 OPC Server features

The IEC 61850 OPC Server supports the following features:

- OPC Data Access v. 1.0/2.0
- OPC Alarms and Events specifications v. 1.10
- Communication diagnostics
- IEC 61850 data modeling
- System supervision:
  - IEC 61850 device communication
- Command handling:
  - The IEC 61850 OPC Server supports the IEC 61850 command services.
- IEC 61850-Ed1 data objects:
  - SPS, DPS, INS, ACT, ACD, SEC, BCR, MV, CMV, SAV, WYE, DEL, SEQ, SPC, DPC, BSC, ISC, APC, SPG, ING, ASG, CURVE, DPL, LPL.
- IEC 61850 buffered and unbuffered reporting services
- IEC 61850 File Transfer
- IEC 61850 GOOSE receive (received GOOSE data updated to OPC)
- Automatic Disturbance Recording upload using IEC 61850 file transfer or FTP
- SPA TCP
- SPA Parameter access (configured with Parameter Filtering Tool)
- Time synchronization:
  - The IEC 61850 OPC Server can act as an SNTP client and server for time synchronization. When the IEC 61850 OPC Server is configured for receiving time synchronization, it updates the operating system time of the PC.
- Multiple instance support
- GOOSE Analyzer support


## 3. Configuration

### 3.1. Building object tree

#### 3.1.1. General about building object tree

Before you can start using the IEC 61850 OPC Server, you must build and configure an object tree in SAB600 to define the Communication structure.

Figure 3.1.1-1 shows an example of an object tree after it has been built. In the example tree, you can see the IEC 61850 OPC Server object and its child objects like subnetworks, devices and data objects. Indentation is used to indicate the parent-child relationship between the objects.

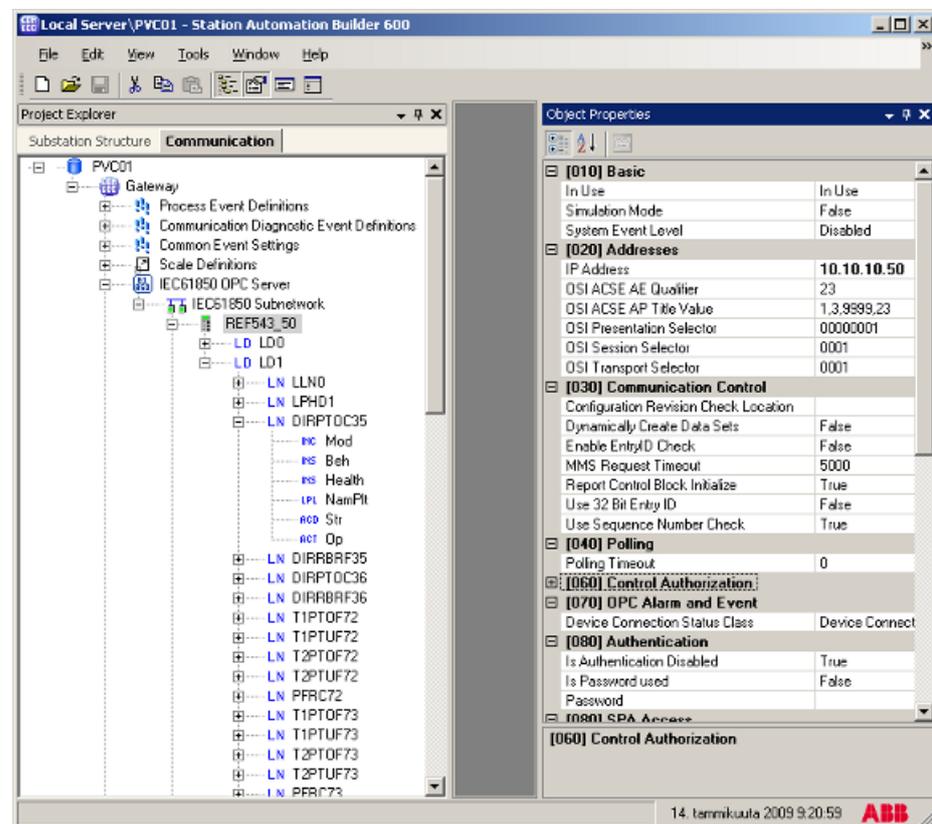

IECSAB600Main.bmp

Figure 3.1.1-1 Example view of SAB600

You have several possible ways to add objects to the object tree in the Communication structure:

- You can right-click the object to which you want to add a child object.
- You can copy the object.
- You can drag and drop the object.

Add the objects in the following order:

1. Gateway (COM600) or Computer Node (MicroSCADA Pro)
2. IEC 61850 OPC Server
3. IEC 61850 Subnetwork
4. IEC 61850 Device (IEC 61850 IED)
5. Import device configurations.



If you want to connect Device Connection Status events to device objects at this point, make sure that you have already created and configured the event objects.

For information on building a substation structure, refer to COM600 HMI Configuration Manual.

### 3.1.2.

#### **Adding Gateway or Computer Node object**

To add a Gateway or Computer Node object:

1. To start building the object tree, add a COM600 Gateway object in the Communication structure by selecting the project name.
2. Right-click the project name and select **New > Communication > Gateway**, see Figure 3.1.2-1.

Continue building the object tree in the same way until you have added all the necessary objects in your current project.

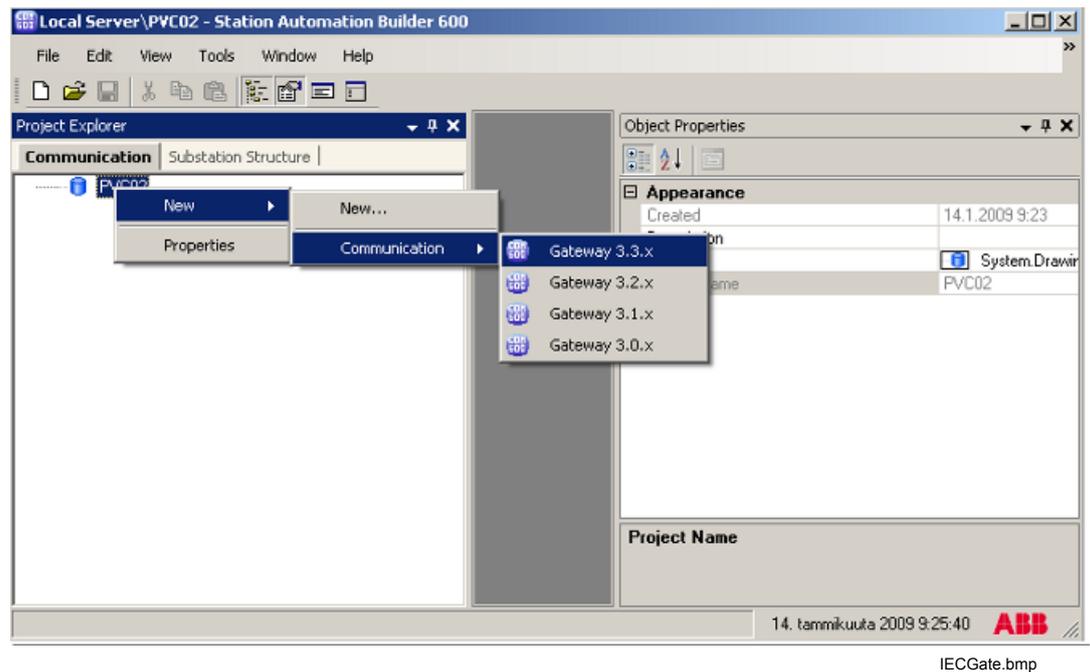


Figure 3.1.2-1 Adding a COM600 Gateway object

### 3.1.3. Adding IEC 61850 OPC Server object

After the Gateway object has been successfully added, you can continue building the object tree by adding an IEC 61850 OPC Server object.

To add an IEC 61850 OPC Server object:

1. Select the Gateway object in the Communication structure.
2. Right-click the Gateway object.
3. Add an IEC 61850 OPC Server object.

By using the SCL Import function, it is possible to import configurations of an entire server or individual devices without having to insert them manually.

To open the SCL Import function:

1. Click the wanted object.
2. Select **Tools > SCL Import**.


Connectivity Packages for certain protection and control devices may also support other ways to build this structure, depending on the configuration of an individual device, for example device-related object types and wizards. Typically, Connectivity Packages include SCL description files which must be installed. For further information on these Connectivity Packages, see the Connectivity Package of a certain device in the product documentation.

You can also import the whole communication structure under IEC 61850 OPC Server with new configurations from an existing file. The communication structure is imported using the SCL import function. The file extensions for the import files can be .icd, .cid, .scd, or .xml. Right-click the IEC 61850 OPC Server and select **SCL Import** from the shortcut menu, see Figure 3.1.3-1 .

To import a new configuration file:

1. Click **Select File**.
2. Browse to a new configuration file from the appearing dialog.
3. Select the file and click **Open**.
4. Select the device to import from the drop-down list. You can preview the configuration on the right.
5. Click **Import**.

The new preconfigured objects appear in the object tree. If the configuration file is large, the import can take time. To import a configuration file for a different OPC Server, right-click the OPC Server, select **SCL Import** again, and repeat the steps above.

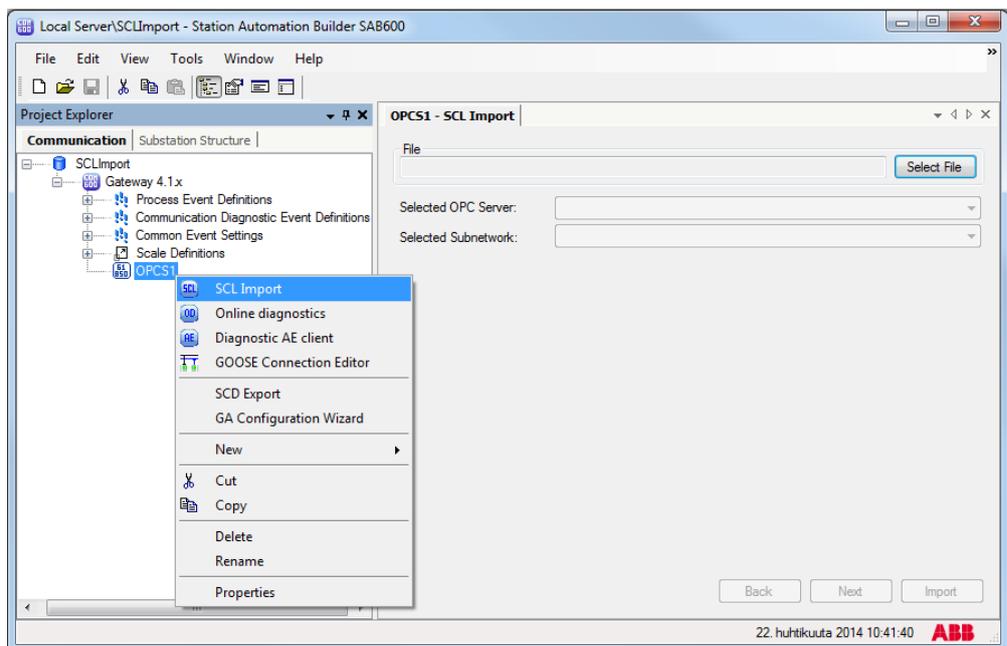

SCLImport.png

Figure 3.1.3-1 IEC 61850 OPC Server SCL Import

For more information about the SCL Import function, see COM600 User's Manual.

### 3.1.4. Adding IEC 61850 Subnetwork objects

After the server object has been successfully added, you can continue building the object tree by adding IEC 61850 subnetwork objects.

To add an IEC 61850 subnetwork object:

1. Select an IEC 61850 OPC Server object.
2. Right-click the IEC 61850 OPC Server object.
3. Add an IEC 61850 subnetwork object.
4. Rename the new object. The names of the IEC 61850 subnetwork objects have to be unique.



You can define one subnetwork per OPC Server.

### 3.1.5. Adding IEC 61850 IED objects

After adding a subnetwork you can add device objects.

To add a Device object:

1. Select a Subnetwork object.
2. Add an IEC 61850 Device (IEC 61850 IED) object.
3. Rename the new object. The names of the devices within an IEC 61850 channel have to be unique.

The maximum number of devices per each subnetwork is 30.

With SCL import function, you can import new objects with configurations from an existing file. Right-click the device and select **SCL Import** from the shortcut menu, see Figure 3.1.3-1.

To import a new configuration file:

1. Click **Select File**.
2. Browse to a new configuration file from the appearing dialog.
3. Select the file and click **Open**.
4. Select the device to import from the drop-down list. You can preview the configuration on the right.
5. Click **Import**.

The new preconfigured objects appear in the object tree. If the configuration file is large, the import may take time. To import a configuration file for a different device, right-click the device, select **SCL Import** again and repeat the steps above.

For more information about the SCL Import function, see COM600 User's Manual.


## 3.2. Configuring objects

### 3.2.1. Configuring object properties

After the objects have been added, you must configure the object properties.

To configure an object:

1. Select an object in the object tree of the Communication structure.
2. The object properties appear now in the Object Properties window, see Figure 3.2.1-1. You can see the selected object on the left and the available properties on the right.
3. Select the property you want to configure. Depending on the property value type, configuring is always done either by
  - selecting a predefined value from a drop-down combo box, or
  - entering a text string or a numerical value in a text field.

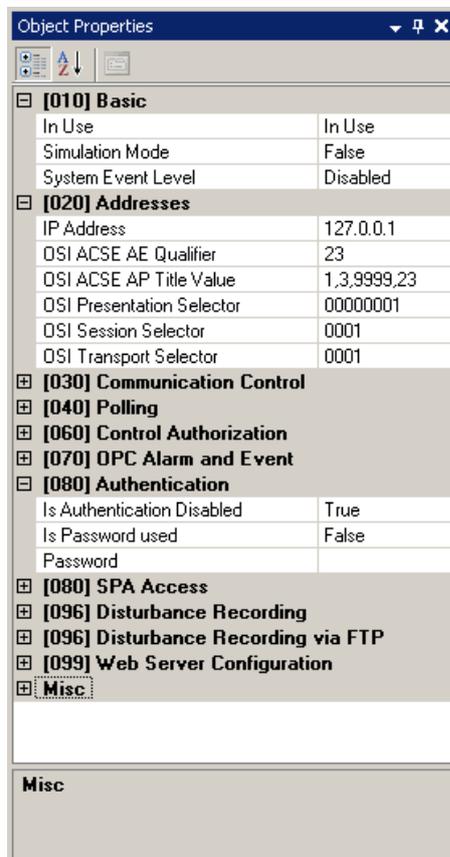

IECObjProp.bmp

Figure 3.2.1-1 Example of object properties

The available properties for different objects are listed in the following subsections.

### 3.2.2. Configuring IEC 61850 OPC Server properties

Table 3.2.2-1 lists the configurable IEC 61850 OPC Server properties and value ranges for them. The actual configuration by using SAB600 is performed as described in 3.2.1, Configuring object properties.

**Table 3.2.2-1 IEC 61850 OPC Server properties**

Name	Value/Value range	Description
<b>Basic</b>		
AE Prog ID		Prog ID for OPC Alarm and Event Server (Automatically generated by management function)
DA Prog ID		Prog ID for OPC Data Access Server
Enable reading of d-attribute (description) from IED	True False Default: False	Specifies whether the d attribute (description) is read from the IED. Normally d is not reported from the IED. It is only read if read operation is requested e.g. with Online Diagnostics. When set to false, the text of the data object Description property is used.
<b>SNTP Client</b>		
1. Address for SNTP Server		IP address or node name for SNTP Server (Primary)
1. Port Number	(1..65535) Default: 123	TCP/IP port number
1. Synchronization Interval	(0..3600) Default: 15	Time synchronization interval in seconds. If value is 0, no time synchronization will be done.
2. Address for SNTP Server		IP address or node name for SNTP Server
2. Port Number	(1...65535) Default: 123	TCP/IP port number
2. Synchronization Interval	(0..3600) Default: 15	Time synchronization interval in seconds. If value is 0, no time synchronization will be done.
3. Address for SNTP Server		IP address or node name for SNTP Server
3. Port Number	(1...65535) Default: 123	TCP/IP port number
3. Synchronization Interval	(0..3600) Default: 15	Time synchronization interval in seconds. If value is 0, no time synchronization will be done.

Name	Value/Value range	Description
4. Address for SNTP Server		IP address or node name for SNTP Server
4. Port Number	(1...65535) Default: 123	TCP/IP port number
4. Synchronization Interval	(0..3600) Default: 15	Time synchronization interval in seconds. If value is 0, no time synchronization will be done.
SNTP Enable Client	True False Default: True	Controls if time synchronization client is initially in use or not
<b>SNTP Server</b>		
Enable Time Synchronization server	True False Default: True	Controls if time synchronization server is initially in use or not
Port Number For Time Synchronization Server	(1...65535) Default: 123	Port number for time synchronization server
<b>Communication Control</b>		
Report Control Identity	Default: Client1	<p>Report Control Identity specifies, which report control block instance is used by the OPC Server. The value must match with the Report Client attribute under the Report Enabled attribute of the report control block to be used.</p> <p>To enable the IEC 61850 OPC Server to use the specific report control blocks and therefore receive spontaneous events, the Report Control Identity field must match with one of the Report enabled fields on device's report control block configurations. This dedicates a report control block's specific instance from the device to be used by the IEC 61850 OPC Server. If the fields do not match, the configured report control block is discarded.</p>

Name	Value/Value range	Description
Server Originator Category	Control operation issued from an operator using a client located at station level  Control operation issued from an unknown location  Control operation from a remote operator outside the substation (for example network control center)  Default: Control operation issued from an operator using a client located at station level	Specifies the default originator category that is used for changing values and IEC 61850 control services. This can be overridden by OPC client for DPC control.
Server Originator Identification	Free string (max length 64 characters). For numeric values hex code can be used (starting with "0x" e.g. 0xABB).  Default: ABB	Specifies the default originator identification that is used for IEC 61850 control services.
System Event Level	Disabled  Level 1 (main operation and errors)  Level 2 (time synchronization errors)  Level 3 (time synchronization done)  Level 4 (reported local updates from devices)  Level 5 (reported unconfigured updates from devices)  Default: Disabled	Level of system event that are sent from the OPC Server. Amount of events sent is cumulative, higher level also contains lower level events. System event level configuration at OPC Server level overrides definitions at subnetwork and device levels.

### 3.2.3.

### Configuring IEC 61850 Subnetwork properties

The IEC 61850 Subnetwork properties that can be configured and value ranges for them can be found in Table 3.2.3-1. The actual configuration by using SAB600 is performed as described in 3.2.1, Configuring object properties.



Each IEC 61850 node of the system must have a unique sub-network/node address.

**Table 3.2.3-1 IEC 61850 Subnetwork properties**

Property/Parameter	Value or Value range/ Default	Description
<b>Basic</b>		
In Use	In Use Not In Use Default: In Use	Controls whether the device communication is initially in use or not
<b>Communication Port</b>		
Communication port	ETH0, ETH1...ETHn Default: ETH0	LAN port used by the IEC 61850 protocol for GOOSE receive.
IP Address	127.0.0.1	IP Address for communication channel. Dotted decimal to be used.
<b>Communication Control</b>		
System Event Level	Disabled Level 1 (main operation and errors) Level 2 (time synchronization errors) Level 3 (time synchronization done) Level 4 (reported local updates from devices) Level 5 (reported unconfigured updates from devices) Default: Disabled	Level of system event that are sent from the OPC Server. Amount of events sent is cumulative, higher level also contains lower-level events. System event level configuration at OPC Server level overrides definitions at subnetwork and device levels.
TCP/IP Keepalive Time-out	(1..3600) Default: 15	TCP/IP Keepalive time-out in seconds

**3.2.4.****Configuring IEC 61850 Device properties**

Table 3.2.4-1 lists the configurable properties for IEC 61850 Devices (used for ABB protection and control devices) and value ranges for these properties. The actual configuration by using SAB600 is performed as described on 3.2.1, Configuring object properties.



Each IEC 61850 node of the system must have a unique subnet or node address.

**Table 3.2.4-1 IEC 61850 Device properties**

Name	Value or Value range/ Default	Description
<b>Basic</b>		
In Use	In use Not in use Default: In use	Controls if the device communication is initially in use or not.
Simulation Mode	True False Default: False	Defines if the device is in simulation mode.
System Event Level	Level0=Dis-abled  Level1=Level 1 (main operation, error replies, errors)  Level2=Level 2 (information reports, OK replies, RCB initializing)  Level3=Level 3 (sent requests (connect, read, write), transparent SPA messages)  Level4=Level 4 (reported local updates)  Level5=Level 5 (reported unconfigured updates)	Level of system events (OPC AE events) can be viewed with a SAB600 CET Diagnostic AE client for OPC Server or with an OPC AE client. Amount of events sent is cumulative: higher level also contains lower level events. System event level configuration at subnet-work overrides definitions at device level. The same or higher event level must be set for Subnetwork as for IED.  System events can be used for debugging and event flow monitoring, see Table 3.2.3-1. Event level can be changed during the run time by using the Diagnostic events level attribute, see 5.3.4, IEC 61850 device attributes
<b>Addresses</b>		
IP Address	127.0.0.1	IEC 61850 Node Number of the device
OSI ACSE AE Qualifier	23	IEC 61850 Subnet Number of the device

Name	Value or Value range/ Default	Description
OSI ACSE AP Title Value	1,3,9999,23	OSI ACSE AP Title Value as defined in IEC 61850-8-1.
OSI Presentation Selector	00000001	OSI Presentation Selector as defined in IEC 61850-8-1.
OSI Session Selector	0001	OSI Session Selector as defined in IEC 61850-8-1.
OSI Transport Selector	0001	OSI Transport Selector as defined in IEC 61850-8-1.
<b>Communication Control</b>		
Automatically set daylight saving time	True False Default: False	Automatically set daylight saving time (for SPAZC-40x only!)
Configuration Revision Check Enabled	True False Default: False	If enabled, checks configuration revisions from all logical devices (LDx.LLN0.NamPft.configRev). If configuration revisions do not match between configuration and IED, communication to the IED is not established.
Data Subscribe Method	GOOSE MMS BOTH Default: MMS	<p>Specifies the method used to subscribe data from the IED. MMS: only normal reporting service, GOOSE: only GOOSE message receive, BOTH: both reporting and GOOSE receive used.</p> <p> Publishing the same data through both reporting and GOOSE using BOTH will result to duplicate events.</p> <p> If GOOSE or BOTH is used, the device connection status follows also the GOOSE communication status.</p>

Name	Value or Value range/ Default	Description
Dynamically Create Data Sets	True False Default: False	<p>Specifies whether data sets and reporting are initialized dynamically.</p> <p> Using static data sets is recommended. The IED needs to support this feature. If enabled, all configured data sets are created and report control blocks configured at runtime to the IED after connecting. The dynamic data sets must be configured with the Dataset Editor and designated to available report control blocks. The report control blocks must be configured and dedicated for the IEC 61850 OPC Server instance. Data sets used with buffered reporting are created once when the BRCB is first initialized. Data sets used with unbuffered reporting are created every time the URCB is initialized. Dynamic data sets are not removed.</p>
Enable EntryID Check	True False Default: False	Enable reporting EntryID check. Report EntryIDs are used as sequence numbers for buffered reporting. A gap in sequence numbers caused a restart of reporting starting from lost sequence number.
MMS Request Timeout	0...65535 Default: 5000	Specifies the time out for MMS Request. If 0 it is not in use.
Report Control Block Initialize	True False Default: True	Initialize to report control blocks and enable reporting.
Use 32 Bit Entry ID	True False Default: False	<p>Enables or disables usage of 32 bit EntryIDs for information report sequence.</p> <p>The IEC 61850 standard defines 64 bit EntryID, but e.g. SPA-ZC 40x uses 32 bit EntryID.</p>
Use Sequence Number Check	True False Default: False	Enables or disables sequence number checking information reports for the IEC 61850 OPC server.
<b>Polling</b>		

## IEC 61850 Master (OPC) User's Manual

Name	Value or Value range/ Default	Description
Polling Timeout	(0..3600) Default: 0 (disabled)	Polling Timeout in seconds. If the device does not support reporting, ST and MX attributes can be polled with this interval.
<b>Control Authorization</b>		
Disable Interlockcheck for All Controls	True False Default: False	Disables interlockcheck condition check for all select and operate controls.
Disable Synchrocheck for All Controls	True False Default: False	Disables synchrocheck condition check for all select and operate controls.
Interlock Override Supported	True False Default: False	Specifies whether Interlock Override is supported by this IED.
Station/Remote Switch OPC Path		OPC path of the station remote switch position to be used with this device.  The format is #ProgID For OPC Server#Channel Name\IED Name\Logical Device Name\Logical Node Name\Data Object Name  E.g. #ABB.IEC61850_OPD_Server.Instance[1]#Channel1\IED1\LD1\GGIO1\loc
Synchrocheck Override Supported	True False Default: False	Specifies whether Synchrocheck Override is supported by this IED.
<b>OPC Alarm and Event</b>		
Area Description		Description of area.
Area Name		Specifies which area this IED belongs to.
Device Connection Status Class	Default: Device Connection Status	Device Connection Status Class definition used with current device.
Measurement Limit Supervision	IED Based limit supervision OPC Server based limit supervision	Specifies whether measurement limit supervision is performed by the IEC 61850 OPC Server.

Name	Value or Value range/ Default	Description
<b>Authentication</b>		
Is Authentication Disabled	True False Default: True	Is Authentication Disabled?
Is Password used	True False Default: False	Is Password used?
Password	Default: None	Password used for authentication.
<b>SPA Access</b>		
SPA parameter for Close Password		SPA parameter for close Password.
SPA value for Open Password		SPA parameter value for open Password.
SPA Store parameter name		SPA store parameter name.
SPA Store parameter value	0..65536	SPA store parameter value.
SPA Value for Close Password	0..65536	SPA value for close password.
SPA value for Open Password	0..65536	SPA value for open password.
<b>Disturbance Recording</b>		
Disturbance Recorder Delete Recordings	Default: False	Specifies whether DRs are deleted from IED after upload.
Disturbance Recorder Enabled	Default: False	Specifies whether DR upload is enabled.
Disturbance Recorder Local Directory		Specifies the folder where all disturbance recordings will be stored in COM600 computer. If left empty "C:\COMTRADE\IEDName" will be used.
Disturbance Recorder Maximum Total File Size	0 - 2147483647 0: no limit Default: 0	Specifies maximum size for folder where uploaded DRs are locally stored for this IED.
Disturbance Recorder Polling Period	0 - 2147483647 0: disabled Default: 120	DR polling period in seconds
Disturbance Recorder Remote Directory		Specifies the folder where all disturbance recordings will be stored in this IED.
<b>Disturbance Recording via FTP</b>		

Name	Value or Value range/ Default	Description
Disturbance Recorder FTP Password		FTP password to be used with DR functionality
Disturbance Recorder FTP User Name		FTP username to be used with DR functionality
Disturbance Recorder Read Via FTP	False: MMS (IEC 61850) True: FTP Default: False	Specifies whether DRs shall be read using FTP.
<b>Web Server Configuration</b>		
Web Server Enabled	True False Default: False	Specifies whether IED Web Server is accessible from COM600 HMI.
Web Server IP Address		IP Address for Web Server. Dotted decimal or DNS name to be used. If omitted and Web Server is enabled, IED IP Address is used.

### 3.2.5.

### Configuring Logical Device properties

The logical devices are already configured when they are imported with IEC61850 devices. The configurations can be monitored with viewers, refer to ???.



If SPA Access is configured on the logical device object, the logical device is shown as an own object in the COM600 HMI tree view. This is needed, for example, when multiple SPA-COM modules are connected to a SPA-ZC 402 communication adapter.

**Table 3.2.5-1 Logical Device properties**

Name	Value or Value range/ Default	Description
<b>Transparent SPA</b>		
SPA Address	(0..999) Default: 0	The SPA address of the device connected via TCP/IP.  By setting value >0 enables the built in TCP/SPA client, which can be used through the Transparent SPA attribute, see 5.3.6, IEC 61850 logical device attributes.

Name	Value or Value range/ Default	Description
SPA TCP Port	(1..65535) Default: 7001	SPA TCP Port
SPA TCP Timeout	(1..65535) Default: 3	SPA TCP Timeout in seconds
<b>Control Authoriza- tion</b>		
Station/Remote Switch OPC Path		Station/Remote Switch OPC Path  OPC path of the station remote switch position to be used with this device.  The format is #ProgID For OPC Server#Channel Name\IED Name\Logical Device Name\Logical Node Name\Data Object Name  E.g. #ABB.IEC61850_OPC_DA_Server.Instance[1]#Channel1\IED1\LD1\GGIO1\loc
<b>SPA Access</b>		
SPA parameter for Close Password		SPA parameter for close Password.
SPA value for Open Password		SPA parameter value for open Password.
SPA Store parameter name		SPA store parameter name.
SPA Store parameter value	0..65536	SPA store parameter value.
SPA Value for Close Password	0..65536	SPA value for close password.
SPA value for Open Password	0..65536	SPA value for open password.

### 3.2.6. Measurement limit supervision

#### 3.2.6.1. Configuring OPC-based measurement limit supervision and units

Typically measurement limit value supervision is done by the IEC 61850 IED with the specified LNs. If the IED does not support limit value supervision or does not provide units for the measurements, it is possible to configure the OPC server instead to handle the limit value supervision and to publish units for the measurements to realize a common

IEC 61850 substation supervision functionality for the 800xA operator workplaces. Supervision mode (IED or OPC) can be configured with the Measurement Limit Supervision property of the IEC61850 device for each IED. If the IED based supervision mode is selected, the limit values can be configured with the properties described in the following sections.

The data objects MV, CMV, SEQ, DEL and WYE support measurement limit supervision. MV, CMV, SAV, SEQ, DEL and WYE measurement data objects support overriding unit and multiplier information.

### 3.2.6.2. Configuring MV properties

**Table 3.2.6.2-1 Configurable limit supervision properties for the MV object**

Property	Type
<b>[060] Limit Value Supervision</b>	
High	float
High-High	float
Low	float
Low-Low	float
Max	float
Min	float
<b>[050] Scale and Unit</b>	
SI Unit	Enum
Multiplier	Enum

### 3.2.6.3. Configuring CMV properties

**Table 3.2.6.3-1 Configurable limit supervision properties for the CMV object**

Property	Type
<b>[060] Limit Value Supervision</b>	
High	float
High-High	float
Low	float
Low-Low	float
Max	float
Min	float
<b>[050] Scale and Unit</b>	

Property	Type
SI Unit	Enum
Multiplier	Enum

### 3.2.6.4. Configuring SAV properties

*Table 3.2.6.4-1 Configurable limit supervision properties for the SAV object*

Property	Type
<b>[050] Scale and Unit</b>	
SI Unit	Enum
Multiplier	Enum

### 3.2.6.5. Configuring SEQ properties

*Table 3.2.6.5-1 Configurable limit supervision properties for the SEQ object*

Property	Type
<b>[060] C1 Limit Value Supervision</b>	
High	float
High-High	float
Low	float
Low-Low	float
Max	float
Min	float
<b>[060] C2 Limit Value Supervision</b>	
High	float
High-High	float
Low	float
Low-Low	float
Max	float
Min	float
<b>[060] C3 Limit Value Supervision</b>	
High	float
High-High	float
Low	float
Low-Low	float

Property	Type
Max	float
Min	float
<b>[050] Scale and Unit</b>	
C1 SI Unit	Enum
C1 Multiplier	Enum
C2 SI Unit	Enum
C2 Multiplier	Enum
C3 SI Unit	Enum
C3 Multiplier	Enum

### 3.2.6.6. Configuring DEL properties

*Table 3.2.6.6-1 Configurable limit supervision properties for the DEL object*

Property	Type
<b>[060] Limit Value Supervision</b>	
High	float
High-High	float
Low	float
Low-Low	float
Max	float
Min	float
<b>[050] Scale and Unit</b>	
Phase SI Unit	Enum
Multiplier	Enum

### 3.2.6.7. Configuring WYE properties

*Table 3.2.6.7-1 Configurable limit supervision properties for the WYE object*

Property	Type
<b>[060] Phase Limit Value Supervision</b>	
High	float
High-High	float
Low	float
Low-Low	float

Property	Type
Max	float
Min	float
<b>[060] Net Limit Value Supervision</b>	
High	float
High-High	float
Low	float
Low-Low	float
Max	float
Min	float
<b>[060] Neut Limit Value Supervision</b>	
High	float
High-High	float
Low	float
Low-Low	float
Max	float
Min	float
<b>[060] Res Limit Value Supervision</b>	
High	float
High-High	float
Low	float
Low-Low	float
Max	float
Min	float
<b>[050] Scale and Unit</b>	
Phase SI Unit	Enum
Phase Multiplier	Enum
Neut SI Unit	Enum
Neut Multiplier	Enum
Net SI Unit	Enum
Net Multiplier	Enum
Res SI Unit	Enum
Res Multiplier	Enum

### 3.2.7. Viewing data object configuration

IEC 61850 OPC Server supports data objects for status, measurand, controllable status, and controllable analog information. IEC 61850 OPC Server supports 28 data object types for an IEC 61850 Device. The data objects are already configured when they are imported with IEC 61850 devices. The configurations can be monitored with viewers, refer to ???.

Data classes for status information:

- Single point status (SPS)
- Double point status (DPS)
- Integer status (INS)
- Protection activation information (ACT)
- Directional protection activation information (ACD)
- Security violation counter (SEC)
- Binary counter reading (BCR)

Data classes for measurand information:

- Measured value (MV)
- Complex measured value (CMV)
- Sampled value (SAV)
- WYE
- Delta (DEL)
- Sequence (SEQ)

Data classes for controllable status information:

- Controllable single point (SPC)
- Controllable double point (DPC)
- Controllable integer status (INC)
- Binary controlled step position information (BSC)
- Integer controlled step position information (ISC)

Data classes for controllable analog information:

- Analog set point (APC)

Data objects classes for status settings:

- Single setting point (SPG)
- Integer status setting (ING)

Data classes for analogue settings:

- Analogue setting (ASG)
- Setting curve (CURVE)

Data classes for description information:

- Device name plate (DPL)
- Logical Node name plate (LPL)

Data classes for internal status information:

- Integer status (Internal INS)
- Single point status (Internal SPS)
- Controllable single point (Internal SPC)

The parameters are stored in object properties in SAB600. The actual configuration for data objects is not supported.

### 3.2.8. **Configuring report control blocks**

A report control block (RCB) controls the spontaneous event reporting, and the client can modify report sending behavior by setting RCB attributes. Buffered Report Control Blocks (BRCB) and Unbuffered Report Control Blocks (URCB) are supported RCBs.

For BRCB, events issue immediate sending of reports or buffer the events for transmission, such that data values are not lost due to transport flow control constraints or loss of connection. For URCB, events issue immediate sending of reports on a best efforts basis. If no association exists or if the transport data flow is not fast enough to support it, events may be lost.

To allow multiple clients to receive the same data values, multiple instances of the report control classes must be made available. Report Enabled and Report Client definitions are used to specify RCB instances to clients. Report Enabled shows the maximum number of available RCB instances, and Report Client dedicates an instance to a client (see Report Control Identity in Table 3.2.2-1). All configured RCBs without IEC 61850 OPC Server specified instances are discarded.

Report Clients' order specifies the RCB instance used and the RCB name. IEC 61850 OPC Server builds the RCB instance name to type RCBName<xx>. Each RCB instance takes on the values from 01 to 99 as <xx>, for example the first Report Client uses RCBName01. The naming convention can also be overridden by removing the Report Enabled element. Now the RCBName is used as it is.

The control attribute values are received from the imported device configuration. Some values can be overridden with the IEC 61850 OPC Server configuration.

- **Buffer Time**  
Controls the time interval in milliseconds when the BRCB buffers the events for inclusion into a single report. Overridable.
- **Buffered**  
Controls RCB to buffered (true) or unbuffered (false). Must be true for BRCB.
- **Configuration Revision**  
Represents the number of times that the configuration of the RCB has changed.
- **Data Set**  
Specifies the data set being monitored and what values are reported.
- **Integrity period**

If this is set to integrity (>0), it indicates the period in milliseconds used for generating an integrity report. An integrity report reports the values of all members of the related data set. Overridable.

- **Report ID**  
Report identifier is the BRCB's client-specified report identifier. Report identifier generates the report.
- **Option Fields**  
Client specified optional fields included in the report issued by BRCB. This attribute defines the optional header fields' subset of the report that are included in the report. Refer to IEC 61850-7-2 and IEC 61850-8-1 standards. The IEC 61850 OPC Server uses a default value for option fields to receive the necessary information for event updates and event flow control (cannot be overridden): BRCB (Sequence Number, Reason Code, Buffer Overflow, Entry ID), URCB (Sequence Number, Reason Code). Overridable.
- **Trigger Options**  
Specifies the trigger conditions which BRCB monitors. The following values are defined: Data Change(dchg), Quality Change(qchg), Data Update(dupd), Period.

Buffer time and Integrity period are overridable. Option fields are also overridable, except the default values that IEC 61850 OPC Server uses to receive the necessary information for event updates and event flow control.

### 3.3. IEC 61850 data publishing

#### 3.3.1. About data sets

A data set is an ordered group of data objects and data attributes organized as a single collection for the convenience of the client. Data sets are used to define the values of data to be transmitted in case a value of a data set member changes. A data set is used for reporting and GOOSE messaging.

#### 3.3.2. Configuring data sets

##### 3.3.2.1. Dataset Editor

A data set groups selected data so that a client can access it easily with a single read operation. A data set is also used for event reporting; data is linked to spontaneous event sending only via report control blocks (RCB) data set definition. The client reads other data separately. Data set definitions are located always under the logical device LD0 and logical node LLN0.

The data set can be modified with the Dataset Editor. Open the Dataset Editor by right-clicking the Dataset object and selecting **Dataset Editor**.

The Dataset object has a set of data attributes:

- **IdInst:** Instance of Logical Device to which the referenced data set belongs.
- **Prefix:** Freely configurable part of LN caption.
- **InInst:** Instance of the LN type.
- **InClass:** Logical node class.
- **doName:** Name of the data object from which the data set is formed.
- **daName:** Name of the data attribute from which the data set is formed.  
Data attributes are collected to the data set in groups, and the functional constraint defines the data attributes.
- **fc:** functional constraint  
Functional constraint divides data attributes, which have the same functional constraint, to groups under the same data object. For example, functional constraint ST (status information) groups stVal, q and t data attributes to the data set.

The caption in the object tree consists of Prefix, InClass and InInst values.

### 3.3.2.2. About data reporting

Data changes are used as a trigger for reporting. This information is grouped using a data set. The data set is the content basis for reporting. Reporting uses information reports to transmit data. The data configured in a data set is transmitted in information reports. Reporting is controlled by report control blocks.

### 3.3.2.3. Report control block

Report control describes the conditions for generating information reports based on parameters set by configuration or by a client. Report Control Blocks control the procedures that are required for reporting values of data from logical nodes to one client.

There are buffered and unbuffered report control blocks:

- In a **Buffered Report Control Block (BRCB)** internal events issue immediate sending of reports, or buffer the events for transmission. This way the values of a data object are not lost due to transport flow control constraints or loss of connection. BRCB provides sequence-of-events functionality.
- In an **Unbuffered Report Control Block (URCB)** internal events issue immediate sending of reports on a best efforts basis. If no association exists, or if the transport data flow is not fast enough to support it, events may be lost.

**Table 3.3.2.3-1 Report Control Block object properties**

Property/Parameter	Value or value range/Default	Description
Basic		

Property/Parameter	Value or value range/Default	Description
Buffer Time	Default: 0 milliseconds	With this value, RCB can be configured to wait for other events after the first change before sending the report. Value 0 means that a new change is immediately reported to the client. Configurable.
Buffered	True False Default: True	Controls if the RCB is buffered or unbuffered.
Configuration Revision	0...2147483647	Configuration revision of the data set referenced by this RCB. Every modification in the data set increases the Configuration Revision property by one.
Data Set		The name of the data set to be sent by the report control block.
Indexed	True False Default: True	Indicates if this RCB is configured with indexed naming convention.
Integrity period	0...214748647 Default: 0	Integrity period in milliseconds. If this attribute has a value > 0 ms, an integrity report with all data listed in the data set is sent periodically in this interval. By default, this feature is not enabled, because it generates an unnecessary load to the server and network. If this feature is used, the Trigger Option 'Period' in RCB needs to be enabled. Configurable.
Report ID		Used as identification in information reports to specify that the report is from this RCB. By default report control block MMS path name is used. Configurable.
<b>Option Fields</b>		Defines what information is sent with the information report. Configurable.
Config Reference	True False Default: False	Config Reference

Property/Parameter	Value or value range/Default	Description
Data Ref	True False Default: False	Data Ref
Data Set	True False Default: False	Data Set
Entry ID	True False Default: True	Entry ID
Reason Code	True False Default: True	Reason Code
Sequence Number	True False Default: True	Sequence Number
Time Stamp	True False Default: False	Time Stamp
<b>Trigger Options</b>		Defines the triggering conditions for creating reports.
Data change	True False Default: True	Specifies whether a report entry shall be generated due to a change of the value of the data attribute.
Data Update	True False Default: False	Specifies whether a report entry shall be generated due to freezing the value of an unfreezable attribute or updating the value of any other attribute. An updated value may have the same value as the old value.
Period	True False Default: False	Specifies whether a report entry shall be generated on the expiration of the integrity period.

Property/Parameter	Value or value range/Default	Description
Quality Change	True False Default: True	Specifies whether a report entry shall be generated due to a change of the value of the quality attribute.

### 3.3.2.4. Configuring reporting

Some IEDs require that reporting is configured manually.

To configure reporting:

1. Create and configure a **Data Set** object.

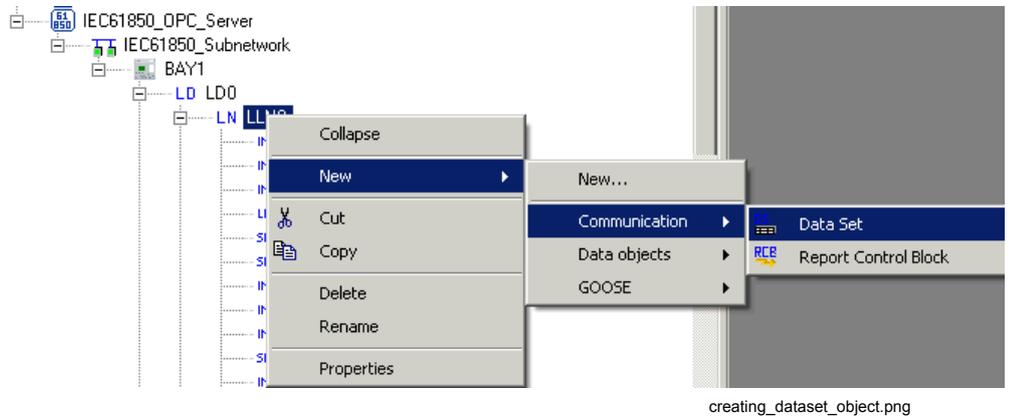



Figure 3.3.2.4-1 Creating a new data set

2. Create a **Report Control Block** object.
3. Add a **Report Enabled** object. Add a **ReportClient** object for each IEC 61850 client. ReportClients create the same amount of instances of the RCB, each dedicated for one client.



Figure 3.3.2.4-2 Adding ReportClient objects

4. Configure the report control block.
5. Configure the data set of the report control block.

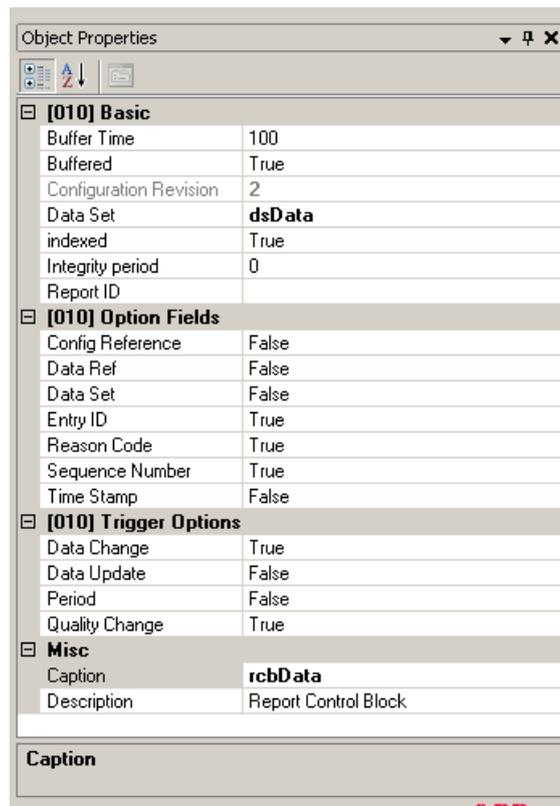

data\_set\_properties

Figure 3.3.2.4-3 Data set properties

## 3.4. Configuring GOOSE Analyzer

### 3.4.1. Configuring the GOOSE Analyzer using the Configuration Wizard


GOOSE Analyzer must be configured through the Configuration Wizard for the IEC61850 OPC Server.

Before you start,

- build and configure the object tree as specified in 3.1, Building object tree and 3.2, Configuring objects, and
- open the management tool to connect to the remote COM600 device for accessing the Network Interface Card (NIC) information of COM600 to the local SAB600 computer for the configuration.

To configure the GOOSE Analyzer:


1. Right-click the IEC61850 OPC Server to open its specific context menu (see Figure 3.4.1-1).

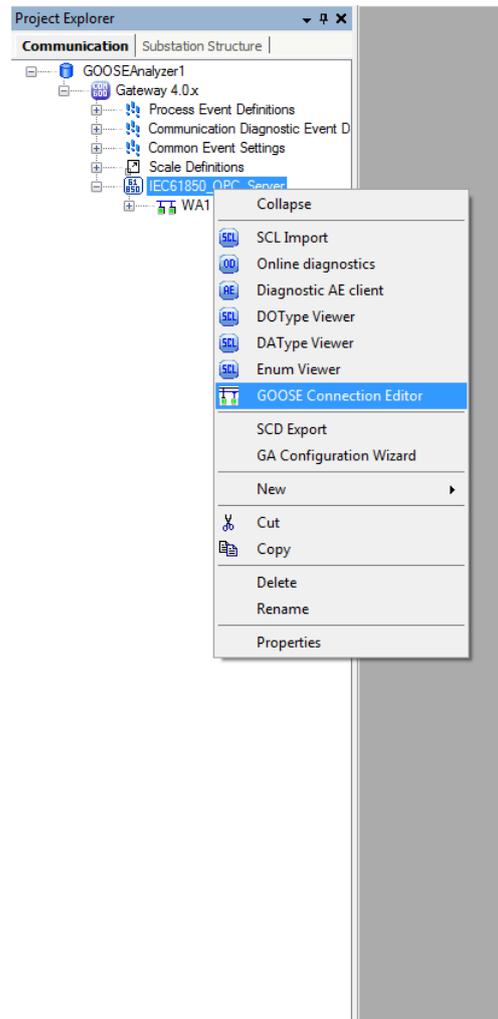

GOOSEAnalyzerConfiguration.png

*Figure 3.4.1-1 GOOSE Analyzer configuration*


2. Select **GA Configuration Wizard** to open the wizard dialog (see Figure 3.4.1-2).

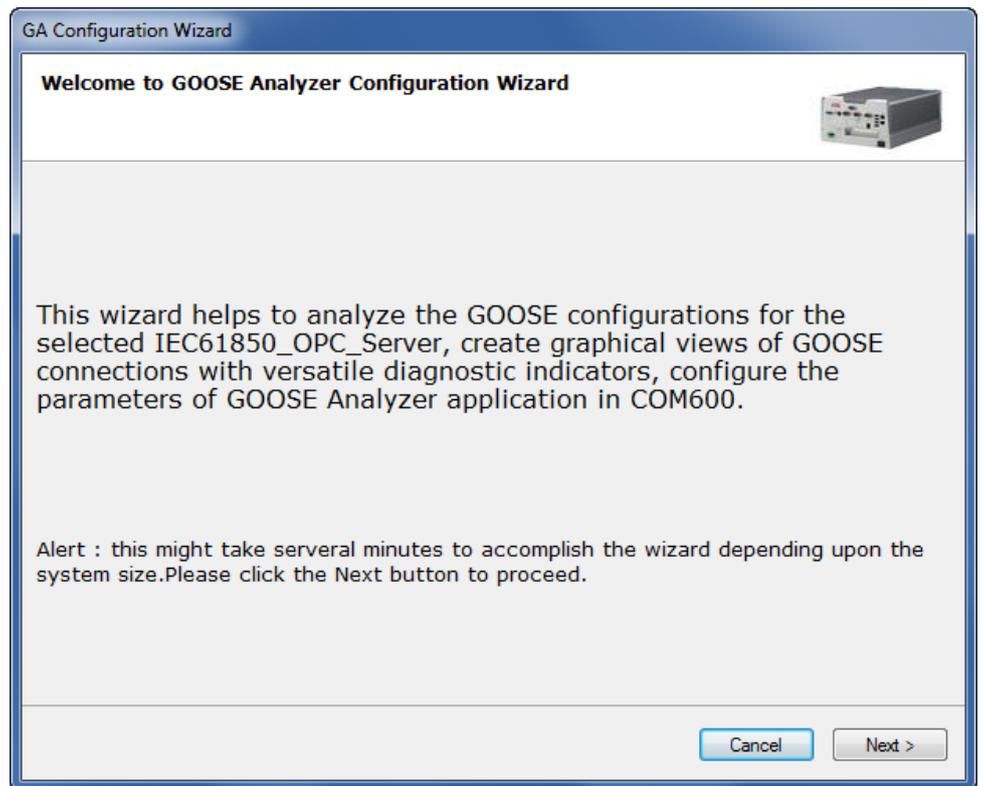

WizardDialog.png

Figure 3.4.1-2 Wizard dialog


3. Click **Next** to start the analysis and generate the corresponding GOOSE Analyzer configuration (see Figure 3.4.1-3).

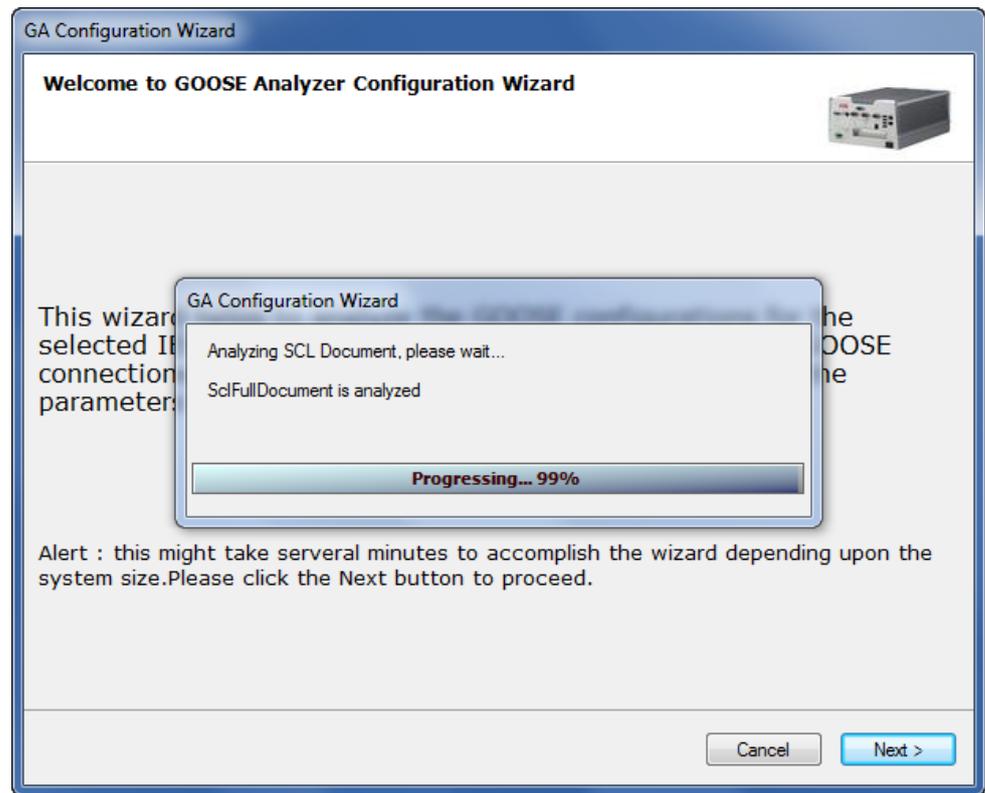

GeneratingGOOSEAnalyzerConfiguration.png

Figure 3.4.1-3 Generating GOOSE Analyzer configuration

4. Configure the properties (see Figure 3.4.1-4). The descriptions for properties are listed in Table 3.4.2-1.

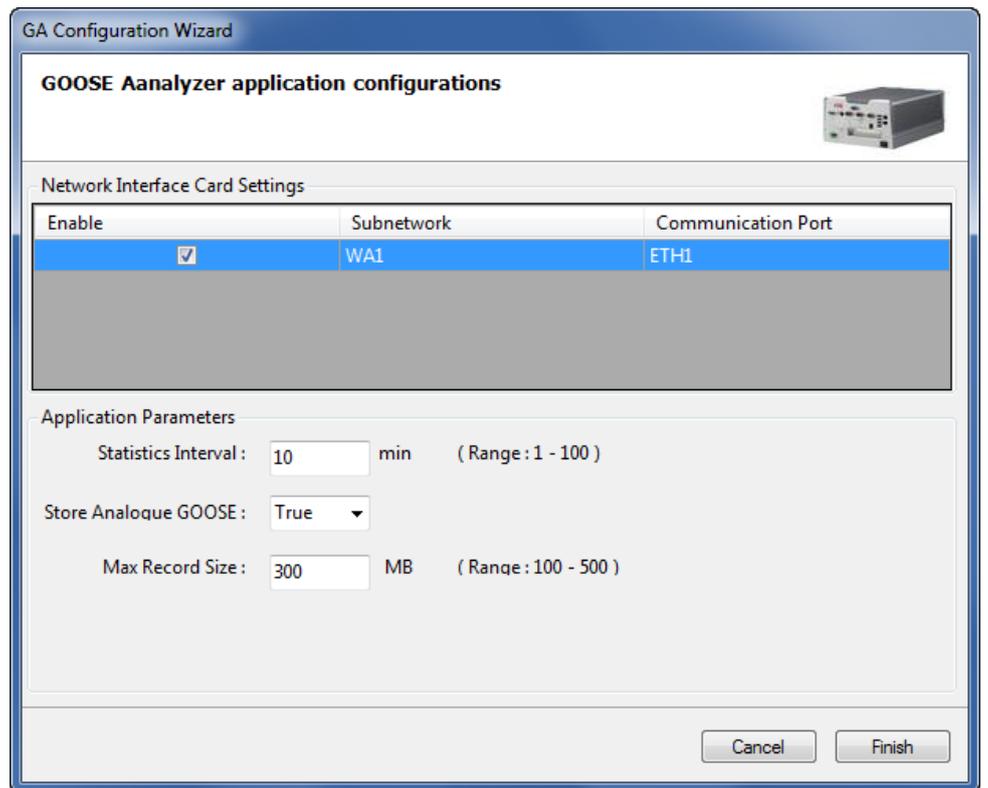

ParameterSetting.png

Figure 3.4.1-4 Parameter Setting

5. Click **Finish** to close the dialog.

### 3.4.2. Configuring GOOSE Analyzer properties

Table 3.4.2-1 lists the configurable GOOSE Analyzer properties and value ranges.

**Table 3.4.2-1 GOOSE Analyzer properties**

Name	Value/Value range	Description
Enable	Enable/Disable	Enable/Disable the analysis of specific sub-network
Statistic interval	1...100 min Default: 10	Duration to do the calculations.
Store analogue GOOSE	True/False	Enable or disable the storing of analogue GOOSE.
Max. record size	100...500 Mb Default: 300 Mb	Maximum record size for GOOSE Tester.

### 3.4.3. Editing GOOSE connection

After the **GOOSE Analyzer** is configured with the **Configuration Wizard**, you can use the **GOOSE Connection Editor** tool.

To view and edit the GOOSE connections:

1. Right-click the IEC61850 OPC Server to open its specific context menu (see Figure 3.4.1-1).
2. Select **GOOSE Connection Editor** to open the tool (see Figure 3.4.3-1).

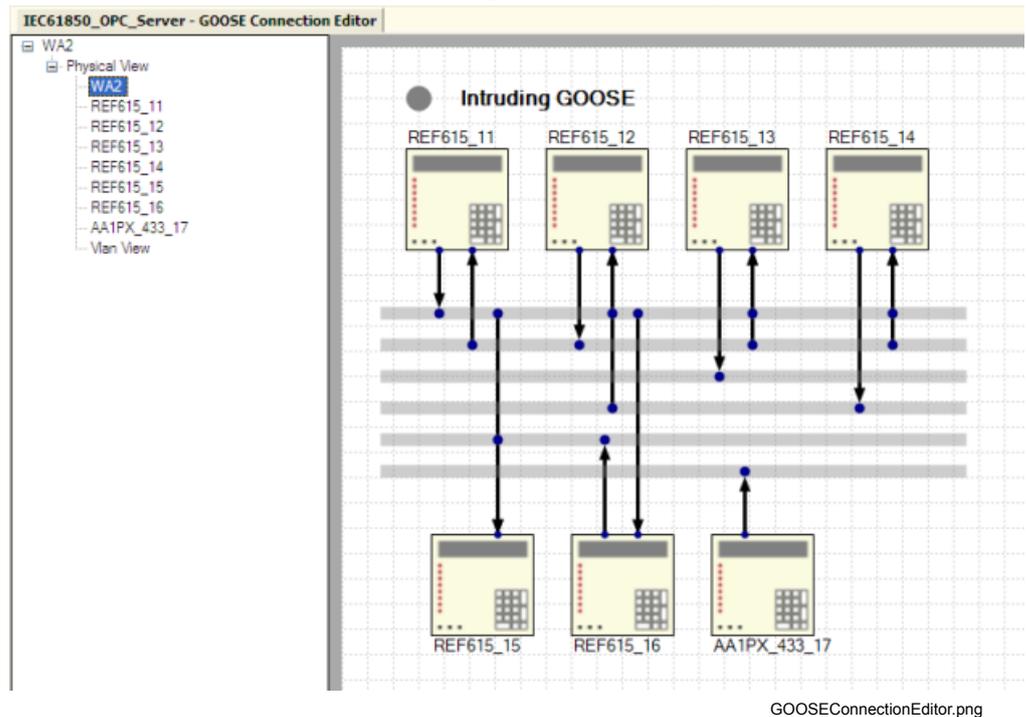


Figure 3.4.3-1 GOOSE Connection Editor

3. Select different connection diagrams using the navigation tree on the left.
4. Make changes to the active diagram including moving the graph, modifying properties, and adding new graphs and texts. The default IED picture can be replaced from the properties window.
5. Click **Save** to save your changes.

## 4. Operation

### 4.1. Activating COM600 with new configuration


For information about activating COM600 with new configuration, see COM600 User's Manual.

### 4.2. IEC 61850 OPC Server diagnostics

After the IEC 61850 OPC Server has been installed and configured, you can, for example, monitor and control the condition of connections in an IEC 61850 network.

This is done by using the Online Diagnostics function in SAB600, select **Tools > Online Diagnostics** or select the object, right-click the IEC 61850 Server object and select **Online Diagnostics** from the shortcut menu, see Figure 4.2-1 .

The server, a device, or data object is dragged and dropped from the Project Explorer's Communication structure under the Online Diagnostics function. Select the Project Explorer from the **View** menu if it is not already open.

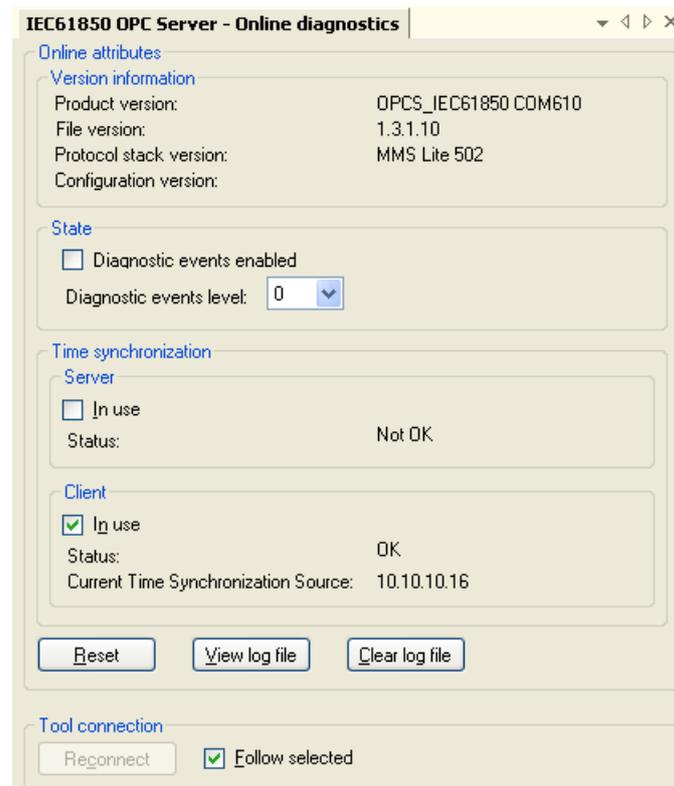


OPCDiag.bmp

Figure 4.2-1 IEC 61850 OPC Server Online Diagnostics

You have the following alternatives:

- to reset counters (restart the OPC server)
- to view the event log file
- to clear the log file
- to reconnect the online diagnostics
- to enable or disable the SNMP client

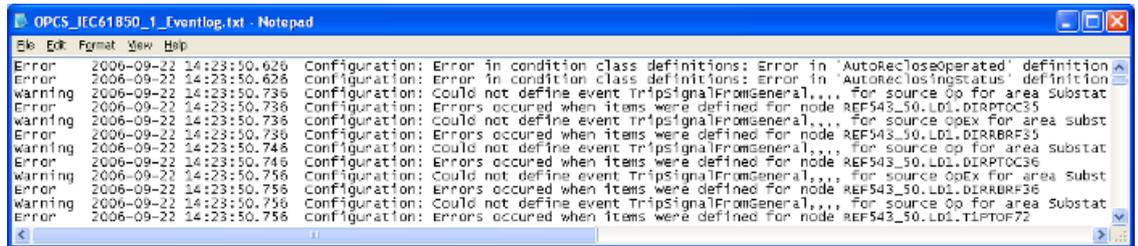

Event\_log\_61850.bmp


Figure 4.2-2 Event log file

### 4.3. Diagnostic AE Client

Diagnostic events can be monitored and controlled using the Diagnostic AE Client function, see Figure 4.3-1 . Click **Refresh** to update the status information. To be able to receive events from a certain device, diagnostic events must be enabled for this device

To enable diagnostic events:

1. Right-click the device.
2. Select **Diagnostic AE client**.

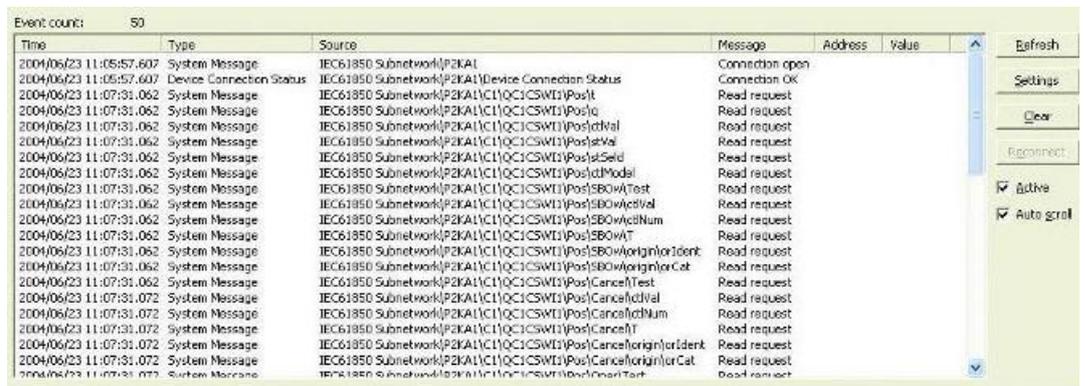

DiagAECClient.jpg

Figure 4.3-1 IEC 61850 OPC Server Diagnostics AE client


## 4.4. Monitoring and controlling IEC 61850 subnetwork activity

The IEC 61850 subnetwork activity can be monitored with the Online Diagnostics function.

You can also take a subnetwork into use or out of use.

To monitor and control IEC 61850 subnetwork activity:

1. Select the subnetwork you want to monitor in the object tree of SAB600.
2. Right-click the channel.
3. Select **Online Diagnostics**.

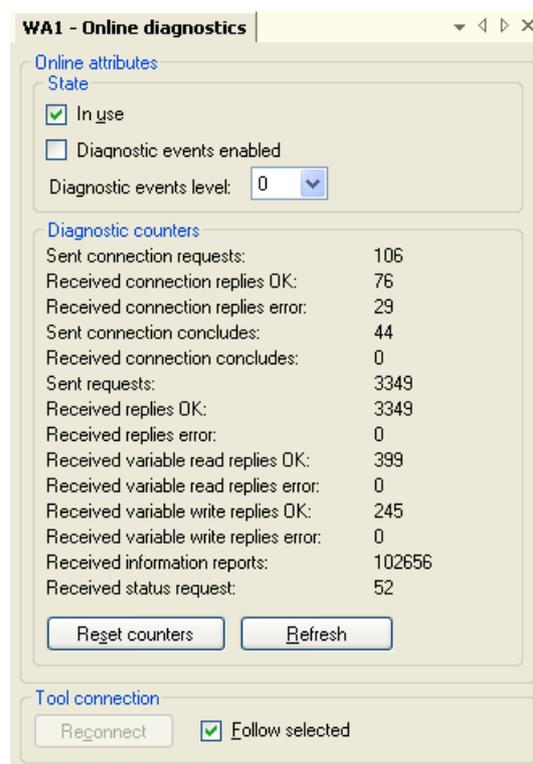

SubDiag.bmp

Figure 4.4-1 IEC 61850 subnetwork Online Diagnostics

In the Diagnostic counters field, you can monitor the subnetwork activity and the available properties, see Figure 4.4-1 . To reset Diagnostic counters, click **Reset counters**.

You can take an IEC 61850 subnetwork into use by selecting the **In use** check box. If you clear the check box, the subnetwork is taken out of use. To update the diagnostic counters click **Refresh**.

## 4.5. Monitoring and controlling IEC 61850 device communication


The IEC 61850 device communication can be monitored with the Online Diagnostics function.

To monitor and control IEC 61850 device communication:

1. Select the device you want to monitor in the object tree of SAB600.
2. Right-click the device.
3. Select **Online Diagnostics**.

In the Status information field, you can monitor the device status. The Diagnostic counters field provides information on device activity. To reset diagnostic counters, click **Reset counters**. To update the diagnostic counters click **Refresh**.

You can take an IEC 61850 device into use by selecting the **In Use** check box. If you clear the check box, the device is taken out of use.

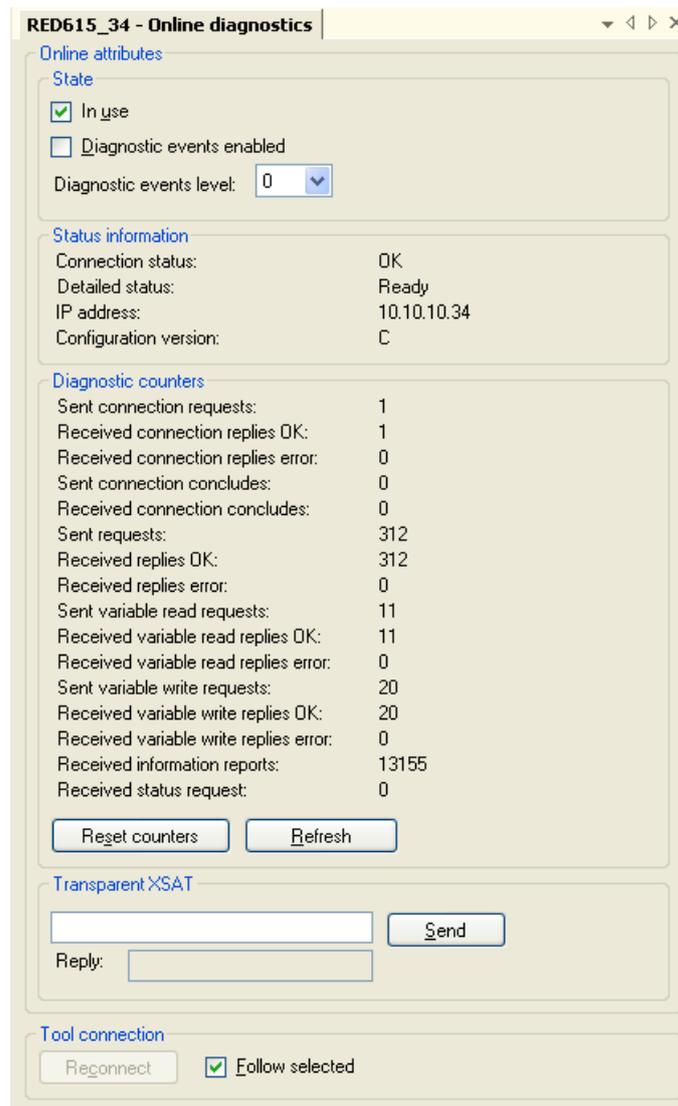

DeviceDiag.bmp

Figure 4.5-1 IEC 61850 Device Online Diagnostics

## 4.6. Monitoring and controlling IEC 61850 data object communication

The IEC 61850 data object diagnostics can be monitored with the Online Diagnostics function.

To monitor and control IEC 61850 data object communication:

1. Select the data object you want to monitor in the object tree.
2. Right-click the device.
3. Select **Online Diagnostics**.

In the Status information field, you can monitor and set attribute values and use control services. The Diagnostic counters field provides information on device activity.

## 5. Technical reference

### 5.1. About this section

This document describes how IEC 61850 data objects according to IEC-61850-7-3 are mapped to OPC nodes and item tags.

In general it is done by using an OPC node to represent an IEC 61850 object, and OPC item tags to represent the attributes of the object. Most objects are single-level (that is, use only one node) but some are hierarchical and use several nodes.

This section provides reference information about the following issues:

- IEC 61850 data object modeling
- IEC 61850 OPC Server data object modeling
- Attributes
- Status codes

### 5.2. IEC 61850 OPC server data object modeling

#### 5.2.1. Common data attribute types

The following sections describe how the IEC 61850 data object attributes and services are presented on the OPC server name space.

The columns in the tables have the following content types:

- **Name** specifies the OPC item name of the attribute or service.
- **Type** specifies the IEC 61850 type of the attribute.
- **Value/Value range** specifies the allowed values and ranges of the attribute or service.
- **Mandatory/Optional** specifies whether the attribute is considered as mandatory or optional according to the IEC 61850 standard.
- **OPC data type** specifies the OPC data type used for the OPC item.
- **Bit** specifies how many bits the attribute takes.
- **Description** describes the data type and access and gives useful information.

#### 5.2.2. IEC 61850 quality

The following table defines the mapping of quality in MMS (IEC 61850 7-3). Only 14 bits (LSB) in quality are valid.

**Table 5.2.2-1 IEC 61850 quality**

Name	Type	Value/Value range	M/O/C	Bit
validity	2bit	good (0)   invalid (1)   reserved (2)   questionable (3)	M	0-1
overflow	1bit	FALSE (0)   TRUE (1)	M	2
outOfRange	1bit	FALSE (0)   TRUE (1)	M	3
badReference	1bit	FALSE (0)   TRUE (1)	M	4
oscillatory	1bit	FALSE (0)   TRUE (1)	M	5
failure	1bit	FALSE (0)   TRUE (1)	M	6
oldData	1bit	FALSE (0)   TRUE (1)	M	7
inconsistent	1bit	FALSE (0)   TRUE (1)	M	8
inaccurate	1bit	FALSE (0)   TRUE (1)	M	9
source	2bit	process (0)   substituted (1)	M	10-11
test	1bit	FALSE (0)   TRUE (1)	M	12
operatorBlocked	1bit	FALSE (0)   TRUE (1)	M	13

**5.2.3.****Mapping quality value to OPC**

The value of validity is presented as the value of the quality attribute. The other values are presented as OPC properties of the quality in the OPC namespace.

**Table 5.2.3-1 Mapping quality value to OPC**

Name	Type	Value/ Value range	M/O/C	OPC Data Type
Validity		good (0)   invalid (1)   reserved (2)   questionable (3)	M	VT_I4
DetailQuality		DetailedQuality	M	VT_I4
Source		process (0)   substituted (1)	M	VT_I4

Name	Type	Value/ Value range	M/O/C	OPC Data Type
Test		FALSE (0)   TRUE (1)	M	VT_BOOL
OperatorBlocked		FALSE (0)   TRUE (1)	M	VT_BOOL

#### 5.2.4. Mapping of DetailedQuality

The value of DetailQuality is mapped to a DetailedQuality bitmap.

**Table 5.2.4-1 Mapping of DetailedQuality**

Name	Type	Value/ Value range	M/O/C	Bit
overflow	1bit	FALSE (0)   TRUE (1)	M	0
outOfRange	1bit	FALSE (0)   TRUE (1)	M	1
badReference	1bit	FALSE (0)   TRUE (1)	M	2
oscillatory	1bit	FALSE (0)   TRUE (1)	M	3
failure	1bit	FALSE (0)   TRUE (1)	M	4
oldData	1bit	FALSE (0)   TRUE (1)	M	5
inconsistent	1bit	FALSE (0)   TRUE (1)	M	6
inaccurate	1bit	FALSE (0)   TRUE (1)	M	7

Example:

DetailQuality = 1d = 00000001b > overflow = true

DetailQuality = 16d = 00010000b > failure = true

#### 5.2.5. Analogue value (AnalogueValue)

Analogue values are always presented as 32-bit float values (VT\_R4) so that the .f and .i extensions are discarded from the attribute names to simplify the OPC namespace. If a device only supports integer values, the value is converted to a floating point presentation of the value according to its configuration and the following formula, refer to 5.2.6, Configuration of analogue value (ScaledValueConfig).

$$f \times 10^{\text{units.multiplier}} = (i \times \text{scaleFactor}) + \text{offset}$$

**Table 5.2.5-1 Analogue value (AnalogueValue)**

Name	Type	Value/ Value range	M/O/C	OPC Data Type
i	INT32	integer value	Not Used	Not Used
f	FLOAT32	floating point value	Not Used	Not Used

Example:

MV: mag.f (VT\_R4) & mag.i (VT\_I4) > mag (VT\_R4)

## 5.2.6. Configuration of analogue value (ScaledValueConfig)

The following table defines the mapping of configuration of analogue value (ScaledValueConfig).

**Table 5.2.6-1 Configuration of analogue value (ScaledValueConfig)**

Name	Type	Value/ Value range	M/O/C	OPC Data Type
scaleFactor	FLOAT32	floating point value	M	VT_R4
offset	FLOAT32	floating point value	M	VT_R4

## 5.2.7. Range configuration (RangeConfig)

The following table defines the mapping of range configuration (RangeConfig).

**Table 5.2.7-1 Range configuration (RangeConfig)**

Name	Type	Value/ Value range	M/O/C	OPC Data Type
hhLim	AnalogueValue	floating point value	M	VT_R4
hLim	AnalogueValue	floating point value	M	VT_R4
lLim	AnalogueValue	floating point value	M	VT_R4
llLim	AnalogueValue	floating point value	M	VT_R4
min	AnalogueValue	floating point value	M	VT_R4

Name	Type	Value/ Value range	M/O/C	OPC Data Type
max	AnalogueValue	floating point value	M	VT_R4

**hhLim, hLim, lLim, llLim:** These attributes are configuration parameters used in the context with the range attribute.

**min:** The min (minimum) attribute represents the minimum process measurement for which values of i or f are considered within process limits.

**max:** The max (maximum) attribute represents the maximum process measurement for which values of i or f are considered within process limits.

### 5.2.8. Step position with transient indication (ValWithTrans)

The following table defines the mapping of Step position with transient indication (ValWithTrans).

**Table 5.2.8-1 Step position with transient indication (ValWithTrans)**

Name	Type	Value/ Value range	M/O/C	OPC Data Type
posVal	INT8	-64 ... 63	M	VT_I4
transInd	BOOLEAN	TRUE   FALSE	M	VT_BOOL

### 5.2.9. Pulse configuration (PulseConfig)

The table following table defines the mapping of pulse configuration (PulseConfig).

**Table 5.2.9-1 Pulse configuration (PulseConfig)**

Name	Type	Value/ Value range	M/O/C	OPC Data Type
cmdQual	ENUMERATED	pulse(0)   persistent(1)	M	VT_I4
onDur	INT32U		M	VT_I4
offDur	INT32U		M	VT_I4
numPls	INT32U		M	VT_I4

### 5.2.10. Originator

The following table defines the mapping of originator (Originator).

**Table 5.2.10-1 Originator**

Name	Type	Value/ Value range	M/O/C	OPC Data Type
orCat	ENUMERATED	not-supported(0)   bay-control(1)   station-control(2)   remote-control(3)   automatic-bay(4)   automatic-station(5)   automatic-remote(6)   maintenance(7)   process(8)	M	VT_I4
orient	OCTET STRING64	TRUE   FALSE	M	VT_BSTR

**5.2.11.****Unit**

The following table defines the mapping of unit (Unit).

**Table 5.2.11-1 Unit**

Name	Type	Value/ Value range	M/O/C	OPC Data Type
SIUnit	ENUMERATED		M	VT_I4
multiplier	ENUMERATED		O	VT_I4

**5.2.12.****Vector**

The following table defines the mapping of vector (Vector).

**Table 5.2.12-1 Vector**

Name	Type	Value/ Value range	M/O/C	OPC Data Type
mag	AnalogueValue	floating point value	M	VT_R4
ang	AnalogueValue	floating point value	O	VT_R4

**5.2.13.****TimeStamp**

The timestamp OPC attributes are presented as OPC type VT\_DATE. It is implemented using an 8-byte floating-point number. Days are represented by whole number increments

starting with 30 December 1899, midnight as time zero. Hour values are expressed as the absolute value of the fractional part of the number.

### 5.2.14. AbbCommandBitmask

The following table defines the mapping of AbbCommandBitmask. This ABB-specific control value is a bitmask value of a command to a device. This value is applicable to ABB extension control attributes.

**Table 5.2.14-1 AbbCommandBitmask**

Name	Type	Value/ Value range	M/O/C	Bit Position
NormalControl	1bit	FALSE (0)   TRUE (1)	M	0
InterlockOverride	1bit	FALSE (0)   TRUE (1)	M	1
Synchrocheck-Override	1bit	FALSE (0)   TRUE (1)	M	2
TestCommand	1bit	FALSE (0)   TRUE (1)	M	3
Originator	4bit	not-supported(0)   bay-control(1)   station-control(2)   remote-control(3)   automatic-bay(4)   automatic-station(5)   automatic-remote(6)   maintenance(7)   process(8)	M	4-7
ControlValue	nbit		M	8-31

**NormalControl:** True = normal operation, false = inverse operation (for example, On > Off).

**InterlockOverride:** True = interlockcheck > false

**SynchrocheckOverride :** True = synchrocheck > false

**TestCommand:** True = test command

**Originator:** Command originator (= Originator.orCat)

## 5.2.15. Common data class specifications for status information

### 5.2.15.1. Single point status (SPS)

The following table defines the common data class of single point status.

**Table 5.2.15.1-1 Single point status (SPS)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
stVal	BOOLEAN	ST	TRUE   FALSE	M	VT_BOOL
q	Quality	ST		M	VT_I4
t	TimeStamp	ST		M	VT_DATE
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	BOOLEAN	SV	TRUE   FALSE	O	VT_BOOL
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRING64	SV		O	VT_BSTR
d	VISIBLE STRING64	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

### 5.2.15.2. Double point status (DPS)

The following table defines the common data class of double point status.

**Table 5.2.15.2-1 Double point status (DPS)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
stVal	CODED ENUM	ST	intermediate-state (0)   off (1)   on (2)   bad-state (3)	M	VT_I4
q	Quality	ST		M	VT_I4

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
t	TimeStamp	ST		M	VT_DATE
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	CODED ENUM	SV	intermediate-state (0)   off (1)   on (2)   bad-state (3)	O	VT_I4
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRING64	SV		O	VT_BSTR
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

### 5.2.15.3. Integer status (INS)

The following table defines the common data class of integer status.

**Table 5.2.15.3-1 Integer status (INS)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
stVal	INT32	ST		M	VT_I4
q	Quality	ST		M	VT_I4
t	TimeStamp	ST		M	VT_DATE
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	INT32	SV		O	VT_I4
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRING64	SV		O	VT_BSTR
d	VISIBLE STRING255	DC		O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

**5.2.15.4.****Enumerated Status (ENS)**

Name	Type	FC	Value/Value range	M/O	OPC data type
stVal	ENUMERATED	ST		M	
q	Quality	ST		M	VT_I4
t	Timestamp	ST		M	VT_I4
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	INT32	SV		O	VT_I4
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRING64	SV	Text	O	VT_BSTR
d	VISIBLE STRING 255	DC	Text	O	VT_BSTR
dU	UNICODE STRING 255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING 255	EX		O	VT_BSTR
cdcName	VISIBLE STRING 255	EX		O	VT_BSTR
dataNs	VISIBLE STRING 255	EX		O	VT_BSTR

**5.2.15.5.****Protection activation information (ACT)**

The following table defines the common data class of protection activation information.

**Table 5.2.15.5-1 Protection activation information (ACT)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
general	BOOLEAN	ST		M	VT_BOOL

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
phsA	BOOLEAN	ST		O	VT_BOOL
phsB	BOOLEAN	ST		O	VT_BOOL
phsC	BOOLEAN	ST		O	VT_BOOL
neut	BOOLEAN	ST		O	VT_BOOL
q	Quality	ST		M	VT_I4
t	TimeStamp	ST		M	VT_DATE
operTm	TimeStamp	CF		O	VT_DATE
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

### 5.2.15.6.

#### Directional protection activation information (ACD)

The following table defines the common data class of directional protection activation information.

**Table 5.2.15.6-1 Directional protection activation information (ACD)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
general	BOOLEAN	ST		M	VT_BOOL
dirGeneral	ENUMERATED	ST	unknown (3)   forward (1)   backward (2)	M	
phsA	BOOLEAN	ST		O	VT_BOOL
dirPhsA	ENUMERATED	ST	unknown (3)   forward (1)   backward (2)	O	
phsB	BOOLEAN	ST		O	VT_BOOL
dirPhsB	ENUMERATED	ST	unknown (3)   forward (1)   backward (2)	O	
phsC	BOOLEAN	ST		O	VT_BOOL

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
dirPhsC	ENUMERATED	ST	unknown (3)   forward (1)   backward (2)	O	
neut	BOOLEAN	ST		O	VT_BOOL
dirNeut	ENUMERATED	ST	unknown (3)   forward (1)   backward (2)	O	
q	Quality	ST		M	VT_I4
t	TimeStamp	ST		M	VT_DATE
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

### 5.2.15.7.

### Security violation counter (SEC)

The following table defines the common data class of security violation counting.

**Table 5.2.15.7-1 Security violation counting (SEC)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
cnt	INT32U	ST		M	VT_I4
sev	ENUMERATED	ST	unknown (0)   critical (1)   major (2)   minor (3)   warning (4)	M	VT_I4
t	TimeStamp	ST		M	VT_DATE
addr	OCTET STRING64	ST		O	VT_BSTR
addInfo	VISIBLE STRING64	ST		O	VT_BSTR
d	VISIBLE STRING255	DC	Text	O	VT_BSTR

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

### 5.2.15.8. Binary counter reading (BCR)

The following table defines the common data class of binary counter reading.

**Table 5.2.15.8-1 Binary counter reading (BCR)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
actVal	INT128	ST		M	VT_I4
frVal	INT128	ST		O <sup>a</sup>	VT_I4
frTm	TimeStamp	ST		O <sup>a</sup>	VT_DATE
q	Quality	ST		M	VT_I4
t	TimeStamp	ST		M	VT_DATE
units	Unit	CF		O	VT_R4
pulsQty	FLOAT32	CF		M	VT_BOOL
frEna	BOOLEAN	CF		O <sup>a</sup>	VT_DATE
strTm	TimeStamp	CF		O <sup>a</sup>	VT_I4
frPd	INT32	CF		O <sup>a</sup>	VT_BOOL
frRds	BOOLEAN	CF		O <sup>a</sup>	VT_BSTR
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

a. All or none of these items must be present.

## 5.2.16. Common data class specifications for measured information

### 5.2.16.1. Measured value (MV)

The following table defines the common data class of measured value.

**Table 5.2.16.1-1 Measured value (MV)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
instMag	Analogue-Value	MX		O	VT_R4
mag	Analogue-Value	MX		M	VT_R4
range	ENUMERATED	MX	normal (0)   high (1)   low (2)   high-high (3)   low-low (4)   ...	O	VT_I4
q	Quality	MX		M	VT_I4
t	TimeStamp	MX		M	VT_DATE
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	Analogue-Value	SV		O	VT_R4
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRING64	SV		O	VT_BSTR
units	Unit	CF		O	
db	INT32U	CF	0...100 000	O	VT_I4
zeroDb	INT32U	CF	0...100 000	O	VT_I4
sVC	ScaledValue-Config	CF		O	
rangeC	RangeConfig	CF		O	
smpRate	INT32U	CF		O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

## 5.2.16.2.

**Complex measured value (CMV)**

The following table defines the common data class of measured value.

**Table 5.2.16.2-1 Complex measured value (CMV)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
instCVal	Vector	MX		O	
cVal	Vector	MX		M	
range	ENUMERATED	MX	normal (0)   high (1)   low (2)   high-high (3)   low-low (4)   ...	O	VT_I4
q	Quality	MX		M	VT_I4
t	TimeStamp	MX		M	VT_DATE
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	Vector	SV		O	
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRING64	SV		O	VT_BSTR
units	Unit	CF		O	
db	INT32U	CF	0...100 000	O	VT_I4
zeroDb	INT32U	CF	0...100 000	O	VT_I4
rangeC	RangeConfig	CF		O	
magSVC	ScaledValue-Config			O	
angSVC	ScaledValue-Config			O	
angRef	ENUMERATED	CF	V   A   other ...	O	VT_I4
smpRate	INT32U	CF		O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

**5.2.16.3.****Sampled value (SAV)**

The following table defines the common data class of sampled value.

**Table 5.2.16.3-1 Sampled value (SAV)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
instMag	Analogue-Value	MX		M	VT_R4
q	Quality	MX		M	VT_I4
t	TimeStamp	MX		M	VT_DATE
units	Unit	CF		O	
sVC	ScaledValue-Config	CF		O	
min	Analogue-Value	CF		O	VT_R4
max	Analogue-Value	CF		O	VT_R4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

**5.2.16.4.****WYE**

The following table defines the common data class of WYE. This class is a collection of simultaneous measurements of values in a three phase system that represent phase to ground values.

**Table 5.2.16.4-1 WYE**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
phsA	CMV	MX		O <sup>a</sup>	
phsB	CMV	MX		O <sup>a</sup>	
phsC	CMV	MX		O <sup>a</sup>	
neut	CMV	MX		O <sup>a</sup>	
net	CMV	MX		O <sup>a</sup>	
res	CMV	MX		O <sup>a</sup>	
angRef	ENUMERATEDe	CF	Va (0)   Vb (1)   Vc (2)   Aa (3)   Ab (4)   Ac (5)   Vab (6)   Vbc (7)   Vca (8)   Vother (9)   Aother (10)	O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

a. One or more of these items (1 - 6) must be present.

**5.2.16.5.****Delta (DEL)**

The following table defines the common data class of delta. This class is a collection of measurements of values in a three phase system that represent phase to phase values.

**Table 5.2.16.5-1 Delta (DEL)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
phsAB	CMV	MX		O <sup>a</sup>	
phsBC	CMV	MX		O <sup>a</sup>	
phsCA	CMV	MX		O <sup>a</sup>	
angRef	ENUMERATED	CF	Va (0)   Vb (1)   Vc (2)   Aa (3)   Ab (4)   Ac (5)   Vab (6)   Vbc (7)   Vca (8)   Vother (9)   Aother (10)	O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

a. One or more of these groups (1 - 3) must be present.

### 5.2.16.6.

### Sequence (SEQ)

The following table defines the common data class of sequence.

**Table 5.2.16.6-1 Sequence (SEQ)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
c1	CMV	MX		O <sup>a</sup>	
c2	CMV	MX		O <sup>a</sup>	
c3	CMV	MX		O <sup>a</sup>	
seqT	ENUMERATED	CF	pos-neg-zero (0)   dir-quad-zero (1)	O	VT_I4
phsRef	ENUMERATED	CF	A (0)   B (1)   C (2)   ...		VT_I4

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

a. One or more of these groups (1 - 3) must be present.

## 5.2.17. Common data class specifications for controllable status information

### 5.2.17.1. Controllable single point (SPC)

The following table defines the common data class of controllable single point.

**Table 5.2.17.1-1 Controllable single point (SPC)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
lastApplError	ApplicationErrorCode		Refer to 5.2.22, Application error codes		VT_I4
ctlVal	BOOLEAN	CO	off (FALSE)   on (TRUE)	M	VT_BOOL
operTm	TimeStamp	CO		O	VT_DATE
origin	Originator	CO, ST			
ctlNum	INT8U	CO, ST	0..255	O	VT_I4
stVal	BOOLEAN	ST	FALSE   TRUE	M	VT_BOOL
q	Quality	ST		M	VT_I4
t	TimeStamp	ST		M	VT_DATE
stSeld	BOOLEAN	ST	FALSE   TRUE	O	VT_BOOL
subEna	BOOLEAN	SV		O	VT_BOOL

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
subVal	BOOLEAN	SV	FALSE   TRUE	O	VT_BOOL
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRIN64	SV		O	VT_BSTR
pulseConfig	PulseConfig	CF		O	
ctlModel	ENUMERATED	CF	Status-only (0)   direct-with-normal-security (1)   sbo-with-normal-security (2)   direct-with-enhanced-security (3)   sbo-with-enhanced-security (4)	M	VT_I4
sboTimeout	INT32U	CF		O	VT_I4
sboClass	ENUMERATED	CF	operate-once (0)   operate-many (1)	O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

## Mapping of controls

Direct Control with Normal Security:

ctlVal: MMS Write.request to Oper structure with value.

SBO with Normal Security:

- ctlVal: MMS Write.request to ctlVal with value. IEC61850 OPC Server will do the select before operate.

Direct Control with Enhanced Security:

- tVal: MMS Write.request to Oper structure with value.

SBO with Enhanced Security:

- `ctlVal`: MMS Write.request to `ctlVal` with value. IEC61850 OPC Server will do the select before operate.

### 5.2.17.2. Controllable double point (DPC)

The following table defines the common data class of controllable double point.

**Table 5.2.17.2-1 Controllable double point (DPC)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
<code>ctlSelOn</code>	AbbCommand-Bitmask			M	VT_I4
<code>ctlSelOff</code>	AbbCommand-Bitmask			M	VT_I4
<code>ctlOperOn</code>	AbbCommand-Bitmask			M	VT_I4
<code>ctlOperOff</code>	AbbCommand-Bitmask			M	VT_I4
<code>ctlCan</code>	AbbCommand-Bitmask			M	VT_I4
<code>ctlOper</code>	AbbCommand-Bitmask			M	VT_I4
<code>lastApplError</code>	ApplicationErrorCode		Refer to 5.2.22, Application error codes		VT_I4
<code>ctlVal</code>	BOOLEAN	CO	off (FALSE)   on (TRUE)	M	VT_BOOL
<code>operTm</code>	TimeStamp	CO		O	VT_DATE
<code>origin</code>	Originator	CO, ST		O	
<code>ctlNum</code>	INT8U	CO, ST	0..255	O	VT_I4
<code>stVal</code>	CODED ENUM	ST	intermediate-state (0)   off (1)   on (2)   bad-state (3)	M	VT_I1
<code>q</code>	Quality	ST		M	VT_I4
<code>t</code>	TimeStamp	ST		M	VT_DATE
<code>stSeld</code>	BOOLEAN	ST	FALSE   TRUE	O	VT_BOOL
<code>subEna</code>	BOOLEAN	SV		O	VT_BOOL

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
subVal	CPT	SV	intermediate-state (0)   off (1)   on (2)   bad-state (3)	O	VT_I1
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRING64	SV		O	VT_BSTR
pulseConfig	PulseConfig	CF		O	
ctlModel	ENUMERATED	CF	Status-only (0)   direct-with-normal-security (1)   sbo-with-normal-security (2)   direct-with-enhanced-security (3)   sbo-with-enhanced-security (4)	M	VT_I4
sboTimeout	INT32U	CF		O	VT_I4
sboClass	ENUMERATED	CF	operate-once (0)   operate-many (1)	O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

**ctlOperOn:** This attribute shall determine the control activity operation in direction On/Close.

**ctlOperOff:** This attribute shall determine the control activity operation in direction Off/Open.

**ctlSelOn:** This attribute shall determine the selection with direction On/Close.

**ctlSelOff:** This attribute shall determine the selection with direction Off/Open.

**ctlCan:** This attribute shall determine the cancellation of the selection

**ctlOper:** This attribute shall determine the selection with direction (direction got from previous select). Only applicable for controls with SBO.

## Mapping of controls

Direct Control with Normal Security:

- ctlSelOn: (not used)
- ctlSelOff: (not used)
- ctlOperOn: MMS Write.request to Oper structure with value ON.
- ctlOperOff: MMS Write.request to Oper structure with value OFF.
- ctlCan: (not used)
- ctlOper: (not used)

The ctlSelOn, ctlSelOff, ctlCan, selCause, cmdTermCause, stSeld and the bits in ControlValues are not applicable.

SBO with Normal Security:

- ctlSelOn: MMS Read.request to SBO structure (to perform select).
- ctlSelOff: MMS Read.request to SBO structure (to perform select).
- ctlOperOn: MMS Write.request to Oper structure with value ON (to operate).
- ctlOperOff: MMS Write.request to Oper structure with value OFF (to operate).
- ctlCan: MMS Write.request to Cancel structure
- ctlOper: MMS Write.request to Oper structure with value ON/OFF according to previous direction of select.

Direct Control with Enhanced Security:

- ctlSelOn: (not used)
- ctlSelOff: (not used)
- ctlOperOn: MMS Write.request to Oper structure with value ON.
- ctlOperOff: MMS Write.request to Oper structure with value OFF.
- ctlCan: MMS Write.request to Cancel structure
- ctlOper: (not used)

SBO with Enhanced Security:

- ctlSelOn: MMS Read.request to SBOw structure.
- ctlSelOff: MMS Read.request to SBOw structure.
- ctlOperOn: MMS Write.request to Oper structure with value ON.
- ctlOperOff: MMS Write.request to Oper structure with value OFF.
- ctlCan: MMS Write.request to Cancel structure
- ctlOper: MMS Write.request to Oper structure with value ON/OFF according to previous direction of select.

**5.2.17.3. Controllable integer status (INC)**

The following table defines the common data class of controllable integer status.

**Table 5.2.17.3-1 Controllable integer status (INC)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
lastAppError	ApplicationErrorCode		Refer to 5.2.22, Application error codes		VT_I4
ctlVal	INT32	CO		M	VT_I4
operTm	TimeStamp	CO		O	VT_DATE
orCat	ENUMERATED			O	VT_I4
orIdent	OCTET STRING64			O	VT_BSTR
ctlNum	INT8U	CO, ST	0..255	O	VT_I4
stVal	INT32	ST		M	VT_I4
q	Quality	ST		M	VT_I4
t	TimeStamp	ST		M	VT_DATE
stSeld	BOOLEAN	ST	FALSE   TRUE	O	VT_BOOL
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	INT32	SV		O	VT_I4
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRING64	SV	Text	O	VT_BSTR
ctlModel	ENUMERATED	CF	Status-only (0)   direct-with-normal-security (1)   sbo-with-normal-security (2)   direct-with-enhanced-security (3)   sbo-with-enhanced-security (4)	M	VT_I4
sboTimeout	INT32U	CF		O	VT_I4
sboClass	ENUMERATED	CF	operate-once (0)   operate-many (1)	O	VT_I4
minVal	INT32	CF		O	VT_I4

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
maxVal	INT32	CF		O	VT_I4
stepSize	INT32U	CF	1 ... (maxVal - minVal)	O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

### Mapping of controls

Direct Control with Normal Security:

- ctlVal: MMS Write.request to Oper structure with value.

SBO with Normal Security:

- ctlVal: MMS Write.request to Oper structure with value. IEC61850 OPC Server will do the select before operate.

Direct Control with Enhanced Security:

- ctlVal: MMS Write.request to Oper structure with value.

SBO with Enhanced Security:

- ctlVal: MMS Write.request to Oper structure with value. IEC61850 OPC Server will do the select before operate.

#### 5.2.17.4.

### Controllable Enumerated Status (ENC)

Name	Type	FC	Value/Value range	M/O	OPC data type
lastAppError	ApplicationErrorCode	CO	Refer to 5.2.22 Application error codes	M	VT_I4
ctlVal	ENUMERATED	CO		M	VT_I4
operTm	Timestamp	CO		O	VT_DATE

Name	Type	FC	Value/Value range	M/O	OPC data type
orCat	ENUMERATED			O	VT_I4
orIdent	OCTET STRING64			O	VT_BSTR
ctlNum	INT8U	CO, ST	0..255	O	VT_I4
stVal	ENUMERATED	ST		M	VT_I4
q	Quality	ST		M	VT_I4
t	Timestamp	ST		M	VT_14
stSeld	BOOLEAN	ST	FALSE TRUE	O	VT_BOOL
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	INT32	SV		O	VT_I4
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRING64	SV	Text	O	VT_BSTR
ctlModel	ENUMERATED	CF	Status-only(0) direct-with-normal-security(1) sbo-with-normal-security(2) direct-with-enhanced-security(3) sbo-with-enhanced-security(4)	M	VT_I4
sboTimeout	INT32U	CF		O	VT_I4
sboClass	ENUMERATED	CF	Operate-once(0) operate-many(1)	O	VT_I4
operTimeout	INT32U	CF		O	VT_I4
d	VISIBLE STRING 255	DC	Text	O	VT_BSTR
dU	UNICODE STRING 255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING 255	EX		O	VT_BSTR
cdcName	VISIBLE STRING 255	EX		O	VT_BSTR

Name	Type	FC	Value/Value range	M/O	OPC data type
dataNs	VISIBLE STRING 255	EX		O	VT_BSTR

### 5.2.17.5.

### Binary controlled step position information (BSC)

The following table defines the common data class of binary controlled step position information.

**Table 5.2.17.5-1 Binary controlled step position information (BSC)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
lastApplError	Application-Error Code		Refer to 5.2.22, Application error codes		VT_I4
ctlVal	ENUMERATED		stop (0)   lower (1)   higher (2)   reserved (3)	M	VT_I4
operTm	TimeStamp	CO		O	VT_DATE
orCat	ENUMERATED		not-supported   bay-control   station-control   remote-control   automatic-bay   automatic-station   automatic-remote   maintenance   process	O	VT_I4
orIdent	OCTET STRING64				VT_BSTR
ctlNum	INT8U	CO, ST	0..255	O	VT_I4
valWTr.posVal	INT8	ST		M	VT_I4
val-WTr.transInd	BOOLEAN	ST		M	VT_BOOL
q	Quality	ST		M	VT_I4
t	TimeStamp	ST		M	VT_DATE
stSeld	BOOLEAN	ST	FALSE   TRUE	M	VT_I4
q	Quality	ST		O	VT_BOOL
t	TimeStamp	ST		M	VT_DATE

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
stSeld	BOOLEAN	ST	FALSE   TRUE	O	VT_BOOL
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	INT32	SV		O	VT_I4
subQ	Quality	SV		O	VT_I4
subID	VISIBLE STRING64	SV	Text	O	VT_BSTR
				O	
ctlModel	ENUMERATED	CF	Status-only (0)   direct-withnormal-security (1)   sbo-withnormal-security (2)   direct-withenhanced-security (3)   sbo-withenhanced-security (4)	M	VT_I4
sboTimeout	INT32U	CF		O	VT_I4
sboClass	ENUMERATED	CF	operate-once (0)   operate-many (1)	O	VT_I4
minVal	INT8	CF		O	VT_I4
maxVal	INT8	CF		O	VT_I4
stepSize	INT8	CF	1 ... (maxVal - minVal)	O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

## Mapping of controls

Direct Control with Normal Security:

- ctlVal: MMS Write.request to Oper structure with value.

SBO with Normal Security:

- ctlVal: MMS Write.request to Oper structure with value.  
IEC61850 OPC Server will do the select before operate.

Direct Control with Enhanced Security:

- ctlVal: MMS Write.request to Oper structure with value.

SBO with Enhanced Security:

- ctlVal: MMS Write.request to Oper structure with value.  
IEC61850 OPC Server will do the select before operate.

### 5.2.17.6. Integer controlled step position information (ISC)

The following table defines the common data class of integer controlled step position information.

**Table 5.2.17.6-1 Integer controlled step position information (ISC)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
lastApplError	ApplicationErrorCode		Refer to 5.2.22, Application error codes		VT_I4
ctlVal	INT8	CO	-64 ... 63	M	VT_I4
operTm	TimeStamp	CO		O	VT_DATE
orCat	ENUMERATED		not-supported   bay-control   station-control   remote-control   automatic-bay   automatic-station   automatic-remote   maintenance   process	O	VT_I4
orIdent	OCTET STRING64			O	VT_BSTR
ctlNum	INT8U	CO, ST	0..255	O	VT_I4
valWTr.posVal	INT8	ST		M	VT_I4
val-WTr.transInd	BOOLEAN	ST		M	VT_BOOL
q	Quality	ST		M	VT_I4
t	TimeStamp	ST		M	VT_DATE
stSeld	BOOLEAN	ST	FALSE   TRUE	O	VT_BOOL

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
				O	
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	INT32	SV		O	VT_I4
subQ	Quality	SV		O	VT_I4
subID	VisibleString	SV	Text	O	VT_BSTR
				O	
ctlModel	ENUMERATED	CF	Status-only (0)   direct-with-normal-security (1)   sbo-with-normal-security (2)   direct-with-enhanced-security (3)   sbo-with-enhanced-security (4)	M	VT_I4
sboTimeout	INT32U	CF		O	VT_I4
sboClass	ENUMERATED	CF	operate-once (0)   operate-many (1)	O	VT_I4
minVal	INT8	CF		O	VT_I4
maxVal	INT8	CF		O	VT_I4
stepSize	INT8	CF	1 ... (maxVal - minVal)	O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

## Mapping of controls

Direct Control with Normal Security:

- ctlVal: MMS Write.request to Oper structure with value.

SBO with Normal Security:

- ctlVal: MMS Write.request to Oper structure with value.  
IEC61850 OPC Server will do the select before operate.

Direct Control with Enhanced Security:

- ctlVal: MMS Write.request to Oper structure with value.

SBO with Enhanced Security:

- ctlVal: MMS Write.request to Oper structure with value.  
IEC61850 OPC Server will do the select before operate.

## 5.2.18. Common data class specifications for controllable analogue information

### 5.2.18.1. Analog set point (APC)

**Table 5.2.18.1-1 Analogue set point (APC)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
lastApplError	ApplicationErrorCode		Refer to 5.2.22, Application error codes Application error codes		VT_I4
ctlVal	Analogue-Value	CO		M	VT_R4
operTm	TimeStamp	CO		O	VT_DATE
orCat	ENUMERATED			O	VT_I4
orIdent	OCTET STRING64			O	VT_BSTR
ctlNum	INT8U	MX	0..255	O	VT_I4
mxVal	Analogue-Value	MX		M	VT_I4
q	Quality	MX		M	VT_I4
t	Timestamp	MX		M	VT_I4
stSeld	BOOLEAN	MX	FALSE TRUE	O	VT_BOOL
subEna	BOOLEAN	SV		O	VT_BOOL
subVal	INT32	SV		O	VT_I4
subQ	Quality	SV		O	VT_I4

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
subID	VISIBLE STRING64	SV	Text	O	VT_BSTR
ctlModel	ENUMERATED	CF	Status-only(0) direct-with-normal-security(1) sbo-with-normal-security(2) direct-with-enhanced-security(3) sbo-with-enhanced-security(4)	M	VT_I4
sboTimeout	INT32U	CF		O	VT_I4
sboClass	ENUMERATED	CF	Operate-once(0) operate-many(1)	O	VT_I4
units	Unit	CF		O	
db	INT32U	CF	0... 100000	O	
sVC	ScaledValue-Config	CF		O	
minVal	Analogue-Value	CF		O	
maxVal	Analogue-Value	CF		O	
stepSize	Analogue-Value	CF		O	
operTimeout	INT32U	CF		O	
d	VISIBLE STRING 255	DC	Text	O	VT_BSTR
dU	UNICODE STRING 255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING 255	EX		O	VT_BSTR
cdcName	VISIBLE STRING 255	EX		O	VT_BSTR
dataNs	VISIBLE STRING 255	EX		O	VT_BSTR

## Mapping of controls

Direct Control with Normal Security:

- setMag: MMS Write.request to Oper structure with value.

SBO with Normal Security:

- setMag: MMS Write.request to Oper structure with value. IEC61850 OPC Server will do the select before operate.

Direct Control with Enhanced Security:

- setMag: MMS Write.request to Oper structure with value.

SBO with Enhanced Security:

- setMag: MMS Write.request to Oper structure with value. IEC61850 OPC Server will do the select before operate.

## 5.2.19. Common data class specifications for status settings

### 5.2.19.1. Single point setting (SPG)

The following table defines the common data class of single point setting.

**Table 5.2.19.1-1 Single point setting (SPG)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
setVal	BOOLEAN	SP	off (FALSE)   on (TRUE)	M	VT_BOOL
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

### 5.2.19.2. Integer status setting (ING)

The following table defines the common data class of integer status setting.

**Table 5.2.19.2-1 Integer status setting (ING)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
setVal	INT32	SP		M	VT_I4
minVal	INT32	CF		O	VT_I4
maxVal	INT32	CF		O	VT_I4
stepSize	INT32	CF	1 ... (maxVal - minVal)	O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

**5.2.20.****Common data class specifications for analogue settings****5.2.20.1.****Analogue setting (ASG)**

The following table defines the common data class of analogue setting.

**Table 5.2.20.1-1 Analogue setting (ASG)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
setMag	Analogue-Value	SP		M	VT_I4
units	Unit	CF		O	
sVC	ScaledValue-Config	CF		O	
minVal	Analogue-Value	CF		O	VT_I4
maxVal	Analogue-Value	CF		O	VT_I4
stepSize	Analogue-Value	CF	1 ... (maxVal - minVal)	O	VT_I4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

### 5.2.20.2. Setting curve (CURVE)

The following table defines the common data class of setting curve.

**Table 5.2.20.2-1 Setting curve (CURVE)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
setCharact	ENUMERATED	SP		M	VT_I4
setParA	FLOAT32	SP		O	VT_R4
setParB	FLOAT32	SP		O	VT_R4
setParC	FLOAT32	SP		O	VT_R4
setParD	FLOAT32	SP		O	VT_R4
setParE	FLOAT32	SP		O	VT_R4
setParF	FLOAT32	SP		O	VT_R4
d	VISIBLE STRING255	DC	Text	O	VT_BSTR
dU	UNICODE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

## 5.2.21. Common data class specifications for description information

### 5.2.21.1. Device name plate (DPL)

The following table defines the common data class of device name plate. Data of this common data class are used to identify entities like primary equipment or physical devices.

**Table 5.2.21.1-1 Device name plate (DPL)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
vendor	VISIBLE STRING255	DC		M	VT_BSTR
hwRev	VISIBLE STRING255	DC		O	VT_BSTR
swRev	VISIBLE STRING255	DC		O	VT_BSTR
serNum	VISIBLE STRING255	DC		O	VT_BSTR
model	VISIBLE STRING255	DC		O	VT_BSTR
location	VISIBLE STRING255	DC		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX			VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

### 5.2.21.2. Logical node name plate (LPL)

The following table defines the common data class of logical node name plate. Data of this common data class are used to identify logical nodes.

**Table 5.2.21.2-1 Logical node name plate (LPL)**

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
vendor	VISIBLE STRING255	DC		M	VT_BSTR
hwRev	VISIBLE STRING255	DC		M	VT_BSTR
d	VISIBLE STRING255	DC	Text	M	VT_BSTR

Name	Type	FC	Value/ Value range	M/O	OPC Data Type
dU	UNICODE STRING255	DC		O	VT_BSTR
configRev	VISIBLE STRING255	DC		O	VT_BSTR
ldNs	VISIBLE STRING255	EX	will be included only in LLN0	O	VT_BSTR
lnNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcNs	VISIBLE STRING255	EX		O	VT_BSTR
cdcName	VISIBLE STRING255	EX		O	VT_BSTR
dataNs	VISIBLE STRING255	EX		O	VT_BSTR

### 5.2.22.

#### Application error codes

Command Error codes of lastAppIError attribute. The attribute is valid only for command data classes and its value presents the status of the last command. It is updated when command responses are received from devices.

The status code is received by adding the additional status code to main status code.

Example: 1003 = Unknown, select failed

**Table 5.2.22-1 Main status codes**

0	OK
1000	Unknown
2000	Timeout test not ok
3000	Operator test not ok

**Table 5.2.22-2 Additional status codes**

0	Unknown
1	Not supported
2	Blocked by switching hierarchy
3	Select failed
4	Invalid position
5	Position reached
6	Parameter change in execution

7	Step limit
8	Blocked by mode
9	Blocked by process
10	Blocked by interlocking
11	Blocked by synchrocheck
12	Command already in execution
13	Blocked by health
14	1 of n control
15	Abortion by cancel
16	Time limit over
17	Abortion by trip
18	Object not selected

## 5.3. Attributes

### 5.3.1. General about attributes

In addition to attributes for process data (indications and commands), the OPC Server also provides some attributes for controlling the devices and retrieving status information from them. These attributes are available for the OPC access client.

### 5.3.2. Server attributes

**Table 5.3.2-1 Server attributes**

Name	Value or Value range/ Default	Description
<b>Protocol stack version</b>	Version information	Data type: Text Access: Read-only The version information of the Protocol Stack
<b>Configuration version</b>	Version information	Data type: Text Access: Read-only The version information of the current configuration file.

Name	Value or Value range/ Default	Description
<b>Reset</b>	By writing 1 the server is reset.  By writing 2 the log file is cleared.  Other values are currently ignored.	Data type: Integer  Access: No limitations  Makes it possible for clients to reset the OPC server. A reset means that the server disconnects all clients and reloads the configuration file.   When the last client is disconnected the server usually shuts down. The server does not shut down if it was not started by the COM runtime or if it is running as a Windows service. In that case the configuration file is not reloaded.
<b>File version</b>	Version information	Data type: Text  Access: Read-only  The file version number of the OPC server/client exe file.
<b>Product version</b>	Version information	Data type: Text  Access: Read-only  The version (revision) of the package that the server/client belong to.
<b>Timesync client</b>		
<b>In use</b>	0 = Not in use  1 = In use  Default: 1	Data type: Integer  Access: No limitations  Status of the integrated SNTP clients time synchronization routine. Value is 0 when not in use and 1 when in use. By writing 0 the client is started and by writing 1 it is stopped. The client can be started only if configuration parameters are given in a configuration file.
<b>Timesync status</b>	False = Not synchronised  True = Synchronised OK	Data type: Boolean  Access: Read-only  Status of the integrated SNTP client time synchronization routine. Value is false when synchronization is not received and true when synchronization received and local time set OK.
<b>Timesync server</b>		

Name	Value or Value range/ Default	Description
In use	0 = Not in use 1 = In use Default: 1	Data type: Integer Access: No limitations Status of the integrated SNTP servers time synchronization routine. Value is 0 when not in use and 1 when in use. By writing 0 the client is started and by writing 1 it is stopped.
Timesync status	False = Failure True = OK	Status of the integrated SNTP servers time synchronization routine. Value is false when operation fails and true when operating OK.

## 5.3.3.

**IEC 61850 subnetwork attributes***Table 5.3.3-1 IEC 61850 subnetwork attributes*

Name	Value or Value range/ Default	Description
In use	0 = Not in use, the subnetwork communication is stopped 1 = In use Default: 1	Data type: Integer Access: No limitations The state of the subnetwork whether it is in use or not. When a subnetwork is not in use, no data can be transmitted on it, and no data is received from it. When a subnetwork is stopped by setting the in use attribute to 0, all data transmission on the subnetwork ceases and all open connections to the devices will be closed. Single devices in use attribute may be set to 1 and this operation also takes the subnetwork in use. Now only the one device is in use. If the subnetwork in use is set to 1, the rest of the devices are taken in use. The in use attribute has no affect on devices in simulation mode.
Object status	89 = Initialize error 90 = Not connected 91 = Initializing 100 = Ready 101 = Suspended (=Not in use) 102 = Simulated	Data type: Integer Access: Read-only Indicates the operating status of the device

Name	Value or Value range/ Default	Description
<b>Diagnostic events enabled</b>	False = Diagnostic events disabled  True = Diagnostic events enabled	Data type: Boolean  Access: No limitations  Enables/disables diagnostic events
<b>Diagnostic events level</b>	0 = Disabled  1 = Level1 (main operation and errors)  2 = Level2 (+ time synchronization error)  3 = Level3 (+ time synchronization done)  4 = Level4  5 = Level5	Data Type: Integer  Access: No limitations  Sets the maximum level for events coming from devices. Limits the lower level events to pass through.  See also System Event level shown in Table 3.2.3-1.
<b>Diagnostic counters</b>		
Sent connection request		Data type: Integer  Access: No limitations  Connect requests sent to devices
Received connection replies ok		Data type: Integer  Access: No limitations  Successful connect replies from devices
Received connection replies error		Data type: Integer  Access: No limitations  Failed connect replies from devices
Sent connection concludes		Data type: Integer  Access: No limitations  Connections closed by IEC 61850 OPC server
Received connection concludes		Data type: Integer  Access: No limitations  Received connection concludes
Received connection aborts		Data type: Integer  Access: No limitations  Connections refused and aborted by devices

Name	Value or Value range/ Default	Description
Received rejects		Data type: Integer Access: No limitations Request rejected by devices (usually if device could not decode the request or they do not support the used service)
Sent requests		Data type: Integer Access: No limitations Request sent to devices
Received replies ok		Data type: Integer Access: No limitations Successful requests to devices (received success responses)
Received replies error		Data type: Integer Access: No limitations Failed requests to devices (received error responses)
Received variable read replies ok		Data type: Integer Access: No limitations Variable read success responses from devices
Received variable read replies error		Data type: Integer Access: No limitations Variable read failure responses from devices
Received variable write replies ok		Data type: Integer Access: No limitations Variable write success responses from devices
Received variable write replies error		Data type: Integer Access: No limitations Variable read failure responses from devices
Received information reports		Data type: Integer Access: No limitations Information reports received from devices

Name	Value or Value range/ Default	Description
Received status requests		Data type: Integer Access: No limitations Unsolicited status requests received from devices

### 5.3.4.

### IEC 61850 device attributes

**Table 5.3.4-1 IEC 61850 device attributes**

Name	Value or Value range/ Default	Description
In use	0 = Out of use 1 = In use Default: 1	Data type: Integer Access: No limitations The operational status of the device whether it is in use or out of use. Taking the device out of use with this attribute stops all data communication with the device and closes the connection. All operations that would result in a data exchange are disabled. Setting in use to 1 will take the device back in use and tries to reestablish the connection to a physical device. The device itself is not affected by the attribute, only protocol stack's image of the device. The in use attribute has no affect on devices in simulation mode.

Name	Value or Value range/ Default	Description
<b>Object status</b>	94 = Init (checking configuration version for single rcb) 95 = init (checking rcb attributes for single rcb) 96 = Init (reading rcb variable list for single rcb) 97 = Init (enabling reporting for single rcb) 98 = Init (rcb init ok for single rcb) 100 = Ready 101 = Suspended (= not in use) 102 = Device simulated 86 = Report control block initialization error (restarting rcb init) 88 = Configuration version error (device is suspended) 89 = error (not specified) 90 = Device not connected 91 = Initializing 92 = Initializing rcb (after error in reporting init or information report flow) 93 = Reinitialize (after reconnection if init done)	Data type: Integer Access: Read-only Indicates the operating status of the device Data type: Integer Access: Read-only Indicates the operating status of the device
<b>Device connection status</b>	False = Device connection suspended True = Device connection OK	Data type: Boolean Access: Read-only Indicates the status of the device connection.
<b>Diagnostic events enabled</b>	False = Diagnostic events disabled True = Diagnostic events enabled	Data type: Boolean Access: No limitations Enables/disables diagnostic events

Name	Value or Value range/ Default	Description
<b>Diagnostic events level</b>	0 = Disabled 1 = Level1 (main operation, error replies, errors) 2 = Level2 (+ Information Reports, OK replies, RCB init) 3 = Level3 (+ sent requests (connect,read,write), transparent SPA messages) 4 = Level4 (+ reported local updates) 5 = Level5 (+ reported unconfigured updates)	Data Type: Integer Access: No limitations Sets diagnostics event level See also System Event Level shown in Table 3.2.4-1.
<b>IP address</b>	0.0.0.0 - 255.255.255.255	Data type: Text Access: Read-only (configuration) IP address of the physical device
<b>Configuration version</b>	Version information	Data type: Text Access: Read-only The version information of the current configuration for this device.
<b>Transparent XSAT</b>		See 5.3.5, Transparent XSAT.
<b>Diagnostic counters</b>		
Sent connection requests		Data type: Integer Access: No limitation Connection requests sent to device
Received connection replies ok		Data type: Integer Access: No limitation Success connection replies received from device (connection accepted)
Received connection replies error		Data type: Integer Access: No limitation Failure connection replies received from device (connection refused).

Name	Value or Value range/ Default	Description
Sent connection concludes		Data type: Integer Access: No limitation Connection to the device closed by IEC 61850 OPC Server.
Received connection concludes		Data type: Integer Access: No limitation Connections closed by device.
Sent requests		Data type: Integer Access: No limitation Additional requests (variable list, access attributes) sent to device
Received replies ok		Data type: Integer Access: No limitation Success replies to additional requests from device.
Received replies error		Data type: Integer Access: No limitation Failure replies to additional requests from device
Sent variable read requests		Data type: Integer Access: No limitation Variable read requests sent to device
Received variable read replies ok		Data type: Integer Access: No limitation Success replies to variable reads from device
Received variable read replies error		Data type: Integer Access: No limitation Failure replies to variable reads from device
Sent variable write requests		Data type: Integer Access: No limitation Variable write requests sent to device

Name	Value or Value range/ Default	Description
Received variable write replies ok		Data type: Integer Access: No limitation Success replies to variable write from device
Received variable write replies error		Data type: Integer Access: No limitation Failure replies to variable write from device
Received information reports		Data type: Integer Access: No limitation Information reports received from device
Received status replies		Data type: Integer Access: No limitation Successful replies to Status requests received from device

### 5.3.5. Transparent XSAT

The Transparent XSAT attribute can be used to read and write IEC 61850 attributes, which are not configured to the OPC namespace of the IEC 61850 OPC Server. For example, the transparent XSAT attribute can be used for setting group controlling. The Transparent XSAT attribute is used through an OPC client. The attribute uses the OPC data type BSTR, which is a variant of VT\_BSTR data type.

The Transparent XSAT attribute passes on request the IEC 61850 servers and their attributes outside the IEC 61850 OPC servers namespace. The IEC 61850 OPC server does not check the outgoing attributes. Therefore the IEC 61850 OPC clients which are using the Transparent XSAT attribute know what attributes they are accessing. The Transparent XSAT attribute only supports read and write requests.

The Transparent XSAT attribute uses synchronic data access in the IEC 61850 OPC server. When an IEC 61850 OPC client writes a request, the IEC 61850 OPC server parses and sends the request to the IEC 61850 server.

The Transparent XSAT attribute returns and releases the request after it has received reply from the IEC 61850 server. The reply is written in the Transparent XSAT attribute as an XSAT string.

## **XSAT Read Request**

### **Attribute Data Type Unknown**

The data type of the attribute is not known, because it is not included in the IEC 61850 OPC Server configuration (SCL). The Transparent XSAT attribute asks first the required data type, before reading the data from an IEC 61850 server.

If the Transparent XSAT attribute receives a success message, the data type is saved. If the Transparent XSAT attribute receives an error message, an XSAT error string is sent to the IEC 61850 OPC client.

The IEC 61850 OPC server request for the data type with a ReadVariableData service. The results are written in the Transparent XSAT attribute as an XSAT string. The XSAT string contains success and error messages.

### **Attribute Data Type Known**

The attribute data type is known from a previous request or the attribute is included in the IEC 61850 OPC Server configuration (SCL). The IEC 61850 OPC server directly uses a ReadVariableData service to complete the request. The reply message is written in the Transparent XSAT attribute as an XSAT string. The XSAT string contains success and error messages.

## **XSAT Write Request**

### **Attribute Data Type Unknown**

The data type of the attribute is not known, because it is not included in the IEC 61850 OPC Server configuration (SCL). The Transparent XSAT attribute first asks the required data type, before writing the data from an IEC 61850 server.

If the Transparent XSAT attribute receives a success message, the data type is saved. If the Transparent XSAT attribute receives an error message, an XSAT error string is sent to the IEC 61850 OPC client.

The IEC 61850 OPC server requests for the data type with a WriteVariableData service. The results are written in the Transparent XSAT attribute as an XSAT string. The XSAT string contains success and error messages.

### **Attribute Data Type Known**

The attribute data type is known from a previous request or the attribute is included in the IEC 61850 OPC Server configuration (SCL). The IEC 61850 OPC server directly uses a WriteVariableData service to complete the request. The reply message is written in the Transparent XSAT attribute as an XSAT string. The XSAT string contains success and error messages.

## XSAT Formats

- *XSAT Read Request*  
 GetDataValue&result={name|noname}&LDInst=""&FunConstr=""&LNName=""[&DORef=""&Attr=""]]
  - *XSAT Write Request*  
 SetDataValue&LDInst=""&FunConstr=""&LNName=""[&DORef=""[&Attr=""]]&v=""
  - *XSAT Read Reply*  
 Success with names (result=name)  

```
<?xml version="1.0"?><!DOCTYPE XSAT SYSTEM "xsat-004.dtd"><XSAT>
<Response><DO><LDInst>...</LDInst><LNName>...</LNName><DORef>...</DORef>
<At><n>...</n><v>...</v><FunConstr>...</FunConstr></At> ... </DO> ...
</Response> </XSAT>
```

 Success without names (result=noname)  

```
<?xml version="1.0"?><!DOCTYPE XSAT SYSTEM "xsat-004.dtd"><XSAT>
<Response><Values><v>...</v> ... </Values></Response></XSAT>
```

 Failure  

```
<?xml version="1.0"?><!DOCTYPE XSAT SYSTEM \"xsat-004.dtd\"> <XSAT>
<Response> <Result>failure</Result></Response></XSAT>
```
  - *XSAT Write Reply*  
 Success  

```
<?xml version="1.0"?><!DOCTYPE XSAT SYSTEM \"xsat-004.dtd\"> <XSAT>
<Response> <Result>ok</Result> </Response> </XSAT>
```

 Failure  

```
<?xml version="1.0"?><!DOCTYPE XSAT SYSTEM \"xsat-004.dtd\"> <XSAT>
<Response> <Result>failure</Result> </Response> </XSAT>
```
- EXAMPLE 1 (Read request + success reply)  
 IEC 61850 Path:  
 LD1\$PTOC1\$ST  
 Request:  
 GetDataValue&result=name&LDInst=LD1&LNName=PTOC1&FunConstr=ST  
 Reply OK:  

```
<?xml version="1.0"?> <!DOCTYPE XSAT SYSTEM "xsat-004.dtd"> <XSAT>
<Response>
<DO><LDInst>LD1</LDInst><LNName>PTOC1</LNName><DORef>Str</DORef>
<At><n>general</n><v>False</v><FunConstr>ST</FunConstr></At>
<At><n>t</n><v>1.1.1970</v><FunConstr>ST</FunConstr></At>
<At><n>q</n><v>12288</v><FunConstr>ST</FunConstr></At> </DO>
<DO><LDInst>LD1</LDInst><LNName>PTOC1</LNName><DORef>Op</DORef>
<At><n>general</n><v>False</v><FunConstr>ST</FunConstr></At>
<At><n>t</n><v>1.1.1970</v><FunConstr>ST</FunConstr></At>
<At><n>q</n><v>68</v><FunConstr>ST</FunConstr></At> </DO> </Response>
</XSAT>
```
- EXAMPLE 2 (Write request + failure reply)  
 IEC 61850 Path:  
 LD1\$LLN0\$BR\$brcbStatUrg02&RptEna

Request:

```
SetDataValue&LDInst=LD1&LNName=LLN0&DORef=brcbStat-
Urg02&Attr=RptEna&FunConstr=BR&v=False
```

Reply OK:

```
<?xml version="1.0"?><!DOCTYPE XSAT SYSTEM "xsat-004.dtd"> <XSAT>
<Response> <Result>failure</Result> </Response> </XSAT>
```

### 5.3.6. IEC 61850 logical device attributes

**Table 5.3.6-1 IEC 61850 logical device attributes**

Name	Value or Value range/ Default	Description
<b>Transparent SPA</b>	The contents of a valid SPA request	<p>Data type: Text</p> <p>Access: No limitations</p> <p>Makes it possible to communicate with SPA unit by sending SPA message and reading the reply as text in SPA format from this item. The communication is passed through a TCP/SPA tunnel, where this attribute acts as an independent TCP/SPA client and is connected to a TCP/SPA server. The TCP/SPA server is then responsible for forwarding the SPA messages to and from the SPA devices. The SPA/TCP client handles its own communication separately from other communication. No checks are done on command or reply contents they are simply passed on. This parameter is available only by configuration.</p> <p>This attribute must be enabled by setting the Transparent SPA Address, see Table 3.2.5-1. For example:</p> <p>SPA address = 1</p> <p>SPA command RF must be written in format RF: and sent in format 1RF:. The reply is received in format &gt;1D:REF543 .:</p>

## 5.4. IEC 61850 File transfer

### 5.4.1. General about IEC 61850 File Transfer

This section defines how the IEC 61850 file transfer services between the IEC 61850 OPC Server and the IEC 61850 devices are used through OPC DA. Since it is not possible

to pass files through OPC, the IEC 61850 OPC Server is used as a file storage. The received and sent files are stored locally in the computer running the OPC server.

File transfer services are controlled by an OPC DA client through the OPC attributes under the IED\Attributes\File transfer node. For more information about the file transfer attributes, refer to 5.4.2, File Transfer attributes.

The supported file transfer services are GetFile, SetFile, DeleteFile, GetFileAttributes, GetFileAttributesEx, RenameFile, and Cancel. For more information about the file transfer services, refer to 5.4.3, File Transfer services.



Make sure that the devices support the file transfer services.

## 5.4.2. File Transfer attributes

**Table 5.4.2-1 File transfer attributes**

Name	Value or Value range/ Default	Description
Remote file name		Data type: Text Access: No limitations File name of the remote file.
Remote file directory		Data type: Text Access: No limitations File directory of the remote directory.
Local file name		Data type: Text Access: No limitations File name of the local file.
Local file directory		Data type: Text Access: No limitations File directory of the local directory.
File size in bytes		Data type: Text Access: No limitations The remote file's size is received in bytes.

Name	Value or Value range/ Default	Description
Received bytes		Data type: Integer Access: No limitations Current remote file size is received in bytes. The IEC 61850 file transfer receives the file part by part in maximum size of the MMS messages. This attribute shows the size of the file that has been received. Value increases while the file transfer continues.
Status	1000 - 10000 For more information about valid status values, refer to 5.4.4, File Transfer service codes.	Data type: Integer Access: Read-only Status of the currently requested or last finished service.
Output		Data type: Text Access: Read-only The GetFileAttributeValues and GetFileAttributeValuesEx services print the requested file structure's output to this attribute. For more information about the output format, refer to 5.4.3, File Transfer services.
Control file reception	0 = Cancel 1 = GetFile 2 = GetFileAttributeValues 3 = GetFileAttributeValuesEx 4 = RenameFile 5 = SetFile 6 = DeleteFile	Data type: Text Access: Write-only This attribute controls the file transfer services. For more information about control codes for specific services, refer to 5.4.3, File Transfer services.

### 5.4.3.

### File Transfer services

The file transfer services are controlled through the OPC DA attributes, see Table 5.4.2-1. To initiate a service, first the required parameters are written to respective OPC attributes and then the service is started by writing the service control code to the file transfer control attribute.

The file transfer control attribute uses synchronous data access for OPC. When an OPC client writes a service request, the corresponding IEC 61850 file transfer service on the

device is called. When the service is finished or an error occurs, the OPC request is released.

The status of the latest service is available in the Status attribute. After a service is started, the status changes to the specific service status code. If the service is completed successfully, the status code is set to Ready (see Table 5.4.4-2). For more information about service failure status codes, refer to Table 5.4.4-3 and Table 5.4.4-4. Only one service can be called at a time.

## GetFile

You can copy a specified file from a remote device to the local file storage with the GetFile service. Through IEC 61850, this is done in three phases. First, the remote file is opened, then read, and finally closed. Remote file parameters identify the remote file. During this operation, the Status, Received bytes and File size in bytes attributes are updated as the file is moved (in max MMS message size parts). The copied file is renamed and placed to the local file storage according to local file parameters.

Required parameters:	Remote file name
	Remote file directory
	Local file name
	Local file directory
Control code:	1
Service status codes:	1100
	1120
	1140
Failure status codes:	91xx
The remote file name:	Remote file directory + Remote file name
The local file name:	Local file directory + Local file name

## GetFileAttributeValues

The GetFileAttributeValues service obtains the name of a file or group of files in the remote file storage. Received file attributes are printed to the Output attribute. This service prints only file names.

Required parameters:	Remote file name
	Remote file directory
Control code:	2
Service status codes:	1200
Failure status codes:	92xx

The remote file or directory name: Remote file directory + Remote file name



To request file attributes for a remote directory, set parameter Remote file name to empty. For example, space and tabulator are accepted as empty parameter.

## Output

The format of the result string is printed to the Output attribute in the following format:

```
{ } = optional
filename1{, filename2{, filename3{...}}
```

### Example:

```
StdOut.txt
```

```
StdOut.txt, Eventlog.log, config.icd
```

## GetFileAttributeValuesEx

The GetFileAttributeValuesEx service obtains the name and the attributes of a file or group of files in the remote file storage. Received file attributes are printed to the Output attribute. This service prints the file names, file sizes, and last modification dates if these are available.

Required parameters:	Remote file name
	Remote file directory
Control code:	3
Service status codes:	1300
Failure status codes:	93xx

The remote file or directory name: Remote file directory + Remote file name



To request file attributes for a remote directory, set parameter Remote file name to empty. For example, space and tabulator are accepted as empty parameter.

## Output

The format of the result string is printed to the Output attribute in a following format:

`{}` = optional

```
filename1[size{;d.m.Y H:M:S}]{, filename2[size{;d.m.Y H:M:S}]
{ ,fn3[...]}}
```

filename	= string
size	= bytes
d	= Day of month as decimal number (01 - 31)
m	= Month as decimal number (01 - 12)
Y	= Year with century, as decimal number
H	Hour in 24-hour format (00 - 23)
M	= Minute as decimal number (00 - 59)
S	= Second as decimal number (00 - 59)

### Example:

```
StdOut.txt[12445;02.03.2004]
```

```
StdOut.txt[12445], EventLog.log[53422], config.icd[2773]
```

## RenameFile

You can rename or move a file in the remote file storage with the RenameFile service.

Required parameters:	Remote file name
	Remote file directory
	Local file name
	Local file directory
Control code:	4
Service status codes:	1400
Failure status codes:	94xx
The remote file name to be renamed:	Remote file directory + Remote file name
The new name for the remote file:	Local file directory + Local file name

## SetFile

The SetFile service initiates the remote device to obtain a file from the local file storage to the remote file storage. The service triggers an IEC 61850 device to call the IEC 61850 clients GetFile service and during this, the IEC 61850 client acts as a file server. During this operation, the Status, Received bytes and File size in bytes attributes are updated as the file is moved (in max MMS message size parts). The local file parameters identify the local file and the copied file is placed to the remote file storage according to remote file parameters.

Required parameters:	Remote file name
	Remote file directory
	Local file name
	Local file directory
Control code:	5
Service status codes:	1500
	1520
	1540
	1560
Failure status codes:	94xx
The remote file name:	Remote file directory + Remote file name
The local file name:	Local file directory + Local file name

## DeleteFile

You can delete a file from the remote file storage with the DeleteFile service.

Required parameters:	Remote file name
	Remote file directory
Control code:	6
Service status codes:	1600
Failure status codes:	96xx
The remote file name:	Remote file directory + Remote file name

## Cancel

You can cancel the current service with the Cancel service. The Cancel service sets the status to Ready and clears for the following attribute values: File size in bytes, Received bytes and Status.

Control code: 0

#### 5.4.4. File Transfer service codes

Status codes can be read from the Status attribute. The status indicates the current service status and the service result.

**Table 5.4.4-1 Service control codes**

0	Cancel
1	GetFile
2	GetFileAttributeValues
3	GetFileAttributeValuesEx
4	Rename File
5	SetFile
6	DeleteFile

In the service status codes, the first number indicates success (1) or failure (9). The second number indicates currently requested service (0 - 6). If a local service is requested in multiple parts for the remote device, the third number indicates the currently called remote service (1 - 3). The fourth number gives a detailed failure code (0 - 3).

Example:

9601 = parameters error, remote file delete error

9123 = remote service error, remote file read error

**Table 5.4.4-2 Success**

1000	Ready
1100	Opening remote file
1120	Reading remote file
1140	Closing remote file
1200	Requesting remote directory file details
1300	Requesting remote directory file details
1400	Renaming remote file
1500	Requesting remote device to obtain local file
1520	Remote device requested to open local file
1540	Remote device requested to read local file
1560	Remote device requested to close local file
1600	Deleting remote file
1000	Service done

The failure status code indicates a failure in requested service. The failure status code can also include a more detailed error code indicating the failure type, which can be local or remote failure (see Table 5.4.4-3).

**Table 5.4.4-3 Failure**

9000	Unspecified error
9100	Remote file open error
9120	Remote file read error
9140	Remote file close error
9200	Remote directory details error
9300	Remote directory details error
9400	Remote file rename error
9500	Error in remote obtaining local file
9520	Error in remote opening local file
9540	Error in remote reading local file
9560	Error in remote closing local file
9600	Remote file delete error

**Table 5.4.4-4 Failure details**

0	No error details
1	Service parameters error (user error) Reason: required name attribute is empty Recovery: check the attribute values and try again
2	Local service error (IEC 61850 OPC Server internal error) Reason: not connected, too much network traffic, and so on Recovery: check connection and try again
3	Remote service error (remote device error) Reason: remote device is not supporting service, wrong parameters, no such file, connection failed, and so on Recovery: check remote device services support, check parameters (file names), check connection and try again

## 5.5.

### ACSI conformance statement

#### 5.5.1.

#### General about ACSI conformance statement

This section defines the compliance to IEC 61850 in terms of service, modeling, and engineering interfaces and gives detailed explanation of IEC 61850 capabilities of a

product. ACSI conformance statement describes the abstract services interfaces, which are normally mapped to certain SCSM (Specific communication service mapping) and therefore indirectly stated in PICS (Protocol Implementation Conformance Statement).

### 5.5.2. ACSI basic conformance statement

**Table 5.5.2-1 ACSI basic conformance statement**

		Client/ Subscriber	Server/ Publisher	Value/ Comments
	<b>Client-Server roles</b>			
B11	<b>Server</b> side (of TWO-PARTY-APPLICATION-ASSOCIATION)	-	a	
B12	<b>Client</b> side of (TWO-PARTY-APPLICATION-ASSOCIATION)	a	-	Supported
	<b>SCSMs supported</b>			
B21	<b>SCSM:</b> IEC 6185-8-1 used			Supported
B22	<b>SCSM:</b> IEC 6185-9-1 used			Not supported
B23	<b>SCSM:</b> IEC 6185-9-2 used			Not supported
B24	<b>SCSM:</b> other			
	<b>Generic substation event model (GSE)</b>			
B31	<b>Publisher</b> side	-	O	
B32	<b>Subscriber</b> side	O	-	Supported
	<b>Transmission of sampled value model (SVC)</b>			
B41	<b>Publisher</b> side	-	O	
B42	<b>Subscriber</b> side	O	-	Not supported

a. Will be M if support for LOGICAL DEVICE model has been declared.

### 5.5.3. ACSI models conformance statement

**Table 5.5.3-1 ACSI models conformance statement**

		Client/ Subscriber	Server/ Publisher	Value/ Comments
	<b>Server (If B1 side supported)</b>			
M1	<b>Logical device</b>	a	a	Supported

		Client/ Subscriber	Server/ Publisher	Value/ Comments
M2	<b>Logical node</b>	b	b	Supported
M3	<b>Data</b>	c	c	Supported
M4	<b>Data set</b>	d	d	Supported
M5	<b>Substitution</b>	O	O	Supported
M6	<b>Setting group control</b>	O	O	Supported (through Transparent XSAT)
	<b>Reporting</b>			
M7	<b>Buffered report control</b>	O	O	Supported
M7-1	sequence-number			
M7-2	report-time-stamp			
M7-3	reason-for-inclusion			
M7-4	data-set-name			
M7-5	data-reference			
M7-6	buffer-overflow			
M7-7	EntryID			
M7-8	BufTim			
M7-9	IntgPd			
M7-10	GI			
M8	<b>Unbuffered report control</b>	M	M	Supported
M8-1	sequence-number			
M8-2	report-time-stamp			
M8-3	reason-for-inclusion			
M8-4	data-set-name			
M8-5	data-reference			
M8-6	BufTim			
M8-7	IntgPd			
	<b>Logging</b>	O	O	Not supported
M9	<b>Log control</b>	O	O	Supported (through Transparent XSAT)
M9-1	IntgPd			
M10	<b>Log</b>	O	O	Not supported
M11	<b>Control</b>	M	M	Supported

		Client/ Sub- scriber	Server/ Pub- lisher	Value/ Com- ments
	<b>GSE (if B31/B32 is supported)</b>			
	<b>GOOSE</b>	<b>O</b>	<b>O</b>	Supported
M12-1	EntryID			
M12-2	DataRefInc			
M13	<b>GSSE</b>	<b>O</b>	<b>O</b>	Not supported
	<b>SVC (if 41/42 is supported)</b>			
M14	Multicast SVC	<b>O</b>	<b>O</b>	Not supported
M15	Unicast SVC	<b>O</b>	<b>O</b>	Not supported
M16	<b>Time</b>	<b>M</b>	<b>M</b>	Supported (Time source with required accuracy will be available)
M17	<b>File transfer</b>	<b>O</b>	<b>O</b>	Supported

- a. Will be M if support for LOGICAL NODE model has been declared.
- b. Will be M if support for DATA model has been declared.
- c. Will be M if support for DATA SET, Substitution, Report, Log Control, or Time model has been declared.
- d. Will be M if support for Report, GSE, or SMV models has been declared.

#### 5.5.4.

#### ACSI service conformance statement

The ACSI service conformance statement is defined in Table 5.5.4-1 (depending on the statements in Table 5.5.2-1).

**Table 5.5.4-1 ACSI service conformance statement**

		AA: TP/MC	Client (C)	Server (S)	Comments
	<b>Server</b>				
S1	ServerDirectory	TP		M	
	<b>Application Association</b>				
S2	Associate		M	M	Supported
S3	Abort		M	M	Supported
S4	Release		M	M	Supported
	<b>Logical device</b>				

		AA: TP/MC	Client (C)	Server (S)	Comments
S5	LogicalDeviceDirectory	TP	M	M	Supported
	<b>Logical node</b>				
S6	LogicalNodeDirectory	TP	M	M	Supported
S7	GetAllDataValues	TP	O	M	Not supported
	<b>Data</b>				
S8	GetDataValues	TP	M	M	Supported
S9	SetDataValues	TP	O	O	Supported
S10	GetDataDirectory	TP	O	M	Supported
S11	GetDataDefinition	v	O	M	Supported
	<b>Data set</b>				
S12	GetDataSetValues	TP	O	M	Supported
S13	SetDataSetValues	TP	O	O	Not supported
S14	CreateDataSet	TP	O	O	Supported
S15	DeleteDataSet	TP	O	O	Not supported
S16	GetDataSetDirectory	TP	O	O	Supported
	<b>Substitution</b>				
S17	SetDataValues	TP	M	M	Supported
	<b>Setting up control</b>				
S18	SelectActiveSG	TP	O	O	Supported
S19	SelectEditSG	TP	O	O	Supported
S20	SetSGValues	TP	O	O	Supported (through Transparent XSAT)
S21	ConfirmEditSGValues	TP	O	O	Supported
S22	GetSGValues	TP	O	O	Supported (through Transparent XSAT)
S23	GetSGCBValues	TP	O	O	Supported
	<b>Reporting</b>				
	Buffered report control block (BRCB)				
S24	Report	TP	a	a	Supported
S24-1	data-change (dchg)				
S24-2	qchg-change (qchg)				
S24-3	data-update (dupd)				

		AA: TP/MC	Client (C)	Server (S)	Comments
S25	GetBRCBValues	TP	a	a	Supported
S26	SetBRCBValues	TP	a	a	Supported
	Unbuffered report control block (URBC)				
S27	Report	TP	a	a	Supported
S27-1	data-change (dchg)				
S27-2	qchg-change (qchg)				
S27-3	data-update (dupd)				
S28	GetURCBValues	TP	a	a	Supported
S29	SetURCBValues	TP	a	a	Supported
	<b>Logging</b>				
	Log control block				
S30	GetLCBValues	TP		M	Supported (through Transparent XSAT)
S31	SetLCBValues	TP		M	Supported (through Transparent XSAT)
	<b>Log</b>				
S32	QueryLogByTime	TP	b	M	Not supported
S33	QueryLogByEntry	TP	b	M	Not supported
S34	GetLogStatusValues	TP		M	Supported (through Transparent XSAT)
	<b>Generic substation event model (GSE)</b>				
	GOOSE-CONTROL-BLOCK				
S35	SendGOOSEMessage	MC	c	c	Not supported
S36	GetReference	TP	O	d	Not supported
S37	GetGOOSEElement-Number	TP	O	d	Not supported
S38	GetGoCBValues	TP	O	O	Supported
S39	SetGoCBValues	TP	O	O	Supported
S40	SendGSSEMessage	MC	c	c	Not supported
S41	GetReference	TP	O	d	Not supported

		AA: TP/MC	Client (C)	Server (S)	Comments
S42	GetGSSEElementNumber	TP	O	d	Not supported
S43	GetGsCBValues	TP	O	O	Supported (through Transparent XSAT)
S44	SetGsCBValues	TP	O	O	Supported (through Transparent XSAT)
	<b>Transmission of sampled value model (SVC)</b>				
	Multicast SVC				
S45	SendMSVMessage	MC	e	e	Not supported
S46	GetMSVCBValues	TP	O	O	Supported (through Transparent XSAT)
S47	SetMSVCBValues	TP	O	O	Supported (through Transparent XSAT)
	Unicast SVC				
S48	SendUSVMessage	TP	e	e	Not supported
S49	GetUSVCBValues	TP	O	O	Supported (through Transparent XSAT)
S50	SetUSVCBValues	TP	O	O	Supported (through Transparent XSAT)
	<b>Control</b>				
S51	Select		M	M	Supported
S52	SelectWithValue	TP	M	M	Supported
S53	Cancel	TP	O	M	Supported
S54	Operate	TP	M	M	Supported
S55	Command-Termination	TP	M	M	Supported
S56	TimeActivated-Operate	TP	O	O	Not supported
	<b>File transfer</b>				
S57	GetFile	TP	O	M	Supported

		AA: TP/MC	Client (C)	Server (S)	Comments
S58	SetFile	TP	O	O	Supported
S59	DeleteFile	TP	O	O	Supported
S60	GetFileAttributeValues	TP	O	M	Supported
	<b>Time</b>				
T1	Time resolution of internal clock				(nearest negative power of 2 in seconds)
T2	Time accuracy of internal clock			T0	
				T1	
				T2	
				T3	
				T4	
				T5	
T3	supported TimeStamp resolution				(nearest negative power of 2 in seconds)

- a. Will declare support for at least one (BRCB or URCB).
- b. Will declare support for at least one (QueryLogByTime or QueryLogByEntry).
- c. Will declare support for at least one (SendGOOSEMessage or SendGSSEMessage).
- d. Will declare support if TP association is available.
- e. Will declare support for at least one (SendMSVMessage or SendUSVMessage).



## Index

### A

ABBCommandBitmask	
mapping .....	63
adding	
Computer Node object .....	18
Gateway .....	18
Analog set point (APC) .....	87
Analogue setting (ASG)	
common data class .....	90
Analogue value	
configuration .....	60
float values .....	59

### B

Binary controlled step position information (BSC)	
common data class .....	83
Binary counter reading (BCR)	
common data class .....	69

### C

Cancel .....	112
common data class	
Analogue setting (ASG) .....	90
Binary controlled step position information (BSC) .....	83
Binary counter reading (BCR) .....	69
Complex measured value (CMV) .....	71
Controllable double point (DPC) .....	77
Controllable integer status (INC) .....	80
Controllable single point (SPC) .....	75
Delta (DEL) .....	73
Device name plate (DPL) .....	92
Directional protection activation information (ACD) .....	67
Double point status (DPS) .....	64
Integer controlled step position information (ISC) .....	85
Integer status (INS) .....	65
Integer status setting (ING) .....	89
Logical node name plate (LPL) .....	92
Measured value (MV) .....	70
Protection activation information (ACT) .....	66
Sampled value (SAV) .....	72
Security violation counter (SEC) .....	68
Setting curve (CURVE) .....	91
Single point setting (SPG) .....	89

Single point status (SPS) .....	64
WYE .....	73
Complex measured value (CMV)	
common data class .....	71
Computer Node object	
adding .....	18
configuration	
Analogue value .....	60
object properties .....	22
configuring	
reporting .....	44
conformance statement	
ACSI basic .....	115
ACSI models .....	115
ACSI service .....	117
general .....	114
Controllable double point (DPC)	
common data class .....	77
Controllable integer status (INC)	
common data class .....	80
Controllable single point (SPC)	
common data class .....	75

## D

data object	
data classes .....	38
data reporting .....	41
configuring .....	44
report control block .....	41
data set .....	40
configuring .....	40
reporting .....	41, 44
Dataset Editor .....	40
DeleteFile .....	112
Delta (DEL)	
common data class .....	73
DetailedQuality	
mapping .....	59
Device name plate (DPL)	
common data class .....	92
diagnostics events	
Diagnostic AE Client .....	52
monitoring .....	52
Directional protection activation information (ACD)	
common data class .....	67
Double point status (DPS)	
common data class .....	64

**F**

File transfer	
attributes .....	107
service codes .....	113
services .....	108

**G**

Gateway	
adding .....	18
GetFile .....	109
GetFileAttributeValues .....	109
GetFileAttributeValuesEx .....	110

**I**

IEC 61850	
data object .....	55
device .....	54
device attributes .....	99
device properties .....	26
IED object .....	21
logical device attributes .....	106
OPC Server object .....	19
subnetwork activity .....	53
subnetwork attributes .....	96
subnetwork object .....	20
subnetwork properties .....	25
IEC 61850 OPC Server	
features .....	16
IEC 61850 quality .....	57
Integer controlled step position information (ISC)	
common data class .....	85
Integer status (INS)	
common data class .....	65
Integer status setting (ING)	
common data class .....	89

**L**

Logical device	
properties .....	32
Logical node name plate (LPL)	
common data class .....	92

**M**

mapping

ABBCommandBitmask .....	63
DetailedQuality .....	59
originator .....	61
pulse configuration .....	61
quality value .....	58
range configuration .....	60
step position with transient indication .....	61
unit .....	62
vector .....	62
Measured value (MV)	
common data class .....	70

## O

object properties	
configuration .....	22
object tree	
building .....	17
OPC Server	
diagnostics .....	51
properties .....	23
originator	
mapping .....	61
Output attribute .....	110–111

## P

properties	
Logical device .....	32
OPC Server .....	23
Protection activation information (ACT)	
common data class .....	66
pulse configuration	
mapping .....	61

## Q

quality value	
mapping .....	58

## R

range configuration	
mapping .....	60
RenameFile .....	111
report control block .....	41
report control block (RCB) .....	39

**S**

Sampled value (SAV)	
common data class .....	72
Security violation counter (SEC)	
common data class .....	68
Sequence (SEQ)	
common data class .....	74
Server attributes .....	94
SetFile .....	112
Setting curve (CURVE)	
common data class .....	91
Single point setting (SPG)	
common data class .....	89
Single point status (SPS)	
common data class .....	64
step position with transient indication	
mapping .....	61
subnetwork	
IEC 61850 .....	20

**T**

timestamp .....	62
Transparent XSAT attribute .....	103

**U**

unit	
mapping .....	62

**V**

vector	
mapping .....	62

**W**

WYE	
common data class .....	73





# Contact us

## **ABB Oy**

### **Distribution Automation**

P.O. Box 699

FI-65101 VAASA, FINLAND

Tel. +358 10 22 11

Fax. +358 10 224 1094

## **ABB Inc.**

### **Distribution Automation**

655 Century Point

Lake Mary, FL 32746, USA

Tel: +1 407 732 2000

Fax: +1 407 732 2335

**[www.abb.com/substationautomation](http://www.abb.com/substationautomation)**