

ABB DRIVES FOR HVAC, ABB DRIVES FOR WATER, ABB GENERAL DRIVES

# ACH580..., ACQ580... and ACS580...+P940 and +P944 drive modules

## Supplement





# ACH580..., ACQ580... and ACS580...+P940 and +P944 drive modules

## Supplement

Table of contents



4. Mechanical installation



5. Electrical installation



3AXD50000210305 Rev C  
EN

Original instructions  
EFFECTIVE: 2023-06-13



# Table of contents

---

## 1 Introduction to the supplement

Contents of this chapter .....	9
Safety instructions .....	9
Applicability .....	9
Target audience .....	10
Purpose of this supplement .....	10
Related documents .....	10

## 2 Hardware description

Contents of this chapter .....	11
Product overview .....	11
Layout of ACH580-31 and ACQ580-31 option +P940 (IP20, UL Open Type) .....	12
Layout of option +P944 (IP20, UL Open Type) .....	13

## 3 Guidelines for planning the cabinet installation

Contents of this chapter .....	15
Limitation of liability .....	15
North America .....	15
Generic cabinet planning instructions .....	15
Vibration dampers .....	16
Layout example .....	17
Minimum air inlet and outlet grating sizes .....	18
Preventing the recirculation of hot air .....	19
Installing drives above one another .....	21
Free space requirements .....	22
Planning the cabling outside cabinet .....	22
Installing ABB common mode filters (option +E208) .....	22

## 4 Mechanical installation

Contents of this chapter .....	23
Safety .....	23
Examining the installation site .....	24
Necessary tools .....	24
Moving the drive module .....	24
Unpacking and examining the delivery .....	25
Examining the delivery .....	25

---



## 6 Table of contents

ACH580-01, ACQ580-01 and ACS580-01 frames R5 and R6 .....	25
ACH580-01, ACQ580-01 and ACS580-01 frame R7 .....	26
ACH580-01, ACQ580-01 and ACS580-01 frames R8 and R9 .....	27
ACH580-31 and ACQ580-31 frame R3 .....	29
ACH580-31 and ACQ580-31 frame R6 .....	30
ACH580-31 and ACQ580-31 frame R8 .....	31
Installing the drive .....	32

## 5 Electrical installation

Contents of this chapter .....	33
Warnings .....	33
Power cable connection diagram .....	34
Cable connection procedure – ACH580-31... and ACQ580-31... +P940 .....	35
Power cable connection procedure (IEC) – ACH580-01..., ACQ580-01... and ACS580-01...+P940 .....	35
Power cable connection procedure (IEC) – ACH580-01..., ACQ580-01... and ACS580-01...+P944 .....	35
Installing the drive module shelves and connecting the power cables ..	36
Frames R5 to R9 .....	36
Connecting the control cables .....	38

## 6 Installation checklist

Contents of this chapter .....	39
--------------------------------	----

## 7 Technical data

Contents of this chapter .....	43
Dimensions, weights and free space requirements .....	43
Degree of protection .....	44

## 8 Dimension drawings – ACH580-01, ACQ580-01 and ACS580-01

Contents of this chapter .....	45
Frame R5 – Option +P944 (IP20, UL Open Type) .....	46
Frame R6 – Option +P944 (IP20, UL Open Type) .....	47
Frame R7 – Option +P944 (IP20, UL Open Type) .....	48
Frame R8 – Option +P944 (IP20, UL Open Type) .....	49
Frame R9 – Option +P944 (IP20, UL Open Type) .....	50

## 9 Dimension drawings – ACH580-31 and ACQ580-31

Contents of this chapter .....	51
Frame R3 – Option +P940 (IP20, UL Open Type) .....	52
Frame R6 – Option +P940 (IP20, UL Open Type) .....	53
Frame R8 – Option +P940 (IP20, UL Open Type) .....	54



## Further information





# 1

# Introduction to the supplement

---

## Contents of this chapter

This chapter describes the supplement.

## Safety instructions

See the hardware manual.

## Applicability

This supplement is applicable to these drive modules:

- ACH580-01 frames R5...R9 with option +P944
- ACQ580-01 frames R5...R9 with option +P944
- ACS580-01 frames R5...R9 with option +P944
- ACH580-31 frames R3, R6 and R8 with option +P940
- ACQ580-31 frames R3, R6 and R8 with option +P940.

It is a supplement to these manuals:

- ACH580-01 hardware manual (3AXD50000044839 [English])
  - ACQ580-01 hardware manual (3AXD50000044862 [English])
  - ACS580-01 hardware manual (3AXD50000044794 [English])
-

## 10 Introduction to the supplement

- ACH580-31 hardware manual (3AXD50000037066 [English])
- ACQ580-31 hardware manual (3AXD50000045935 [English]).

**Note:** Installation of ACH580-01, ACQ580-01 and ACS580-01 frames R1...R3 is possible without front cover and cable box with options +B063 and +B066. The installation requires flange mounting option +C135. Refer to ACH580-01..., ACQ580-01... and ACS580-01...+C135 drives with flange mounting kit supplement (3AXD50000349821 [English]).

### Target audience

This manual is intended for people who plan the installation, install, commission and do maintenance work on the drive, or create instructions for the end user of the drive concerning the installation and maintenance of the drive.

Read the manual before you work on the drive. You are expected to know the fundamentals of electricity, wiring, electrical components and electrical schematic symbols.

### Purpose of this supplement

The supplement gives you instructions on how to install the drive module into a user-defined cabinet.

### Related documents

You can find manuals on the Internet. See below for the relevant code/link. For more documentation, go to [www.abb.com/drives/documents](http://www.abb.com/drives/documents).



ACH580-01 manuals



ACQ580-01 manuals



ACS580-01 manuals



ACH580-31 manuals



ACQ580-31 manuals

2

# Hardware description

---

## Contents of this chapter

This chapter briefly describes the construction of the drive module options +P940 and +P944.

## Product overview


Drives with option +P940 and +P944 are modules to be installed into a user-defined cabinet.

Drive type	Option code	Degree of protection	Description
ACH580-31 ACQ580-31	+P940	IP20 (UL Open Type)	Drive module without front covers and bottom plate
ACH580-01 ACQ580-01 ACS580-01	+P944	IP20 (UL Open Type)	Drive module with front covers but without cable box

---

■ **Layout of ACH580-31 and ACQ580-31 option +P940 (IP20, UL Open Type)**


This image shows the layout of an example drive module, ACH580-31 frame R3.

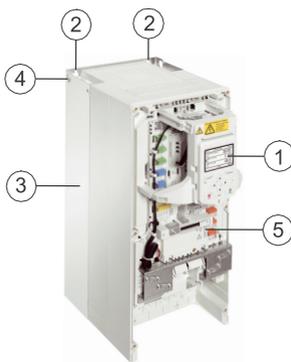

1	Control panel
2	Four fastening points at the back of the drive
3	Heatsink
4	Lifting eyes
5	Control unit

### ■ Layout of option +P944 (IP20, UL Open Type)

This image shows the layout of example drive modules: ACS580-01 frame R5, ACH580-01 frame R5 and ACQ580-01 frame R6.

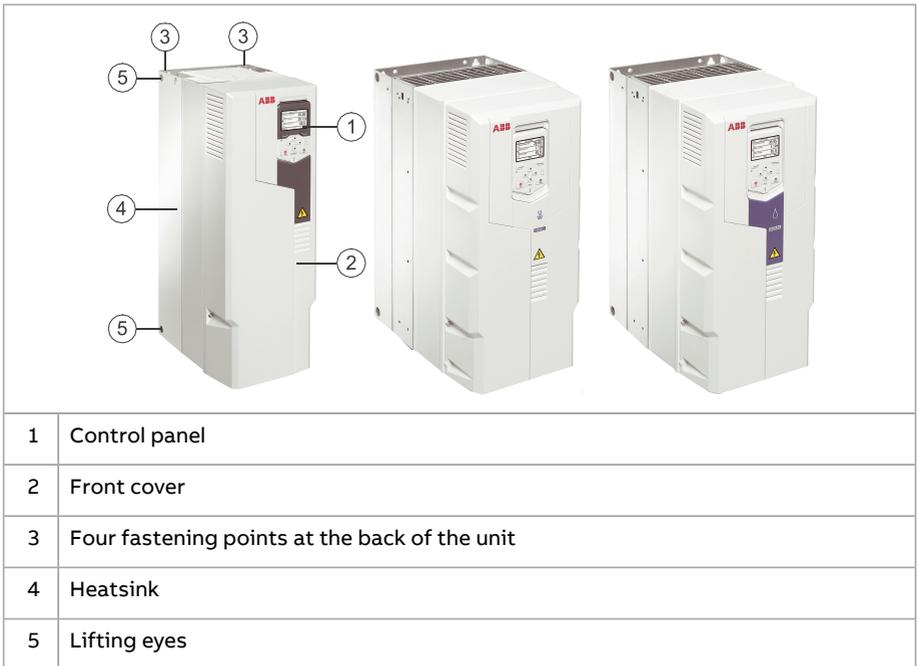



# 3

## Guidelines for planning the cabinet installation

---

### Contents of this chapter

This chapter gives ACS580-01, ACH580-01, ACQ580-01, ACH580-31 and ACQ580-31 specific guidelines for planning drive cabinets and installing the drive modules into a user-defined cabinet. The guidelines are essential for the safe and trouble-free use of the drive system.

### Limitation of liability

The installation must always be designed and made according to applicable local laws and regulations. ABB does not assume any liability whatsoever for any installation which breaches the local laws and/or other regulations. Furthermore, if the recommendations given by ABB are not followed, the drive may experience problems that the warranty does not cover.

#### ■ North America

Installations must be compliant with NFPA 70 (NEC)<sup>1)</sup> and/or Canadian Electrical Code (CE) along with state and local codes for your location and application.

<sup>1)</sup> National Fire Protection Association 70 (National Electric Code).

### Generic cabinet planning instructions

Refer to Drive modules cabinet design and construction instructions (3AUA0000107668 [English]) for

---

## 16 Guidelines for planning the cabinet installation

- cabinet construction: disposition of the devices, grounding of mounting structures, busbar material and joints, shrouds and tightening torques
- cooling and degrees of protection
- EMC requirements, 360° high-frequency grounding of the cable shields at the cable entries
- fastening the cabinet
- cabinet placement on a cable channel
- planning the use of cubicle heaters
- control panel mounting platforms.



### **Vibration dampers**

Vibration dampers are not needed in cabinet installations of ACH580-01, ACQ580-01, ACS580-01, ACH580-31 and ACQ580-31 drive modules.

---


## Layout example

An example cabinet layout is shown below.

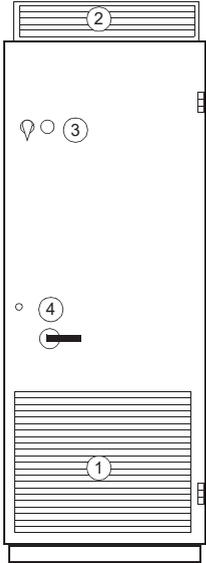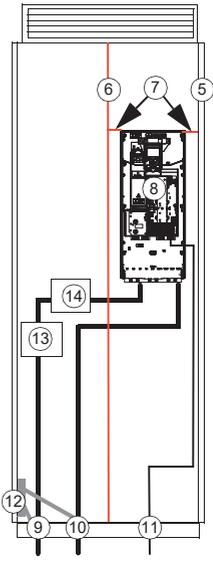			
1	Air inlet	8	Drive module with control unit and control panel
2	Air outlet	9	Input power cable including the protective ground conductor (PE) of the drive
3	Contactors control switch and emergency stop switch (connected to the contactor control circuit inside the cabinet)	10	Motor cable including the protective ground conductor
4	Operating handle of the disconnecter	11	External control cables
5	Supporting frame of the cabinet	12	Cabinet grounding busbar (PE)
6	Vertical air baffle that separates the cool and hot areas (leak-proof entries)	13	Disconnecter and fuses
7	Horizontal air baffles	14	Contactor

## 18 Guidelines for planning the cabinet installation

Roof air flow viewed from top:



### Minimum air inlet and outlet grating sizes

Make sure that the air inlet and outlets are large enough to allow sufficient air flow in and out of the cabinet. This is critical for the correct cooling of the drive module. See the minimum grating sizes below.

Frame size	Minimum effective area of cabinet air inlet (cm <sup>2</sup> )		Minimum effective area of cabinet air outlet (cm <sup>2</sup> )	
	IP22	IP54	IP22	IP54
R1	175	250	350	550
R2	225	350	450	700
R3	275	450	550	900
R4	350	550	700	1100
R5	400	650	800	1250
R6	475	750	950	1500
R7	650	1100	1300	2000
R8	1000	1600	2000	3200
R9	1500	2400	3000	4800

Frame size	Minimum effective area of cabinet air inlet (in <sup>2</sup> )		Minimum effective area of cabinet air outlet (in <sup>2</sup> )	
	UL Type 1	UL Type 12	UL Type 1	UL Type 12
R1	27.13	38.75	54.25	85.25
R2	34.88	54.25	69.75	108.50
R3	42.63	69.75	85.25	139.50
R4	54.25	85.25	108.50	170.50
R5	62.00	100.75	124.00	193.75
R6	73.63	116.25	147.25	232.50
R7	100.75	170.50	201.50	310.00
R8	155.00	248.00	310.00	496.00
R9	232.50	372.00	465.00	744.00

## Preventing the recirculation of hot air


Prevent hot air circulation outside the cabinet by leading the outgoing hot air away from the area where the inlet air to the cabinet is taken. Possible solutions are listed below:

- gratings that guide air flow at the air inlet and outlet
- air inlet and outlet at different sides of the cabinet
- cool air inlet in the lower part of the front door, and an extra exhaust fan on the roof of the cabinet.

Prevent hot air circulation inside the cabinet with, for example, leak-proof air baffles. Usually, no gaskets are required.


---

## 20 Guidelines for planning the cabinet installation

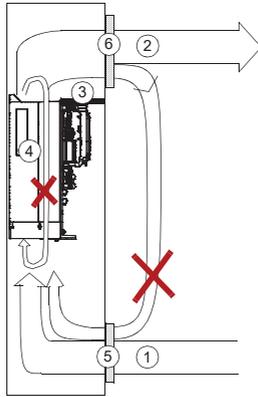

1	Main air flow in	4	Drive
2	Main air flow out	5	Air inlet filter
3	Air baffle plate	6	Air outlet filter


■ **Installing drives above one another**

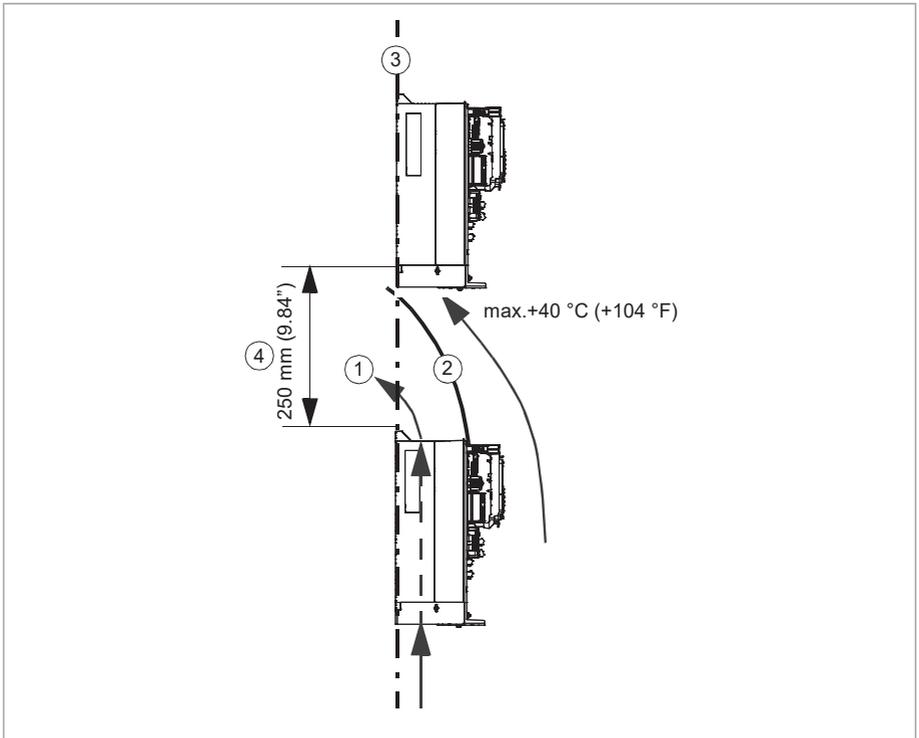

1	Air flow through the drive	3	Mounting plate that allows air flow
2	Air baffle	4	Minimum spacing between the drives

### Free space requirements

The required free space at the top and bottom of the drive module is shown below. The free space is needed to make sure that the module cools correctly.

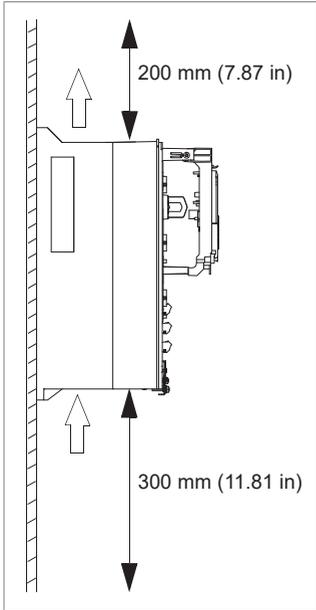

### Planning the cabling outside cabinet

Refer to the cable routing instructions in the hardware manual.

### Installing ABB common mode filters (option +E208)

Common mode filter kits are available as options from ABB. For drive modules without the cable entry box, hang the common mode filter ring on the cabinet structure.

For the dimensions of the ring and installing the motor cable through the ring, refer to

ACH580-01, ACQ580-01, ACS580-01: drawing in the common mode filter package	-
ACS880-01...+E208 frame R7, ACH580-31... and ACQ580-31...+E208 frame R8 kit installation instructions	3AXD50000015179

## 4

# Mechanical installation

---

## Contents of this chapter

This chapter gives guidelines for the mechanical installation of the drive module into a cabinet.




## Safety

---

**WARNING!**

For frame sizes R6 to R9: Use the lifting eyes of the drive when you lift the drive. Do not tilt the drive. **The drive is heavy and its center of gravity is high. An overturning drive can cause physical injury.**



## Examining the installation site

See the drive hardware manual for

- allowed ambient conditions in chapter Technical data
- allowed installation positions.

Examine the installation site. Make sure that:

- The installation site is sufficiently ventilated or cooled to remove heat from the drive. See the technical data.
- The ambient conditions of the drive meet the specifications. See the technical data.
- The material behind, above and below the drive is non-flammable.
- The installation surface is as close to vertical as possible and strong enough to support the drive.
- There is sufficient free space around the drive for cooling, maintenance, and operation. See the free space specifications for the drive.
- Make sure that there are no sources of strong magnetic fields such as high-current single-core conductors or contactor coils near the drive. A strong magnetic field can cause interference or inaccuracy in the operation of the drive.



## Necessary tools

To move a heavy drive, you need a crane, fork-lift or pallet truck (check load capacity!).

To lift a heavy drive, you need a hoist.

To install the drive mechanically, you need the following tools:

- drill with suitable bits
- screwdriver set (Torx, flat and/or Phillips, as appropriate)
- torque wrench
- socket set, Hex key set (metric)
- tape measure, if you will not be using the provided mounting template.

## Moving the drive module

Move the drive module in its transport package to the installation site.

---


## Unpacking and examining the delivery

### ■ Examining the delivery

Examine that all the items are present and there are no signs of damage. Read the data on the type designation label of the drive module to make sure that the drive module is of the correct type.

### ■ ACH580-01, ACQ580-01 and ACS580-01 frames R5 and R6

This figure shows the drive package with its contents.

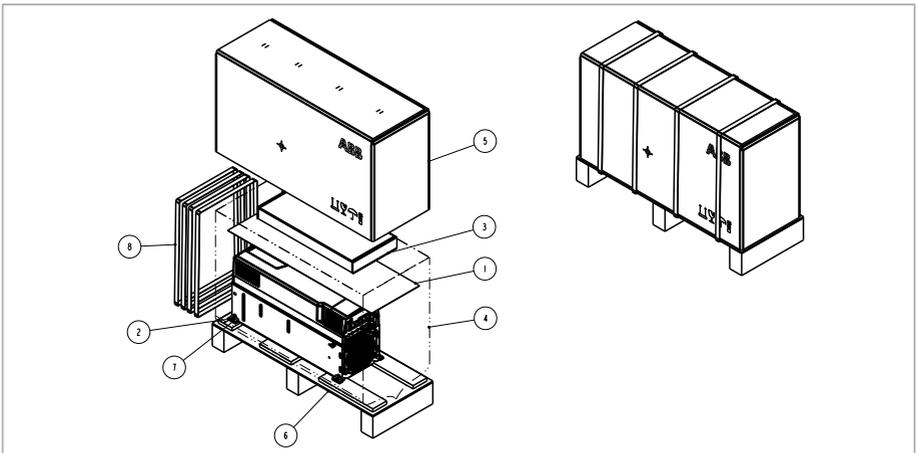

1	Mounting template	5	Cardboard cover
2	Steel bracket	6	Wooden pallet
3	Cardboard box	7	Screw
4	VCI bag	8	Straps


To unpack:

- Cut the straps (8).
- Remove the cardboard cover (5), option box (3) and mounting template (1).
- Remove the VCI bag (4).
- Loosen the four screws (7) that attach the drive module to the pallet.
- Lift the drive.



■ **ACH580-01, ACQ580-01 and ACS580-01 frame R7**

This figure shows the drive package with its contents.

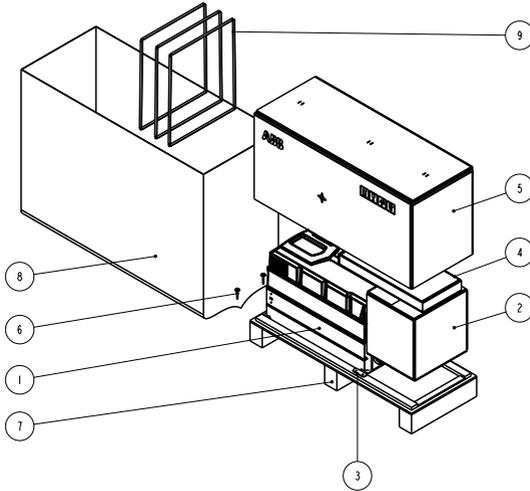


1	Drive with factory installed options	6	Screw
2	Cable box (not included with option +P944)	7	Wooden pallet
3	Bracket	8	VCI bag
4	Option box	9	Straps
5	Cardboard cover	-	-

**To unpack:**

- Cut the straps (9).
- Remove the cardboard cover (5).
- Remove the box (4) and VCI bag (8).
- Loosen the screws that attach the drive module to the pallet tray.
- Attach lifting hooks to the lifting eyes of the drive module. Lift the drive module with a hoist.

## ■ ACH580-01, ACQ580-01 and ACS580-01 frames R8 and R9

This figure shows the drive package with its contents.

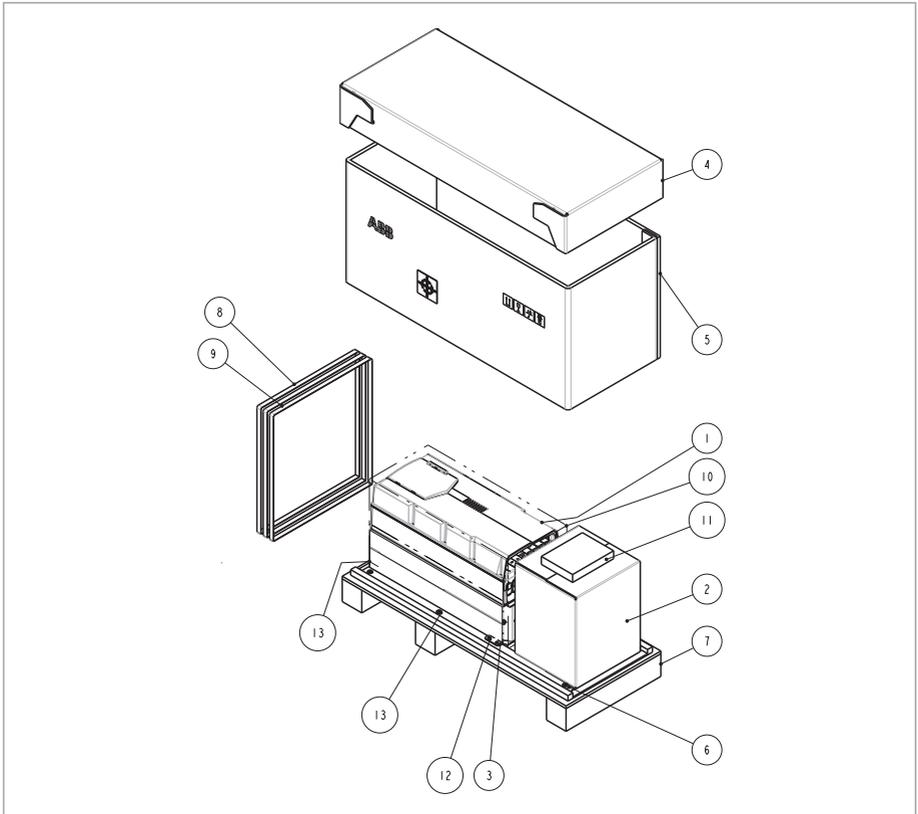

1	Drive with factory installed options	7	Wooden pallet
2	Cable box (not included with option +P944)	8, 9	Straps
3	Bracket	10	VCI bag
4	Cardboard lid	11	Printed quick guides and multilingual residual voltage warning sticker
5	Cardboard sleeve	12, 13	Screw
6	Plywood support	-	-

## 28 Mechanical installation


### To unpack:

- Cut the straps (8, 9)
- Remove the cardboard lid (4)
- Remove the VCI bag.
- Undo the screws that attach the drive module to the pallet.
- Attach lifting hooks to the lifting eyes of the drive module. Lift the drive module with a hoist.



## ■ ACH580-31 and ACQ580-31 frame R3

This figure shows the drive package with its contents.

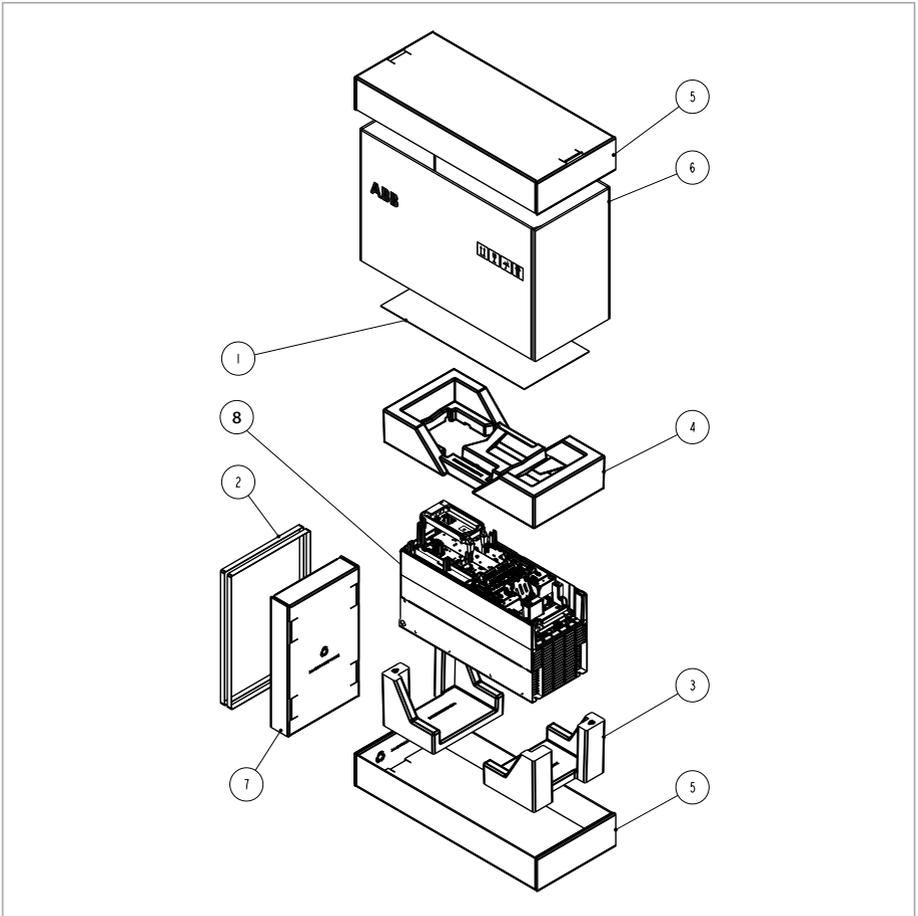

1	Mounting template	6	Sleeve
2	Straps	7	Option box
3, 4	Package cushions		
5	Cardboard tray	8	Drive with factory installed options


To unpack:

- Cut the straps (2)
- Remove the top tray (5), sleeve (6), mounting template (1) and cushion (4)
- Lift the drive.



## ■ ACH580-31 and ACQ580-31 frame R6

This figure shows the drive package with its contents.

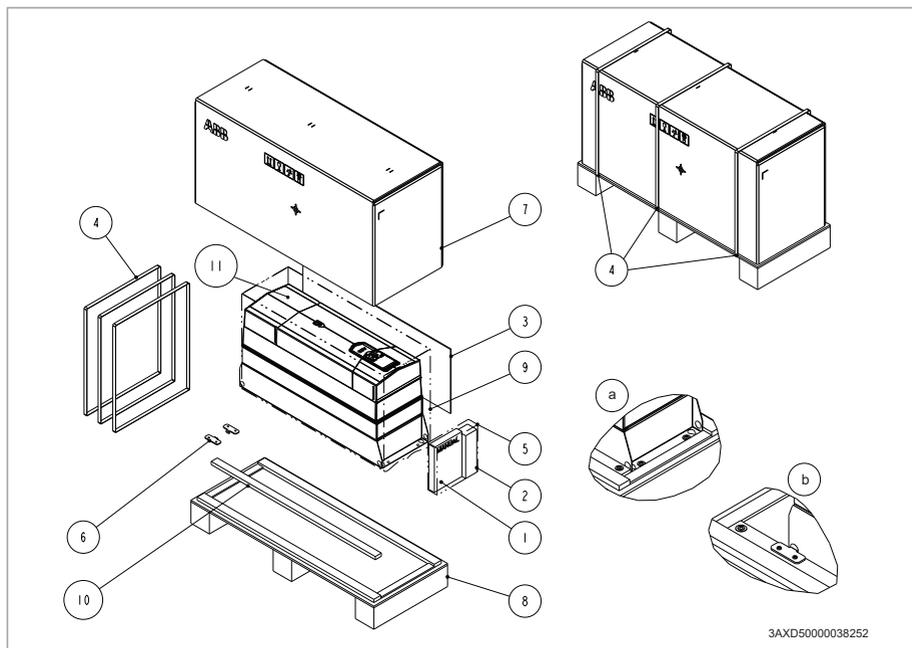

3AXD50000038252


1	Printed quick guides and manuals, multilingual residual voltage warning sticker	7	Cardboard box
2	Accessories	8	Wooden pallet
3	Mounting template	9	VCI bag
4	Straps	10	Plywood support
5	Plastic bag	11	Drive with factory installed options. Drives with option +P940 are delivered without front covers.
6	Packing brackets	-	-

### To unpack:

- Cut the straps (4)
- Remove the cardboard box (7) and the mounting template (3)
- Undo the attaching screws (a, b)
- Attach lifting hooks to the lifting eyes of the drive module. Lift the drive module with a hoist.

## ■ ACH580-31 and ACQ580-31 frame R8

This figure shows the drive package with its contents. Note that drives with option +P940 are delivered without front covers.

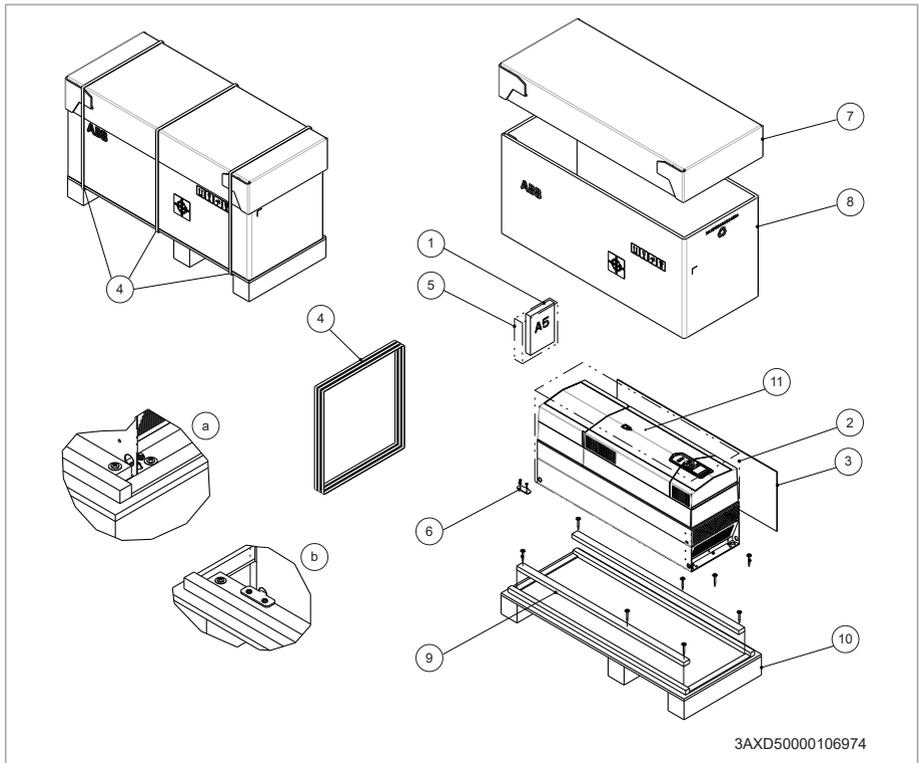

3AXD50000106974

1	Printed quick guides and manuals, multilingual residual voltage warning sticker	7	Tray
2	VCI bag	8	Sleeve
3	Mounting template	9	Plywood supports
4	Straps	10	Wooden pallet
5	Plastic bag	11	Drive with factory installed options. Drives with option +P940 are delivered without front covers.
6	Packing bracket	-	-


## 32 Mechanical installation

To unpack:

- Cut the straps (4)
- Remove the top tray (7), sleeve (8) and mounting template (3)
- Undo the attaching screws (a, b)
- Attach lifting hooks to the lifting eyes of the drive module. Lift the drive module with a hoist.

### Installing the drive

1. See the dimension drawings. Mark the locations for the four mounting holes.
2. Start the screws or bolts into the mounting holes.
3. Position the drive onto the screws.
4. Tighten the screws in the wall securely.

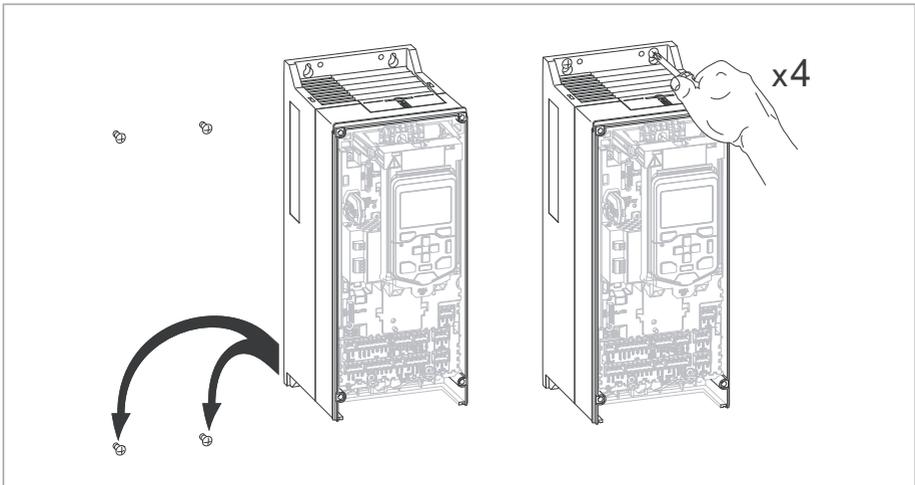

# 5

## Electrical installation

---

### Contents of this chapter

This chapter gives instructions on how to install the power and control cables to the drive module. For other electrical installation instructions that concern the drive, see the hardware manual.

### Warnings

---


**WARNING!**

Obey the safety instructions of the drive. If you ignore them, injury or death, or damage to the equipment can occur. If you are not a qualified electrical professional, do not do installation, commissioning or maintenance work.

---



## Power cable connection diagram

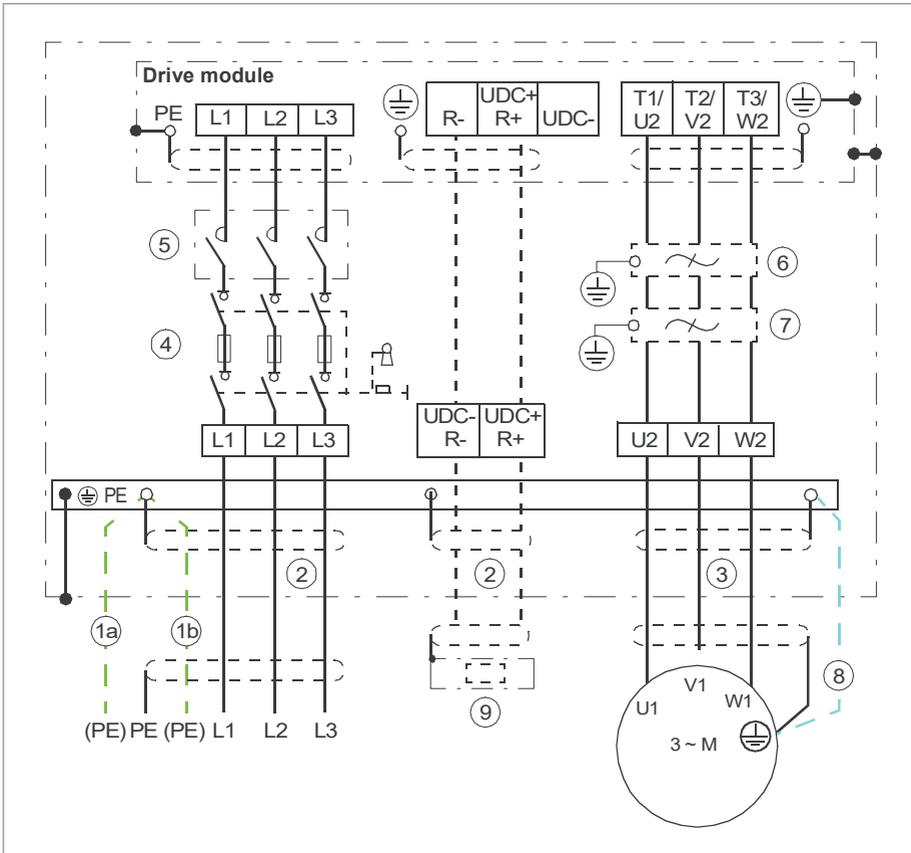

1	Use a separate grounding PE cable (1a) or a cable with a separate PE conductor (1b) if the conductivity of the shield does not meet the requirements for the PE conductor.
2	ABB recommends 360° grounding if shielded cable is used. Ground the other end of the input cable shield or PE conductor at the distribution board.
3	ABB requires 360° grounding.
4	Switch-disconnector and fuses. See section Selecting the supply disconnecting device in the hardware manual.
5	Line contactor (optional)
6	Common mode filter (option +E208)
7	du/dt filter or sine filter (optional)

8	Use a separate grounding cable if the shield does not meet the requirements of IEC 61439-1 and there is no symmetrically constructed grounding conductor in the cable. See the hardware manual.
9	External brake resistor

If there is a symmetrically constructed grounding conductor on the motor cable in addition to the conductive shield, connect the grounding conductor to the grounding terminal at the drive and motor ends.

Do not use an asymmetrically constructed motor cable for motors above 30 kW. Connecting its fourth conductor at the motor end increases bearing currents and causes extra wear.

**Note:** ACH580-31 and ACQ580-31 have an optional external brake chopper which is connected to the drive UDC+ and UDC- terminals.

### **Cable connection procedure – ACH580-31... and ACQ580-31... +P940**

Connect the power cables as described in the hardware manual. Secure the cables mechanically.

### **Power cable connection procedure (IEC) – ACH580-01..., ACQ580-01... and ACS580-01...+P940**

Connect the power cables as described in the hardware manual. Secure the cables mechanically.

### **Power cable connection procedure (IEC) – ACH580-01..., ACQ580-01... and ACS580-01...+P944**


This section gives instructions on how to connect the power cables.



## ■ Installing the drive module shelves and connecting the power cables


### Frames R5 to R9

1. Remove the shroud on the power cable terminals by releasing the clips and lifting the shroud up from the sides with a screwdriver. Knock out holes in the shroud for the cables to be installed.

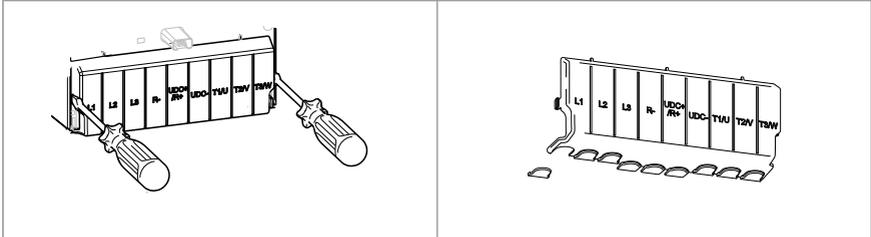


2. Attach the power cable shield grounding shelf to the drive module.

**Note:** This shelf is not included with option +C135.

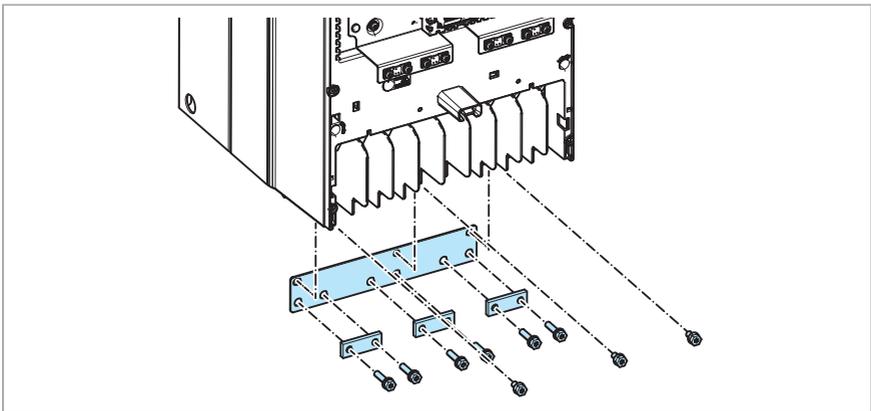

3. Connect the twisted shields of the power cables under the grounding clamps or with cable lugs under the clamp screws.
4. Connect the phase conductors of the input cable to the L1, L2 and L3 terminals and the phase conductors of the motor cable to the T1/U, T2/V and T3/W


terminals. Connect the brake resistor conductors (if present) to the R+ and R- terminals. Tighten the screws to the torque given in the figure below

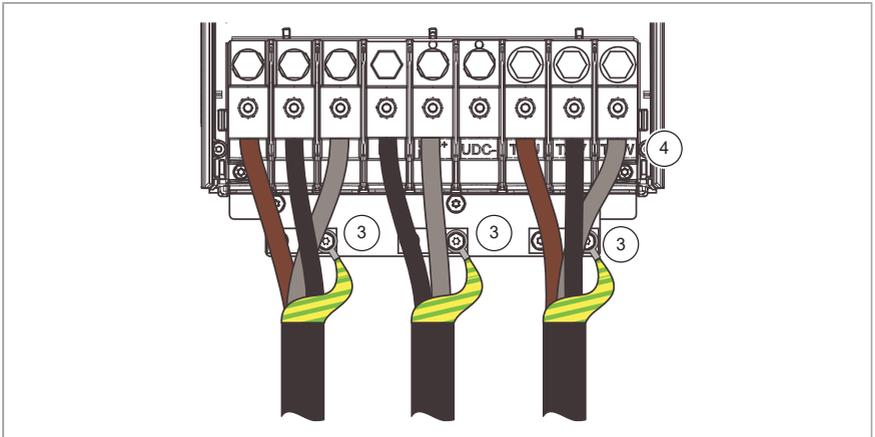

Frame	L1, L2, L3, T1/U, T2/V, T3/W		R-, R+/UDC+, UDC-		Grounding		
	N-m	lbf-ft	N-m	lbf-ft	N-m	lbf-ft	
R5	5.6	4.1	5.6	4.1	2.2	1.6	
R6	30	22.1	20	14.8	9.8	7.2	
R7	40 (30*)	29.5 (22.1)	30	22.1	9.8	7.2	
R8	40	29.5	40	29.5	9.8	7.2	
R9	70	51.6	70	51.6	9.8	7.2	
* 525...690 V							



5. Reinstall the shroud on the power terminals.

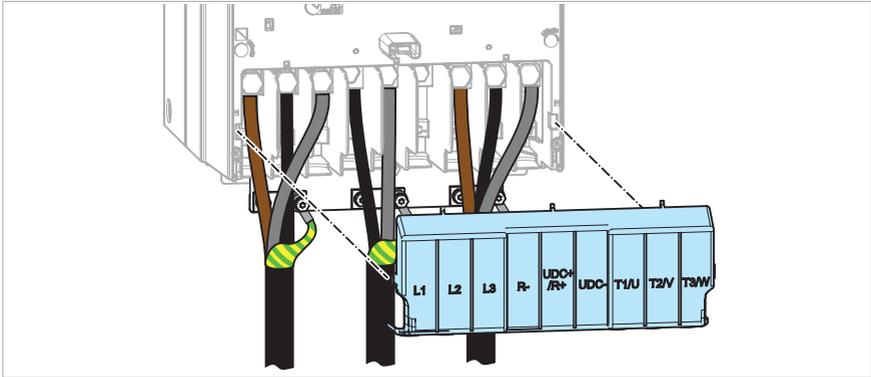

6. Secure the cables mechanically.

## Connecting the control cables

1. Strip the cable ends and cut to suitable length (note the extra length of the grounding conductors).
2. Ground the outer shields of all control cables 360 degrees at the cabinet entry.
3. Secure the cables mechanically at the clamps next to the control unit.
4. Ground the pair-cable shields and grounding wire at the SCR terminal. Leave the other end of the shields unconnected or ground them indirectly via a high-frequency capacitor with a few nanofarads, eg, 3.3 nF / 630 V.
5. Connect the conductors to the appropriate terminals of the control unit (see default I/O connections in the drive hardware manual).
6. Wire the optional modules if included in the delivery.



## 6

# Installation checklist

---

## Contents of this chapter

This chapter contains a checklist for the mechanical and electrical installation of the drive.


**WARNING!**

Obey the safety instructions of the drive. If you ignore them, injury or death, or damage to the equipment can occur. If you are not a qualified electrical professional, do not do installation, commissioning or maintenance work.



**WARNING!** Stop the drive and do the steps in section Electrical safety precautions in the hardware manual before you start the work.

<b>Make sure that ...</b>	<input checked="" type="checkbox"/>
The ambient operating conditions meet the drive ambient conditions specification and enclosure rating (IP code).	<input type="checkbox"/>
The supply voltage matches the nominal input voltage of the drive. See the type designation label.	<input type="checkbox"/>
The insulation resistance of the input power cable, motor cable and motor is measured according to local regulations and the manuals of the drive.	<input type="checkbox"/>
The drive is attached securely on an even, vertical and non-flammable wall.	<input type="checkbox"/>

---

## 40 Installation checklist

<b>Make sure that ...</b>	<input checked="" type="checkbox"/>
The drive cabinet is attached to the floor, and if necessary due to vibration etc, also by its top to the wall or roof.	<input type="checkbox"/>
The drive module is fastened properly to the enclosure.	<input type="checkbox"/>
The cooling air can flow freely in and out of the drive. Air recirculation inside the cabinet is not possible (air baffle plates are installed, or there is another air guiding solution).	<input type="checkbox"/>
<u>If the drive is connected to a network other than a symmetrically grounded TN-S system:</u> You have done all the required modifications (for example, you may need to disconnect the EMC filter or ground-to-phase varistor). See the electrical installation instructions.	<input type="checkbox"/>
The enclosures of the equipment in the cabinet have proper galvanic connection to the cabinet protective earth (ground) busbar; The connection surfaces at the fastening points are bare (unpainted) and the connections are tight, or separate grounding conductors have been installed.	<input type="checkbox"/>
The main circuit connections inside the drive cabinet correspond to the circuit diagrams.	<input type="checkbox"/>
The control unit has been connected. See the circuit diagrams.	<input type="checkbox"/>
Appropriate AC fuses and main disconnecting device are installed.	<input type="checkbox"/>
There is an adequately sized protective earth (ground) conductor(s) between the drive and the switchboard, the conductor is connected to correct terminal, and the terminal is tightened to the correct torque. Grounding has also been measured according to the regulations.	<input type="checkbox"/>
The input power cable is connected to the correct terminals, the phase order is correct, and the terminals are tightened to the correct torque.	<input type="checkbox"/>
There is an adequately sized protective earth (ground) conductor between the motor and the drive. The conductor is connected to the correct terminal, and the terminal is tightened to the correct torque. Grounding has also been measured according to the regulations.	<input type="checkbox"/>
The motor cable is connected to the correct terminals, the phase order is correct, and the terminals are tightened to the correct torque.	<input type="checkbox"/>
The motor cable is routed away from other cables.	<input type="checkbox"/>
No power factor compensation capacitors are connected to the motor cable.	<input type="checkbox"/>
The control cables are connected to the correct terminals, and the terminals are tightened to the correct torque.	<input type="checkbox"/>

<b>Make sure that ...</b>	<input checked="" type="checkbox"/>
<u>If a drive bypass connection will be used:</u> The direct-on-line contactor of the motor and the drive output contactor are either mechanically and/or electrically interlocked, that is, they cannot be closed at the same time. A thermal overload device must be used for protection when bypassing the drive. Refer to local codes and regulations.	<input type="checkbox"/>
There are no tools, foreign objects or dust from drilling inside the drive.	<input type="checkbox"/>
The area in front of the drive is clean: the drive cooling fan cannot draw any dust or dirt inside.	<input type="checkbox"/>
The terminal box cover of the motor is in place. Cabinet shrouds are in place and doors are closed. Drive covers and the terminal box cover of the motor are in place.	<input type="checkbox"/>
The motor and the driven equipment are ready for power-up.	<input type="checkbox"/>



## 7

# Technical data

---

## Contents of this chapter

This chapter contains some technical data of the drive module. For other data, see the hardware manual.

## Dimensions, weights and free space requirements

ACH580-01... ACQ580-01... and ACS580-01...+P944								
Frame	IP 20				UL Open Type			
	Height mm	Width mm	Depth mm	Weight kg	Height in	Width in	Depth in	Weight lb
R5	596	203	295	26.5	23.46	7.99	11.61	58
R6	549	252	369	42.6	21.63	9.92	14.53	94
R7	601	284	370	49.6	23.67	11.18	14.57	109
R8	680	300	393	62.8	26.77	11.81	15.47	138
R9	680	380	418	84.8	26.77	14.96	16.46	187

---

ACH580-31... and ACQ580-31... +P940								
Frame	IP 20				UL Open Type			
	Height mm	Width mm	Depth mm	Weight kg	Height in	Width in	Depth in	Weight lb
R3	490	203	349	18.3	19.29	7.99	13.78	40
R6	771	252	358	59	30.35	9.92	14.09	103
R8	964	300	430	109	37.95	11.81	16.94	240

For more information on dimensions, see the dimension drawings.

200 mm (7.87 in.) free space is required at the top of the drive module.

300 mm (11.81 in.) free space is required at the bottom of the drive module.

### Degree of protection

IP20 (UL Open Type).



# **Dimension drawings – ACH580-01, ACQ580-01 and ACS580-01**

---





## **Contents of this chapter**

This chapter contains dimension drawings of ACH580-01..., ACQ580-01... and ACS580-01...+P944 drive modules.

---




# Frame R6 – Option +P944 (IP20, UL Open Type)

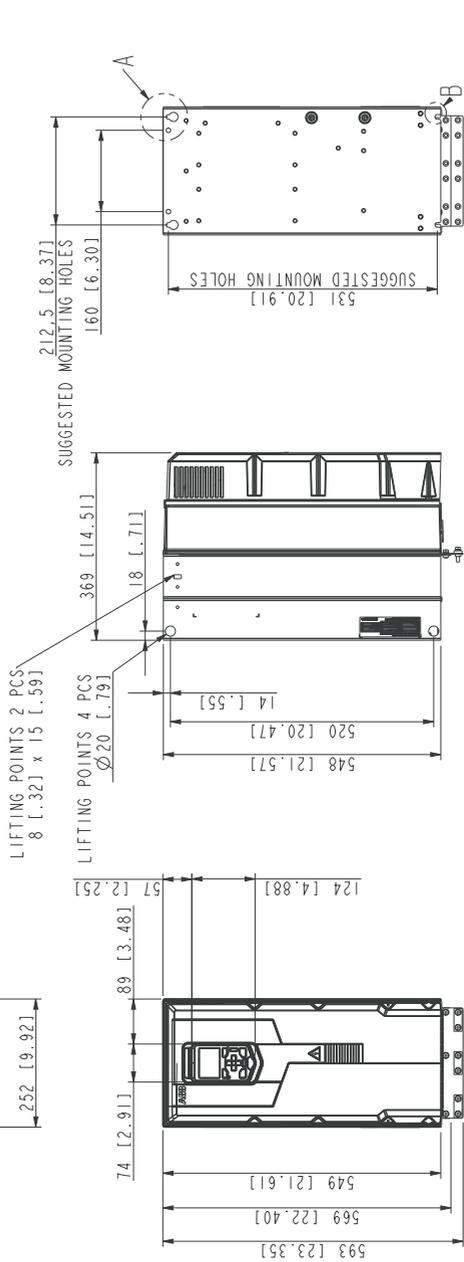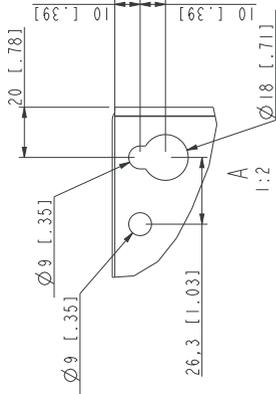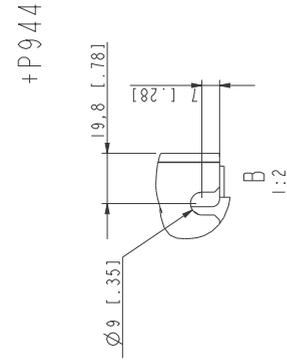

3AXD50000192113

# Frame R7 – Option +P944 (IP20, UL Open Type)




+P944

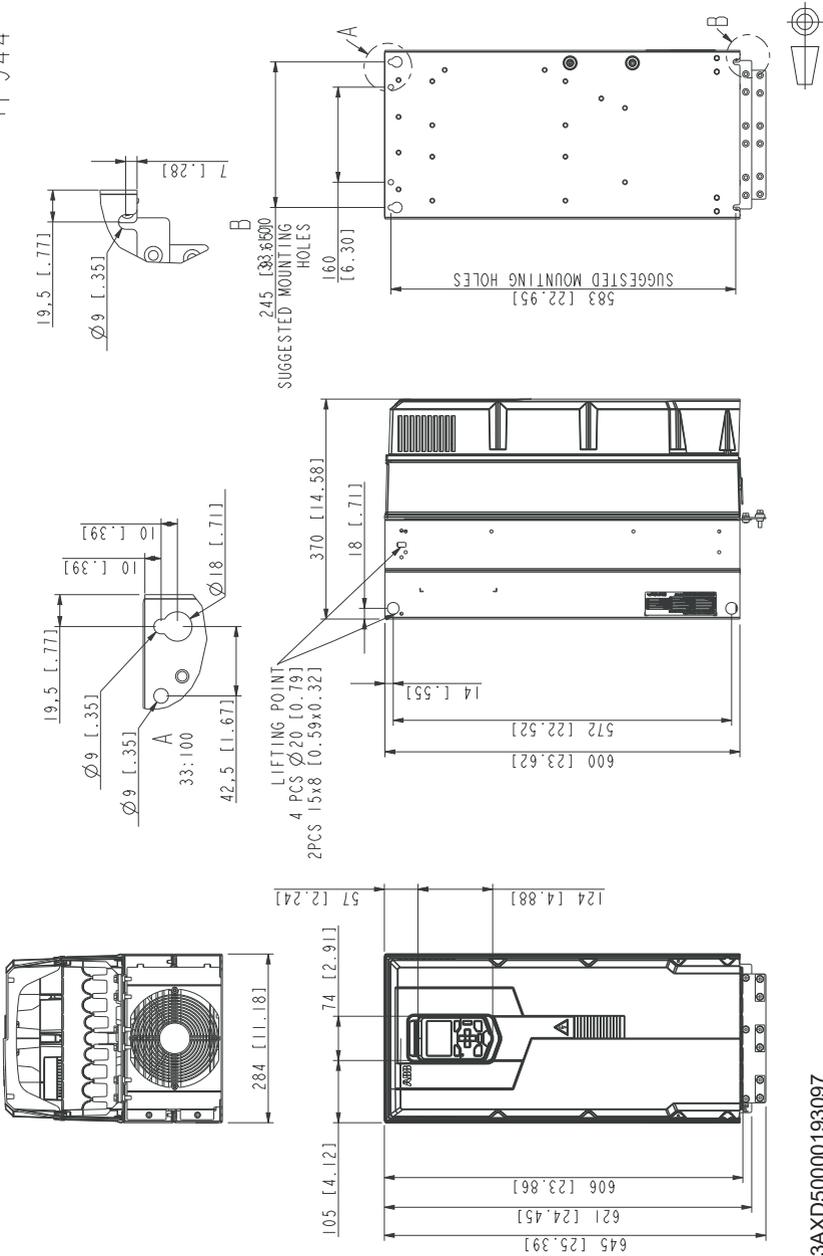



3AXD50000193097

# Frame R8 – Option +P944 (IP20, UL Open Type)


+P944

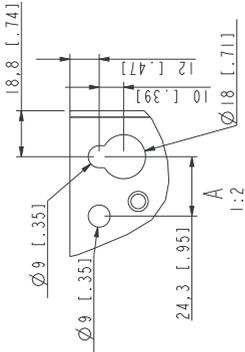

B  
1:2

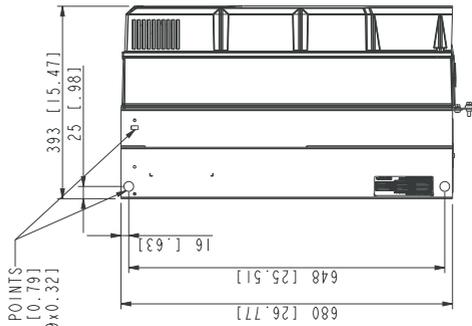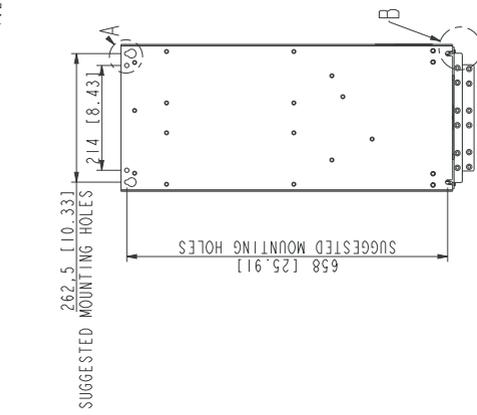


LIFTING POINTS  
4 PCS Ø20 [0.79]  
2 PCS 15x8 [0.59x0.32]

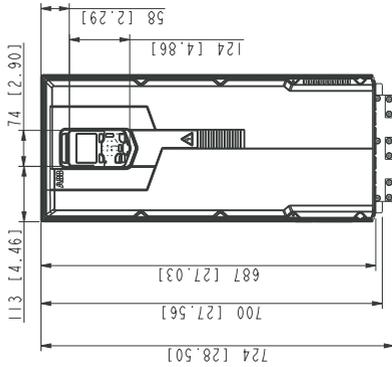

3AXD50000193424

# Frame R9 – Option +P944 (IP20, UL Open Type)

+P944

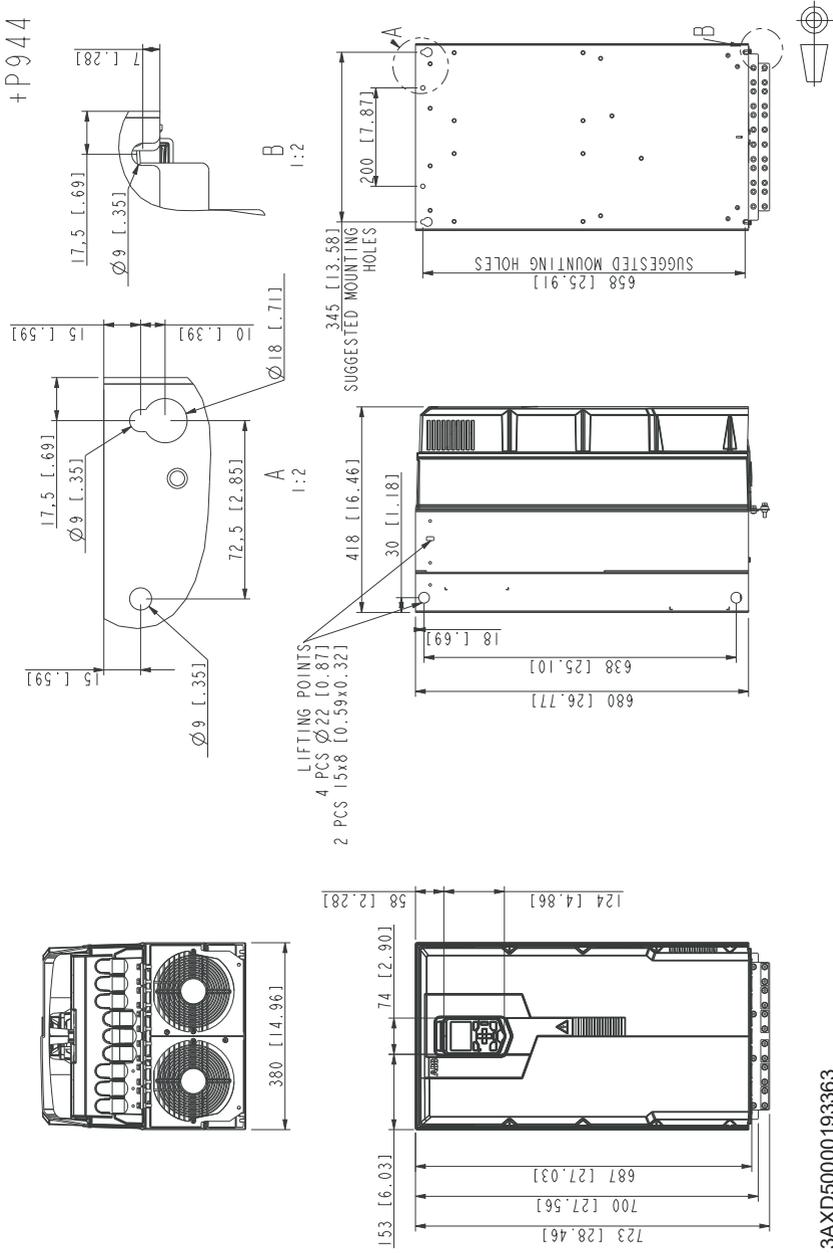

3AXD50000193363



# **Dimension drawings – ACH580-31 and ACQ580-31**






---

## **Contents of this chapter**

This chapter contains dimension drawings of ACH580-31... and ACQ580-31... +P940 drive modules.


---

# Frame R3 – Option +P940 (IP20, UL Open Type)

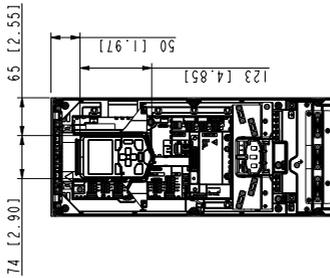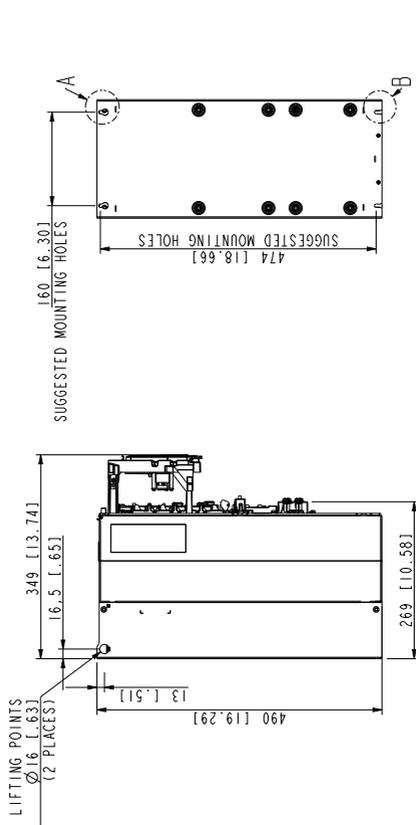



### Frame R8 – Option +P940 (IP20, UL Open Type)

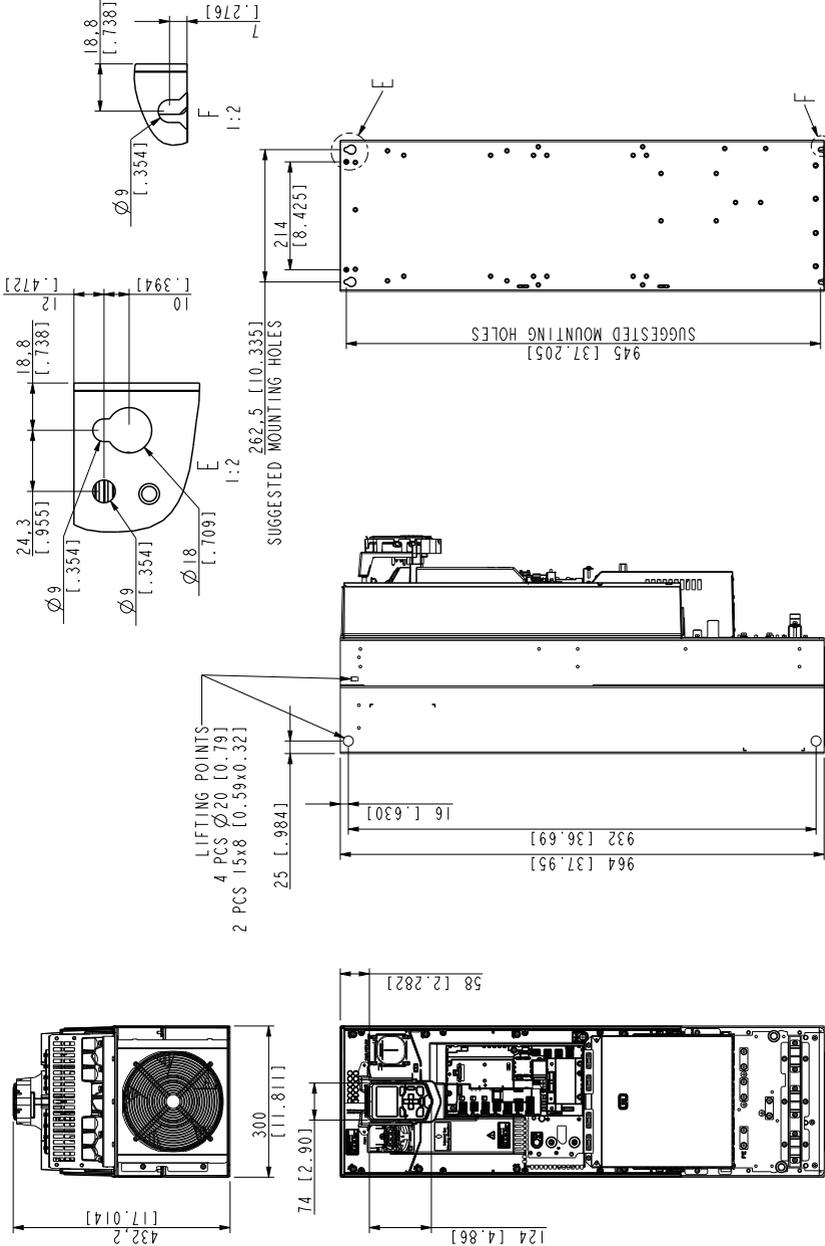

3AXD50000147052

LIFTING POINTS  
4 PCS Ø20 [0.79]  
2 PCS 15x8 [0.59x0.32]

SUGGESTED MOUNTING HOLES

SUGGESTED MOUNTING HOLES

---

## Further information

### Product and service inquiries

Address any inquiries about the product to your local ABB representative, quoting the type designation and serial number of the unit in question. A listing of ABB sales, support and service contacts can be found by navigating to [www.abb.com/searchchannels](http://www.abb.com/searchchannels).

### Product training

For information on ABB product training, navigate to [new.abb.com/service/training](http://new.abb.com/service/training).

### Providing feedback on ABB manuals

Your comments on our manuals are welcome. Navigate to [new.abb.com/drives/manuals-feedback-form](http://new.abb.com/drives/manuals-feedback-form).

### Document library on the Internet

You can find manuals and other product documents in PDF format on the Internet at [www.abb.com/drives/documents](http://www.abb.com/drives/documents).



[www.abb.com/drives](http://www.abb.com/drives)



3AXD50000210305C