

# Compact Secondary Substation (CSS) Jupiter 16

## Steel housing

Primary voltage 12 and 24 kV

Power rating up to 1600 kVA

### Features

- High level of safety for equipment and personnel
- All equipment inside CSS is type tested
- Engineered footprint meeting required clearance standards
- Oil collection pit underneath the transformer
- Inside operated steel housing
- Can be lifted with transformer installed (consult ABB first)
- Engineered for smooth air flow and natural cooling
- Locking system for all doors to prevent un-authorized entry of personnel
- Stainless steel hinges for corrosion resistance
- No access to live parts
- Steel parts are tested according to ISO 6988

### Definition

CSS is a type tested assembly comprising of an enclosure containing a medium voltage switchgear, a distribution transformer, a low voltage switchboard, interconnections and auxiliary equipment to transform energy from medium to low voltage systems.

### Standard features

CSS layout can be equipped with air or gas insulated ring main unit (RMU) for secondary distribution network.

Low voltage side is equipped with LVS concept switchboard. Jupiter 16 layout can accommodate up to 20 NH3 size fuselists. Low voltage switchboard can be equipped with DIN busbars, Z busbars or Kabeldon type busbars.

### Transformer

CSS is designed and manufactured for installation of dry or oil type transformers with the transformer compartment designed for natural cooling which will meet temperature rise limits and IEC requirements.

### Medium voltage

CSS medium voltage compartment design can accommodate 12/24 kV SafeRing / SafePlus with SF6 or non-SF6 insulation up to 6 bays.



### Low voltage

Low voltage switchboard is type tested according to IEC standards and can accommodate various types of switching devices such as MCCB's, ACB's or fuse switches.

Measurement and monitoring devices, as well as control and communication devices can be accommodated if needed. Busbar sizes are dimensioned according to transformer ratings. Various number and ratings of outgoing feeders are possible, depending on the transformer size and customer needs.


### Interconnections

Transformer medium voltage connection is done with single-core XLPE insulated cables (PVC or PE sheath).

Low voltage cable connections are done with double insulated high flexible cable, to provide earth fault and short-circuit proof design for service personnel safety. Interconnection is dimensioned according to maximum transformer ratings.

## Optional Features

Enclosure	LV	MV
– Different colors (RAL color system only)	– Lighting	– Surge arresters (overvoltage protection)
– Wooden panels on walls	– Surge arresters (overvoltage protection)	– Motor operation
– Anti-graffiti coating	– Socket outlet	– Remote control system functionality
– Increased roof slope: 18°	– Multimeter	– Tripping devices for transformer feeder
– Distribution transformer	– Current measuring	– Fuse links
– Temperature and pressure tripping wirings	– Voltage measuring	
– Transformer installation	– Fuse links	

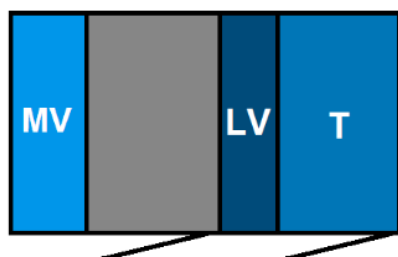

Description	Jupiter 16
Power rating	1600 kVA
MV Switchgear	ABB SafeRing/SafePlus
Rated voltage	Up to 24 kV
Short circuit withstand current of internal earthing network	Up to 20 kA, 1 s
Substation dimension (L x W x H)	3630 x 2430 x 2600 mm
Weight of substation with or w/o LV/MV switchgear excluding transformer	2900 kg / Up to 3900 kg
Transformer compartment dimension (L x W x H)	2160 x 1270 x 2200 mm
Maximum allowed transformer load / no load losses	Ak - Ao
Enclosure IP class	IP23D
Enclosure thermal class	20K
Rated current of LV panel	Up to 2500 A
Rated short circuit withstand capacity of LV busbar system	Up to 105 kA, 1 s

## Contact us

### ABB AS

Aruküla tee 83, Jüri, Rae vald  
Harjumaa, 75301, Estonia  
info.css@ee.abb.com

The data and illustrations are not binding. We reserve the right to make changes in the course of technical development of the product.

© Copyright 2014 ABB

All rights reserved

Power and productivity  
for a better world™

