

RELION® 615 SERIES

Transformer Protection and Control

RET615 ANSI

Modbus Point List Manual





Document ID: 1MAC203705-MB
Issued: 2018-02-26
Revision: A
Product version: 5.0 FP1

© Copyright 2018 ABB. All rights reserved

Copyright

This document and parts thereof must not be reproduced or copied without written permission from ABB, and the contents thereof must not be imparted to a third party, nor used for any unauthorized purpose.

The software or hardware described in this document is furnished under a license and may be used, copied, or disclosed only in accordance with the terms of such license.

Trademarks

ABB and Relion are registered trademarks of the ABB Group. All other brand or product names mentioned in this document may be trademarks or registered trademarks of their respective holders.

Warranty

Please inquire about the terms of warranty from your nearest ABB representative.

www.abb.com/mediumvoltage

www.abb.com/substationautomation

Disclaimer

The data, examples and diagrams in this manual are included solely for the concept or product description and are not to be deemed as a statement of guaranteed properties. All persons responsible for applying the equipment addressed in this manual must satisfy themselves that each intended application is suitable and acceptable, including that any applicable safety or other operational requirements are complied with. In particular, any risks in applications where a system failure and/or product failure would create a risk for harm to property or persons (including but not limited to personal injuries or death) shall be the sole responsibility of the person or entity applying the equipment, and those so responsible are hereby requested to ensure that all measures are taken to exclude or mitigate such risks.

This product has been designed to be connected and communicate data and information via a network interface which should be connected to a secure network. It is the sole responsibility of the person or entity responsible for network administration to ensure a secure connection to the network and to take the necessary measures (such as, but not limited to, installation of firewalls, application of authentication measures, encryption of data, installation of anti virus programs, etc.) to protect the product and the network, its system and interface included, against any kind of security breaches, unauthorized access, interference, intrusion, leakage and/or theft of data or information. ABB is not liable for any such damages and/or losses.

This document has been carefully checked by ABB but deviations cannot be completely ruled out. In case any errors are detected, the reader is kindly requested to notify the manufacturer. Other than under explicit contractual commitments, in no event shall ABB be responsible or liable for any loss or damage resulting from the use of this manual or the application of the equipment.

Conformity

This product complies with the directive of the Council of the European Communities on the approximation of the laws of the Member States relating to electromagnetic compatibility (EMC Directive 2004/108/EC) and concerning electrical equipment for use within specified voltage limits (Low-voltage directive 2006/95/EC). This conformity is the result of tests conducted by ABB in accordance with the product standards EN 50263 and EN 60255-26 for the EMC directive, and with the product standards EN 60255-1 and EN 60255-27 for the low voltage directive. The product is designed in accordance with the international standards of the IEC 60255 series and ANSI C37.90. This product complies with the UL 508 certification.

Table of contents

Section 1	Introduction.....	9
	This manual.....	9
	Intended audience.....	9
	Product documentation.....	10
	Product documentation set.....	10
	Document revision history.....	10
	Related documentation.....	11
	Symbols and conventions.....	11
	Symbols.....	11
	Document conventions.....	11
	Functions, codes and symbols.....	12
Section 2	Modbus data mappings.....	17
	Overview.....	17
	Supported functions.....	17
	Supported functions in RET615.....	17
	Indications.....	20
	Premapped indications.....	20
	Common data 1.....	20
	CTRL.CBCILO1 Circuit breaker enable signals (1).....	20
	CTRL.CBCSWI1 Circuit breaker (1) mom. position.....	21
	CTRL.CBCSWI1 Circuit breaker (1) mom+mcd position.....	21
	CTRL.CBXCBR1 Circuit-breaker control (1) – 52-1.....	21
	CTRL.DCSXSWI1 Disconnector position indication (1) – 52-	
	TOC.....	22
	CTRL.DCSXSWI2 Disconnector position indication (2) –	
	29DS-1.....	22
	CTRL.DCSXSWI3 Disconnector position indication (3) –	
	29DS-2.....	22
	CTRL.DCXSWI1 Disconnector control (1) – 29DS-1.....	22
	CTRL.DCXSWI2 Disconnector control (2) – 29DS-2.....	23
	CTRL.ESSXSWI1 Grounding switch indication (1) – 29GS-1.....	24
	CTRL.ESSXSWI2 Grounding switch indication (2) – 29GS-2.....	24
	CTRL.ESXSWI1 Grounding switch control (1) – 29GS-1.....	24
	LD0.ARCSARC1 Arc protection (1) – AFD-1.....	25
	LD0.ARCSARC2 Arc protection (2) – AFD-2.....	25

Table of contents

LD0.ARCSARC3 Arc protection (3) – AFD-3.....	25
LD0.CCBRBRF1 Circuit breaker failure protection (1) – 50BF-1..	26
LD0.CMMXU1 Three-phase current measurement (1) – IA, IB, IC.....	26
LD0.CMMXU2 Three-phase current measurement (2) – IA, IB, IC (2).....	26
LD0.DARREC1 Autoreclosing state (1) – 79-1.....	27
LD0.DPHLPDOC2 Three-phase directional overcurrent protection, low stage (2) – 67/51P-2.....	27
LD0.DPHLPDOC1 Three-phase directional overcurrent protection, low stage (1) – 67/51P-1.....	27
LD0.EFHPTOC1 Non-directional ground-fault protection, high stage (1) – 50G-1.....	28
LD0.EFHPTOC2 Non-directional ground-fault protection, high stage (2) – 50G-2.....	28
LD0.EFLPTOC1 Non-directional ground-fault protection, low stage (1) – 51G-1.....	29
LD0.EFLPTOC2 Non-directional ground-fault protection, low stage (2) – 51N-1.....	29
LD0.LEDGGIO1 Indication LED states Color1/Color2 – LED.....	29
LD0.LEDGGIO1 Indication LED states OFF/ColorX – LED.....	30
LD0.LEDPTRC1 Global conditioning (1).....	32
LD0.LEDPTRC1 Global conditioning - phase information (1).....	32
LD0.LREFPNDF1 Numerically stabilized low-impedance restricted ground-fault protection (1) – 87LOZREF-1.....	32
LD0.MAPGAPC1 Multipurpose protection (1) – MAP-1.....	33
LD0.MAPGAPC2 Multipurpose protection (2) – MAP-2.....	33
LD0.MAPGAPC3 Multipurpose protection (3) – MAP-3.....	33
LD0.MAPGAPC4 Multipurpose protection (4) – MAP-4.....	34
LD0.MAPGAPC5 Multipurpose protection (5) – MAP-5.....	34
LD0.MAPGAPC6 Multipurpose protection (6) – MAP-6.....	34
LD0.MDSOPT1 Runtime counter for machines and devices (1) – OPTM-1.....	35
LD0.MVGAPC1 Move (8 pcs) (1) – MV-1.....	35
LD0.MVGAPC2 Move (8 pcs) (2) – MV-2.....	36
LD0.NSPTOC1 Negative-sequence overcurrent protection (1) – 46-1.....	36
LD0.NSPTOC2 Negative-sequence overcurrent protection (2) – 46-2.....	37
LD0.OEPVPH1 Overexcitation protection (1) – 24-1.....	37
LD0.OEPVPH2 Overexcitation protection (2) – 24-2.....	37

Table of contents

LD0.PHHPTOC1 Three-phase non-directional overcurrent protection, high stage (1) – 50P-1.....	38
LD0.PHHPTOC2 Three-phase non-directional overcurrent protection, high stage (2) – 50P-1 (2).....	38
LD0.PHIPTOC1 Three-phase non-directional overcurrent protection, instantaneous stage (1) – 50P-3 (1).....	39
LD0.PHIPTOC2 Three-phase non-directional overcurrent protection, instantaneous stage (2) – 50P-3 (2).....	39
LD0.PHLPTOC1 Three-phase non-directional overcurrent protection, low stage (1) – 51P-1.....	40
LD0.PHLPTOC2 Three-phase non-directional overcurrent protection, low stage (2) – 51P-2.....	40
LD0.PHPTOV1 Three-phase overvoltage protection (1) – 59-1... ..	41
LD0.PHPTOV2 Three-phase overvoltage protection (2) – 59-2... ..	41
LD0.PHPTUV1 Three-phase undervoltage protection (1) – 27-1.42	
LD0.PHPTUV2 Three-phase undervoltage protection (2) – 27-2.42	
LD0.RESCMMXU1 Residual current measurement (1) – IG-1....	43
LD0.RESCMMXU2 Residual current measurement (2) – IG-2....	43
LD0.RESVMMXU1 Residual voltage measurement (1) – VG-1... ..	43
LD0.ROVPTOV1 Residual overvoltage protection (1) – 59G-1....	44
LD0.ROVPTOV2 Residual overvoltage protection (2) – 59N-1....	44
LD0.SEQSPVC1 Fuse failure supervision (1) – 60-1.....	44
LD0.SPCGAPC2 Generic control point (16 pcs) (2) – SPC-2.....	44
LD0.SSCBR1 Circuit-breaker condition monitoring (1) – 52CM-1.....	46
LD0.T2PTTR1 Three-phase thermal overload protection, two time constants (1) – 49T-1.....	46
LD0.TCSSCBR1 Trip circuit supervision (1) – TCM-1.....	47
LD0.TCSSCBR2 Trip circuit supervision (2) – TCM-2.....	47
LD0.TR2PTDF1 Stabilized and instantaneous differential protection for two-winding transformers (1) – 87T-1.....	47
LD0.TRPPTRC1 Master trip (1) – 86/94-1.....	48
LD0.TRPPTRC2 Master trip (2) – 86/94-2.....	48
LD0.VMMXU1 Three-phase voltage measurement (1) – VA, VB, VC.....	48
LD0.XAGGIO130 Physical I/O states (AIM card XA130).....	49
LD0.XARGGIO130 Alarm/warning.....	49
LD0.XBGGIO110 Physical I/O states (BIO card XB110).....	49
LD0.XGGIO100 Physical I/O states (PSM card X100).....	51
LD0.XGGIO110 Physical I/O states (BIO card X110).....	51
LD0.XGGIO130 Physical I/O states (BIO card X130)	52

Table of contents

LD0.XRGGIO130 Alarm/warning.....	53
Unmapped indications.....	54
All premapped three-phase protection function stages, trip/ phase-dependent objects added.....	54
Common data 2.....	54
LD0.DIAGLCCH1 Ethernet supervision (1).....	55
LD0.IL1TCTR1 Three-phase CT supervision (1).....	55
LD0.IL1TCTR2 Three-phase CT supervision (2).....	55
LD0.LDPRLRC1 Load profile record (1) – LoadProf.....	56
LD0.MAPGAPC7 Multipurpose protection (7) – MAP-7.....	56
LD0.MAPGAPC8 Multipurpose protection (8) – MAP-8.....	56
LD0.MAPGAPC9 Multipurpose protection (9) – MAP-9.....	57
LD0.MAPGAPC10 Multipurpose protection (10) – MAP-10.....	57
LD0.MAPGAPC11 Multipurpose protection (11) – MAP-11.....	57
LD0.MAPGAPC12 Multipurpose protection (12) – MAP-12.....	58
LD0.MAPGAPC13 Multipurpose protection (13) – MAP-13.....	58
LD0.MAPGAPC14 Multipurpose protection (14) – MAP-14.....	58
LD0.MAPGAPC15 Multipurpose protection (15) – MAP-15.....	59
LD0.MAPGAPC16 Multipurpose protection (16) – MAP-16.....	59
LD0.MAPGAPC17 Multipurpose protection (17) – MAP-17.....	59
LD0.MAPGAPC18 Multipurpose protection (18) – MAP-18.....	60
LD0.RESTCTR1 IG CT supervision (1).....	60
LD0.RESTCTR2 IG CT supervision (2).....	60
LD0.RESTVTR1 VG VT supervision (1).....	61
LD0.SPCGAPC1 Generic control point (16 pcs) (1) – SPC-1.....	61
LD0.TRPPTRC3 Master trip (3) – 86/94-3.....	62
LD0.TRPPTRC4 Master trip (4) – 86/94-4.....	62
LD0.TRPPTRC5 Master trip (5) – 86/94-5.....	63
LD0.UDFCNT1 Multipurpose generic up-down counter (1) – CTR-1.....	63
LD0.UDFCNT2 Multipurpose generic up-down counter (2) – CTR-2.....	63
LD0.UDFCNT3 Multipurpose generic up-down counter (3) – CTR-3.....	64
LD0.UDFCNT4 Multipurpose generic up-down counter (4) – CTR-4.....	64
LD0.UL1TVTR1 Three-phase VT supervision (1).....	64
Registers.....	65
Premapped registers.....	65
Active parameter setting group - read and write.....	65
Control structure 1.....	65

Table of contents

Control structure 2.....	66
Control structure 3.....	66
Control structure 4.....	66
Control structure 5.....	67
Control structure 6.....	67
Control structure 7.....	67
Control structure 8.....	68
Device ID string.....	68
Event record structure.....	68
Fault record structure header.....	72
Fault record data.....	73
Protection relay's real-time clock (in local time mode) - read and write (synchronize).....	77
Protection relay's real-time clock (in UTC time mode) - read and write (synchronize).....	77
Indication bits mirrored in registers.....	78
SSR1 System status register (1) device health.....	78
SSR2 System status register (2) protection relay's mode and state.....	79
SSR3 System status register (3) data available 1 (client- dependent).....	79
SSR4 System status register (4) data available 2 (client- dependent, user-definable).....	80
SSR5 System status register (5) device alive register.....	80
SSR6 System status register (6) control command status (client-dependent).....	81
System diagnostic values.....	81
Time and reason for latest protection relay reset.....	82
User-definable bits [Alt.2], visible on 0x,1x,3x and 4x.....	82
User-definable registers [Alt.1], visible on 3x and 4x.....	83
CTRL.CBCSWI1 Circuit breaker operation counter (1)	83
LD0.ARCSARCx1 Arc protection – AFD.....	83
LD0.CMMXU1 Phase current demand values (1) – IA, IB, IC.....	84
LD0.CMMXU1 Three-phase current measurement (1) – IA, IB, IC.....	85
LD0.CMMXU2 Phase current demand values (2) – IA, IB, IC (2).85	85
LD0.CMMXU2 Three-phase current measurement (2) – IA, IB, IC (2).....	86
LD0.CSMSQI1 Sequence current measurement (1) – I1, I2, I0... 87	87
LD0.PEMMTR1 Three-phase energy measurements.....	87

Table of contents

LD0.PEMMXU1 Power measurement demand values (1) – P, E-1.....	87
LD0.PEMMXU1 Three-phase power and energy measurement (1) – P, E-1.....	88
LD0.RESCMMXU1 Residual current demand value (1) – IG-1....	88
LD0.RESCMMXU1 Residual current measurement (1) – IG-1....	89
LD0.RESCMMXU2 Residual current demand value (2) – IG-2....	89
LD0.RESCMMXU2 Residual current measurement (2) – IG-2....	90
LD0.RESVMMXU1 Residual voltage demand value (1) – VG-1..	90
LD0.RESVMMXU1 Residual voltage measurement (1) – VG-1...	91
LD0.SSCBR1 Circuit-breaker condition monitoring (1) – 52CM-1.....	91
LD0.T2PTTR1 Three-phase thermal overload protection, two time constants (2) – 49T-1.....	91
LD0.TPOSYLTC1 Tap changer position indication (1) – 84T-1....	92
LD0.TR2PTDF1 Stabilized and instantaneous differential protection for two-winding transformers (1)LD0.TR2PTDF1 Stabilized and instantaneous differential protection for two-winding transformers (1) – 87T-1.....	92
LD0.VMMXU1 Three-phase voltage measurement (1) – VA, VB, VC.....	93
LD0.VMMXU1 Voltage demand values (1) – VA, VB, VC.....	93
LD0.VSMSQI1 Sequence voltage measurement (1) – V1, V2, V0.....	94
LD0.XARGGIO130 RTD input values.....	94
LD0.XRGGIO130 RTD input values.....	94
Unmapped registers.....	95
CTRL.LLN0 Local, Remote, Station, Off and Combinations.....	95
LD0.FMMXU1 Frequency measurement (1) – f-1.....	95
LD0.LLN0/LPHD1/LDEV1 System values	95
LD0.MDSOPT1 Runtime counter for machines and devices (1) – OPTM-1.....	95
LD0.MVI4GAPC1 Integer value move (1) – MVI4-1.....	96
LD0.SCA4GAPC1 Analog value scaling (1) – SCA4-1.....	96
LD0.SCA4GAPC2 Analog value scaling (2) – SCA4-2.....	96
LD0.SCA4GAPC3 Analog value scaling (3) – SCA4-3.....	97
LD0.SCA4GAPC4 Analog value scaling (4) – SCA4-4.....	97
LD0.SPEMMTR1 Single-phase power and energy measurement (1).....	97
LD0.SPEMMXU1 Single-phase power and energy measurement demand values (1) – SP, SE-1.....	99

Table of contents

LD0.SPEMMXU1 Single-phase power and energy measurement (1) – SP, SE-1.....	100
Controls.....	101
Reset, acknowledge and trigger points.....	101
CTRL.CBCSWI1 Circuit breaker control (1).....	102
CTRL.CBCSWI2 Circuit breaker control (2).....	103
CTRL.DCXSWI1 Disconnector control (1) – 29DS-1.....	103
CTRL.DCXSWI2 Disconnector control (2) – 29DS-2.....	103
CTRL.ESXSWI1 Grounding switch control (1) – 29GS-1.....	104
LD0.LDEV1 Protection relay's warm reset (1).....	104
LD0.SPCGAPC1 Generic control point (16 pcs) (1) – SPC-1.....	104
LD0.SPCGAPC2 Generic control point (16 pcs) (2) – SPC-2.....	105
LD0.SRGAPC1 Set-reset (8 pcs) (1) – SR-1.....	106
LD0.SRGAPC2 Set-reset (8 pcs) (2) – SR-2.....	106
Unmapped control points.....	107
Unmapped controls.....	107
LD0.UDFCNT1 Multipurpose generic up-down counter (1) – CTR-1.....	107
LD0.UDFCNT2 Multipurpose generic up-down counter (2) – CTR-2.....	107
LD0.UDFCNT3 Multipurpose generic up-down counter (3) – CTR-3.....	107
LD0.UDFCNT4 Multipurpose generic up-down counter (4) – CTR-4.....	108
Section 3 Glossary.....	109

Section 1 Introduction

1.1 This manual

The point list manual describes the outlook and properties of the data points specific to the protection relay. The manual should be used in conjunction with the corresponding communication protocol manual.

1.2 Intended audience

This manual addresses the communication system engineer or system integrator responsible for pre-engineering and engineering for communication setup in a substation from a protection relay perspective.

The system engineer or system integrator must have a basic knowledge of communication in protection and control systems and thorough knowledge of the specific communication protocol.

1.3 Product documentation

1.3.1 Product documentation set

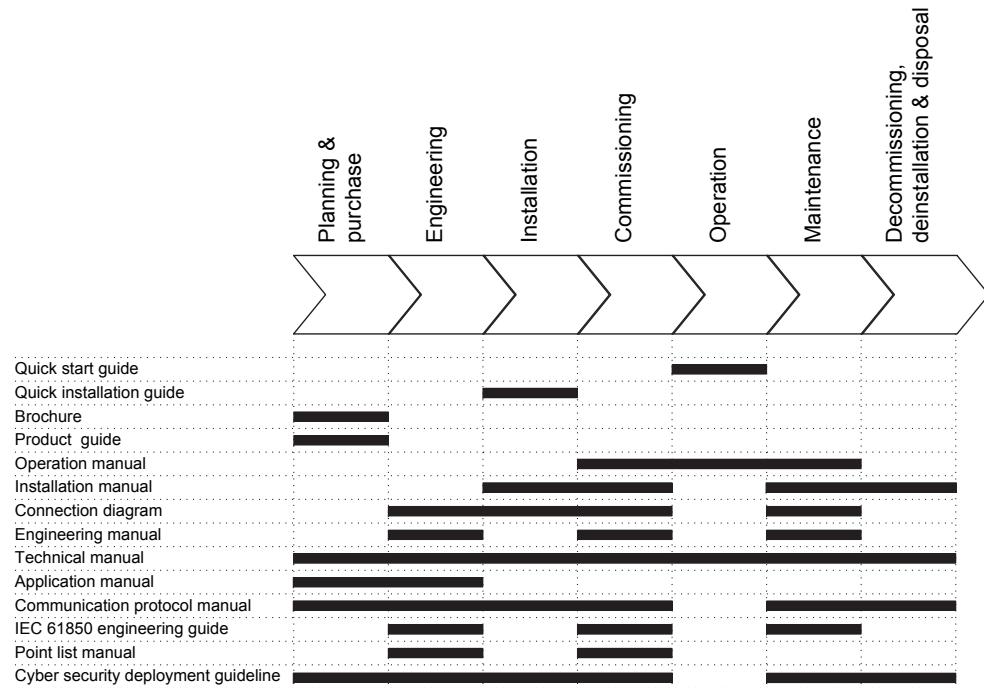


Figure 1: The intended use of documents during the product life cycle



Product series- and product-specific manuals can be downloaded from the ABB Web site <http://www.abb.com/relion>.

1.3.2 Document revision history

Document revision/date	Product version	History
A/2018-02-26	5.0 FP1	First release



Download the latest documents from the ABB Web site
<http://www.abb.com/substationautomation>.

1.3.3

Related documentation

Name of the document	Document ID
Modbus Communication Protocol Manual	1MAC057386-MB

1.4

Symbols and conventions

1.4.1

Symbols



The caution icon indicates important information or warning related to the concept discussed in the text. It might indicate the presence of a hazard which could result in corruption of software or damage to equipment or property.



The information icon alerts the reader of important facts and conditions.



The tip icon indicates advice on, for example, how to design your project or how to use a certain function.

Although warning hazards are related to personal injury, it is necessary to understand that under certain operational conditions, operation of damaged equipment may result in degraded process performance leading to personal injury or death. Therefore, comply fully with all warning and caution notices.

1.4.2

Document conventions

A particular convention may not be used in this manual.

- Abbreviations and acronyms are spelled out in the glossary. The glossary also contains definitions of important terms.
- Push button navigation in the LHMI menu structure is presented by using the push button icons.
To navigate between the options, use and .
- Menu paths are presented in bold.
Select **Main menu/Settings**.
- LHMI messages are shown in Courier font.
To save the changes in nonvolatile memory, select **Yes** and press .

- Parameter names are shown in italics.
The function can be enabled and disabled with the *Operation* setting.
- Parameter values are indicated with quotation marks.
The corresponding parameter values are "Enabled" and "Disabled".
- Input/output messages and monitored data names are shown in Courier font.
When the function picks up, the PICKUP output is set to TRUE.
- Dimensions are provided both in inches and mm. If it is not specifically mentioned, the dimension is in mm.
- This document assumes that the parameter setting visibility is "Advanced".

1.4.3

Functions, codes and symbols

Table 1: Functions included in the relay

Function	IEC 61850	IEC 60617	ANSI/C37.2-2008
Protection			
Three-phase non-directional overcurrent protection, low stage	PHLPTOC1	3I> (1)	51P (1)
	PHLPTOC2	3I> (2)	51P (2)
Three-phase non-directional overcurrent protection, high stage	PHHPTOC1	3I>> (1)	50P-1 (1)
	PHHPTOC2	3I>> (2)	50P-1 (2)
Three-phase non-directional overcurrent protection, instantaneous stage	PHIPTOC1	3I>>> (1)	50P-3 (1)
	PHIPTOC2	3I>>> (2)	50P-3 (2)
Three-phase directional overcurrent protection, low stage	DPHLPDOC1	3I> -> (1)	67/51P-1(2)
	DPHLPDOC2	3I> -> (2)	67/51P-2(2)
Non-directional ground-fault protection, low stage	EFLPTOC2	Io> (2)	51N (2)
Non-directional ground-fault protection, high stage	EFHPTOC2	Io>> (2)	50G-2 (2)
Directional ground-fault protection, low stage	DEFLPDEF1	Io> -> (1)	67/51N-1 (2)
	DEFLPDEF2	Io> -> (2)	67/51N-2 (2)
Negative-sequence overcurrent protection	NSPTOC1	I2> (1)	46 (1)
	NSPTOC2	I2> (2)	46 (2)
Residual overvoltage protection	ROVPTOV1	Uo> (1)	59G (1)
	ROVPTOV2	Uo> (2)	59N (1)
	ROVPTOV3	Uo> (3)	59N (2)
Three-phase undervoltage protection	PHPTUV1	3U< (1)	27-1 (2)
	PHPTUV2	3U< (2)	27-2 (2)
Three-phase overvoltage protection	PHPTOV1	3U> (1)	59-1 (2)
	PHPTOV2	3U> (2)	59-2 (2)
Table continues on next page			

Function	IEC 61850	IEC 60617	ANSI/C37.2-2008
Frequency protection	FRPFRQ1	f>/f<,df/dt (1)	81-1 (2)
	FRPFRQ2	f>/f<,df/dt (2)	81-2 (2)
Overexcitation protection	OEPVPH1	U/f> (1)	24-1 (2)
	OEPVPH2	U/f> (2)	24-2 (2)
Three-phase thermal overload protection, two time constants	T2PTTR1	3Ith>T/G/C (1)	49T (1)
Stabilized and instantaneous differential protection for two-winding transformers	TR2PTDF1	3dI>T (1)	87T
Numerically stabilized low-impedance restricted ground-fault protection	LREFPNDF1	dloLo> (1)	87LOZREF (2)
Circuit breaker failure protection	CCBRBRF1	3I>/lo>BF (1)	50BF (1)
	CCBRBRF2	3I>/lo>BF (2)	50BF (2)
Master trip	TRPPTRC1	Master Trip (1)	86/94-1
	TRPPTRC2	Master Trip (2)	86/94-2
	TRPPTRC3	Master Trip (3)	86/94-3
	TRPPTRC4	Master Trip (4)	86/94-4
	TRPPTRC5	Master Trip (5)	86/94-5
Arc protection	ARCSARC1	ARC (1)	AFD-1 (2)
	ARCSARC2	ARC (2)	AFD-2 (2)
	ARCSARC3	ARC (3)	AFD-3 (2)
Table continues on next page			

Function	IEC 61850	IEC 60617	ANSI/C37.2-2008
Multipurpose protection	MAPGAPC1 MAPGAPC2 MAPGAPC3 MAPGAPC4 MAPGAPC5 MAPGAPC6 MAPGAPC7 MAPGAPC8 MAPGAPC9 MAPGAPC10 MAPGAPC11 MAPGAPC12 MAPGAPC13 MAPGAPC14 MAPGAPC15 MAPGAPC16 MAPGAPC17 MAPGAPC18	MAP (1) MAP (2) MAP (3) MAP (4) MAP (5) MAP (6) MAP (7) MAP (8) MAP (9) MAP (10) MAP (11) MAP (12) MAP (13) MAP (14) MAP (15) MAP (16) MAP (17) MAP (18)	MAP-1 MAP-2 MAP-3 MAP-4 MAP-5 MAP-6 MAP-7 MAP-8 MAP-9 MAP-10 MAP-11 MAP-12 MAP-13 MAP-14 MAP-15 MAP-16 MAP-17 MAP-18
Control			
Circuit-breaker control	CBXCBR1 CBXCBR2	I <-> O CB (1) I <-> O CB (2)	52 (1) 52 (2)
Disconnecter control	DCXSWI1 DCXSWI2	I <-> O DCC (1) I <-> O DCC (2)	29DS-1 29DS-2
Grounding switch control	ESXSWI1	I <-> O ESC (1)	29GS-1
Disconnecter position indication	DCSXSWI1 DCSXSWI2 DCSXSWI3	I <-> O DC (1) I <-> O DC (2) I <-> O DC (3)	52-TOC 29DS-1 29DS-2
Grounding switch indication	ESSXSWI1 ESSXSWI2	I <-> O ES (1) I <-> O ES (2)	29GS-1 29GS-2
Tap changer position indication	TPOSYLTC1	TPOSM (1)	84T
Synchronism and energizing check	SECRSYN1	SYNC (1)	25 (2)
Condition monitoring			
Circuit-breaker condition monitoring	SSCBR1 SSCBR2	CBCM (1) CCBM (2)	52CM (1) 52CM (2)
Trip circuit supervision	TCSSCBR1 TCSSCBR2	TCS (1) TCS (2)	TCM-1 TCM-2
Table continues on next page			

Function	IEC 61850	IEC 60617	ANSI/C37.2-2008
Fuse failure supervision	SEQSPVC1	FUSEF (1)	60 (1)
Runtime counter for machines and devices	MDSOPT1	OPTS (1)	OPTM-1
Measurement			
Load profile record	LDPRLRC1	LOADPROF (1)	LoadProf
Three-phase current measurement	CMMXU1	3I (1)	IA, IB, IC (1)
	CMMXU2	3I (2)	IA, IB, IC (2)
Sequence current measurement	CSMSQI1	I1, I2, I0 (1)	I1, I2, I0 (1)
Residual current measurement	RESCMMXU2	Io (2)	IG (2)
Three-phase voltage measurement	VMMXU1	3U (1)	VA, VB, VC (2)
Residual voltage measurement	RESVMMXU1	Uo (1)	VG (2)
Sequence voltage measurement	VSMSQI1	U1, U2, U0 (1)	V1, V2, V0 (2)
Single-phase power and energy measurement	SPEMMXU1	SP, SE	SP, SE (2)
Three-phase power and energy measurement	PEMMXU1	P, E (1)	P, E (2)
RTD/mA measurement	XRGGIO130	X130 (RTD) (1)	X130 (RTD) (1)
Frequency measurement	FMMXU1	f (1)	f
IEC 61850-9-2 LE sampled value sending	SMVSENDER	SMVSENDER	SMVSENDER
IEC 61850-9-2 LE sampled value receiving (voltage sharing)	SMVRECEIVER	SMVRECEIVER	SMVRECEIVER
Other			
Minimum pulse timer (2 pcs)	TPGAPC1	TP (1)	62TP-1
	TPGAPC2	TP (2)	62TP-2
	TPGAPC3	TP (3)	62TP-3
	TPGAPC4	TP (4)	62TP-4
Minimum pulse timer (second resolution)	TPSGAPC1	TPS (1)	62TPS-1
Minimum pulse timer (minute resolution)	TPMGAPC1	TPM (1)	62TPM-1
Pulse timer	PTGAPC1	PT (1)	62PT-1
	PTGAPC2	PT (2)	62PT-2
Time delay off	TOFGAPC1	TOF (1)	62TOF-1
	TOFGAPC2	TOF (2)	62TOF-2
	TOFGAPC3	TOF (3)	62TOF-3
	TOFGAPC4	TOF (4)	62TOF-4
Time delay on	TONGAPC1	TON (1)	62TON-1
	TONGAPC2	TON (2)	62TON-2
	TONGAPC3	TON (3)	62TON-3
	TONGAPC4	TON (4)	62TON-4
Table continues on next page			

Function	IEC 61850	IEC 60617	ANSI/C37.2-2008
Set-reset	SRGAPC1	SR (1)	SR-1
	SRGAPC2	SR (2)	SR-2
	SRGAPC3	SR (3)	SR-3
	SRGAPC4	SR (4)	SR-4
Move	MVGAPC1	MV (1)	MV-1
	MVGAPC2	MV (2)	MV-2
Generic control point	SPCGAPC1	SPC (1)	SPC-1
	SPCGAPC2	SPC (2)	SPC-2
Analog value scaling	SCA4GAPC1	SCA4 (1)	SCA4-1
	SCA4GAPC2	SCA4 (2)	SCA4-2
	SCA4GAPC3	SCA4 (3)	SCA4-3
	SCA4GAPC4	SCA4 (4)	SCA4-4
Integer value move	MVI4GAPC1	MVI4 (1)	MVI4-1
Generic up-down counters	UDFCNT1	UDCNT (1)	CTR-1
	UDFCNT2	UDCNT (2)	CTR-2
	UDFCNT3	UDCNT (3)	CTR-3
	UDFCNT4	UDCNT (4)	CTR-4

Section 2 Modbus data mappings

2.1 Overview

This document describes the Modbus data points and structures available in the protection relay. The point lists describe a superset of all data available through the standard configuration/s including the optional functionalities.

2.2 Supported functions

2.2.1 Supported functions in RET615

Table 2: Supported functions

Function	IEC 61850	ANSI	B	F
			TA02	TA06
Protection				
Three-phase non-directional overcurrent protection, low stage	PHLPTOC1	51P (1)	1 ^{HV}	1 ^{HV}
	PHLPTOC2	51P (2)	1 ^{MV}	1 ^{MV}
Three-phase non-directional overcurrent protection, high stage	PHHPTOC1	50P-1 (1)	1 ^{HV}	1 ^{HV}
	PHHPTOC2	50P-1 (2)	1 ^{MV}	1 ^{MV}
Three-phase non-directional overcurrent protection, instantaneous stage	PHIPTOC1	50P-3 (1)	1 ^{HV}	1 ^{HV}
	PHIPTOC2	50P-3 (2)	1 ^{MV}	1 ^{MV}
Three-phase directional overcurrent protection, low stage	DPHLPDOC	67/51P (2)		2 ^{MV}
Non-directional ground-fault protection, low stage	EFLPTOC	51N (2)	1 ^{MV}	1 ^{MV}
Non-directional ground-fault protection, high stage	EFHPTOC	50G-2 (2)	1 ^{MV}	1 ^{MV}
Directional ground-fault protection, low stage	DEFLPDEF	67/51N (2)		2 ^{MV}
Negative-sequence overcurrent protection	NSPTOC1	46 (1)	1 ^{HV}	1 ^{HV}
	NSPTOC2	46 (2)	1 ^{MV}	1 ^{MV}
Residual overvoltage protection	ROVPTOV1	59G (1)		1 ^{MV}
	ROVPTOV2	59N (1)		1 ^{MV}
Table continues on next page				

Section 2

Modbus data mappings

1MAC203705-MB A

Function	IEC 61850	ANSI	B	F
			TA02	TA06
Three-phase undervoltage protection	PHPTUV	27 (2)		2 ^{MV}
Three-phase overvoltage protection	PHPTOV	59 (2)		2 ^{MV}
Frequency protection	FRPFRQ	81 (2)		2 ^{MV}
Overexcitation protection	OEPVPH	24 (2)		2 ^{MV}
Three-phase thermal overload protection, two time constants	T2PTTR	49T (1)	1 ^{HV}	1 ^{HV}
Stabilized and instantaneous differential protection for two-winding transformers	TR2PTDF	87T	1	1
Numerically stabilized low-impedance restricted ground-fault protection	LREFPNDF	87LOZREF (2)	1 ^{MV}	1 ^{MV}
Circuit breaker failure protection	CCBRBRF1	50BF (1)	1 ^{HV1}	1 ^{HV1}
	CCBRBRF2	50BF (2)	1 ^{MV}	1 ^{MV}
Master trip	TRPPTRC	86/94	2 (3) ²	2 (3) ²
Arc protection	ARCSARC	AFD (2)	(3) ³	(3) ³
Multipurpose protection	MAPGAPC	MAP	18	18
Control				
Circuit-breaker control	CBXCBR1	52 (1)	1 ^{HV}	1 ^{HV}
	CBXCBR2	52 (2)	1 ^{MV}	1 ^{MV}
Disconnecter control	DCXSWI	29DS	2	2
Grounding switch control	ESXSWI	29GS	1	1
Disconnecter position indication	DCSXSWI	52-TOC	1	1
		29DS	2	2
Grounding switch indication	ESSXSWI	29GS	2	2
Tap changer position indication	TPOSYLT	84T	1	1
Synchronism and energizing check	SECRSYN	25 (2)		1 ^{MV}
Condition monitoring				
Circuit-breaker condition monitoring	SSCBR1	52CM (1)	1 ^{HV}	1 ^{HV}
	SSCBR2	52CM (2)	1 ^{MV}	1 ^{MV}
Trip circuit supervision	TCSSCBR	TCM	2	2
Fuse failure supervision	SEQSPVC	60 (1)		1
Runtime counter for machines and devices	MDSOPT	OPTM	1	1
Measurement				
Load profile record	LDPRLRC	LoadProf	1	1
Three-phase current measurement	CMMXU	IA, IB, IC (1)	1 ^{HV}	1 ^{HV}
Table continues on next page				

Function	IEC 61850	ANSI	B	F
			TA02	TA06
		IA, IB, IC (2)	1MV	1MV
Sequence current measurement	CSMSQI	I1, I2, I0 (1)	1HV	1HV
Residual current measurement	RESCMMXU	IG (2)	1MV	1MV
Three-phase voltage measurement	VMMXU	VA, VB, VC (2)		1MV
Residual voltage measurement	RESVMMXU	VG (2)		1MV
Sequence voltage measurement	VSMSQI	V1, V2, V0 (2)		1MV
Single-phase power and energy measurement	SPEMMXU	SP, SE (2)		1MV
Three-phase power and energy measurement	PEMMXU	P, E (2)		1MV
RTD/mA measurement	XRGGIO130	X130 (RTD) (1)	(1)	(1)
Frequency measurement	FMMXU	f		1
IEC 61850-9-2 LE sampled value sending ⁴⁾	SMVSENDER	SMVSENDER		(1)
IEC 61850-9-2 LE sampled value receiving (voltage sharing)	SMVRECEIVER	SMVRECEIVER		(1)
Other				
Minimum pulse timer (2 pcs)	TPGAPC	62TP	4	4
Minimum pulse timer (2 pcs, second resolution)	TPSGAPC	62TPS	1	1
Minimum pulse timer (2 pcs, minute resolution)	TPMGAPC	62TPM	1	1
Pulse timer (8 pcs)	PTGAPC	62PT	2	2
Time delay off (8 pcs)	TOFGAPC	62TOF	4	4
Time delay on (8 pcs)	TONGAPC	62TON	4	4
Set-reset (8 pcs)	SRGAPC	SR	4	4
Move (8 pcs)	MVGAPC	MV	2	2
Generic control point (16 pcs)	SPCGAPC	SPC	2	2
Analog value scaling	SCA4GAPC	SCA4	4	4
Integer value move	MVI4GAPC	MVI4	1	1
Generic up-down counters	UDFCNT	CTR	4	4
1, 2, ... = Number of included instances. The instances of a protection function represent the number of identical protection function blocks available in the standard configuration. () = Optional HV = The function block is to be used on the high-voltage side in the application. MV = The function block is to be used on the medium-voltage side in the application.				

- 1) "Calculated I0" is always used
- 2) Master Trip included and connected to corresponding HSO in the configuration only when BIO0007 module is used. If additionally the ARC option is selected, then AFD is connected in the configuration to the corresponding Master Trip input.
- 3) IoB calculated and 3IB are always used
- 4) Only available with COM0031...0037

2.3 Indications

Table 3: Explanations of the indications table columns

Column name	Description
BitA	Default 0X and 1X bit address for the data.
RegA	Default 3X and 4X register.bit (00-15) address for the data.
IEC 61850 name	Original IED data object identification. Described in the IEC 61850 format as Logical Device.Logical Node and thereafter .Data Object.Data Attribute. Logical Node is the same as the application function block name.
SA name	The signal may have a defined label that is visible, for example, in the Application Configuration tool in PCM600.
Description	Short description of the signal. See the technical manual for more information.
Value	Meaning of the value states.

2.3.1 Premapped indications

2.3.1.1 Common data 1

Table 4: Common data 1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.LLN0			
2720	170.00	.Loc.stVal	-	Remote/Local state	0/1=Rem/Loc
2721	170.01	.LocKeyHMI.stVal.Station	-	Station state	1=Station
		DR.RDRE1			
2722	170.02	.RcdMade.stVal	-	DR recording made	1=Made
2723	170.03	.mcd			

2.3.1.2 CTRL.CBCILO1 Circuit breaker enable signals (1)

Table 5: CTRL.CBCILO1 Circuit breaker enable signals (1)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.CBCILO1			
2824	176.08	.EnaOpn.stVal	ENA_OPEN	Open enabled	1=Enabled
2825	176.09	.EnaCls.stVal	ENA_CLOSE	Close enabled	1=Enabled

2.3.1.3

CTRL.CBCSWI1 Circuit breaker (1) mom. position

Table 6: CTRL.CBCSWI1 Circuit breaker (1) mom. position

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.CBCSWI1	POSITION		
2804	175.04	.Pos.stVal.Close	-	Close bit	1=Close
2805	175.05	.Pos.stVal.Open	-	Open bit	1=Open
2806	175.06	.Pos.stVal.Fault	-	Fault bit	1=Pos(00/11)
2834	177.02	.SynItlBypss.stVal	ITL_BYPASS	Interlock bypass	1=Bypass
2835	177.03	.mcd			

2.3.1.4

CTRL.CBCSWI1 Circuit breaker (1) mom+mcd position

Table 7: CTRL.CBCSWI1 Circuit breaker (1) mom+mcd position

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.CBCSWI1	POSITION		
2816	176.00	.Pos.stVal.Close		Close bit	1=Close
2817	176.01	.mcd			
2818	176.02	.Pos.stVal.Open		Open bit	1=Open
2819	176.03	.mcd			
2820	176.04	< reserved >			
2821	176.05	< reserved >			
2822	176.06	.Pos.stSelD	SELECTED	CB selected for control	1=Selected
2823	176.07	.mcd			

2.3.1.5

CTRL.CBXCBR1 Circuit-breaker control (1) – 52-1

Table 8: CTRL.CBXCBR1 Circuit-breaker control (1) – 52-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.CBXCBR1			
2836	177.04	.BlkOpn.stVal	BLK_OPEN	Open blocked	1=Blocked
2837	177.05	.mcd			
2838	177.06	.BlkCls.stVal	BLK_CLOSE	Close blocked	1=Blocked
2839	177.07	.mcd			
2840	177.08	.ItlByPss.stVal	ITL_BYPASS	Interlock bypass	1=Bypass
2841	177.09	.mcd			

2.3.1.6 CTRL.DCSXSWI1 Disconnector position indication (1) – 52-TOC

Table 9: CTRL.DCSXSWI1 Disconnector position indication (1) – 52-TOC

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.DCSXSWI1	POSITION		
2792	174.08	.Pos.stVal.Close	-	Close bit	1=Close
2793	174.09	.Pos.stVal.Open	-	Open bit	1=Open
2794	174.10	.Pos.stVal.Fault	-	Fault bit	1=Pos(00/11)

2.3.1.7 CTRL.DCSXSWI2 Disconnector position indication (2) – 29DS-1

Table 10: CTRL.DCSXSWI2 Disconnector position indication (2) – 29DS-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.DCSXSWI2	POSITION		
2795	174.11	.Pos.stVal.Close	-	Close bit	1=Close
2796	174.12	.Pos.stVal.Open	-	Open bit	1=Open
2797	174.13	.Pos.stVal.Fault	-	Fault bit	1=Pos(00/11)

2.3.1.8 CTRL.DCSXSWI3 Disconnector position indication (3) – 29DS-2

Table 11: CTRL.DCSXSWI3 Disconnector position indication (3) – 29DS-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.DCSXSWI3	POSITION		
2798	174.14	.Pos.stVal.Close	-	Close bit	1=Close
2799	174.15	.Pos.stVal.Open	-	Open bit	1=Open
2800	175.00	.Pos.stVal.Fault	-	Fault bit	1=Pos(00/11)

2.3.1.9 CTRL.DCXSWI1 Disconnector control (1) – 29DS-1

Table 12: CTRL.DCXSWI1 Disconnector control (1) – 29DS-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.DCXSWI1	POSITION		
3472	217.00	.Pos.stVal.Close	-	Close bit	1=Close
3473	217.01	.Pos.stVal.Open	-	Open bit	1=Open
3474	217.02	.Pos.stVal.Fault	-	Fault bit	1=Pos(00/11)
3475	217.03	.Pos.stSelD	-	Control selected	1=Selected
		CTRL.DCCIGO1			

Table continues on next page

BitA	RegA	IEC 61850 name	SA name	Description	Values
3476	217.04	.EnaOpn.stVal	ENA_OPEN	Open enabled	1=Enabled
3477	217.05	.EnaCls.stVal	ENA_CLOSE	Close enabled	1=Enabled
		CTRL.DCXSWI1			
3478	217.06	.BlkOpn.stVal	BLK_OPEN	Open blocked	1=Blocked
3479	217.07	.mcd			
3480	217.08	.BlkCls.stVal	BLK_CLOSE	Close blocked	1=Blocked
3481	217.09	.mcd			
		CTRL.DCCILO1			
3482	217.10	.ItlByps.stVal	ITL_BYPASS	Interlock bypass	1=Bypass
3483	217.11	.mcd			

2.3.1.10 CTRL.DCXSWI2 Disconnector control (2) – 29DS-2

Table 13: *CTRL.DCXSWI2 Disconnector control (2) – 29DS-2*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.DCXSWI2	POSITION		
3484	217.12	.Pos.stVal.Close	-	Close bit	1=Close
3485	217.13	.Pos.stVal.Open	-	Open bit	1=Open
3486	217.14	.Pos.stVal.Fault	-	Fault bit	1=Pos(00/11)
3487	217.15	.Pos.stSelD	-	Control selected	1=Selected
		CTRL.DCCILO2			
3488	218.00	.EnaOpn.stVal	ENA_OPEN	Open enabled	1=Enabled
3489	218.01	.EnaCls.stVal	ENA_CLOSE	Close enabled	1=Enabled
		CTRL.DCXSWI2			
3490	218.02	.BlkOpn.stVal	BLK_OPEN	Open blocked	1=Blocked
3491	218.03	.mcd			
3492	218.04	.BlkCls.stVal	BLK_CLOSE	Close blocked	1=Blocked
3493	218.05	.mcd			
		CTRL.DCCILO2			
3494	218.06	.ItlByps.stVal	ITL_BYPASS	Interlock bypass	1=Bypass
3495	218.07	.mcd			

2.3.1.11

CTRL.ESSXSWI1 Grounding switch indication (1) – 29GS-1

Table 14: CTRL.ESSXSWI1 Grounding switch indication (1) – 29GS-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.ESSXSWI1	POSITION		
2801	175.01	.Pos.stVal.Close	-	Close bit	1=Close
2802	175.02	.Pos.stVal.Open	-	Open bit	1=Open
2803	175.03	.Pos.stVal.Fault	-	Fault bit	1=Pos(00/11)

2.3.1.12

CTRL.ESSXSWI2 Grounding switch indication (2) – 29GS-2

Table 15: CTRL.ESSXSWI2 Grounding switch indication (2) – 29GS-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.ESSXSWI2	POSITION		
2807	175.07	.Pos.stVal.Close	-	Close bit	1=Close
2808	175.08	.Pos.stVal.Open	-	Open bit	1=Open
2809	175.09	.Pos.stVal.Fault	-	Fault bit	1=Pos(00/11)

2.3.1.13

CTRL.ESXSWI1 Grounding switch control (1) – 29GS-1

Table 16: CTRL.ESXSWI1 Grounding switch control (1) – 29GS-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		CTRL.ESXSWI1	POSITION		
3496	218.08	.Pos.stVal.Close	-	Close bit	1=Close
3497	218.09	.Pos.stVal.Open	-	Open bit	1=Open
3498	218.10	.Pos.stVal.Fault	-	Fault bit	1=Pos(00/11)
3499	218.11	.Pos.stSelD	-	Control selected	1=Selected
		CTRL.ESCILO1			
3500	218.12	.EnaOpn.stVal	ENA_OPEN	Open enabled	1=Enabled
3501	218.13	.EnaCls.stVal	ENA_CLOSE	Close enabled	1=Enabled
		CTRL.ESXSWI1			
3502	218.14	.BlkOpn.stVal	BLK_OPEN	Open blocked	1=Blocked
3503	218.15	.mcd			
3504	219.00	.BlkCls.stVal	BLK_CLOSE	Close blocked	1=Blocked
3505	219.01	.mcd			
		CTRL.ESCILO1			
3506	219.02	.ItlByps.stVal	ITL_BYPASS	Interlock bypass	1=Bypass
3507	219.03	.mcd			

2.3.1.14 LD0.ARCSARC1 Arc protection (1) – AFD-1
Table 17: LD0.ARCSARC1 Arc protection (1) – AFD-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.ARCSARC11			
2978	186.02	.FADet.stVal	ARC_FLT_DET	Arc detected	1=Detected
2979	186.03	.mcd			
		LD0.ARCPTRC11			
2982	186.06	.Op.general	TRIP	Stage trip	1=Trip
2983	186.07	.mcd			

2.3.1.15 LD0.ARCSARC2 Arc protection (2) – AFD-2
Table 18: LD0.ARCSARC2 Arc protection (2) – AFD-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.ARCSARC21			
2984	186.08	.FADet.stVal	ARC_FLT_DET	Arc detected	1=Detected
2985	186.09	.mcd			
		LD0.ARCPTRC21			
2988	186.12	.Op.general	TRIP	Stage trip	1=Trip
2989	186.13	.mcd			

2.3.1.16 LD0.ARCSARC3 Arc protection (3) – AFD-3
Table 19: LD0.ARCSARC3 Arc protection (3) – AFD-3

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.ARCSARC31			
2990	186.14	.FADet.stVal	ARC_FLT_DET	Arc detected	1=Detected
2991	186.15	.mcd			
		LD0.ARCPTRC31			
2994	187.02	.Op.general	TRIP	Stage trip	1=Trip
2995	187.03	.mcd			

Section 2 Modbus data mappings

1MAC203705-MB A

2.3.1.17 LD0.CCBRBRF1 Circuit breaker failure protection (1) – 50BF-1

Table 20: LD0.CCBRBRF1 Circuit breaker failure protection (1) – 50BF-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.CCBRBRF1			
2828	176.12	.Str.general	CB_FAULT_AL	Timer running	1=Running
2829	176.13	.mcd			
2830	176.14	.OpEx.general	TRBU	Fail, external trip	1=Ext.trip
2831	176.15	.mcd			
2832	177.00	.Opln.general	TRRET	Internal re-trip	1=Re-trip
2833	177.01	.mcd			

2.3.1.18 LD0.CMMXU1 Three-phase current measurement (1) – IA, IB, IC

Table 21: LD0.CMMXU1 Three-phase current measurement (1) – IA, IB, IC

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.CMMXU1			
2752	172.00	.HiAlm.stVal	HIGH_ALARM	High alarm	1=Alarm
2753	172.01	.mcd			
2754	172.02	.HiWrn.stVal	HIGH_WARN	High warning	1=Warning
2755	172.03	.mcd			
2756	172.04	.LoWrn.stVal	LOW_WARN	Low warning	1=Warning
2757	172.05	.mcd			
2758	172.06	.LoAlm.stVal	LOW_ALARM	Low alarm	1=Alarm
2759	172.07	.mcd			

2.3.1.19 LD0.CMMXU2 Three-phase current measurement (2) – IA, IB, IC (2)

Table 22: LD0.CMMXU2 Three-phase current measurement (2) – IA, IB, IC (2)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.CMMXU2			
2784	174.00	.HiAlm.stVal	HIGH_ALARM	High alarm	1=Alarm
2785	174.01	.mcd			
2786	174.02	.HiWrn.stVal	HIGH_WARN	High warning	1=Warning
2787	174.03	.mcd			
2788	174.04	.LoWrn.stVal	LOW_WARN	Low warning	1=Warning

Table continues on next page

BitA	RegA	IEC 61850 name	SA name	Description	Values
2789	174.05	.mcd			
2790	174.06	.LoAlm.stVal	LOW_ALARM	Low alarm	1=Alarm
2791	174.07	.mcd			

2.3.1.20 LD0.DARREC1 Autoreclosing state (1) – 79-1

Table 23: *LD0.DARREC1 Autoreclosing state (1) – 79-1*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.DARREC1			
2724	170.04	.AutoRecOn.stVal	AR_ON	AutoRecloser state	0/1=Off/On

2.3.1.21 LD0.DPHLPDOC2 Three-phase directional overcurrent protection, low stage (2) – 67/51P-2

Table 24: *LD0.DPHLPDOC2 Three-phase directional overcurrent protection, low stage (2) – 67/51P-2*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.DPHLPDOC2			
4004	250.4	.Str.general	PICKUP	General pickup	1=Pickup
4005	250.5	.mcd			
		.Str.phsA		phsA pickup	1=Pickup
		.mcd			
		.Str.phsB		phsB pickup	1=Pickup
		.mcd			
		.Str.phsC		phsC pickup	1=Pickup
		.mcd			
4006	250.6	.Op.general	TRIP	General trip	1=Trip
4007	250.7	.mcd			

2.3.1.22 LD0.DPHLPDOC1 Three-phase directional overcurrent protection, low stage (1) – 67/51P-1

Table 25: *LD0.DPHLPDOC1 Three-phase directional overcurrent protection, low stage (1) – 67/51P-1*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.DPHLPDOC1			
4000	250	.Str.general	PICKUP	General pickup	1=Pickup
4001	250.1	.mcd			

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

BitA	RegA	IEC 61850 name	SA name	Description	Values
		.Str.phsA		phsA pickup	1=Pickup
		.mcd			
		.Str.phsB		phsB pickup	1=Pickup
		.mcd			
		.Str.phsC		phsC pickup	1=Pickup
		.mcd			
4002	250.2	.Op.general	TRIP	General trip	1=Trip
4003	250.3	.mcd			

2.3.1.23 LD0.EFHPTOC1 Non-directional ground-fault protection, high stage (1) – 50G-1

Table 26: *LD0.EFHPTOC1 Non-directional ground-fault protection, high stage (1) – 50G-1*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.EFHPTOC1			
2944	184.00	.Str.general	PICKUP	Stage pickup	1=Pickup
2945	184.01	.mcd			
2946	184.02	.Op.general	TRIP	Stage trip	1=Trip
2947	184.03	.mcd			

2.3.1.24 LD0.EFHPTOC2 Non-directional ground-fault protection, high stage (2) – 50G-2

Table 27: *LD0.EFHPTOC2 Non-directional ground-fault protection, high stage (2) – 50G-2*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.EFHPTOC2			
2952	184.08	.Str.general	PICKUP	Stage pickup	1=Pickup
2953	184.09	.mcd			
2954	184.10	.Op.general	TRIP	Stage trip	1=Trip
2955	184.11	.mcd			

2.3.1.25 LD0.EFLPTOC1 Non-directional ground-fault protection, low stage (1) – 51G-1
Table 28: LD0.EFLPTOC1 Non-directional ground-fault protection, low stage (1) – 51G-1


BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.EFLPTOC1			
2940	183.12	.Str.general	PICKUP	Stage pickup	1=Pickup
2941	183.13	.mcd			
2942	183.14	.Op.general	TRIP	Stage trip	1=Trip
2943	183.15	.mcd			

2.3.1.26 LD0.EFLPTOC2 Non-directional ground-fault protection, low stage (2) – 51N-1
Table 29: LD0.EFLPTOC2 Non-directional ground-fault protection, low stage (2) – 51N-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.EFLPTOC2			
2948	184.04	.Str.general	PICKUP	Stage pickup	1=Pickup
2949	184.05	.mcd			
2950	184.06	.Op.general	TRIP	Stage trip	1=Trip
2951	184.07	.mcd			

2.3.1.27 LD0.LEDGGIO1 Indication LED states Color1/Color2 – LED

These LED indication points interpret the case when a signal is wired to both the OK and ALARM inputs, but inverted to the other. This means that the LED toggles between red and green colors. The default color for ALARM is red and green for OK. Colors can, however, be reconfigured with a setting parameter.

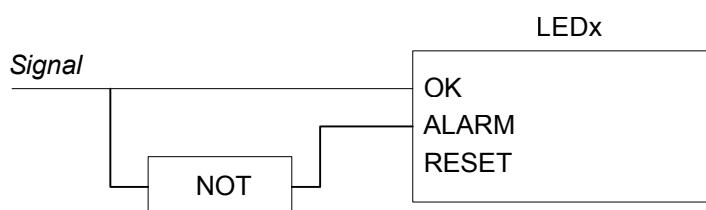
Figure 2: Signal wired to both OK and ALARM inputs – inverted to the other



If the OK and ALARM inputs are wired to separate indication signals, the LED will have three legal states and cannot be expressed with one bit only. In this case, it is possible to combine this LED bit interpretation with the corresponding value from the other LED state interpretation.

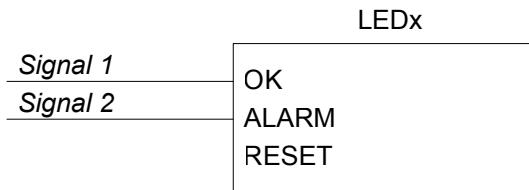


Figure 3: Separate signals wired to OK and ALARM inputs

Table 30: LD0.LEDGGIO1 Indication LED states Color1/Color2 – LED

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.LEDGGIO1			
3520	220.00	.LEDSt1.stVal	-	LED 1 state	0/1=Color1/2
3521	220.01	.LEDSt2.stVal	-	LED 2 state	0/1=Color1/2
3522	220.02	.LEDSt3.stVal	-	LED 3 state	0/1=Color1/2
3523	220.03	.LEDSt4.stVal	-	LED 4 state	0/1=Color1/2
3524	220.04	.LEDSt5.stVal	-	LED 5 state	0/1=Color1/2
3525	220.05	.LEDSt6.stVal	-	LED 6 state	0/1=Color1/2
3526	220.06	.LEDSt7.stVal	-	LED 7 state	0/1=Color1/2
3527	220.07	.LEDSt8.stVal	-	LED 8 state	0/1=Color1/2
3528	220.08	.LEDSt9.stVal	-	LED 9 state	0/1=Color1/2
3529	220.09	.LEDSt10.stVal	-	LED 10 state	0/1=Color1/2
3530	220.10	.LEDSt11.stVal	-	LED 11 state	0/1=Color1/2
3531	220.11	<reserved>			0

2.3.1.28

LD0.LEDGGIO1 Indication LED states OFF/ColorX – LED

These LED indication points interpret the case when an indication signal is wired to either the OK or ALARM input of the LED function block. The default color for ALARM is red and green for OK. Colors can, however, be reconfigured with a setting parameter.

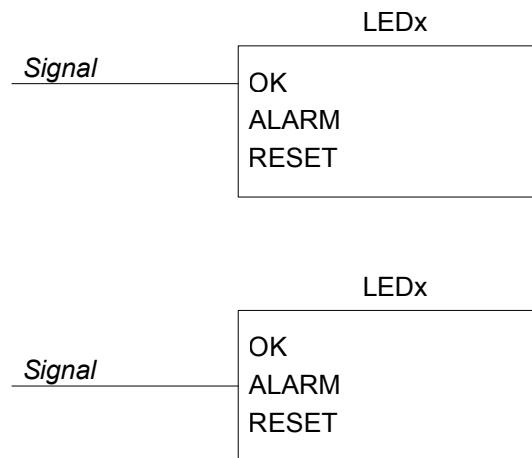


Figure 4: Signal wired to either OK or Alarm input

Table 31: LD0.LEDGGIO1 Indication LED states OFF/ColorX – LED

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.LEDGGIO1			
2768	173.00	.LEDS1.stVal	-	LED 1 state	0/1=Off/Color
2769	173.01	.LEDS2.stVal	-	LED 2 state	0/1=Off/Color
2770	173.02	.LEDS3.stVal	-	LED 3 state	0/1=Off/Color
2771	173.03	.LEDS4.stVal	-	LED 4 state	0/1=Off/Color
2772	173.04	.LEDS5.stVal	-	LED 5 state	0/1=Off/Color
2773	173.05	.LEDS6.stVal	-	LED 6 state	0/1=Off/Color
2774	173.06	.LEDS7.stVal	-	LED 7 state	0/1=Off/Color
2775	173.07	.LEDS8.stVal	-	LED 8 state	0/1=Off/Color
2776	173.08	.LEDS9.stVal	-	LED 9 state	0/1=Off/Color
2777	173.09	.LEDS10.stVal	-	LED 10 state	0/1=Off/Color
2778	173.10	.LEDS11.stVal	-	LED 11 state	0/1=Off/Color
2779	173.11	<reserved>			0

2.3.1.29 LD0.LEDPTRC1 Global conditioning (1)

Table 32: LD0.LEDPTRC1 Global conditioning (1)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.LEDPTRC1			
2736	171.00	.Str.general	-	Global pickup	1=Pickup
2737	171.01	.mcd			
2738	171.02	.Op.general	-	Global trip	1=Trip
2739	171.03	.mcd			

2.3.1.30 LD0.LEDPTRC1 Global conditioning - phase information (1)

Table 33: LD0.LEDPTRC1 Global conditioning - phase information (1)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.LEDPTRC1			
2864	179.00	.Str.phsA		Pickup phsA	1=Pickup
2865	179.01	.mcd			
2866	179.02	.Str.phsB		Pickup phsB	1=Pickup
2867	179.03	.mcd			
2868	179.04	.Str.phsC		Pickup phsC	1=Pickup
2869	179.05	.mcd			
2870	179.06	.Op.phsA		Trip phsA	1=Trip
2871	179.07	.mcd			
2872	179.08	.Op.phsB		Trip phsB	1=Trip
2873	179.09	.mcd			
2874	179.10	.Op.phsC		Trip phsC	1=Trip
2875	179.11	.mcd			

2.3.1.31 LD0.LREFPNDF1 Numerically stabilized low-impedance restricted ground-fault protection (1) – 87LOZREF-1

Table 34: LD0.LREFPNDF1 Numerically stabilized low-impedance restricted ground-fault protection (1) – 87LOZREF-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.LREFPNDF1			
2964	185.04	.Str.general	PICKUP	Stage pickup	1=Pickup
2965	185.05	.mcd			
2966	185.06	.Op.general	TRIP	Stage trip	1=Trip
2967	185.07	.mcd			

2.3.1.32 LD0.MAPGAPC1 Multipurpose protection (1) – MAP-1

Table 35: LD0.MAPGAPC1 Multipurpose protection (1) – MAP-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC1			
3016	188.08	.Op.general	TRIP	Stage trip	1 = Trip
3017	188.09	.mcd			
3018	188.10	.Str.general	PICKUP	Stage pickup	1 = Pickup
3019	188.11	.mcd			

2.3.1.33 LD0.MAPGAPC2 Multipurpose protection (2) – MAP-2

Table 36: LD0.MAPGAPC2 Multipurpose protection (2) – MAP-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC2			
3020	188.12	.Op.general	TRIP	Stage trip	1 = Trip
3021	188.13	.mcd			
3022	188.14	.Str.general	PICKUP	Stage pickup	1 = Pickup
3023	188.15	.mcd			

2.3.1.34 LD0.MAPGAPC3 Multipurpose protection (3) – MAP-3

Table 37: LD0.MAPGAPC3 Multipurpose protection (3) – MAP-3

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC3			
3024	189.00	.Op.general	TRIP	Stage trip	1 = Trip
3025	189.01	.mcd			
3026	189.02	.Str.general	PICKUP	Stage pickup	1 = Pickup
3027	189.03	.mcd			

2.3.1.35 LD0.MAPGAPC4 Multipurpose protection (4) – MAP-4

Table 38: LD0.MAPGAPC4 Multipurpose protection (4) – MAP-4

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC4			
3028	189.04	.Op.general	TRIP	Stage trip	1 = Trip
3029	189.05	.mcd			
3030	189.06	.Str.general	PICKUP	Stage pickup	1 = Pickup
3031	189.07	.mcd			

2.3.1.36 LD0.MAPGAPC5 Multipurpose protection (5) – MAP-5

Table 39: LD0.MAPGAPC5 Multipurpose protection (5) – MAP-5

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC5			
3036	189.12	.Op.general	TRIP	Stage trip	1 = Trip
3037	189.13	.mcd			
3038	189.14	.Str.general	PICKUP	Stage pickup	1 = Pickup
3039	189.15	.mcd			

2.3.1.37 LD0.MAPGAPC6 Multipurpose protection (6) – MAP-6

Table 40: LD0.MAPGAPC6 Multipurpose protection (6) – MAP-6

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC6			
3012	188.04	.Op.general	TRIP	Stage trip	1 = Trip
3013	188.05	.mcd			
3014	188.06	.Str.general	PICKUP	Stage pickup	1 = Pickup
3015	188.07	.mcd			

2.3.1.38

LD0.MDSOPT1 Runtime counter for machines and devices (1) – OPTM-1

Table 41: LD0.MDSOPT1 Runtime counter for machines and devices (1) – OPTM-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MDSOPT1			
2748	171.12	.OpTmWrn.stVal		Accum.op.time Warn.	1=Warning
2749	171.13	.mcd			
2750	171.14	.OpTmAlm.stVal		Accum.op.time Alarm	1=Alarm
2751	171.15	.mcd			

2.3.1.39

LD0.MVGAPC1 Move (8 pcs) (1) – MV-1

Table 42: LD0.MVGAPC1 Move (8 pcs) (1) – MV-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MVGAPC1			
3536	221.00	.SPCSO1.stVal		Input 1	0/1=Off/On
3537	221.01	.mcd			
3538	221.02	.SPCSO2.stVal		Input 2	0/1=Off/On
3539	221.03	.mcd			
3540	221.04	.SPCSO3.stVal		Input 3	0/1=Off/On
3541	221.05	.mcd			
3542	221.06	.SPCSO4.stVal		Input 4	0/1=Off/On
3543	221.07	.mcd			
3544	221.08	.SPCSO5.stVal		Input 5	0/1=Off/On
3545	221.09	.mcd			
3546	221.10	.SPCSO6.stVal		Input 6	0/1=Off/On
3547	221.11	.mcd			
3548	221.12	.SPCSO7.stVal		Input 7	0/1=Off/On
3549	221.13	.mcd			
3550	221.14	.SPCSO8.stVal		Input 8	0/1=Off/On
3551	221.15	.mcd			

2.3.1.40 LD0.MVGAPC2 Move (8 pcs) (2) – MV-2

Table 43: LD0.MVGAPC2 Move (8 pcs) (2) – MV-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MVGAPC2			
3552	222.00	.SPCSO1.stVal		Input 1	0/1=Off/On
3553	222.01	.mcd			
3554	222.02	.SPCSO2.stVal		Input 2	0/1=Off/On
3555	222.03	.mcd			
3556	222.04	.SPCSO3.stVal		Input 3	0/1=Off/On
3557	222.05	.mcd			
3558	222.06	.SPCSO4.stVal		Input 4	0/1=Off/On
3559	222.07	.mcd			
3560	222.08	.SPCSO5.stVal		Input 5	0/1=Off/On
3561	222.09	.mcd			
3562	222.10	.SPCSO6.stVal		Input 6	0/1=Off/On
3563	222.11	.mcd			
3564	222.12	.SPCSO7.stVal		Input 7	0/1=Off/On
3565	222.13	.mcd			
3566	222.14	.SPCSO8.stVal		Input 8	0/1=Off/On
3567	222.15	.mcd			

2.3.1.41 LD0.NSPTOC1 Negative-sequence overcurrent protection (1) – 46-1

Table 44: LD0.NSPTOC1 Negative-sequence overcurrent protection (1) – 46-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.NSPTOC1			
2956	184.12	.Str.general	PICKUP	Stage pickup	1=Pickup
2957	184.13	.mcd			
2958	184.14	.Op.general	TRIP	Stage trip	1=Trip
2959	184.15	.mcd			

2.3.1.42

LD0.NSPTOC2 Negative-sequence overcurrent protection (2) – 46-2

Table 45: LD0.NSPTOC2 Negative-sequence overcurrent protection (2) – 46-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.NSPTOC2			
2960	185.00	.Str.general	PICKUP	Stage pickup	1=Pickup
2961	185.01	.mcd			
2962	185.02	.Op.general	TRIP	Stage trip	1=Trip
2963	185.03	.mcd			

2.3.1.43

LD0.OEPVPH1 Overexcitation protection (1) – 24-1

Table 46: LD0.OEPVPH1 Overexcitation protection (1) – 24-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.OEPVPH1			
4008	250.8	.Str.general	PICKUP	Stage pickup	1=Pickup
4009	250.9	.mcd			
4010	250.1	.Op.general	TRIP	Stage trip	1=Trip
4011	250.11	.mcd			

2.3.1.44

LD0.OEPVPH2 Overexcitation protection (2) – 24-2

Table 47: LD0.OEPVPH1 Overexcitation protection (1) – 24-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.OEPVPH1			
4008	250.8	.Str.general	PICKUP	Stage pickup	1=Pickup
4009	250.9	.mcd			
4010	250.1	.Op.general	TRIP	Stage trip	1=Trip
4011	250.11	.mcd			

2.3.1.45

**LD0.PHHPTOC1 Three-phase non-directional overcurrent protection,
high stage (1) – 50P-1**

Table 48: LD0.PHHPTOC1 Three-phase non-directional overcurrent protection, high stage (1) – 50P-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.PHHPTOC1			
2890	180.10	.Str.general	PICKUP	General pickup	1=Pickup
2891	180.11	.mcd			
2892	180.12	.Str.phsA		Phs A pickup	1=Pickup
2893	180.13	.mcd			
2894	180.14	.Str.phsB		Phs B pickup	1=Pickup
2895	180.15	.mcd			
2896	181.00	.Str.phsC		Phs C pickup	1=Pickup
2897	181.01	.mcd			
2898	181.02	.Op.general	TRIP	General trip	1=Trip
2899	181.03	.mcd			

2.3.1.46

**LD0.PHHPTOC2 Three-phase non-directional overcurrent protection,
high stage (2) – 50P-1 (2)**

Table 49: Three-phase non-directional overcurrent protection, high stage (2) – 50P-1 (2)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.PHHPTOC2			
2920	182.08	.Str.general	PICKUP	General pickup	1=Pickup
2921	182.09	.mcd			
2922	182.10	.Str.phsA		phsA pickup	1=Pickup
2923	182.11	.mcd			
2924	182.12	.Str.phsB		phsB pickup	1=Pickup
2925	182.13	.mcd			
2926	182.14	.Str.phsC		phsC pickup	1=Pickup
2927	182.15	.mcd			
2928	183.00	.Op.general	TRIP	General trip	1=Trip
2929	183.01	.mcd			

2.3.1.47**LD0.PHIPTOC1 Three-phase non-directional overcurrent protection, instantaneous stage (1) – 50P-3 (1)****Table 50:** LD0.PHIPTOC1 Three-phase non-directional overcurrent protection, instantaneous stage (1) – 50P-3 (1)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.PHIPTOC1			
2900	181.04	.Str.general	PICKUP	General pickup	1=Pickup
2901	181.05	.mcd			
2902	181.06	.Str.phsA		phsA pickup	1=Pickup
2903	181.07	.mcd			
2904	181.08	.Str.phsB		phsB pickup	1=Pickup
2905	181.09	.mcd			
2906	181.10	.Str.phsC		phsC pickup	1=Pickup
2907	181.11	.mcd			
2908	181.12	.Op.general	TRIP	General trip	1=Trip
2909	181.13	.mcd			

2.3.1.48**LD0.PHIPTOC2 Three-phase non-directional overcurrent protection, instantaneous stage (2) – 50P-3 (2)****Table 51:** LD0.PHIPTOC2 Three-phase non-directional overcurrent protection, instantaneous stage (2) – 50P-3 (2)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.PHIPTOC2			
2930	183.02	.Str.general	PICKUP	General pickup	1=Pickup
2931	183.03	.mcd			
2932	183.04	.Str.phsA		phsA pickup	1=Pickup
2933	183.05	.mcd			
2934	183.06	.Str.phsB		phsB pickup	1=Pickup
2935	183.07	.mcd			
2936	183.08	.Str.phsC		phsC pickup	1=Pickup
2937	183.09	.mcd			
2938	183.10	.Op.general	TRIP	General trip	1=Trip
2939	183.11	.mcd			

2.3.1.49

LD0.PHLPTOC1 Three-phase non-directional overcurrent protection, low stage (1) – 51P-1

Table 52: LD0.PHLPTOC1 Three-phase non-directional overcurrent protection, low stage (1) – 51P-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.PHLPTOC1			
2880	180.00	.Str.general	PICKUP	General pickup	1=Pickup
2881	180.01	.mcd			
2882	180.02	.Str.phsA		Phs A pickup	1=Pickup
2883	180.03	.mcd			
2884	180.04	.Str.phsB		Phs B pickup	1=Pickup
2885	180.05	.mcd			
2886	180.06	.Str.phsC		Phs C pickup	1=Pickup
2887	180.07	.mcd			
2888	180.08	.Op.general	TRIP	General trip	1=Trip
2889	180.09	.mcd			

2.3.1.50

LD0.PHLPTOC2 Three-phase non-directional overcurrent protection, low stage (2) – 51P-2

Table 53: LD0.PHLPTOC2 Three-phase non-directional overcurrent protection, low stage (2) – 51P-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.PHLPTOC2			
2910	181.14	.Str.general	PICKUP	General pickup	1=Pickup
2911	181.15	.mcd			
2912	182.00	.Str.phsA		phsA pickup	1=Pickup
2913	182.01	.mcd			
2914	182.02	.Str.phsB		phsB pickup	1=Pickup
2915	182.03	.mcd			
2916	182.04	.Str.phsC		phsC pickup	1=Pickup
2917	182.05	.mcd			
2918	182.06	.Op.general	TRIP	General trip	1=Trip
2919	182.07	.mcd			

2.3.1.51

LD0.PHPTOV1 Three-phase overvoltage protection (1) – 59-1

Table 54: LD0.PHPTOV1 Three-phase overvoltage protection (1) – 59-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.PHPTOV1			
3088	193.00	.Str.general	PICKUP	General pickup	1=Pickup
3089	193.01	.mcd			
3090	193.02	.Str.phsA		phsA pickup	1=Pickup
3091	193.03	.mcd			
3092	193.04	.Str.phsB		phsB pickup	1=Pickup
3093	193.05	.mcd			
3094	193.06	.Str.phsC		phsC pickup	1=Pickup
3095	193.07	.mcd			
3096	193.08	.Op.general	TRIP	General trip	1=Trip
3097	193.09	.mcd			

2.3.1.52

LD0.PHPTOV2 Three-phase overvoltage protection (2) – 59-2

Table 55: LD0.PHPTOV2 Three-phase overvoltage protection (2) – 59-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.PHPTOV2			
3098	193.10	.Str.general	PICKUP	General pickup	1=Pickup
3099	193.11	.mcd			
3100	193.12	.Str.phsA		phsA pickup	1=Pickup
3101	193.13	.mcd			
3102	193.14	.Str.phsB		phsB pickup	1=Pickup
3103	193.15	.mcd			
3104	194.00	.Str.phsC		phsC pickup	1=Pickup
3105	194.01	.mcd			
3106	194.02	.Op.general	TRIP	General trip	1=Trip
3107	194.03	.mcd			

2.3.1.53

LD0.PHPTUV1 Three-phase undervoltage protection (1) – 27-1

Table 56: LD0.PHPTUV1 Three-phase undervoltage protection (1) – 27-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.PHPTUV1			
3138	196.02	.Str.general	PICKUP	General pickup	1=Pickup
3139	196.03	.mcd			
3140	196.04	.Str.phsA		Phs A pickup	1=Pickup
3141	196.05	.mcd			
3142	196.06	.Str.phsB		Phs B pickup	1=Pickup
3143	196.07	.mcd			
3144	196.08	.Str.phsC		Phs C pickup	1=Pickup
3145	196.09	.mcd			
3146	196.10	.Op.general	TRIP	General trip	1=Trip
3147	196.11	.mcd			

2.3.1.54

LD0.PHPTUV2 Three-phase undervoltage protection (2) – 27-2

Table 57: LD0.PHPTUV2 Three-phase undervoltage protection (2) – 27-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.PHPTUV2			
3148	196.12	.Str.general	PICKUP	General pickup	1=Pickup
3149	196.13	.mcd			
3150	196.14	.Str.phsA		phsA pickup	1=Pickup
3151	196.15	.mcd			
3152	197.00	.Str.phsB		phsB pickup	1=Pickup
3153	197.01	.mcd			
3154	197.02	.Str.phsC		phsC pickup	1=Pickup
3155	197.03	.mcd			
3156	197.04	.Op.general	TRIP	General trip	1=Trip
3157	197.05	.mcd			

2.3.1.55 LD0.RESCMMXU1 Residual current measurement (1) – IG-1

Table 58: LD0.RESCMMXU1 Residual current measurement (1) – IG-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.RESCMMXU1			
2760	172.08	.HiAlm.stVal	HIGH_ALARM	High alarm	1=Alarm
2761	172.09	.mcd			
2762	172.10	.HiWrn.stVal	HIGH_WARN	High warning	1=Warning
2763	172.11	.mcd			

2.3.1.56 LD0.RESCMMXU2 Residual current measurement (2) – IG-2

Table 59: LD0.RESCMMXU2 Residual current measurement (2) – IG-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.RESCMMXU2			
2764	172.12	.HiAlm.stVal	HIGH_ALARM	High alarm	1=Alarm
2765	172.13	.mcd			
2766	172.14	.HiWrn.stVal	HIGH_WARN	High warning	1=Warning
2767	172.15	.mcd			

2.3.1.57 LD0.RESVMMXU1 Residual voltage measurement (1) – VG-1

Table 60: LD0.RESVMMXU1 Residual voltage measurement (1) – VG-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.RESVMMXU1			
3048	190.08	.HiAlm.stVal	HIGH_ALARM	High alarm	1=Alarm
3049	190.09	.mcd			
3050	190.10	.HiWrn.stVal	HIGH_WARN	High warning	1=Warning
3051	190.11	.mcd			

Section 2 Modbus data mappings

1MAC203705-MB A

2.3.1.58 LD0.ROVPTOV1 Residual overvoltage protection (1) – 59G-1

Table 61: LD0.ROVPTOV1 Residual overvoltage protection (1) – 59G-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.ROVPTOV1			
3168	198.00	.Str.general	PICKUP	General pickup	1=Pickup
3169	198.01	.mcd			
3170	198.02	.Op.general	TRIP	General trip	1=Trip
3171	198.03	.mcd			

2.3.1.59 LD0.ROVPTOV2 Residual overvoltage protection (2) – 59N-1

Table 62: LD0.ROVPTOV2 Residual overvoltage protection (2) – 59N-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.ROVPTOV2			
3172	198.04	.Str.general	PICKUP	General pickup	1=Pickup
3173	198.05	.mcd			
3174	198.06	.Op.general	TRIP	General trip	1=Trip
3175	198.07	.mcd			

2.3.1.60 LD0.SEQSPVC1 Fuse failure supervision (1) – 60-1

Table 63: LD0.SEQSPVC1 Fuse failure supervision (1) – 60-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.SEQSPVC1			
2996	187.04	.Str.general	FUSEF_U	Pickup	1=Pickup
2997	187.05	.mcd			
2998	187.06	.Str3Ph.general	FUSEF_3PH	3-phase pickup	1=Pickup
2999	187.07	.mcd			

2.3.1.61 LD0.SPCGAPC2 Generic control point (16 pcs) (2) – SPC-2

Table 64: LD0.SPCGAPC2 Generic control point (16 pcs) (2) – SPC-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.SPCGAPC2			
3632	227.00	.SPCS01.stVal		Ouput state 1	0/1=Off/On
3633	227.01	.mcd			

Table continues on next page

BitA	RegA	IEC 61850 name	SA name	Description	Values
3634	227.02	.SPCS02.stVal		Ouput state 2	0/1=Off/On
3635	227.03	.mcd			
3636	227.04	.SPCS03.stVal		Ouput state 3	0/1=Off/On
3637	227.05	.mcd			
3638	227.06	.SPCS04.stVal		Ouput state 4	0/1=Off/On
3639	227.07	.mcd			
3640	227.08	.SPCS05.stVal		Ouput state 5	0/1=Off/On
3641	227.09	.mcd			
3642	227.10	.SPCS06.stVal		Ouput state 6	0/1=Off/On
3643	227.11	.mcd			
3644	227.12	.SPCS07.stVal		Ouput state 7	0/1=Off/On
3645	227.13	.mcd			
3646	227.14	.SPCS08.stVal		Ouput state 8	0/1=Off/On
3647	227.15	.mcd			
3648	228.00	.SPCS09.stVal		Ouput state 9	0/1=Off/On
3649	228.01	.mcd			
3650	228.02	.SPCS10.stVal		Ouput state 10	0/1=Off/On
3651	228.03	.mcd			
3652	228.04	.SPCS11.stVal		Ouput state 11	0/1=Off/On
3653	228.05	.mcd			
3654	228.06	.SPCS12.stVal		Ouput state 12	0/1=Off/On
3655	228.07	.mcd			
3656	228.08	.SPCS13.stVal		Ouput state 13	0/1=Off/On
3657	228.09	.mcd			
3658	228.10	.SPCS14.stVal		Ouput state 14	0/1=Off/On
3659	228.11	.mcd			
3660	228.12	.SPCS15.stVal		Ouput state 15	0/1=Off/On
3661	228.13	.mcd			
3662	228.14	.SPCS16.stVal		Ouput state 16	0/1=Off/On
3663	228.15	.mcd			

2.3.1.62

LD0.SSCBR1 Circuit-breaker condition monitoring (1) – 52CM-1

Table 65: LD0.SSCBR1 Circuit-breaker condition monitoring (1) – 52CM-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.SSCBR1			
2848	178.00	.OpnAlm.stVal	TRV_T_OP_ALM	Opn travel time alarm	1=Alarm
2849	178.01	.ClsAlm.stVal	TRV_T_CL_ALM	Cls travel time alarm	1=Alarm
		LD0.SSOPM1			
2850	178.02	.SprChaAlm.stVal	SPR_CHR_ALM	Spring charge alarm	1=Alarm
		LD0.SSCBR1			
2851	178.03	.OpCntAlm.stVal	OPR_ALM	CB operations alarm	1=Alarm
2852	178.04	.OpCntLO.stVal	OPR_LO	CB operations lockout	1=Lockout
2853	178.05	.LonTmAlm.stVal	MON_ALM	CB inactive alarm	1=Alarm
		LD0.SSIGM1			
2854	178.06	.InsAlm.stVal	PRES_ALM	Low pressure alarm	1=Alarm
2855	178.07	.InsBlk.stVal	PRES_LO	Low pressure lockout	1=Lockout
		LD0.SSCBR1			
2856	178.08	.APwrAlm.stVal	IPOW_ALM	Lyt alarm	1=Alarm
2857	178.09	.APwrLO.stVal	IPOW_LO	Lyt lockout	1=Lockout
2858	178.10	.RmnNumOpAlm.stVal	CB_LIFE_ALM	CB lifetime alarm	1=Alarm

2.3.1.63

LD0.T2PTTR1 Three-phase thermal overload protection, two time constants (1) – 49T-1

Table 66: LD0.T2PTTR1 Three-phase thermal overload protection, two time constants (1) – 49T-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.T2PTTR1			
2972	185.12	.Str.general	PICKUP	General pickup	1=Pickup
2973	185.13	.mcd			
2974	185.14	.AlmThm.general	ALARM	Thermal alarm	1=Alarm
2975	185.15	.mcd			
2976	186.00	.Op.general	TRIP	General trip	1=Trip
2977	186.01	.mcd			

2.3.1.64 LD0.TCSSCBR1 Trip circuit supervision (1) – TCM-1
Table 67: *LD0.TCSSCBR1 Trip circuit supervision (1) – TCM-1*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.TCSSCBR1			
2780	173.12	.CircAlm.stVal	ALARM	Supervision alarm	1=Alarm
2781	173.13	.mcd			

2.3.1.65 LD0.TCSSCBR2 Trip circuit supervision (2) – TCM-2
Table 68: *LD0.TCSSCBR2 Trip circuit supervision (2) – TCM-2*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.TCSSCBR2			
2782	173.14	.CircAlm.stVal	ALARM	Supervision alarm	1=Alarm
2783	173.15	.mcd			

2.3.1.66 LD0.TR2PTDF1 Stabilized and instantaneous differential protection for two-winding transformers (1) – 87T-1
Table 69: *LD0.TR2PTDF1 Stabilized and instantaneous differential protection for two-winding transformers (1) – 87T-1*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.TR2PTDF1			
3000	187.08	.Op.general	TRIP	General trip	1=Trip
3001	187.09	.mcd			
3002	187.10	.Op.phsA		phsA trip	1=Trip
3003	187.11	.mcd			
3004	187.12	.Op.phsB		phsB trip	1=Trip
3005	187.13	.mcd			
3006	187.14	.Op.phsC		phsC trip	1=Trip
3007	187.15	.mcd			
3008	188.00	.Blk2HSt.general	BLKD2H	2nd harmonic res block.	1=Blocking
3009	188.01	.mcd			

2.3.1.67 LD0.TRPPTRC1 Master trip (1) – 86/94-1

Table 70: LD0.TRPPTRC1 Master trip (1) – 86/94-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.TRPPTRC1			
2740	171.04	.Op.general	-	Op. input signal	1=Operate
2741	171.05	.mcd			
2742	171.06	.Tr.general	-	Trip output signal	1=Trip
2743	171.07	.mcd			

2.3.1.68 LD0.TRPPTRC2 Master trip (2) – 86/94-2

Table 71: LD0.TRPPTRC2 Master trip (2) – 86/94-2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.TRPPTRC2			
2744	171.08	.Op.general	-	Op. input signal	1=Operate
2745	171.09	.mcd			
2746	171.10	.Tr.general	-	Trip output signal	1=Trip
2747	171.11	.mcd			

2.3.1.69 LD0.VMMXU1 Three-phase voltage measurement (1) – VA, VB, VC

Table 72: LD0.VMMXU1 Three-phase voltage measurement (1) – VA, VB, VC

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.VMMXU1			
3040	190.00	.HiAlm.stVal	HIGH_ALARM	High alarm	1=Alarm
3041	190.01	.mcd			
3042	190.02	.HiWrn.stVal	HIGH_WARN	High warning	1=Warning
3043	190.03	.mcd			
3044	190.04	.LoWrn.stVal	LOW_WARN	Low warning	1=Warning
3045	190.05	.mcd			
3046	190.06	.LoAlm.stVal	LOW_ALARM	Low alarm	1=Alarm
3047	190.07	.mcd			

2.3.1.70 LD0.XAGGIO130 Physical I/O states (AIM card XA130)

Table 73: LD0.XAGGIO130 Physical I/O states (AIM card XA130)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.XAGGIO130			
3264	204.00	.Ind1.stVal		XA130-Input 1 State	0/1=Off/On
3265	204.01	.mcd			
		.mom-only		Mom only alternative	
3266	204.02	.Ind2.stVal		XA130-Input 2 State	0/1=Off/On
3267	204.03	.mcd			
		.mom-only		Mom only alternative	
3268	204.04	.Ind3.stVal		XA130-Input 3 State	0/1=Off/On
3269	204.05	.mcd			
		.mom-only		Mom only alternative	
3270	204.06	.Ind4.stVal		XA130-Input 4 State	0/1=Off/On
3271	204.07	.mcd			
		.mom-only		Mom only alternative	

2.3.1.71 LD0.XARGGIO130 Alarm/warning

Table 74: LD0.XARGGIO130 Alarm/warning

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.XARGGIO130			
3032	189.08	.Alm.stVal	-	XRGGIO130 Alarm	1=Alarm
3033	189.09	.mcd			
3034	189.10	.Wrn.stVal	-	XRGGIO130 Warning	1=Warning
3035	189.11	.mcd			

2.3.1.72 LD0.XBGGIO110 Physical I/O states (BIO card XB110)

Table 75: LD0.XBGGIO110 Physical I/O states (BIO card XB110)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.XBGGIO110			
3216	201.00	.Ind1.stVal		X110-Input 1 State	0/1=Off/On
3217	201.01	.mcd			
		.mom-only		Mom only alternative	
3218	201.02	.Ind2.stVal		X110-Input 2 State	0/1=Off/On

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

BitA	RegA	IEC 61850 name	SA name	Description	Values
3219	201.03	.mcd			
		.mom-only		Mom only alternative	
3220	201.04	.Ind3.stVal		X110-Input 3 State	0/1=Off/On
3221	201.05	.mcd			
		.mom-only		Mom only alternative	
3222	201.06	.Ind4.stVal		X110-Input 4 State	0/1=Off/On
3223	201.07	.mcd			
		.mom-only		Mom only alternative	
3224	201.08	.Ind5.stVal		X110-Input 5 State	0/1=Off/On
3225	201.09	.mcd			
		.mom-only		Mom only alternative	
3226	201.10	.Ind6.stVal		X110-Input 6 State	0/1=Off/On
3227	201.11	.mcd			
		.mom-only		Mom only alternative	
3228	201.12	.Ind7.stVal		X110-Input 7 State	0/1=Off/On
3229	201.13	.mcd			
		.mom-only		Mom only alternative	
3230	201.14	.Ind8.stVal		X110-Input 8 State	0/1=Off/On
3231	201.15	.mcd			
		.mom-only		Mom only alternative	
3232	202.00	.SPCSO1.stVal		X110-Output 1 State	0/1=Off/On
3233	202.01	.mcd			
		.mom-only		Mom only alternative	
3234	202.02	.SPCSO2.stVal		X110-Output 2 State	0/1=Off/On
3235	202.03	.mcd			
		.mom-only		Mom only alternative	
3236	202.04	.SPCSO3.stVal		X110-Output 3 State	0/1=Off/On
3237	202.05	.mcd			
		.mom-only		Mom only alternative	

2.3.1.73

LD0.XGGIO100 Physical I/O states (PSM card X100)

Table 76: LD0.XGGIO100 Physical I/O states (PSM card X100)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.XGGIO100			
3248	203.00	.SPCSO1.stVal		X100-Output 1 State	0/1=Off/On
3249	203.01	.mcd			
		.mom-only		Mom only alternative	
3250	203.02	.SPCSO2.stVal		X100-Output 2 State	0/1=Off/On
3251	203.03	.mcd			
		.mom-only		Mom only alternative	
3252	203.04	.SPCSO3.stVal		X100-Output 3 State	0/1=Off/On
3253	203.05	.mcd			
		.mom-only		Mom only alternative	
3254	203.06	.SPCSO4.stVal		X100-Output 4 State	0/1=Off/On
3255	203.07	.mcd			
		.mom-only		Mom only alternative	
3256	203.08	.SPCSO5.stVal		X100-Output 5 State	0/1=Off/On
3257	203.09	.mcd			
		.mom-only		Mom only alternative	
3258	203.10	.SPCSO6.stVal		X100-Output 6 State	0/1=Off/On
3259	203.11	.mcd			
		.mom-only		Mom only alternative	

2.3.1.74

LD0.XGGIO110 Physical I/O states (BIO card X110)

Table 77: LD0.XGGIO110 Physical I/O states (BIO card X110)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.XGGIO110			
3216	201.00	.Ind1.stVal		X110-Input 1 State	0/1=Off/On
3217	201.01	.mcd			
		.mom-only		Mom only alternative	
3218	201.02	.Ind2.stVal		X110-Input 2 State	0/1=Off/On
3219	201.03	.mcd			
		.mom-only		Mom only alternative	
3220	201.04	.Ind3.stVal		X110-Input 3 State	0/1=Off/On
3221	201.05	.mcd			

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

BitA	RegA	IEC 61850 name	SA name	Description	Values
		.mom-only		Mom only alternative	
3222	201.06	.Ind4.stVal		X110-Input 4 State	0/1=Off/On
3223	201.07	.mcd			
		.mom-only		Mom only alternative	
3224	201.08	.Ind5.stVal		X110-Input 5 State	0/1=Off/On
3225	201.09	.mcd			
		.mom-only		Mom only alternative	
3226	201.10	.Ind6.stVal		X110-Input 6 State	0/1=Off/On
3227	201.11	.mcd			
		.mom-only		Mom only alternative	
3228	201.12	.Ind7.stVal		X110-Input 7 State	0/1=Off/On
3229	201.13	.mcd			
		.mom-only		Mom only alternative	
3230	201.14	.Ind8.stVal		X110-Input 8 State	0/1=Off/On
3231	201.15	.mcd			
		.mom-only		Mom only alternative	
3232	202.00	.SPCSO1.stVal		X110-Output 1 State	0/1=Off/On
3233	202.01	.mcd			
		.mom-only		Mom only alternative	
3234	202.02	.SPCSO2.stVal		X110-Output 2 State	0/1=Off/On
3235	202.03	.mcd			
		.mom-only		Mom only alternative	
3236	202.04	.SPCSO3.stVal		X110-Output 3 State	0/1=Off/On
3237	202.05	.mcd			
		.mom-only		Mom only alternative	
3238	202.06	.SPCSO4.stVal		X110-Output 4 State	0/1=Off/On
3239	202.07	.mcd			
		.mom-only		Mom only alternative	

2.3.1.75

LD0.XGGIO130 Physical I/O states (BIO card X130)

Table 78: LD0.XGGIO130 Physical I/O states (BIO card X130)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.XGGIO130			
3184	199.00	.Ind1.stVal		X130-Input 1 State	0/1=Off/On
3185	199.01	.mcd			

Table continues on next page

BitA	RegA	IEC 61850 name	SA name	Description	Values
		.mom-only		Mom only alternative	
3186	199.02	.Ind2.stVal		X130-Input 2 State	0/1=Off/On
3187	199.03	.mcd			
		.mom-only		Mom only alternative	
3188	199.04	.Ind3.stVal		X130-Input 3 State	0/1=Off/On
3189	199.05	.mcd			
		.mom-only		Mom only alternative	
3190	199.06	.Ind4.stVal		X130-Input 4 State	0/1=Off/On
3191	199.07	.mcd			
		.mom-only		Mom only alternative	
3192	199.08	.Ind5.stVal		X130-Input 5 State	0/1=Off/On
3193	199.09	.mcd			
		.mom-only		Mom only alternative	
3194	199.10	.Ind6.stVal		X130-Input 6 State	0/1=Off/On
3195	199.11	.mcd			
		.mom-only		Mom only alternative	
3264	204.00	.SPCSO1.stVal		X130-Output 1 State	0/1=Off/On
3265	204.01	.mcd			
		.mom-only		Mom only alternative	
3266	204.02	.SPCSO2.stVal		X130-Output 2 State	0/1=Off/On
3267	204.03	.mcd			
		.mom-only		Mom only alternative	
3268	204.04	.SPCSO3.stVal		X130-Output 3 State	0/1=Off/On
3269	204.05	.mcd			
		.mom-only		Mom only alternative	

2.3.1.76 LD0.XRGGIO130 Alarm/warning

Table 79: LD0.XRGGIO130 Alarm/warning

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.XRGGIO130			
3032	189.08	.Alm.stVal	-	XRGGIO130 Alarm	1=Alarm
3033	189.09	.mcd			
3034	189.10	.Wrn.stVal	-	XRGGIO130 Warning	1=Warning
3035	189.11	.mcd			

2.3.2 Unmapped indications

Unmapped indications are indication data that have no initial Modbus mapping locations, but can be added to the user-definable Modbus area using the Communication Management tool in PCM600. If Modbus events are enabled for these indication signals, the event identification is the user-definable area address.

2.3.2.1 All premapped three-phase protection function stages, trip/phase-dependent objects added

Table 80: All premapped three-phase protection function stages, trip/phase-dependent objects added

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.xxxxxxx (various)			
		.Op.phsA		Phs A trip	1 = Trip
		.mcd			
		.Op.phsB		Phs B trip	1 = Trip
		.mcd			
		.Op.phsC		Phs C trip	1 = Trip
		.mcd			

2.3.2.2 Common data 2

Table 81: Common data 2

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.LDEV1			
		.StLstOv.stVal		Internal ind. overflow	1=Overflow
		.mcd			
		.MeasLstOv.stVal		Internal meas. overflow	1=Overflow
		.mcd			
		.ChgFlg.stVal		Configuration changed	1=Changed
		.mcd			
		.FacSet.stVal		Factory settings in use	1=In use
		.mcd			
		LD0.GNRLLTMS1			
		.TmChSt1.stVal		Time synch. status	0/1=Down/Up
		.mcd			
		LD0.SCHLCCH1			
		.ChLiv.stVal	CH1LIV	Ethernet channel 1 live	1=Live

Table continues on next page

BitA	RegA	IEC 61850 name	SA name	Description	Values
		.mcd			
		LD0.SCHLCCH2			
		.ChLiv.stVal	CH2LIV	Ethernet channel 2 live	1=Live
		.mcd			
		LD0.SCHLCCH3			
		.ChLiv.stVal	CH3LIV	Ethernet channel 3 live	1=Live
		.mcd			

2.3.2.3 LD0.DIAGLCCH1 Ethernet supervision (1)

Table 82: LD0.DIAGLCCH1 Ethernet supervision (1)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.DIAGLCCH1			
		.ChLiv.stVal	CHLIV	Ethernet channel live	1=Live
		.mcd			
		.RedChLiv.stVal	REDCHLIV	Red. Ethernet channel live	1=Live
		.mcd			

2.3.2.4 LD0.IL1TCTR1 Three-phase CT supervision (1)

Table 83: LD0.IL1TCTR1 Three-phase CT supervision (1)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.IL1TCTR1			
		.Alm.stVal	ALARM	Alarm	1=Alarm
		.mcd			
		.Wrn.stVal	WARNING	Warning	1=Warning
		.mcd			

2.3.2.5 LD0.IL1TCTR2 Three-phase CT supervision (2)

Table 84: LD0.IL1TCTR2 Three-phase CT supervision (2)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.IL1TCTR2			
		.Alm.stVal	ALARM	Alarm	1=Alarm
		.mcd			
		.Wrn.stVal	WARNING	Warning	1=Warning
		.mcd			

2.3.2.6 LD0.LDPRLRC1 Load profile record (1) – LoadProf

Table 85: LD0.LDPRLRC1 Load profile record (1) – LoadProf

BitA	RegA	IEC 61850 name	SA name	Description	Value
		LD0.LDPRLRC1			
		.MemWrn.stVal		Recording memory warning	1=Warning
		.mcd			
		.MemAlm.stVal		Recording memory alarm	1=Alarm
		.mcd			

2.3.2.7 LD0.MAPGAPC7 Multipurpose protection (7) – MAP-7

Table 86: LD0.MAPGAPC7 Multipurpose protection (7) – MAP-7

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC7			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.8 LD0.MAPGAPC8 Multipurpose protection (8) – MAP-8

Table 87: LD0.MAPGAPC8 Multipurpose protection (8) – MAP-8

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC8			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.9

LD0.MAPGAPC9 Multipurpose protection (9) – MAP-9

Table 88: LD0.MAPGAPC9 Multipurpose protection (9) – MAP-9

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC9			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.10

LD0.MAPGAPC10 Multipurpose protection (10) – MAP-10

Table 89: LD0.MAPGAPC10 Multipurpose protection (10) – MAP-10

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC10			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.11

LD0.MAPGAPC11 Multipurpose protection (11) – MAP-11

Table 90: LD0.MAPGAPC11 Multipurpose protection (11) – MAP-11

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC11			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.12 LD0.MAPGAPC12 Multipurpose protection (12) – MAP-12

Table 91: LD0.MAPGAPC12 Multipurpose protection (12) – MAP-12

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC12			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.13 LD0.MAPGAPC13 Multipurpose protection (13) – MAP-13

Table 92: LD0.MAPGAPC13 Multipurpose protection (13) – MAP-13

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC13			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.14 LD0.MAPGAPC14 Multipurpose protection (14) – MAP-14

Table 93: LD0.MAPGAPC14 Multipurpose protection (14) – MAP-14

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC14			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.15

LD0.MAPGAPC15 Multipurpose protection (15) – MAP-15

Table 94: LD0.MAPGAPC15 Multipurpose protection (15) – MAP-15

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC15			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.16

LD0.MAPGAPC16 Multipurpose protection (16) – MAP-16

Table 95: LD0.MAPGAPC16 Multipurpose protection (16) – MAP-16

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC1			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.17

LD0.MAPGAPC17 Multipurpose protection (17) – MAP-17

Table 96: LD0.MAPGAPC17 Multipurpose protection (17) – MAP-17

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC17			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.18 LD0.MAPGAPC18 Multipurpose protection (18) – MAP-18

Table 97: LD0.MAPGAPC18 Multipurpose protection (18) – MAP-18

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.MAPGAPC18			
		.Str.general	PICKUP	Stage pickup	1 = Pickup
		.mcd			
		.Op.general	TRIP	Stage trip	1 = Trip
		.mcd			

2.3.2.19 LD0.RESTCTR1 IG CT supervision (1)

Table 98: LD0.RESTCTR1 IG CT supervision (1)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.RESTCTR1			
		.Alm.stVal	ALARM	Alarm	1=Alarm
		.mcd			
		.Wrn.stVal	WARNING	Warning	1=Warning
		.mcd			

2.3.2.20 LD0.RESTCTR2 IG CT supervision (2)

Table 99: LD0.RESTCTR2 IG CT supervision (2)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.RESTCTR2			
		.Alm.stVal	ALARM	Alarm	1=Alarm
		.mcd			
		.Wrn.stVal	WARNING	Warning	1=Warning
		.mcd			

2.3.2.21

LD0.RESTVTR1 VG VT supervision (1)

Table 100: LD0.RESTVTR1 VG VT supervision (1)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.RESTVTR1			
		.Alm.stVal	ALARM	Alarm	1=Alarm
		.mcd			
		.Wrn.stVal	WARNING	Warning	1=Warning
		.mcd			

2.3.2.22

LD0.SPCGAPC1 Generic control point (16 pcs) (1) – SPC-1

Table 101: LD0.SPCGAPC1 Generic control point (16 pcs) (1) – SPC-1

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.SPCGAPC1			
		.SPCSO1.stVal		Ouput state 1	0/1=Off/On
		.mcd			
		.SPCSO2.stVal		Ouput state 2	0/1=Off/On
		.mcd			
		.SPCSO3.stVal		Ouput state 3	0/1=Off/On
		.mcd			
		.SPCSO4.stVal		Ouput state 4	0/1=Off/On
		.mcd			
		.SPCSO5.stVal		Ouput state 5	0/1=Off/On
		.mcd			
		.SPCSO6.stVal		Ouput state 6	0/1=Off/On
		.mcd			
		.SPCSO7.stVal		Ouput state 7	0/1=Off/On
		.mcd			
		.SPCSO8.stVal		Ouput state 8	0/1=Off/On
		.mcd			
		.SPCSO9.stVal		Ouput state 9	0/1=Off/On
		.mcd			
		.SPCSO10.stVal		Ouput state 10	0/1=Off/On
		.mcd			
		.SPCSO11.stVal		Ouput state 11	0/1=Off/On
		.mcd			

Table continues on next page

Section 2 Modbus data mappings

1MAC203705-MB A

BitA	RegA	IEC 61850 name	SA name	Description	Values
		.SPCSO12.stVal		Ouput state 12	0/1=Off/On
		.mcd			
		.SPCSO13.stVal		Ouput state 13	0/1=Off/On
		.mcd			
		.SPCSO14.stVal		Ouput state 14	0/1=Off/On
		.mcd			
		.SPCSO15.stVal		Ouput state 15	0/1=Off/On
		.mcd			
		.SPCSO16.stVal		Ouput state 16	0/1=Off/On
		.mcd			

2.3.2.23 LD0.TRPPTRC3 Master trip (3) – 86/94-3

Table 102: LD0.TRPPTRC3 Master trip (3) – 86/94-3

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.TRPPTRC3			
		.Op.general		Op. input signal	1 = Operate
		.mcd			
		.Tr.general		Trip output signal	1 = Trip
		.mcd			

2.3.2.24 LD0.TRPPTRC4 Master trip (4) – 86/94-4

Table 103: LD0.TRPPTRC4 Master trip (4) – 86/94-4

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.TRPPTRC4			
		.Op.general		Op. input signal	1 = Operate
		.mcd			
		.Tr.general		Trip output signal	1 = Trip
		.mcd			

2.3.2.25 LD0.TRPPTRC5 Master trip (5) – 86/94-5
Table 104: *LD0.TRPPTRC5 Master trip (5) – 86/94-5*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.TRPPTRC5			
		.Op.general		Op. input signal	1 = Operate
		.mcd			
		.Tr.general		Trip output signal	1 = Trip
		.mcd			

2.3.2.26 LD0.UDFCNT1 Multipurpose generic up-down counter (1) – CTR-1
Table 105: *LD0.UDFCNT1 Multipurpose generic up-down counter (1) – CTR-1*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0. UDFCNT1			
		.DnCntSt.stVal	DNCNT_STS	Status of the down counting	1= down counting
		.mcd			
		UpCntSt.stVal	UPCNT_STS	Status of the up counting	1= up counting
		.mcd			

2.3.2.27 LD0.UDFCNT2 Multipurpose generic up-down counter (2) – CTR-2
Table 106: *LD0.UDFCNT2 Multipurpose generic up-down counter (2) – CTR-2*

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0. UDFCNT2			
		.DnCntSt.stVal	DNCNT_STS	Status of the down counting	1= down counting
		.mcd			
		UpCntSt.stVal	UPCNT_STS	Status of the up counting	1= up counting
		.mcd			

2.3.2.28 LD0.UDFCNT3 Multipurpose generic up-down counter (3) – CTR-3

Table 107: LD0.UDFCNT3 Multipurpose generic up-down counter (3) – CTR-3

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0. UDFCNT3			
		.DnCntSt.stVal	DNCNT_STS	Status of the down counting	1= down counting
		.mcd			
		UpCntSt.stVal	UPCNT_STS	Status of the up counting	1= up counting
		.mcd			

2.3.2.29 LD0.UDFCNT4 Multipurpose generic up-down counter (4) – CTR-4

Table 108: LD0.UDFCNT4 Multipurpose generic up-down counter (4) – CTR-4

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0. UDFCNT4			
		.DnCntSt.stVal	DNCNT_STS	Status of the down counting	1= down counting
		.mcd			
		UpCntSt.stVal	UPCNT_STS	Status of the up counting	1= up counting
		.mcd			

2.3.2.30 LD0.UL1TVTR1 Three-phase VT supervision (1)

Table 109: LD0.UL1TVTR1 Three-phase VT supervision (1)

BitA	RegA	IEC 61850 name	SA name	Description	Values
		LD0.UL1TVTR1			
		.Alm.stVal	ALARM	Alarm	1=Alarm
		.mcd			
		.Wrn.stVal	WARNING	Warning	1=Warning
		.mcd			

2.4 Registers

Table 110: Explanations of columns in register tables

Column name	Description
RegA	Default 3X and 4X register address for the data.
Type	Type of the register. The alternatives are u16, u32 (unsigned 16 and 32 bits integer) or i16, i32 (signed 16 and 32 bit integer).
Scale	Scale factor as default. Also, an adjustable offset value exists that is set to 0 by default.
IEC 61850 name	Original IED data object identification. Described in the IEC 61850 format as Logical Device.Logical Node and thereafter .Data Object.Data Attribute. Logical Node is the same as the application function block name.
SA name	The signal may have a defined label that is visible, for example, in the Application Configuration tool in PCM600.
Description	Short description of the signal. See the technical manual for more information. Also, if a register is writable, it is stated here.
Values	The value range of the original IEC 61850 value, that is, before scaling.

2.4.1 Premapped registers

2.4.1.1 Active parameter setting group - read and write

Table 111: Active parameter setting group - read and write

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
2301	u16	1			Active setting group	1...6

2.4.1.2 Control structure 1

Table 112: Control structure 1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
8001					Execute register	1
8002					Password reg 1	acc to setting
8003					Password reg 2	acc to setting
8004					Control register	< single bit >
8005					Confirm register	< single bit >

2.4.1.3 Control structure 2

Table 113: Control structure 2

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
8006					Execute register	1
8007					Password reg 1	acc to setting
8008					Password reg 2	acc to setting
8009					Control register	< single bit >
8010					Confirm register	< single bit >

2.4.1.4 Control structure 3

Table 114: Control structure 3

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
8011					Execute register	1
8012					Password reg 1	acc to setting
8013					Password reg 2	acc to setting
8014					Control register	< single bit >
8015					Confirm register	< single bit >

2.4.1.5 Control structure 4

Table 115: Control structure 4

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
8016					Execute register	1
8017					Password reg 1	acc to setting
8018					Password reg 2	acc to setting
8019					Control register	< single bit >
8020					Confirm register	< single bit >

2.4.1.6 Control structure 5

Table 116: Control structure 5

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
8021					Execute register	1
8022					Password reg 1	acc to setting
8023					Password reg 2	acc to setting
8024					Control register	< single bit >
8025					Confirm register	< single bit >

2.4.1.7 Control structure 6

Table 117: Control structure 6

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
8026					Execute register	1
8027					Password reg 1	acc to setting
8028					Password reg 2	acc to setting
8029					Control register	< single bit >
8030					Confirm register	< single bit >

2.4.1.8 Control structure 7

Table 118: Control structure 7

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
8031					Execute register	1
8032					Password reg 1	acc to setting
8033					Password reg 2	acc to setting
8034					Control register	< single bit >
8035					Confirm register	< single bit >

2.4.1.9 Control structure 8

Table 119: Control structure 8

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
8036					Execute register	1
8037					Password reg 1	acc to setting
8038					Password reg 2	acc to setting
8039					Control register	< single bit >
8040					Confirm register	< single bit >

2.4.1.10 Device ID string

Table 120: Device ID string

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9000	u16				ASCII coded string	1)
...						
9120	u16					

1) See the technical manual.

2.4.1.11 Event record structure

Table 121: Event record structure

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
					Selection write:	
9250	u16	1			- Num of multiple records	1...10
9251	i16	1			- Read selection	-499...3
					Record 1 data to read:	
9252	u16	1			- Record sequence num	1...9999
9253	u16	1			- Unread records left	0...499
					Timestamp of record	
9254	u16	1			- Year, Month	Year/Month
9255	u16	1			- Day, Hour	Day/Hour
9256	u16	1			- Minute, Second	Min/Sec
9257	u16	1			- Millisecond	Millisecond
9258	u16	1			Event identification	1)
9259	u16	1			Data object ID1	1)

Table continues on next page

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9260	u16	1			Data object ID2	1)
9261	u16	1			Event data value 1	1)
9262	u16	1			Event data value 2	1)
					Record 2 data to read:	If selected
9263	u16	1			- Record sequence num	1..9999
9264	u16	1			- Unread records left	0..499
					Timestamp of record	
9265	u16	1			- Year, Month	Year/Month
9266	u16	1			- Day, Hour	Day/Hour
9267	u16	1			- Minute, Second	Min/Sec
9268	u16	1			- Millisecond	Millisecond
9269	u16	1			Event identification	1)
9270	u16	1			Data object ID1	1)
9271	u16	1			Data object ID2	1)
9272	u16	1			Event data value 1	1)
9273	u16	1			Event data value 2	1)
					Record 3 data to read:	If selected
9274	u16	1			- Record sequence num	1...9999
9275	u16	1			- Unread records left	0...499
					Timestamp of record	
9276	u16	1			- Year, Month	Year/Month
9277	u16	1			- Day, Hour	Day/Hour
9278	u16	1			- Minute, Second	Min/Sec
9279	u16	1			- Millisecond	Millisecond
9280	u16	1			Event identification	1)
9281	u16	1			Data object ID1	1)
9282	u16	1			Data object ID2	1)
9283	u16	1			Event data value 1	1)
9284	u16	1			Event data value 2	1)
					Record 4 data to read:	If selected
9285	u16	1			- Record sequence num	1...9999
9286	u16	1			- Unread records left	0...499

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
					Timestamp of record	
9287	u16	1			- Year, Month	Year/Month
9288	u16	1			- Day, Hour	Day/Hour
9289	u16	1			- Minute, Second	Min/Sec
9290	u16	1			- Millisecond	Millisecond
9291	u16	1			Event identification	1)
9292	u16	1			Data object ID1	1)
9293	u16	1			Data object ID2	1)
9294	u16	1			Event data value 1	1)
9295	u16	1			Event data value 2	1)
					Record 5 data to read:	If selected
9296	u16	1			- Record sequence num	1...9999
9297	u16	1			- Unread records left	0...499
					Timestamp of record	
9298	u16	1			- Year, Month	Year/Month
9299	u16	1			- Day, Hour	Day/Hour
9300	u16	1			- Minute, Second	Min/Sec
9301	u16	1			- Millisecond	Millisecond
9302	u16	1			Event identification	1)
9303	u16	1			Data object ID1	1)
9304	u16	1			Data object ID2	1)
9305	u16	1			Event data value 1	1)
9306	u16	1			Event data value 2	1)
					Record 6 data to read:	If selected
9307	u16	1			- Record sequence num	1...9999
9308	u16	1			- Unread records left	0...499
					Timestamp of record	
9309	u16	1			- Year, Month	Year/Month
9310	u16	1			- Day, Hour	Day/Hour
9311	u16	1			- Minute, Second	Min/Sec
9312	u16	1			- Millisecond	Millisecond
9313	u16	1			Event identification	1)
9314	u16	1			Data object ID1	1)

Table continues on next page

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9315	u16	1			Data object ID2	1)
9316	u16	1			Event data value 1	1)
9317	u16	1			Event data value 2	1)
					Record 7 data to read:	If selected
9318	u16	1			- Record sequence num	1...9999
9319	u16	1			- Unread records left	0...499
					Timestamp of record	
9320	u16	1			- Year, Month	Year/Month
9321	u16	1			- Day, Hour	Day/Hour
9322	u16	1			- Minute, Second	Min/Sec
9323	u16	1			- Millisecond	Millisecond
9324	u16	1			Event identification	1)
9325	u16	1			Data object ID1	1)
9326	u16	1			Data object ID2	1)
9327	u16	1			Event data value 1	1)
9328	u16	1			Event data value 2	1)
					Record 8 data to read:	If selected
9329	u16	1			- Record sequence num	1...9999
9330	u16	1			- Unread records left	0...499
					Timestamp of record	
9331	u16	1			- Year, Month	Year/Month
9332	u16	1			- Day, Hour	Day/Hour
9333	u16	1			- Minute, Second	Min/Sec
9334	u16	1			- Millisecond	Millisecond
9335	u16	1			Event identification	1)
9336	u16	1			Data object ID1	1)
9337	u16	1			Data object ID2	1)
9338	u16	1			Event data value 1	1)
9339	u16	1			Event data value 2	1)
					Record 9 data to read:	If selected
9340	u16	1			- Record sequence num	1...9999

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9341	u16	1			- Unread records left	0...499
					Timestamp of record	
9342	u16	1			- Year, Month	Year/Month
9343	u16	1			- Day, Hour	Day/Hour
9344	u16	1			- Minute, Second	Min/Sec
9345	u16	1			- Millisecond	Millisecond
9346	u16	1			Event identification	1)
9347	u16	1			Data object ID1	1)
9348	u16	1			Data object ID2	1)
9349	u16	1			Event data value 1	1)
9350	u16	1			Event data value 2	1)
					Record 10 data to read:	If selected
9351	u16	1			- Record sequence num	1...9999
9352	u16	1			- Unread records left	0...499
					Timestamp of record	
9353	u16	1			- Year, Month	Year/Month
9354	u16	1			- Day, Hour	Day/Hour
9355	u16	1			- Minute, Second	Min/Sec
9356	u16	1			- Millisecond	Millisecond
9357	u16	1			Event identification	1)
9358	u16	1			Data object ID1	1)
9359	u16	1			Data object ID2	1)
9360	u16	1			Event data value 1	1)
9361	u16	1			Event data value 2	1)

1) See the technical manual.

2.4.1.12 Fault record structure header

Table 122: *Fault record structure header*

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
					Selection write	
9401	i16	1			Read selection	-99...3
					Record data header	

Table continues on next page

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9402	u16	1			Record sequence num	0...65535
9403	u16	1			Unread records left	0...99
					Timestamp of record	
9404	u16	1			Year, month	Year/Month
9405	u16	1			Day, hour	Day/Hour
9406	u16	1			Minute, second	Min/Sec
9407	u16	1			Millisecond	Millisecond
9408	u16	1			Timestamp quality	

2.4.1.13 Fault record data

The table shows all potential data available in the fault record application. Which data is actually recorded depends on the functions available and enabled in the protection relay's configuration.

Table 123: Fault record data

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.FLTRFRC1		Fault record data	
9409	u32	1	.OpCnt.stVal		Fault record number (high)	0..999999
9410					(Low word)	
9411	i16	1	.ProFnc.stVal		Protection function	-32768...32767
9412	u16	100	.Hz.mag		Frequency	30...80.00 [Hz]
9413	u16	100	.StrDur.mag		Start duration	0...100.00 [%]
9414	u32	1000	.StrOpTm.mag		Operate time [ms] (high)	0...999999.999
9415					(Low word)	
9416	u32	100	.FltPtR.mag		Fault resistance	0.00...1000000.00 ohms
9417					(Low word)	
9418	u32	100	.FltDiskm.mag		Fault distance	0.00...9999.99 pu
9419					(Low word)	
9420	u16	1	.ActSetGr.stVal		Active setting group	1...6
9421	u16	1	.ShotPntr.stVal		AR shot pointer value	0...7
					Captured values during fault	
9422	u16	1000	.Max50DifAA.mag		Max. diff. current phs A	0.000...80.000 [pu]

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9423	u16	1000	.Max50DifAB.mag		Max. diff. current phs B	0.000...80.000 [pu]
9424	u16	1000	.Max50DifAC.mag		Max. diff. current phs C	0.000...80.000 [pu]
9425	u16	1000	.Max50RstAA.mag		Max. bias current phs A	0.000...50.000 [pu]
9426	u16	1000	.Max50RstAB.mag		Max. bias current phs B	0.000...50.000 [pu]
9427	u16	1000	.Max50RstAC.mag		Max. bias current phs C	0.000...50.000 [pu]
9428	u16	1000	.DifAPhsA.mag		Diff. current phs A	0.000...80.000 [pu]
9429	u16	1000	.DifAPhsB.mag		Diff. current phs B	0.000...80.000 [pu]
9430	u16	1000	.DifAPhsC.mag		Diff. current phs C	0.000...80.000 [pu]
9431	u16	1000	.RstAPhsA.mag		Bias current phs A	0.000...50.000 [pu]
9432	u16	1000	.RstAPhsB.mag		Bias current phs B	0.000...50.000 [pu]
9433	u16	1000	.RstAPhsC.mag		Bias current phs C	0.000...50.000 [pu]
9434	u16	1000	.DifARes.mag		Diff. current Io	0.000...80.000 [pu]
9435	u16	1000	.RstARes.mag		Bias current Io	0.000...50.000 [pu]
9436	u16	1000	.Max50APhsA1.mag		Max. current phs A(1)	0.000...50.000 [$\times I_n$]
9437	u16	1000	.Max50APhsB1.mag		Max. current phs B(1)	0.000...50.000 [$\times I_n$]
9438	u16	1000	.Max50APhsC1.mag		Max. current phs C(1)	0.000...50.000 [$\times I_n$]
9439	u16	1000	.Max50ARes1.mag		Max. current Io(1)	0.000...50.000 [$\times I_n$]
9440	u16	1000	.APhsA1.mag		Current phs A(1)	0.000...50.000 [$\times I_n$]
9441	u16	1000	.APhsB1.mag		Current phs B(1)	0.000...50.000 [$\times I_n$]
9442	u16	1000	.APhsC1.mag		Current phs C(1)	0.000...50.000 [$\times I_n$]
9443	u16	1000	.ARes1.mag		Current Io(1)	0.000...50.000 [$\times I_n$]
9444	u16	1000	.AResClc1.mag		Current Io-Calc(1)	0.000...50.000 [$\times I_n$]

Table continues on next page

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9445	u16	1000	.APsSeq1.mag		Current Ps-Seq(1)	0.000...50.000 [\times In]
9446	u16	1000	.ANgSeq1.mag		Current Ng-Seq(1)	0.000...50.000 [\times In]
9447	u16	1000	.PhVPhsA1.mag		Voltage phs A(1)	0.000...4.000 [\times Un]
9448	u16	1000	.PhVPhsB1.mag		Voltage phs B(1)	0.000...4.000 [\times Un]
9449	u16	1000	.PhVPhsC1.mag		Voltage phs C(1)	0.000...4.000 [\times Un]
9450	u16	1000	.PPVPhsAB1.mag		Voltage phs AB(1)	0.000...4.000 [\times Un]
9451	u16	1000	.PPVPhsBC1.mag		Voltage phs BC(1)	0.000...4.000 [\times Un]
9452	u16	1000	.PPVPhsCA1.mag		Voltage phs CA(1)	0.000...4.000 [\times Un]
9453	u16	1000	.VRes1.mag		Voltage Uo(1)	0.000...4.000 [\times Un]
9454	u16	1000	.VZro1.mag		Voltage Zro-Seq(1)	0.000...4.000 [\times Un]
9455	u16	1000	.VPsSeq1.mag		Voltage Ps-Seq(1)	0.000...4.000 [\times Un]
9456	u16	1000	.VNgSeq1.mag		Voltage Ng-Seq(1)	0.000...4.000 [\times Un]
9457	u16	100	.MaxTmpRl.mag		PTTR thermal level	0.00...99.99
9458	u16	100	.AMaxNgPs.mag		PDNSPTOC1 ratio I2/I1	0.00...999.99 [%]
9459	i16	100	.HzRteChg.mag		Frequency gradient	-10.00...10.00 [Hz/s]
9460	i16	100	.CondNeut.mag		Conductance Yo	-1000.00...10 00.00 [mS]
9461	i16	100	.SusNeut.mag		Susceptance Yo	-1000.00...10 00.00 [mS]
9462	i32	100	.PPLoopRis.mag		Fault loop resistance	-1000.00...10 00.00 [ohm]
9463	i32				(Low word)	
9464	i32	100	.PPLoopReact.mag		Fault loop reactance	-1000.00...10 00.00 [ohm]
9465	i32				(Low word)	
9466	u16	1000	.CBCIrTm.mag		Breaker clear time	0.000...3.000 [s]
9467	u16	1000	.APhsA2.mag		Current phs A(2)	0.000...50.000 [\times In]

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9468	u16	1000	.APhsB2.mag		Current phs B(2)	0.000... 50.000 [$\times \ln$]
9469	u16	1000	.APhsC2.mag		Current phs C(2)	0.000... 50.000 [$\times \ln$]
9470	u16	1000	.ARes2.mag		Current Io(2)	0.000... 50.000 [$\times \ln$]
9471	u16	1000	.AResClc2.mag		Current Io-Calc(2)	0.000... 50.000 [$\times \ln$]
9472	u16	1000	.APsSeq2.mag		Current Ps-Seq(2)	0.000... 50.000 [$\times \ln$]
9473	u16	1000	.ANgSeq2.mag		Current Ng-Seq(2)	0.000... 50.000 [$\times \ln$]
9474	u16	1000	.PhVPhsA2.mag		Voltage phs A(2)	0.000...4.000 [$\times U_n$]
9475	u16	1000	.PhVPhsB2.mag		Voltage phs B(2)	0.000...4.000 [$\times U_n$]
9476	u16	1000	.PhVPhsC2.mag		Voltage phs C(2)	0.000...4.000 [$\times U_n$]
9477	u16	1000	.PPVPhsAB2.mag		Voltage phs AB(2)	0.000...4.000 [$\times U_n$]
9478	u16	1000	.PPVPhsBC2.mag		Voltage phs BC(2)	0.000...4.000 [$\times U_n$]
9479	u16	1000	.PPVPhsCA2.mag		Voltage phs CA(2)	0.000...4.000 [$\times U_n$]
9480	u16	1000	.VRes2.mag		Voltage Uo(2)	0.000...4.000 [$\times U_n$]
9481	u16	1000	.VZro2.mag		Voltage Zro-Seq(2)	0.000...4.000 [$\times U_n$]
9482	u16	1000	.VPsSeq2.mag		Voltage Ps-Seq(2)	0.000...4.000 [$\times U_n$]
9483	u16	1000	.VNgSeq2.mag		Voltage Ng-Seq(2)	0.000...4.000 [$\times U_n$]
9484	i16	100	.DifANAngVN1.mag.		Angle Uo-lo(1)	-180.00... 180.00 [deg]
9485	i16	100	.DifAAAngVBC1.mag.		Angle UBC-IA(1)	-180.00... 180.00 [deg]
9486	i16	100	.DifABAngVCA1.mag		Angle UCA-IB(1)	-180.00... 180.00 [deg]
9487	i16	100	.DifACAngVAB1.mag		Angle UAB-IC(1)	-180.00... 180.00 [deg]
9488	i16	100	.DifANAngVN2.mag.		Angle Uo-lo(2)	-180.00... 180.00 [deg]

Table continues on next page

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9489	i16	100	.DifAAAngVBC2.mag.		Angle UBC-IA(2)	-180.00...180.00 [deg]
9490	i16	100	.DifABAAngVCA2.mag		Angle UCA-IB(2)	-180.00...180.00 [deg]
9491	i16	100	.DifACAngVAB2.mag		Angle UAB-IC(2)	-180.00...180.00 [deg]

2.4.1.14 Protection relay's real-time clock (in local time mode) - read and write (synchronize)

Table 124: Protection relay's real-time clock (in local time mode) - read and write (synchronize)

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9201					Control register	0...2 ¹⁾
9202					Year	2000...2999
9203					Month	1...12
9204					Day	1...31
9205					Hour	0...23
9206					Minute	0...59
9207					Second	0...59
9208					Millisecond	0...999

1) See the technical manual.

2.4.1.15 Protection relay's real-time clock (in UTC time mode) - read and write (synchronize)

Table 125: Protection relay's real-time clock (in UTC time mode) - read and write (synchronize)

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9211					Control register	0...2 ¹⁾
9212					Year	2000...2999
9213					Month	1...12
9214					Day	1...31
9215					Hour	0...23
9216					Minute	0...59
9217					Second	0...59
9218					Millisecond	0...999

1) See the technical manual.

2.4.1.16 Indication bits mirrored in registers

Table 126: Indication bits mirrored in registers

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
170.00	Bit				Indication bit 2720 (0x1700)	
170.01	Bit				Indication bit 2721 (0x1701)	
:	:				:	
170.14	Bit				Indication bit 2734 (0x170E)	
170.15	Bit				Indication bit 2735 (0x170F)	
171.00	Bit				Indication bit 2736 (0x1710)	

2.4.1.17 SSR1 System status register (1) device health

Table 127: SSR1 System status register (1) device health

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
128.00	Bit				Device global error	1=Error
128.01	Bit				Device global warning	1=Warning
128.02	Bit				< reserved >	0
128.03	Bit				< reserved >	0
128.04	Bit				< reserved >	0
128.05	Bit				< reserved >	0
128.06	Bit				< reserved >	0
128.07	Bit				< reserved >	0
128.08	Bit				< reserved >	0
128.09	Bit				< reserved >	0
128.10	Bit				< reserved >	0
128.11	Bit				< reserved >	0
128.12	Bit				< reserved >	0
128.13	Bit				< reserved >	0
128.14	Bit				< reserved >	0
128.15	Bit				< reserved >	0

2.4.1.18 SSR2 System status register (2) protection relay's mode and state

Table 128: SSR2 System status register (2) protection relay's mode and state

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
129.00	Bit				Device test mode	1=Test mode
129.01	Bit				< reserved >	0
129.02	Bit				Remote/Local state	0/1=Rem/Loc
					Active setting group	SG=1...6
129.03	Bit				- bit 0	
129.04	Bit				- bit 1	
129.05	Bit				- bit 2	
129.06	Bit				Protection relay's timesynch failure	1=Failure
129.07	Bit				< reserved >	0
129.08	Bit				Last reset cause a	1=Cold start
129.09	Bit				Last reset cause b	1=Watchdog
129.10	Bit				Last reset cause c	1=Warm start
129.11	Bit				< reserved >	0
129.12	Bit				< reserved >	0
129.13	Bit				< reserved >	0
129.14	Bit				< reserved >	0
129.15	Bit				< reserved >	0

2.4.1.19 SSR3 System status register (3) data available 1 (client-dependent)

Table 129: SSR3 System status register (3) data available 1 (client-dependent)

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
130.00	Bit				Unread event records available	1=Available
130.01	Bit				Unread fault records available	1=Available
130.02	Bit				< reserved >	0
130.03	Bit				< reserved >	0
130.04	Bit				Any momentary bit updated	1=Updated
130.05	Bit				Any mcd bit set	1=Set
130.06	Bit				Device restart bit	1=IED restart
130.07	Bit				< reserved >	0
130.08	Bit				Event record selected	1=Selected
130.09	Bit				Fault record selected	1=Selected
130.10	Bit				< reserved >	0

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
130.11	Bit				< reserved >	0
130.12	Bit				< reserved >	0
130.13	Bit				< reserved >	0
130.14	Bit				< reserved >	0
130.15	Bit				< reserved >	0

2.4.1.20 SSR4 System status register (4) data available 2 (client-dependent, user-definable)

Table 130: *SSR4 System status register (4) data available 2 (client-dependent, user-definable)*

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
131.00	Bit				Data category 1 has changed	1=Changed
131.01	Bit				Data category 2 has changed	1=Changed
131.02	Bit				Data category 3 has changed	1=Changed
131.03	Bit				Data category 4 has changed	1=Changed
131.04	Bit				Data category 5 has changed	1=Changed
131.05	Bit				Data category 6 has changed	1=Changed
131.06	Bit				Data category 7 has changed	1=Changed
131.07	Bit				Data category 8 has changed	1=Changed
131.08	Bit				Data category 9 has changed	1=Changed
131.09	Bit				Data category 10 has changed	1=Changed
131.10	Bit				Data category 11 has changed	1=Changed
131.11	Bit				Data category 12 has changed	1=Changed
131.12	Bit				Data category 13 has changed	1=Changed
131.13	Bit				Data category 14 has changed	1=Changed
131.14	Bit				Data category 15 has changed	1=Changed
131.15	Bit				Data category 16 has changed	1=Changed

2.4.1.21 SSR5 System status register (5) device alive register

Table 131: *SSR5 System status register (5) device alive register*

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
132	u16	1			Device alive counter	0...65535

2.4.1.22

SSR6 System status register (6) control command status (client-dependent)**Table 132:** *SSR6 System status register (6) control command status (client-dependent)*

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
					Last cmd result code	1)
133.00	Bit				- bit 0	
133.01	Bit				- bit 1	
133.02	Bit				- bit 2	
133.03	Bit				- bit 3	
133.04	Bit				- bit 4	
133.05	Bit				- bit 5	
133.06	Bit				- bit 6	
133.07	Bit				- bit 7	
					Response Type	1)
133.08	Bit				- bit 0	
133.09	Bit				- bit 1	
					Command state	1)
133.10	Bit				- bit 0	
133.11	Bit				- bit 1	
					Cmd sequence number	0...15
133.12	Bit				- bit 0	
133.13	Bit				- bit 1	
133.14	Bit				- bit 2	
133.15	Bit				- bit 3	

1) See the technical manual.

2.4.1.23

System diagnostic values**Table 133:** *System diagnostic values*

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.LPHD1			
2060	u16	1	.PhyHealth1.stVal	Warning	Last warning code	1)
2061	u16	1	.PhyHealth2.stVal	Internal fault	Last internal fault code	1)
			DR.RDRE1			
2062	u16	1	.FitNum.stVal		Num. of DR recordings	0...N
2063	u16	1	.MemUsed.stVal		DR memory used	0...100 [%]

Table continues on next page

Section 2 Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.LPHD1			
2064	u16	1	.NumPwrUp.stVal		Num. of cold starts	0...65535
2065	u16	1	.WrmStr.stVal		Num. of warm starts	0...65535
2066	u16	1	.WacTrg.stVal		Num. of watchdog resets	0...65535
2067	u16	1	.NumCmpChg.stVal		Num. of conf. changes	0...65535
			LD0.LLN0			
	u16	1	.ParChgCnt.stVal		Num. of setting changes	0...65535

1) See the technical manual.

2.4.1.24 Time and reason for latest protection relay reset

Table 134: *Time and reason for latest protection relay reset*

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
9221	u16	1			Year	2000...2999
9222	u16	1			Month	1...12
9223	u16	1			Day	1...31
9224	u16	1			Hour	0...23
9225	u16	1			Minute	0...59
9226	u16	1			Second	0...59
9227	u16	1			Millisecond	0...999
9228	u16	1			Reset reason	
9228.0	Bit				- bit 0	1=Cold start
9228.1	Bit				- bit 1	1=Watchdog
9228.2	Bit				- bit 2	1=Warm start

2.4.1.25 User-definable bits [Alt.2], visible on 0x,1x,3x and 4x

Table 135: *User-definable bits [Alt.2], visible on 0x,1x,3x and 4x*

BitA	Type	Scale	IEC 61850 name	SA name	Description	Values
(0)	Bit				< not mappable - not visible >	
1	Bit				Usr reg 1.Bit 01	
2	Bit				Usr reg 1.Bit 02	
3	Bit				Usr reg 1.Bit 03	
:	:				:	
:	:				:	
15	Bit				Usr reg 1.Bit 15	

Table continues on next page

BitA	Type	Scale	IEC 61850 name	SA name	Description	Values
16	Bit				Usr reg 2.Bit 00	
17	Bit				Usr reg 2.Bit 01	
:	:				:	
:	:				:	
2046	Bit				Usr reg 127.Bit 14	
2047	Bit				Usr reg 127.Bit 15	

2.4.1.26 User-definable registers [Alt.1], visible on 3x and 4x

Table 136: *User-definable registers [Alt.1], visible on 3x and 4x*

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
(0)	Reg				< not mappable - not visible >	
1	Reg				User register 1	
2	Reg				User register 2	
3	:				:	
:	:				:	
:	:				:	
127	Reg				User register 127	

2.4.1.27 CTRL.CBCSWI1 Circuit breaker operation counter (1)

Table 137: *CTRL.CBCSWI1 Circuit breaker operation counter (1)*

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			CTRL.CBCSWI1			
2053	u16	1	.OpCntRs.stVal	Operation counter	Operation counter	0...65535

2.4.1.28 LD0.ARCSARCx1 Arc protection – AFD

Table 138: *LD0.ARCSARCx1 Arc protection – AFD*

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.ARCSARC11			
2054	u16	1	.FACntRs.stVal		Fault arc 1 counter	0...65535
			LD0.ARCSARC21			
2055	u16	1	.FACntRs.stVal		Fault arc 2 counter	0...65535
			LD0.ARCSARC31			
2056	u16	1	.FACntRs.stVal		Fault arc 3 counter	0...65535

Section 2

Modbus data mappings

1MAC203705-MB A

2.4.1.29

LD0.CMMXU1 Phase current demand values (1) – IA, IB, IC

Table 139: LD0.CMMXU1 Phase current demand values (1) – IA, IB, IC

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.CAVMMXU1		Demand value	
2001	u16	1000	.A.phsA.cVal.mag	I_DMD_A	Phs A amplitude	0.00...50.0 [xIn]
2002	u16	1000	.A.phsB.cVal.mag	I_DMD_B	Phs B amplitude	0.00...50.0 [xIn]
2003	u16	1000	.A.phsB.cVal.mag	I_DMD_C	Phs C amplitude	0.00...50.0 [xIn]
2004					Year - month	
2005					Day - hour	
2006					Minute - second	
2007					Milliseconds	
2008					Time quality	
			LD0.CMAMMXU1		Max demand values	
2009	u16	1000	.A.phsA.cVal.mag	Max demand IL1	Phs A amplitude	0.00...50.0 [xIn]
2010					Year - month	
2011					Day - hour	
2012					Minute - second	
2013					Milliseconds	
2014					Time quality	
2015	u16	1000	.A.phsB.cVal.mag	Max demand IL2	Phs B amplitude	0.00...50.0 [xIn]
2016					Year - month	
2017					Day - hour	
2018					Minute - second	
2019					Milliseconds	
2020					Time quality	
2021	u16	1000	.A.phsC.cVal.mag	Max demand IL2	Phs C amplitude	0.00...50.0 [xIn]
2022					Year - month	
2023					Day - hour	
2024					Minute - second	
2025					Milliseconds	
2026					Time quality	
			LD0.CMIMMXU1		Min demand values	

Table continues on next page

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
	u16	1000	.A.phsA.cVal.mag	Max demand IL1	Phs A amplitude	0.00...50.0 [xIn]
	u16	1000	.A.phsB.cVal.mag	Max demand IL2	Phs B amplitude	0.00...50.0 [xIn]
	u16	1000	.A.phsC.cVal.mag	Max demand IL3	Phs C amplitude	0.00...50.0 [xIn]

2.4.1.30 LD0.CMMXU1 Three-phase current measurement (1) – IA, IB, IC

Table 140: LD0.CMMXU1 Three-phase current measurement (1) – IA, IB, IC

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.CMMXU1		Phase current (1)	
138	u16	1000	.A.phsA.instCVal.mag	I_INST_A	Phs A amplitude	0.00...40.0 [xIn]
139	u16	1000	.A.phsB.instCVal.mag	I_INST_B	Phs B amplitude	0.00...40.0 [xIn]
140	u16	1000	.A.phsC.instCVal.mag	I_INST_C	Phs C amplitude	0.00...40.0 [xIn]

2.4.1.31 LD0.CMMXU2 Phase current demand values (2) – IA, IB, IC (2)

Table 141: LD0.CMMXU2 Phase current demand values (2) – IA, IB, IC (2)

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.CMMXU2		Demand value	
2027	u16	1000	.AvAmpsA.mag	I_DMD_A	Phs A amplitude	0.00...40.0 [xIn]
2028	u16	1000	.AvAmpsB.mag	I_DMD_B	Phs B amplitude	0.00...40.0 [xIn]
2029	u16	1000	.AvAmpsC.mag	I_DMD_C	Phs C amplitude	0.00...40.0 [xIn]
					Update time stamp	See doc.
2030	u16	-			Year - month	
2031	u16	-			Day - hour	
2032	u16	-			Minute - second	
2033	u16	-			Milliseconds	
2034	u16	-			Time quality	
2035	u16	1000	.MaxAmpsA.mag	Max demand IL1	Max. phs A demand	0.00...40.0 [xIn]
					Update time stamp	See doc.

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
2036	u16	-			Year - month	
2037	u16	-			Day - hour	
2038	u16	-			Minute - second	
2039	u16	-			Milliseconds	
2040	u16	-			Time quality	
2041	u16	1000	.MaxAmpsB.mag	Max demand IL2	Max. phs B demand	0.00...40.0 [xIn]
					Update time stamp	See doc.
2042	u16	-			Year - month	
2043	u16	-			Day - hour	
2044	u16	-			Minute - second	
2045	u16	-			Milliseconds	
2046	u16	-			Time quality	
2047	u16	1000	.MaxAmpsC.mag	Max demand IL3	Max. phsC demand	0.00...40.0 [xIn]
					Update time stamp	see doc.
2048	u16	-			Year - month	
2049	u16	-			Day - hour	
2050	u16	-			Minute - second	
2051	u16	-			Milliseconds	
2052	u16	-			Time quality	

2.4.1.32 LD0.CMMXU2 Three-phase current measurement (2) – IA, IB, IC (2)

Table 142: LD0.CMMXU2 Three-phase current measurement (2) – IA, IB, IC (2)

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.CMMXU2		Phase current (2)	
152	u16	1000	.A.phsA.instCVal.mag	I_INST_A	Phs A amplitude	0.00...40.0 [xIn]
153	u16	1000	.A.phsB.instCVal.mag	I_INST_B	Phs B amplitude	0.00...40.0 [xIn]
154	u16	1000	.A.phsC.instCVal.mag	I_INST_C	Phs C amplitude	0.00...40.0 [xIn]

2.4.1.33 LD0.CSMSQI1 Sequence current measurement (1) – I1, I2, I0

Table 143: LD0.CSMSQI1 Sequence current measurement (1) – I1, I2, I0

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.CSMSQI1		Sequence of currents	
142	u16	1000	.SeqA.c1.instCVal.mag	I1_INST	Positive amplitude	0.00...40.0 [xIn]
143	u16	1000	.SeqA.c2.instCVal.mag	I2_INST	Negative amplitude	0.00...40.0 [xIn]
144	u16	1000	.SeqA.c2.instCVal.mag	I3_INST	Zero amplitude	0.00...40.0 [xIn]

2.4.1.34 LD0.PEMMTR1 Three-phase energy measurements

Table 144: LD0.PEMMTR1 Three-phase energy measurements

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.PEMMTR1			
2100	u32	1	.SupWh.actVal		Reverse active energy (high)	0..1E10 [kWh]
2101			.SupWh.actVal		(low word)	
2102	u32	1	.SupVArh.actVal		Reverse reactive energy (high)	0..1E10 [kVArh]
2103			.SupVArh.actVal		(low word)	
2104	u32	1	.DemWh.actVal		Forward active energy (high)	0..1E10 [kWh]
2105			.DemWh.actVal		(low word)	
2106	u32	1	.DemVArh.actVal		Forward reactive energy (high)	0..1E10 [kVArh]
2107			.DemVArh.actVal		(low word)	

2.4.1.35 LD0.PEMMXU1 Power measurement demand values (1) – P, E-1

Table 145: LD0.PEMMXU1 Power measurement demand values (1) – P, E-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.PEAVMMXU1		Demand value	
1939	i32	1	.TotW.mag		Active power P (high)	-/+ 999,999
1940					(Low word)	
1941	i32	1	.TotVAr.mag		Reactive power Q (high)	-/+ 999,999
1942					(Low word)	
1943	i32	1	.TotVA.mag		Apparent power S (high)	-/+ 999,999
1944					(Low word)	

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
1945	i16	1000	.TotPF.mag		Power factor	-1...1
			LD0.PEMAMMMXU1		Max demand value	
	i32	1	.TotW.mag		Active power P	-/+ 999,999
	i32	1	.TotVAr.mag		Reactive power Q	-/+ 999,999
	i32	1	.TotVA.mag		Apparent power S	-/+ 999,999
			LD0.PEMIMMMXU1		Min demand value	
	i32	1	.TotW.mag		Active power P	-/+ 999,999
	i32	1	.TotVAr.mag		Reactive power Q	-/+ 999,999
	i32	1	.TotVA.mag		Apparent power S	-/+ 999,999

2.4.1.36

LD0.PEMMXU1 Three-phase power and energy measurement (1) – P, E-1

Table 146: LD0.PEMMXU1 Three-phase power and energy measurement (1) – P, E-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.PEMMXU1			
163	i32	1	.TotW.instMag	P_INST	Total active power P (high)	-/+ 999,999
164			.TotW.instMag		(Low word)	
165	i32	1	.TotVAr.instMag	Q_INST	Total reactive power Q (high)	-/+ 999,999
166			.TotVAr.instMag		(Low word)	
167	i32	1	.TotVA.instMag	S_INST	Total apparent power S (high)	-/+ 999,999
168			.TotVA.instMag		(Low word)	
169	i16	1000	.TotPF.instMag	PF_INST	Average power factor	-1...1

2.4.1.37

LD0.RESCMMXU1 Residual current demand value (1) – IG-1

Table 147: LD0.RESCMMXU1 Residual current demand value (1) – IG-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.RCAVMMXU1		Demand value	
1989	u16	1000	.A.res.cVal.mag	I_DMD_RES	Residual amplitude	0.00...50.0 [xIn]
1990					Year - month	
1991					Day - hour	
1992					Minute - second	
1993					Milliseconds	
1994					Time quality	
			LD0.RCMAMMMXU1		Max. demand value	

Table continues on next page

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
1995	u16	1000	.A.res.cVal.mag	Max demand Io	Residual amplitude	0.00...50.0 [xIn]
1996					Year - month	
1997					Day - hour	
1998					Minute - second	
1999					Milliseconds	
2000					Time quality	
			LD0.RESCMMXU1		Min. demand value	
	u16	1000	.A.res.cVal.mag	Min demand Io	Residual amplitude	0.00...50.0 [xIn]

2.4.1.38 LD0.RESCMMXU1 Residual current measurement (1) – IG-1

Table 148: LD0.RESCMMXU1 Residual current measurement (1) – IG-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.RESCMMXU1		Residual current (1)	
141	u16	1000	.A.res.instCVal.mag	I0_INST	- amplitude	0.00...40.0 [xIn]

2.4.1.39 LD0.RESCMMXU2 Residual current demand value (2) – IG-2

Table 149: LD0.RESCMMXU2 Residual current demand value (2) – IG-2

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.RESCMMXU2		Demand value	
1965	u16	1000	.AvAmps.mag	I_DMD_RES	Residual amplitude	0.00..40.0 [xIn]
					Update time stamp	1)
1966	u16	-			- Year - month	
1967	u16	-			Day - hour	
1968	u16	-			Minute - second	
1969	u16	-			Milliseconds	
1970	u16	-			- Time quality	
1971	u16	1000	.MaxAmps.mag	Max demand Io	Max Io demand	0.00..40.0 [xIn]
					Update time stamp	1)
1972	u16	-			Year - month	
1973	u16	-			Day - hour	

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
1974	u16	-			Minute - second	
1975	u16	-			Milliseconds	
1976	u16	-			Time quality	

1) See the technical manual.

2.4.1.40 LD0.RESCMMXU2 Residual current measurement (2) – IG-2

Table 150: LD0.RESCMMXU2 Residual current measurement (2) – IG-2

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.RESCMMXU2		Residual current (2)	
155	u16	1000	.A.res.instCVal.mag	I0_INST	Amplitude	0.00...40.0 [xUn]

2.4.1.41 LD0.RESVMMXU1 Residual voltage demand value (1) – VG-1

Table 151: LD0.RESVMMXU1 Residual voltage demand value (1) – VG-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.RVAVMMXU1		Demand value	
1977	u16	1000	.PhV.res.cVal.mag	U_DMD_RES	Residual amplitude	0.00...4.0 [xUn]
1978					Year - month	
1979					Day - hour	
1980					Minute - second	
1981					Milliseconds	
1982					Time quality	
			LD0.RVMAMMXU1		Max. demand value	
1983	u16	1000	.PhV.res.cVal.mag	Max demand Uo	Residual amplitude	0.00...4.0 [xUn]
1984					Year - month	
1985					Day - hour	
1986					Minute - second	
1987					Milliseconds	
1988					Time quality	
			LD0.RVMIMMXU1		Min. demand value	
	u16	1000	.PhV.res.cVal.mag	Min demand Io	Residual amplitude	0.00...4.0 [xUn]

2.4.1.42 LD0.RESVMMXU1 Residual voltage measurement (1) – VG-1
Table 152: LD0.RESVMMXU1 Residual voltage measurement (1) – VG-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.RESVMMXU1		Residual voltage (1)	
137	u16	1000	.A.res.instCVal.mag	U0_INST	- amplitude	0.00..4.00 [xUn]

2.4.1.43 LD0.SSCBR1 Circuit-breaker condition monitoring (1) – 52CM-1
Table 153: LD0.SSCBR1 Circuit-breaker condition monitoring (1) – 52CM-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.SSCBR1			
2070	u16	1	.InaTmdCnt.stVal	INA_DAYS	CB inactive days	0..65535
2071	u16	1	.TmmsOprn.mag	T_TRV_OP	Open travel time	0..60000 [ms]
2072	u16	1	.TmmsClz.mag	T_TRV_CL	Close travel time	0..60000 [ms]
2073	u16	100	.TmsSprChz.mag	T_SPR_CHR	Spring charge time	0.00...99.99 [s]
2074	i16	1	.RmnLifPhA.stVal	CB_LIFE_A	Remain.life phs A	-/+ 9999
2075	i16	1	.RmnLifPhB.stVal	CB_LIFE_B	Remain.life phs B	-/+ 9999
2076	i16	1	.RmnLifPhC.stVal	CB_LIFE_C	Remain.life phs C	-/+ 9999
2077	u16	1	.AccAPwrPhA.mag	IPOW_A	Iyt phs A	0..1E6
2078	u16	1	.AccAPwrPhB.mag	IPOW_B	Iyt phs B	0..1E6
2079	u16	1	.AccAPwrPhC.mag	IPOW_C	Iyt phs C	0..1E6

2.4.1.44 LD0.T2PTTR1 Three-phase thermal overload protection, two time constants (2) – 49T-1
Table 154: LD0.T2PTTR1 Three-phase thermal overload protection, two time constants (2) – 49T-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.T2PTTR1			
146	i16	1	.Tmp.mag	TEMP	Object temperature	-100.0...9999.9 [C]
147	u16	1	.TmpRI.mag	TEMP_RL	Relative temperature	0.00...99.99 [C]
2068	u16	1	.TmsOp.stVal	THERMLEV_ST	Est. time to operate	0...60000 [s]
2069	u16	1	.TmsRecEna.stVal	THERMLEV_END	Est. time to deactivate block	0...60000 [s]

2.4.1.45 LD0.TPOSYLTc1 Tap changer position indication (1) – 84T-1

Table 155: LD0.TPOSYLTc1 Tap changer position indication (1) – 84T-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.TPOSYLTc1			
151	i16	1	.TapPos.valWTr.posVal	TAP_POS	Tap changer position	-64...63

2.4.1.46 LD0.TR2PTDF1 Stabilized and instantaneous differential protection for two-winding transformers (1)LD0.TR2PTDF1 Stabilized and instantaneous differential protection for two-winding transformers (1) – 87T-1

Table 156: LD0.TR2PTDF1 Stabilized and instantaneous differential protection for two-winding transformers (1)

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.TR2PTDF1		Differential current	
2080	u16	1000	.DifAClc.phsA.mag		Phs A magnitude	0...40.00 [xIn]
2081	u16	1000	.DifAClc.phsB.mag		-Phs B magnitude	0...40.00 [xIn]
2082	u16	1000	.DifAClc.phsC.mag		Phs C magnitude	0...40.00 [xIn]
			LD0.TR2PTDF1		Bias current	
2083	u16	1000	.RstA.phsA.mag		Phs A magnitude	0...40.00 [xIn]
2084	u16	1000	.RstA.phsB.mag		Phs B magnitude	0...40.00 [xIn]
2085	u16	1000	.RstA.phsC.mag		Phs C magnitude	0...40.00 [xIn]

Table 157: LD0.TR2PTDF1 Stabilized and instantaneous differential protection for two-winding transformers (1) – 87T-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.TR2PTDF1		Differential current	
2080	u16	1000	.DifAClc.phsA.mag		Phs A magnitude	0...40.00 [xIn]
2081	u16	1000	.DifAClc.phsB.mag		-Phs B magnitude	0...40.00 [xIn]
2082	u16	1000	.DifAClc.phsC.mag		Phs C magnitude	0...40.00 [xIn]
			LD0.TR2PTDF1		Bias current	
2083	u16	1000	.RstA.phsA.mag		Phs A magnitude	0...40.00 [xIn]
2084	u16	1000	.RstA.phsB.mag		Phs B magnitude	0...40.00 [xIn]
2085	u16	1000	.RstA.phsC.mag		Phs C magnitude	0...40.00 [xIn]

2.4.1.47

LD0.VMMXU1 Three-phase voltage measurement (1) – VA, VB, VC

Table 158: LD0.VMMXU1 Three-phase voltage measurement (1) – VA, VB, VC

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.VMMXU1		Phase-ground voltage (1)	
134	u16	1000	.phV.phsA.cVal.mag	U_DB_A	Phs A amplitude	0.00..4.00 [xUn]
135	u16	1000	.phV.phsB.cVal.mag	U_DB_B	Phs B amplitude	0.00..4.00 [xUn]
136	u16	1000	.phV.phsC.cVal.mag	U_DB_C	Phs C amplitude	0.00..4.00 [xUn]
:			LD0.VMMXU1		Phase-phase voltage (1)	
160	u16	1000	.PPV.phsAB.cVal.mag	U_DB_AB	Phs AB amplitude	0.00..4.00 [xUn]
161	u16	1000	.PPV.phsBC.cVal.mag	U_DB_BC	Phs BC amplitude	0.00..4.00 [xUn]
162	u16	1000	.PPV.phsCA.cVal.mag	U_DB_CA	Phs CA amplitude	0.00..4.00 [xUn]

2.4.1.48

LD0.VAVMMXU1 Voltage demand values (1) – VA, VB, VC

Table 159: LD0.VAVMMXU1 Voltage demand values (1) – VA, VB, VC

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.VAVMMXU1		Demand value	
1954	u16	1000	.PhV.phsA.cVal.mag	U_DMD_A	Phs A amplitude	0.00...4.0 [xUn]
1955	u16	1000	.PhV.phsB.cVal.mag	U_DMD_B	Phs B amplitude	0.00...4.0 [xUn]
1956	u16	1000	.PhV.phsC.cVal.mag	U_DMD_C	Phs C amplitude	0.00...4.0 [xUn]
1957	u16	1000	.PPV.phsAB.cVal.mag	U_DMD_AB	Phs AB amplitude	0.00...4.0 [xUn]
1958	u16	1000	.PPV.phsBC.cVal.mag	U_DMD_BC	Phs BC amplitude	0.00...4.0 [xUn]
1959	u16	1000	.PPV.phsCA.cVal.mag	U_DMD_CA	Phs CA amplitude	0.00...4.0 [xUn]

2.4.1.49 LD0.VSMSQI1 Sequence voltage measurement (1) – V1, V2, V0

Table 160: LD0.VSMSQI1 Sequence voltage measurement (1) – V1, V2, V0

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.VSMSQI1		Sequence of voltages	
148	u16	1000	.SeqA.c1.instCVal.mag	U1_INST	Positive amplitude	0.00...4.00 [xUn]
149	u16	1000	.SeqA.c2.instCVal.mag	U2_INST	Negative amplitude	0.00...4.00 [xUn]
150	u16	1000	.SeqA.c2.instCVal.mag	U3_INST	Zero amplitude	0.00...4.00 [xUn]

2.4.1.50 LD0.XARGGIO130 RTD input values

Table 161: LD0.XARGGIO130 RTD input values

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.XARGGIO130			
2091	i16	1	.AnIn1.mag	AI_VAL1	RTD input 1 in ohms	-/+ 10000.00
2092	i16	1	.AnIn2.mag	AI_VAL2	RTD input 2 in ohms	-/+ 10000.00
2093	i16	1	.AnIn3.mag	AI_VAL3	RTD input 3 in ohms	-/+ 10000.00
2094	i16	1	.AnIn4.mag	AI_VAL4	RTD input 4 in ohms	-/+ 10000.00

2.4.1.51 LD0.XRGGIO130 RTD input values

Table 162: LD0.XRGGIO130 RTD input values

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.XRGGIO130			
2091	i16	1	.AnIn1.mag	AI_VAL1	RTD input 1 in ohms	-/+ 10000.00
2092	i16	1	.AnIn2.mag	AI_VAL2	RTD input 2 in ohms	-/+ 10000.00
2093	i16	1	.AnIn3.mag	AI_VAL3	RTD input 3 in ohms	-/+ 10000.00
2094	i16	1	.AnIn4.mag	AI_VAL4	RTD input 4 in ohms	-/+ 10000.00
2095	i16	1	.AnIn5.mag	AI_VAL5	RTD input 5 in ohms	-/+ 10000.00
2096	i16	1	.AnIn6.mag	AI_VAL6	RTD input 6 in ohms	-/+ 10000.00
2097	i16	1	.AnIn7.mag	AI_VAL7	RTD input 7 in ohms	-/+ 10000.00
2098	i16	1	.AnIn8.mag	AI_VAL8	RTD input 8 in ohms	-/+ 10000.00

2.4.2 Unmapped registers

Unmapped registers are register data that have no initial Modbus mapping locations, but can be added to the user-definable Modbus area using the Communication Management tool in PCM600. The initial register type settings of these objects have little meaning, since it is always possible to redefine the settings completely for the user-definable register.

2.4.2.1 CTRL.LLN0 Local, Remote, Station, Off and Combinations

Table 163: CTRL.LLN0 Local, Remote, Station, Off and Combinations

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			CTRL.LLN0			
	u16	1	.LocKeyHMI.stVal		0=Off; 1=Loc; 2=Rem; 3=Stat; 4=L+R; 5=L+S; 6=L+S+R; 7=S+R	0...7

2.4.2.2 LD0.FMMXU1 Frequency measurement (1) – f-1

Table 164: LD0.FMMXU1 Frequency measurement (1) – f-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.FMMXU1			
	u16	100	.Hz.mag	F_DB	Frequency	35.00...75.00 [Hz]

2.4.2.3 LD0.LLN0/LPHD1/LDEV1 System values

Table 165: LD0.LLN0/LPHD1/LDEV1 System values

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.LLN0			
	u16	1	.ParChgCnt.stVal		Num. of setting changes	0...65535

2.4.2.4 LD0.MDSOPT1 Runtime counter for machines and devices (1) – OPTM-1

Table 166: LD0.MDSOPT1 Runtime counter for machines and devices (1) – OPTM-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.MDSOPT1			
	u16	1	.OpTmh.stVal	OPR_TIME	Total operation hours	0...299999

2.4.2.5 LD0.MVI4GAPC1 Integer value move (1) – MVI4-1

Table 167: LD0.MVI4GAPC1 Integer value move (1) – MVI4-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.MVI4GAPC1			
	i32	1	.ISCS01.stVal	OUT1	- Integer value 1 (high)	-/+2147483647
					- Low word	
	i32	1	.ISCS02.stVal	OUT2	- Integer value 2 (high)	-/+2147483647
					- Low word	
	i32	1	.ISCS03.stVal	OUT3	- Integer value 3 (high)	-/+2147483647
					- Low word	
	i32	1	.ISCS04.stVal	OUT4	- Integer value 4 (high)	-/+2147483647
					- Low word	

2.4.2.6 LD0.SCA4GAPC1 Analog value scaling (1) – SCA4-1

Table 168: LD0.SCA4GAPC1 Analog value scaling (1) – SCA4-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.SCA4GAPC1			
	i16	1000	.AnValOut1.mag	AO1_VALUE	Analog value 1 after scaling	0...N
	i16	1000	.AnValOut2.mag	AO2_VALUE	Analog value 2 after scaling	0...N
	i16	1000	.AnValOut3.mag	AO3_VALUE	Analog value 3 after scaling	0...N
	i16	1000	.AnValOut4.mag	AO4_VALUE	Analog value 4 after scaling	0...N

2.4.2.7 LD0.SCA4GAPC2 Analog value scaling (2) – SCA4-2

Table 169: LD0.SCA4GAPC2 Analog value scaling (2) – SCA4-2

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.SCA4GAPC2			
	i16	1000	.AnValOut1.mag	AO1_VALUE	Analog value 1 after scaling	0...N
	i16	1000	.AnValOut2.mag	AO2_VALUE	Analog value 2 after scaling	0...N
	i16	1000	.AnValOut3.mag	AO3_VALUE	Analog value 3 after scaling	0...N
	i16	1000	.AnValOut4.mag	AO4_VALUE	Analog value 4 after scaling	0...N

2.4.2.8

LD0.SCA4GAPC3 Analog value scaling (3) – SCA4-3

Table 170: LD0.SCA4GAPC3 Analog value scaling (3) – SCA4-3

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.SCA4GAPC3			
	i16	1000	.AnValOut1.mag	AO1_VALUE	Analog value 1 after scaling	0...N
	i16	1000	.AnValOut2.mag	AO2_VALUE	Analog value 2 after scaling	0...N
	i16	1000	.AnValOut3.mag	AO3_VALUE	Analog value 3 after scaling	0...N
	i16	1000	.AnValOut4.mag	AO4_VALUE	Analog value 4 after scaling	0...N

2.4.2.9

LD0.SCA4GAPC4 Analog value scaling (4) – SCA4-4

Table 171: LD0.SCA4GAPC4 Analog value scaling (4) – SCA4-4

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.SCA4GAPC4			
	i16	1000	.AnValOut1.mag	AO1_VALUE	Analog value 1 after scaling	0...N
	i16	1000	.AnValOut2.mag	AO2_VALUE	Analog value 2 after scaling	0...N
	i16	1000	.AnValOut3.mag	AO3_VALUE	Analog value 3 after scaling	0...N
	i16	1000	.AnValOut4.mag	AO4_VALUE	Analog value 4 after scaling	0...N

2.4.2.10

LD0.SPEMMTR1 Single-phase power and energy measurement (1)

Table 172: LD0.SPEMMTR1 Single-phase power and energy measurement (1)

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.SPE1MMTR1			
	u32	1	.SupWh.actVal		Accumulated Reverse active energy (high) , phase A	0...1E10 [kWh]
			.SupWh.actVal		(low word)	
	u32	1	.SupVArh.actVal		Accumulated Reverse reactive energy (high) , phase A	0...1E10 [kWh]
			.SupVArh.actVal		(low word)	
	u32	1	.DmdWh.actVal		Accumulated Forward active energy (high) , phase A	0...1E10 [kWh]
			.DmdWh.actVal		(low word)	
	u32	1	.DmdVArh.actVal		Accumulated Forward reactive energy (high) , phase A	0...1E10 [kWh]
			.DmdVArh.actVal		(low word)	

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
	u32	1	.EnValRs.Oper.ctlVal		Reset of accumulated energy reading	0...1E10
						[kWh]
			.EnValRs.Oper.ctlVal		(low word)	
			LD0.SPE2MMTR1			
	u32	1	.SupWh.actVal		Accumulated Reverse active energy (high) , phase B	0...1E10
						[kWh]
			.SupWh.actVal		(low word)	
	u32	1	.SupVArh.actVal		Accumulated Reverse reactive energy (high) , phase B	0...1E10
						[kWh]
			.SupVArh.actVal		(low word)	
	u32	1	.DmdWh.actVal		Accumulated Forward active energy (high) , phase B	0...1E10
						[kWh]
			.DmdWh.actVal		(low word)	
	u32	1	.DmdVArh.actVal		Accumulated Forward reactive energy (high) , phase B	0...1E10
						[kWh]
			.DmdVArh.actVal		(low word)	
			LD0.SPE3MMTR1			
	u32	1	.SupWh.actVal		Accumulated Reverse active energy (high) , phase C	0...1E10
						[kWh]
			.SupWh.actVal		(low word)	
	u32	1	.SupVArh.actVal		Accumulated Reverse reactive energy (high) , phase C	0...1E10
						[kWh]
			.SupVArh.actVal		(low word)	
	u32	1	.DmdWh.actVal		Accumulated Forward active energy (high) , phase C	0...1E10
						[kWh]
			.DmdWh.actVal		(low word)	
	u32	1	.DmdVArh.actVal		Accumulated Forward reactive energy (high) , phase C	0...1E10
						[kWh]
			.DmdVArh.actVal		(low word)	

2.4.2.11

LD0.SPEMMXU1 Single-phase power and energy measurement demand values (1) – SP, SE-1

Table 173: LD0.SPEMMXU1 Single-phase power and energy measurement demand values (1) – SP, SE-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.SPEAVMMXU1		Demand value	
i32	1	.W.phsA.cVal.mag			Active power P (high) , phase A	-/+ 999,999
		.			(low word)	
i32	1	.W.phsB.cVal.mag			Active power P (high) , phase B	-/+ 999,999
		.			(low word)	
i32	1	.W.phsC.cVal.mag			Active power P (high) , phase C	-/+ 999,999
		.			(low word)	
i32	1	.VAr.phsA.cVal.mag			Reactive power Q (high) , phase A	-/+ 999,999
		.			(low word)	
i32	1	.VAr.phsB.cVal.mag			Reactive power Q (high), phase B	-/+ 999,999
		.			(low word)	
i32	1	.VAr.phsC.cVal.mag			Reactive power Q (high) , phase C	-/+ 999,999
		.			(low word)	
i32	1	.VA.phsA.cVal.mag			Apparent power S (high) , phase A	-/+ 999,999
		.			(low word)	
i32	1	.VA.phsB.cVal.mag			Apparent power S (high), phase B	-/+ 999,999
		.			(low word)	
i32	1	.VA.phsC.cVal.mag			Apparent power S (high) , phase C	-/+ 999,999
		.			(low word)	
i16	1000	.PF.phsA.cVal.mag			Power factor , phase A	-1...1
i16	1000	.PF.phsB.cVal.mag			Power factor, phase B	-1...1
i16	1000	.PF.phsC.cVal.mag			Power factor , phase C	-1...1
		LD0.SPEMAMMXU1			Max demand value	
i32	1	.W.phsA.cVal.mag			Active power P, phase A	-/+ 999,999
i32	1	.W.phsB.cVal.mag			Active power P, phase B	-/+ 999,999
i32	1	.W.phsC.cVal.mag			Active power P, phase C	-/+ 999,999
i32	1	.VAr.phsA.cVal.mag			Reactive power Q, phase A	-/+ 999,999
i32	1	.VAr.phsB.cVal.mag			Reactive power Q, phase B	-/+ 999,999
i32	1	.VAr.phsC.cVal.mag			Reactive power Q, phase C	-/+ 999,999

Table continues on next page

Section 2

Modbus data mappings

1MAC203705-MB A

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
	i32	1	.VA.phsA.cVal.mag		Apparent power S, phase A	-/+ 999,999
	i32	1	.VA.phsB.cVal.mag		Apparent power S, phase B	-/+ 999,999
	i32	1	.VA.phsC.cVal.mag		Apparent power S, phase C	-/+ 999,999
			LD0.SPEMIMMXU1		Min demand value	
	i32	1	.W.phsA.cVal.mag		Active power P, phase A	-/+ 999,999
	i32	1	.W.phsB.cVal.mag		Active power P, phase B	-/+ 999,999
	i32	1	.W.phsC.cVal.mag		Active power P, phase C	-/+ 999,999
	i32	1	.VAr.phsA.cVal.mag		Reactive power Q, phase A	-/+ 999,999
	i32	1	.VAr.phsB.cVal.mag		Reactive power Q, phase B	-/+ 999,999
	i32	1	.VAr.phsC.cVal.mag		Reactive power Q, phase C	-/+ 999,999
	i32	1	.VA.phsA.cVal.mag		Apparent power S, phase A	-/+ 999,999
	i32	1	.VA.phsB.cVal.mag		Apparent power S, phase B	-/+ 999,999
	i32	1	.VA.phsC.cVal.mag		Apparent power S, phase C	-/+ 999,999

2.4.2.12

LD0.SPEMMXU1 Single-phase power and energy measurement (1) – SP, SE-1

Table 174: LD0.SPEMMXU1 Single-phase power and energy measurement (1) – SP, SE-1

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
			LD0.SPEMMXU1			
	i32	1	.W.phsA.instCVal.mag	PL1-kW:1	Total active power, phase A	-/+ 999,999
			.W.phsA.instCVal.mag		(low word)	
	i32	1	.W.phsB.instCVal.mag	PL2-kW:1	Total active power, phase B	-/+ 999,999
			.W.phsB.instCVal.mag		(low word)	
	i32	1	.W.phsC.instCVal.mag	PL3-kW:1	Total active power, phase C	-/+ 999,999
			.W.phsC.instCVal.mag		(low word)	
	i32	1	.VAr.phsA.instCVal.mag	QL1-VAr:1	Total reactive power , phase A	-/+ 999,999
			.VAr.phsA.instCVal.mag		(low word)	
	i32	1	.VAr.phsB.instCVal.mag	QL2-VAr:1	Total reactive power , phase B	-/+ 999,999
			.VAr.phsB.instCVal.mag		(low word)	
	i32	1	.VAr.phsC.instCVal.mag	QL3-VAr:1	Total reactive power , phase C	-/+ 999,999
			.VAr.phsC.instCVal.mag		(low word)	
	i32	1	.VA.phsA.instCVal.mag	SL1-kVA:1	Total apparent power , phase A	-/+ 999,999
			.VA.phsA.instCVal.mag		(low word)	
	i32	1	.VA.phsB.instCVal.mag	SL2-kVA:1	Total apparent power , phase B	-/+ 999,999
			.VA.phsB.instCVal.mag		(low word)	

Table continues on next page

RegA	Type	Scale	IEC 61850 name	SA name	Description	Values
	i32	1	.VA.phsC.instCVal.mag	SL3-kVA:1	Total apparent power , phase C	-/+ 999,999
			.VA.phsC.instCVal.mag		(low word)	
	i16	1000	.PF.phsA.instCVal.mag	PFL1:1	Average power factor , phase A	-1...1
	i16	1000	.PF.phsB.instCVal.mag	PFL2:1	Average power factor , phase B	-1...1
	i16	1000	.PF.phsC.instCVal.mag	PFL3:1	Average power factor , phase C	-1...1
			.RcdRs.Oper.ctlVal		(Demands)	

2.5 Controls

Table 175: Explanations of the controls table columns

Column name	Description
0xA	Coil (0X) address for control value.
CS	Control structure and bit within the structure for control value.
IEC 61850 name	Original IED data object identification. Described in the IEC 61850 format as Logical Device.Logical Node and thereafter .Data Object.Data Attribute. Logical Node is the same as the application function block name.
SA name	The signal may have a defined label that is visible, for example, in the Application Configuration tool in PCM600.
Description	Short description of the signal. See the technical manual for more information.
Value	Meaning of the written value.

2.5.1 Reset, acknowledge and trigger points

Table 176: Reset, acknowledge and trigger points

0xA	CS	IEC 61850 name	SA name	Description	Values
		LD0.LLN0			
2060	2.00	.LEDRs1.Oper.ctlVal		Reset indications and LEDs	1=Reset
2061	2.01	.LEDRs2.Oper.ctlVal		Reset alarm LEDs	1=Reset
		LD0.PEMMXU1			
2062	2.02	.RecRs.Oper.ctlVal		Reset power max demands	1=Reset
2063	2.03	< reserved >			
2064	2.04	< reserved >			
		LD0.SSCBR1			
2065	2.05	.RsAccAPwr.Oper.ctlVal		Reset CB accum. energy	1=Reset
2066	2.06	.RsCBWear.Oper.ctlVal		Reset CB wear data	1=Reset
		DR.RDRE1			

Table continues on next page

Section 2 Modbus data mappings

1MAC203705-MB A

0xA	CS	IEC 61850 name	SA name	Description	Values
2067	2.07	.RcdTrg.Oper.ctlVal		Trig DR recording	1=Trig
2068	2.08	.MemClr.Oper.ctlVal		Clear DR memory	1=Clear
		LD0.CMMXU1			
2069	2.09	.RecRs.Oper.ctlVal		Reset max current1 demands	1=Reset
		LD0.PEMMXU1			
2070	2.10	.SupDmdRs.Oper.ctlVal		Reset energy values	1=Reset
		LD0.SCCBR1			
2071	2.11	.RsTrvTm.Oper.ctlVal		Reset CB travel time	1=Reset
2072	2.12	.RsSprChaTm.Oper.ctlVa l		Reset CB spring charge time	1=Reset
		LD0.RESCMMXU1			
2073	2.13	.RecRs.Oper.ctlVal		Reset Io (1) max demands	1=Reset
		LD0.RESVMMXU1			
2074	2.14	.RecRs.Oper.ctlVal		Reset Uo (1) max demands	1=Reset
		LD0.CMMXU2			
2075	2.15	.RecRs.Oper.ctlVal		Reset max current2 demands	1=Reset
		LD0.RESCMMXU2			
2076	3.14	.RecRs.Oper.ctlVal		Reset Io (2) max demands	1=Reset

2.5.2 CTRL.CBCSWI1 Circuit breaker control (1)

Table 177: *CTRL.CBCSWI1 Circuit breaker control (1)*

0xA	CS	IEC 61850 name	SA name	Description	Values
		CTRL.CBCSWI1			
2048	1.00	.Pos.Oper.ctlVal		Select open	1=Select
2049	1.01	.Pos.Oper.ctlVal		Select close	1=Select
2050	1.02	.Pos.Oper.ctlVal		Cancel selection	1=Cancel
2051	1.03	.Pos.Oper.ctlVal		Execute selection	1=Execute
2052	1.04	.Pos.Oper.ctlVal		Direct open	1=Open
2053	1.05	.Pos.Oper.ctlVal		Direct close	1=Close

2.5.3

CTRL.CBCSWI2 Circuit breaker control (2)

Table 178: CTRL.CBCSWI2 Circuit breaker control (2)

0xA	CS	IEC 61850 name	SA name	Description	Values
		CTRL.CBCS WI2			
2156	8	.Pos.Oper.ctl Val		Select open	1=Select
2157	8.01	.Pos.Oper.ctl Val		Select close	1=Select
2158	8.02	.Pos.Oper.ctl Val		Cancel selection	1=Cancel
2159	8.03	.Pos.Oper.ctl Val		Execute selection	1=Execute
2160	8.04	.Pos.Oper.ctl Val		Direct open	1=Open
2161	8.05	.Pos.Oper.ctl Val		Direct close	1=Close

2.5.4

CTRL.DCXSWI1 Disconnector control (1) – 29DS-1

Table 179: CTRL.DCXSWI1 Disconnector control (1) – 29DS-1

0xA	CS	IEC 61850 name	SA name	Description	Values
		CTRL.DCCSWI1			
2144	7.00	.Pos.Oper.ctlVal		Select open	1=Select
2145	7.01	.Pos.Oper.ctlVal		Select close	1=Select
2146	7.02	.Pos.Oper.ctlVal		Cancel selection	1=Cancel
2147	7.03	.Pos.Oper.ctlVal		Execute selection	1=Execute
2148	7.04	.Pos.Oper.ctlVal		Direct open	1=Open
2149	7.05	.Pos.Oper.ctlVal		Direct close	1=Close

2.5.5

CTRL.DCXSWI2 Disconnector control (2) – 29DS-2

Table 180: CTRL.DCXSWI2 Disconnector control (2) – 29DS-2

0xA	CS	IEC 61850 name	SA name	Description	Values
		CTRL.DCCSWI2			
2150	7.06	.Pos.Oper.ctlVal		Select open	1=Select
2151	7.07	.Pos.Oper.ctlVal		Select close	1=Select
2152	7.08	.Pos.Oper.ctlVal		Cancel selection	1=Cancel

Table continues on next page

0xA	CS	IEC 61850 name	SA name	Description	Values
2153	7.09	.Pos.Oper.ctlVal		Execute selection	1=Execute
2154	7.10	.Pos.Oper.ctlVal		Direct open	1=Open
2155	7.11	.Pos.Oper.ctlVal		Direct close	1=Close

2.5.6 CTRL.ESXSWI1 Grounding switch control (1) – 29GS-1

Table 181: *CTRL.ESXSWI1 Grounding switch control (1) – 29GS-1*

0xA	CS	IEC 61850 name	SA name	Description	Values
		CTRL.ESXSWI1			
2054	1.06	.Pos.Oper.ctlVal		Select open	1=Select
2055	1.07	.Pos.Oper.ctlVal		Select close	1=Select
2056	1.08	.Pos.Oper.ctlVal		Cancel selection	1=Cancel
2057	1.09	.Pos.Oper.ctlVal		Execute selection	1=Execute
2058	1.10	.Pos.Oper.ctlVal		Direct open	1=Open
2059	1.11	.Pos.Oper.ctlVal		Direct close	1=Close

2.5.7 LD0.LDEV1 Protection relay's warm reset (1)

Table 182: *LD0.LDEV1 Protection relay's warm reset (1)*

0xA	CS	IEC 61850 name	SA name	Description	Values
		LD0.LDEV1			
2080	3.00	.WrmStrCmd.Oper.ctlVal		Warm reboot of protection relay	1=Reboot

2.5.8 LD0.SPCGAPC1 Generic control point (16 pcs) (1) – SPC-1

The binary outputs can be configured either as pulse- or persistent-type outputs. Pulse-type outputs are triggered with the write value "1". Persistent-type outputs can be written with both values "1" and "0". The setting mode "toggled" for local operation corresponds to "persistent" for remote operation.

Table 183: *LD0.SPCGAPC1 Generic control point (16 pcs) (1) – SPC-1*

0xA	CS	IEC 61850 name	SA name	Description	Values
		LD0.SPCGAPC1			
2112	5.00	.SPCS01.ctlVal		Output 1 control	0/1=Off/On
2113	5.01	.SPCS02.ctlVal		Output 2 control	0/1=Off/On
2114	5.02	.SPCS03.ctlVal		Output 3 control	0/1=Off/On

Table continues on next page

0xA	CS	IEC 61850 name	SA name	Description	Values
2115	5.03	.SPCS04.ctlVal		Output 4 control	0/1=Off/On
2116	5.04	.SPCS05.ctlVal		Output 5 control	0/1=Off/On
2117	5.05	.SPCS06.ctlVal		Output 6 control	0/1=Off/On
2118	5.06	.SPCS07.ctlVal		Output 7 control	0/1=Off/On
2119	5.07	.SPCS08.ctlVal		Output 8 control	0/1=Off/On
2120	5.08	.SPCS09.ctlVal		Output 9 control	0/1=Off/On
2121	5.09	.SPCS10.ctlVal		Output 10 control	0/1=Off/On
2122	5.10	.SPCS11.ctlVal		Output 11 control	0/1=Off/On
2123	5.11	.SPCS12.ctlVal		Output 12 control	0/1=Off/On
2124	5.12	.SPCS13.ctlVal		Output 13 control	0/1=Off/On
2125	5.13	.SPCS14.ctlVal		Output 14 control	0/1=Off/On
2126	5.14	.SPCS15.ctlVal		Output 15 control	0/1=Off/On
2127	5.15	.SPCS16.ctlVal		Output 16 control	0/1=Off/On

2.5.9 LD0.SPCGAPC2 Generic control point (16 pcs) (2) – SPC-2

The binary outputs can be configured either as pulse- or persistent-type outputs. Pulse-type outputs are triggered with the write value "1". Persistent-type outputs can be written with both values "1" and "0". The setting mode "toggled" for local operation corresponds to "persistent" for remote operation.

Table 184: LD0.SPCGAPC2 Generic control point (16 pcs) (2) – SPC-2

0xA	CS	IEC 61850 name	SA name	Description	Values
		LD0.SPCGAPC2			
2128	6.00	.SPCS01.ctlVal		Output 1 control	0/1=Off/On
2129	6.01	.SPCS02.ctlVal		Output 2 control	0/1=Off/On
2130	6.02	.SPCS03.ctlVal		Output 3 control	0/1=Off/On
2131	6.03	.SPCS04.ctlVal		Output 4 control	0/1=Off/On
2132	6.04	.SPCS05.ctlVal		Output 5 control	0/1=Off/On
2133	6.05	.SPCS06.ctlVal		Output 6 control	0/1=Off/On
2134	6.06	.SPCS07.ctlVal		Output 7 control	0/1=Off/On
2135	6.07	.SPCS08.ctlVal		Output 8 control	0/1=Off/On
2136	6.08	.SPCS09.ctlVal		Output 9 control	0/1=Off/On
2137	6.09	.SPCS10.ctlVal		Output 10 control	0/1=Off/On
2138	6.10	.SPCS11.ctlVal		Output 11 control	0/1=Off/On
2139	6.11	.SPCS12.ctlVal		Output 12 control	0/1=Off/On
2140	6.12	.SPCS13.ctlVal		Output 13 control	0/1=Off/On

Table continues on next page

Section 2 Modbus data mappings

1MAC203705-MB A

0xA	CS	IEC 61850 name	SA name	Description	Values
2141	6.13	.SPCS14.ctlVal		Output 14 control	0/1=Off/On
2142	6.14	.SPCS15.ctlVal		Output 15 control	0/1=Off/On
2143	6.15	.SPCS16.ctlVal		Output 16 control	0/1=Off/On

2.5.10 LD0.SRGAPC1 Set-reset (8 pcs) (1) – SR-1

Table 185: LD0.SRGAPC1 Set-reset (8 pcs) (1) – SR-1

0xA	CS	IEC 61850 name	SA name	Description	Values
		LD0.SRGAPC1			
2096	4.00	.Rs1.Oper.ctlVal		Reset flip-flop 1	1=Reset
2097	4.01	.Rs2.Oper.ctlVal		Reset flip-flop 2	1=Reset
2098	4.02	.Rs3.Oper.ctlVal		Reset flip-flop 3	1=Reset
2099	4.03	.Rs4.Oper.ctlVal		Reset flip-flop 4	1=Reset
2100	4.04	.Rs5.Oper.ctlVal		Reset flip-flop 5	1=Reset
2101	4.05	.Rs6.Oper.ctlVal		Reset flip-flop 6	1=Reset
2102	4.06	.Rs7.Oper.ctlVal		Reset flip-flop 7	1=Reset
2103	4.07	.Rs8.Oper.ctlVal		Reset flip-flop 8	1=Reset

2.5.11 LD0.SRGAPC2 Set-reset (8 pcs) (2) – SR-2

Table 186: LD0.SRGAPC2 Set-reset (8 pcs) (2) – SR-2

0xA	CS	IEC 61850 name	SA name	Description	Values
		LD0.SRGAPC2			
2104	4.08	.Rs1.Oper.ctlVal		Reset flip-flop 1	1=Reset
2105	4.09	.Rs2.Oper.ctlVal		Reset flip-flop 2	1=Reset
2106	4.10	.Rs3.Oper.ctlVal		Reset flip-flop 3	1=Reset
2107	4.11	.Rs4.Oper.ctlVal		Reset flip-flop 4	1=Reset
2108	4.12	.Rs5.Oper.ctlVal		Reset flip-flop 5	1=Reset
2109	4.13	.Rs6.Oper.ctlVal		Reset flip-flop 6	1=Reset
2110	4.14	.Rs7.Oper.ctlVal		Reset flip-flop 7	1=Reset
2111	4.15	.Rs8.Oper.ctlVal		Reset flip-flop 8	1=Reset

2.5.12

Unmapped control points

Table 187: Unmapped control points

IEC 61850 name	Description	Value
LD0.LLN0.MeasStatRs.Oper.ctlVal	Reset all min. and max. demands	1=Reset
LD0.LLN0.PQRs.Oper.ctlVal	Reset all power quality data	1=Reset
LD0.FLTRFRC1.RcdRs.Oper.ctlVal	Reset fault record data	1=Reset

2.5.13

Unmapped controls

2.5.13.1

LD0.UDFCNT1 Multipurpose generic up-down counter (1) – CTR-1

Table 188: LD0.UDFCNT1 Multipurpose generic up-down counter (1) – CTR-1

IEC 61850 name	SA name	Description	Values
RsCnt.Oper.ctlVal	Reset counter	Resets counter value	0=Cancel; 1=Reset
LodCnt.Oper.ctlVal	Load counter	Loads the counter to preset value	0=Cancel; 1=Load

2.5.13.2

LD0.UDFCNT2 Multipurpose generic up-down counter (2) – CTR-2

Table 189: LD0.UDFCNT2 Multipurpose generic up-down counter (2) – CTR-2

IEC 61850 name	SA name	Description	Values
RsCnt.Oper.ctlVal	Reset counter	Resets counter value	0=Cancel; 1=Reset
LodCnt.Oper.ctlVal	Load counter	Loads the counter to preset value	0=Cancel; 1=Load

2.5.13.3

LD0.UDFCNT3 Multipurpose generic up-down counter (3) – CTR-3

Table 190: LD0.UDFCNT3 Multipurpose generic up-down counter (3) – CTR-3

IEC 61850 name	SA name	Description	Values
RsCnt.Oper.ctlVal	Reset counter	Resets counter value	0=Cancel; 1=Reset
LodCnt.Oper.ctlVal	Load counter	Loads the counter to preset value	0=Cancel; 1=Load

2.5.13.4

LD0.UDFCNT4 Multipurpose generic up-down counter (4) – CTR-4

Table 191: LD0.UDFCNT4 Multipurpose generic up-down counter (4) – CTR-4

IEC 61850 name	SA name	Description	Values
RsCnt.Oper.ctrlVal	Reset counter	Resets counter value	0=Cancel; 1=Reset
LodCnt.Oper.ctrlVal	Load counter	Loads the counter to preset value	0=Cancel; 1=Load

Section 3 Glossary

ANSI	American National Standards Institute
EMC	Electromagnetic compatibility
HSO	High-speed output
IEC 61850	International standard for substation communication and modeling
IED	Intelligent electronic device
LED	Light-emitting diode
LHMI	Local human-machine interface
Modbus	A serial communication protocol developed by the Modicon company in 1979. Originally used for communication in PLCs and RTU devices.
PCM600	Protection and Control IED Manager



ABB Inc.

4300 Coral Ridge Drive
Coral Springs, Florida 33065, USA

Phone +1 954 752 6700
Fax +1 954 345 5329
Phone +1 800 222 1946 (Customer
Service 24/7)

www.abb.com/mediumvoltage

www.abb.com/substationautomation