



中国国家强制性产品认证证书

证书编号：2003010305054693

委托人名称、地址

ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

生产者（制造商）名称、地址

ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

生产企业名称、地址

ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

产品名称和系列、规格、型号

指示装置

TYPE C(CP、C2SS、C3SS、CL、CE、CB、CEP)；详见参数附件

产品标准和技术要求

GB/T14048.5-2017

上述产品符合强制性产品认证实施规则 CNCA-C03-02:2014 的要求，
特发此证。

发证日期：2020 年 05 月 06 日 有效期至：2024 年 11 月 14 日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书，证书首次颁发日期：2003 年 07 月 16 日

本证书的相关信息可通过国家认监委网站 www.cnca.gov.cn 查询
经中国合格评定国家认可委员会认可 CNAS C001-P



主任：

陆梅



中国质量认证中心



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO.: 2003010305054693

NAME AND ADDRESS OF THE APPLICANT

ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province,
P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province,
P.R.China

NAME AND ADDRESS OF THE FACTORY

ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province,
P.R.China

PRODUCT NAME, MODEL AND SPECIFICATION

Pilot devices
TYPE C(CP、C2SS、C3SS、CL、CE、CB、CEP): See the Appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T14048.5-2017

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO.CNCA-C03-02:2014).

Valid from: May.06,2020

Valid until: Nov.14,2024

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Date of original issued: Jul.16,2003

The certificate information is available through CNCA's website: www.cnca.gov.cn
Accredited by China National Accreditation Service for Conformity Assessment CNAS C001-P



President:

Lu Mei



CHINA QUALITY CERTIFICATION CENTRE



中国国家强制性产品认证证书

附 录

第 1 页 共 9 页

证书编号: 2003010305054693

纸 号: 2562797

TYPE C(CP、C2SS、C3SS、CL、CE、CB、CEP);

Ui:300V (按钮、选择开关和急停开关,蜂鸣器和带灯按钮),415V (指示灯);

Uimp:6kV (按钮、选择开关和急停开关和带灯按钮),4kV (蜂鸣器);

Ith:5A(按钮、选择开关、急停按钮和带灯按钮);

按钮、选择开关、急停按钮、带灯按钮、塑料按钮盒(套装):

AC-15: 120V/3A,240V/2A (触头 Ag),120V/1.5A,240V/1A (触头 Cu/Ep.Ag);

DC-13: 24V/0.3A,125V/0.2A;

LED 指示灯: Ue=110-130VAC,230VAC, Ie=15mA;

Ue=48VAC/DC, Ie=12mA; Ue=110-130VDC, Ie=7mA;

Ue=220VDC, Ie=5mA; Ue=380VAC, Ie=16mA;

Ue=60VAC/DC,415VAC, Ie=17mA;

LED II 指示灯: Ue=48-60VAC/DC, Ie=13-17mA;

Ue=110-130VAC, Ie=15-17mA;

Ue=110-130VDC, Ie=8-9mA; Ue=230VAC, Ie=17mA;

Ue=220VDC, Ie=6mA; Ie=2mA(CL2-720),

Ue=380-415VAC, Ie=15-17mA;

白织灯指示灯: Uemax=240VAC;

蜂鸣器(红,黄色带灯):

注: 此附录与证书同时使用时有效。



主 任:

陆 楠



中国质量认证中心



中国国家强制性产品认证证书

附 录

第 2 页 共 9 页

证书编号：2003010305054693

纸 号：2562797

Ue=110-130VAC, 230VAC, Ie=70mA; Ue=110-130VDC, Ie=15mA;

(绿色带灯): Ue=110-130VAC, 230VAC, Ie=55mA; Ue=110-130VDC, Ie=15mA;

外壳防护等级：安装在特定面板后头部外壳防护等级可达到 IP66, LED II 指示灯尾部端面可达到 IP20, 基于标准产品的特殊印刷 LED 指示灯 CL9 安装在特定面板后头部外壳防护等级可达到 IP66 和尾部端面可达到 IP20, 没有安装平垫圈的 LED 指示灯 CL9 安装在特定面板后头部外壳防护等级可达到 IP40 和尾部端面可达到 IP20。塑料按钮盒(套装) CEP 没有安装保护罩或标牌时外壳防护等级可达到 IP66, 安装保护罩或标牌时外壳防护等级为 IP40;

型号的解释:

注：此附录与证书同时使用时有效。



主 任：

陆梅



中国质量认证中心



中国国家强制性产品认证证书


附录

第 3 页 共 9 页

证书编号: 2003010305054693

纸号: 2562797

1 按钮

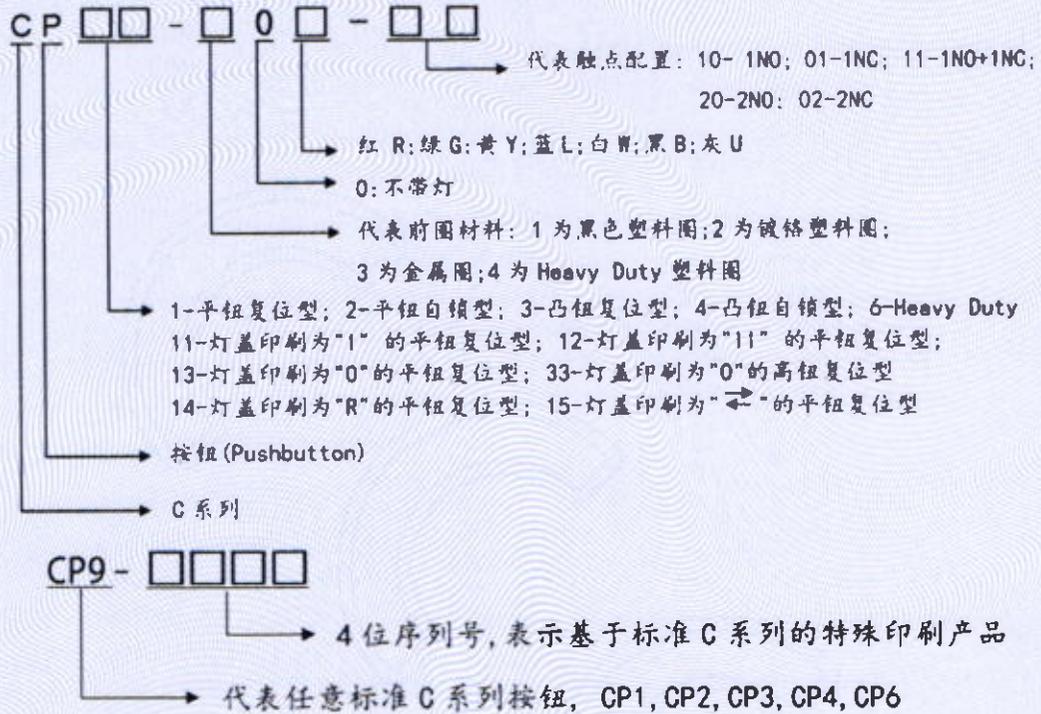

注: 此附录与证书同时使用时有效。



主任:

陆梅



中国质量认证中心



中国国家强制性产品认证证书


附录

第 4 页 共 9 页


证书编号: 2003010305054693

纸号: 2562797

带灯按钮

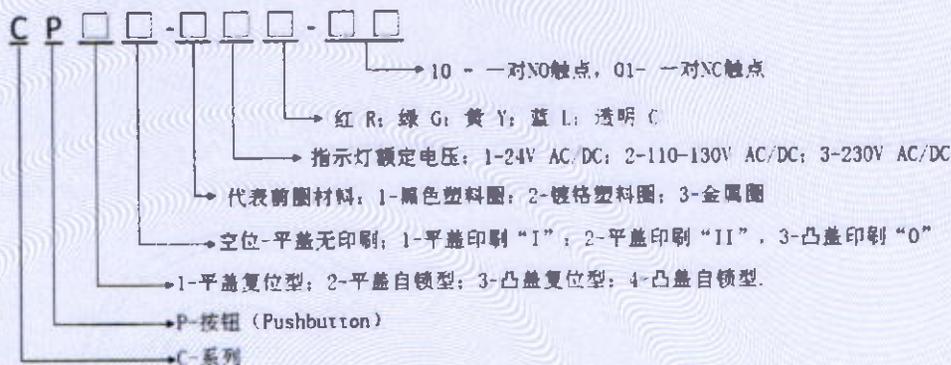

2 位选择开关

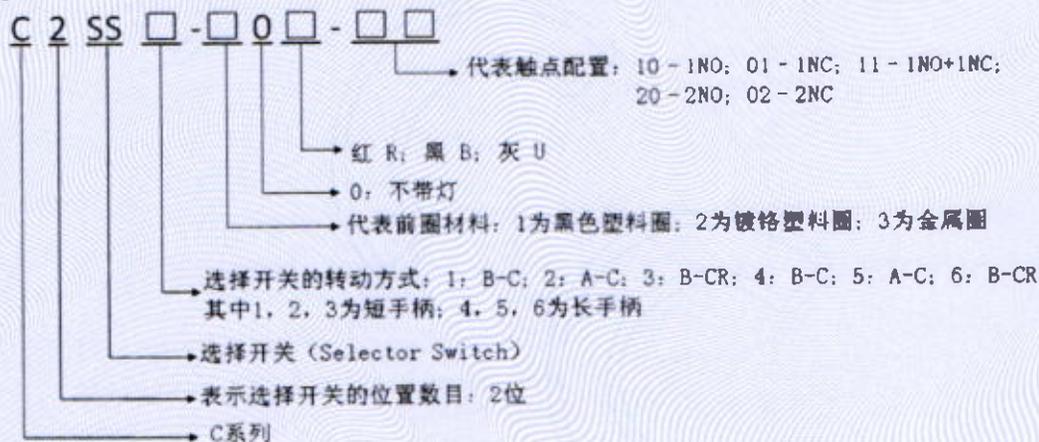

注: 此附录与证书同时使用时有效。



主任:

陆梅



中国质量认证中心



中国国家强制性产品认证证书

附 录

第 5 页 共 9 页

证书编号：2003010305054693

纸 号：2562797

C2SS9-□□□□

4 位序列号, 表示基于标准 C 系列的特殊印刷产品

代表任意标准 C 系列 2 位选择开关: C2SS1, C2SS2, C2SS3, C2SS7, C2SS4, C2SS5, C2SS6, C2SS8

3 位选择开关

C 3 SS □ - □ 0 □ - □ □

代表触点配置: 10 - 1NO; 01 - 1NC; 11 - 1NO+1NC; 20 - 2NO; 02 - 2NC

红 R; 黑 B; 灰 U

0: 不带灯

代表前面材料: 1 为黑色塑料圈; 2 为琥珀塑料圈; 3 为金属圈

选择开关的转动方式: 1: A-B-C; 2: AR-B-CR; 3: A-B-CR; 4: A-B-C

5: AR-B-CR; 6: A-B-CR; 7: AR-B-C; 8: AR-B-C

其中 1, 2, 3, 7 为短手柄; 4, 5, 6, 8 为长手柄

选择开关 (Selector Switch)

表示选择开关的位置数目: 3 位

C 系列

注: 此附录与证书同时使用时有效。



主 任:

陆 楠



中国质量认证中心



中国国家强制性产品认证证书



附 录

第 6 页 共 9 页

证书编号: 2003010305054693

纸 号: 2562797

4 指示灯

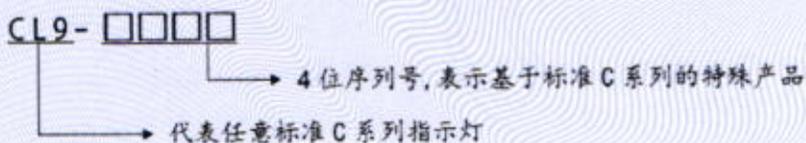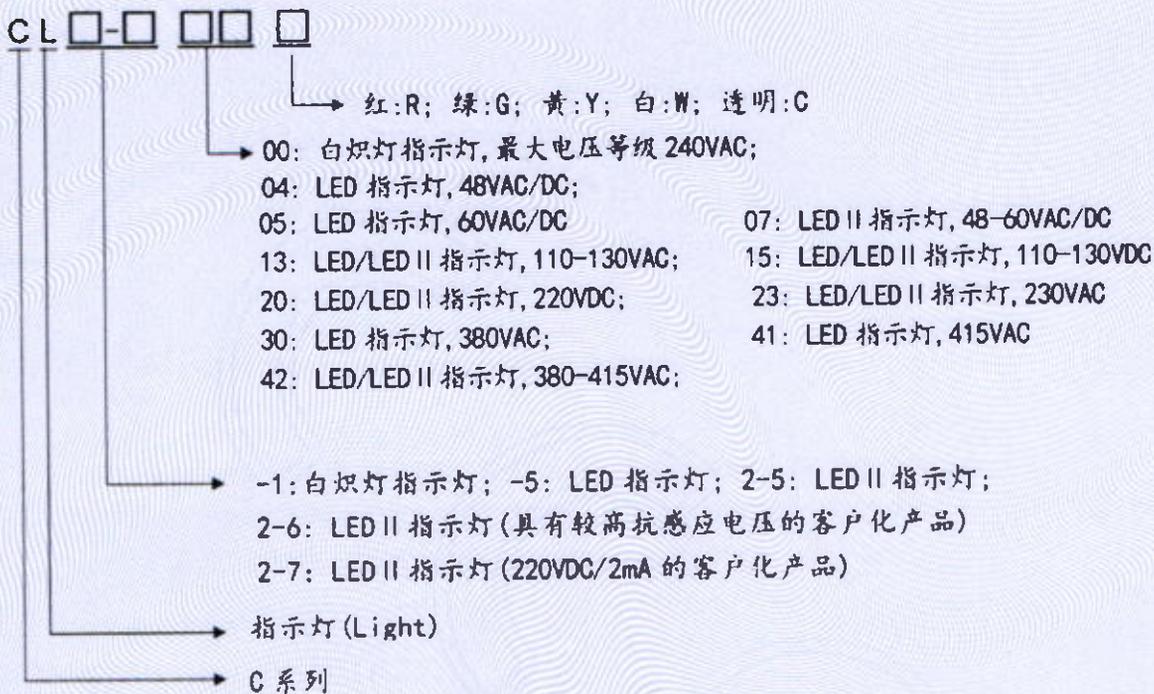

注: 此附录与证书同时使用时有效。



主 任: 陆 楠



中国质量认证中心



中国国家强制性产品认证证书

附录


第 7 页 共 9 页

证书编号: 2003010305054693

纸号: 2562797

5 急停开关

CE □ □ □ - 1 0 □ - □ □

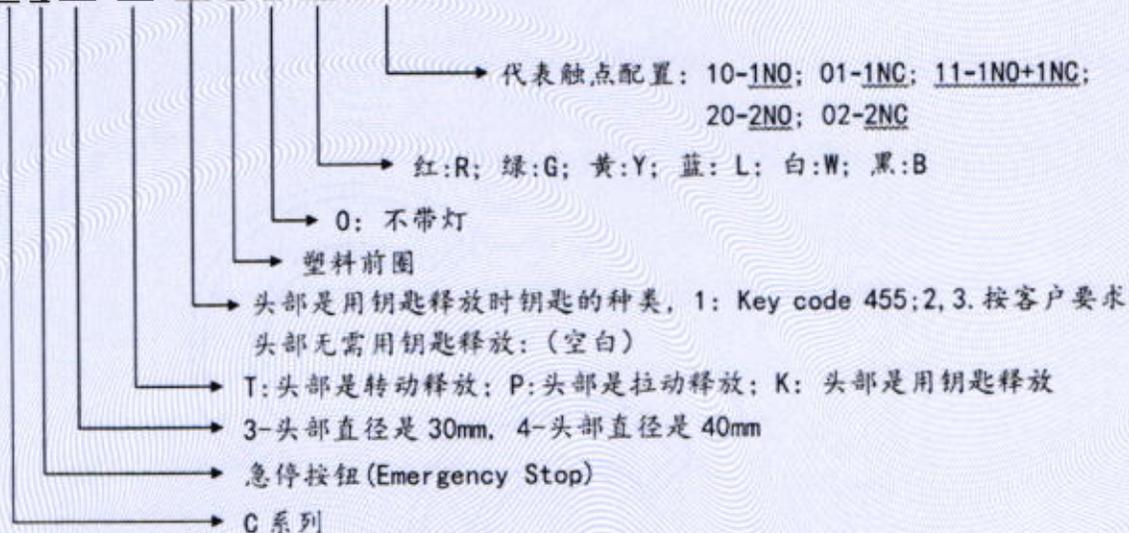

CE9- □ □ □ □



注: 此附录与证书同时使用时有效。



主任: 陆梅



中国质量认证中心



中国国家强制性产品认证证书

附 录

第 8 页 共 9 页

证书编号：2003010305054693

纸 号：2562797

6 蜂鸣器



注：此附录与证书同时使用时有效。



主 任：

陆 楠



中国质量认证中心



中国国家强制性产品认证证书

附 录


第 9 页 共 9 页

证书编号：2003010305054693

纸 号：2562797

7 塑料按钮盒(套装)

CEP □ 1 - □□□□

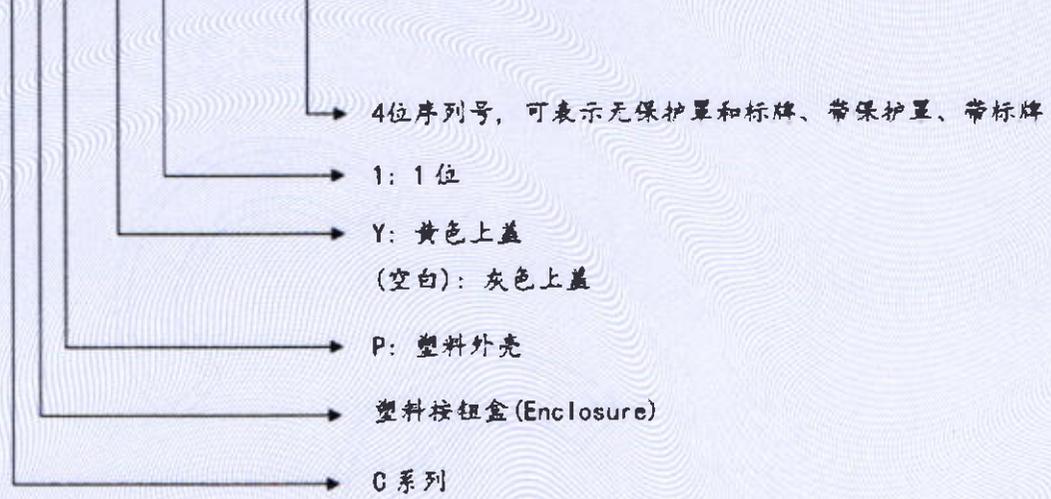

注：此附录与证书同时使用时有效。



主 任： 陆 楠



中国质量认证中心