


INSTALLATION INSTRUCTION

Terminal set OZXB2



Segmental conductors have to be rounded before mounting

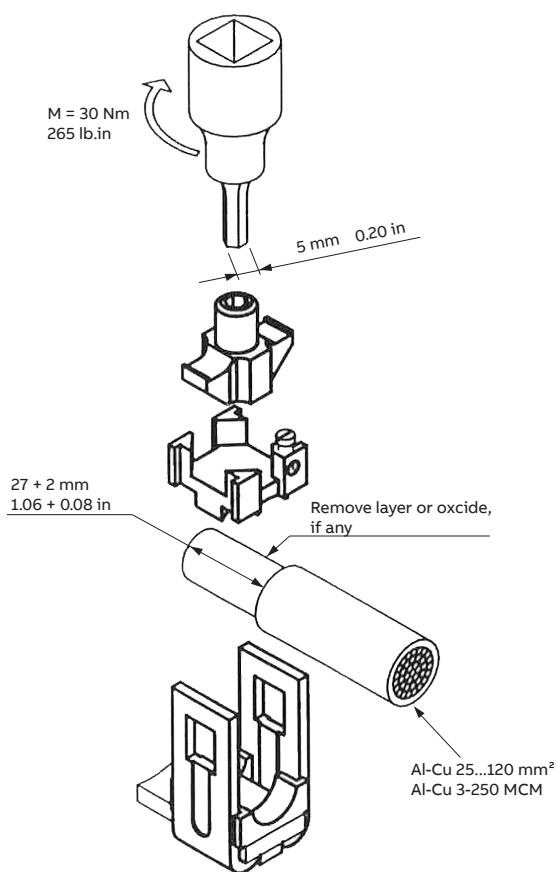

Contact us

ABB Oy

P.O. Box 622
FI-65101 Vaasa
Finland

abb.com/lowvoltage