
US CATALOG

Emergi-Lite®

Specification-grade emergency lighting products and accessories



**Thomas & Betts is now ABB
Installation Products, but our long
legacy of quality products and
innovation remains the same. From
connectors that help wire buildings
on Earth to cable ties that help put
machines in space, we continue to
work every day to make, market,
design and sell products that
provide a smarter, safer and more
reliable flow of electricity, from
source to socket.**

Table of contents

	Page
Company profile	2
Nexus® monitoring system	4
High output MR16 LED	6
LED emergency lighting	7
Circuitry	8
Popular options	9
Specification Grade table of contents	10
Specification Grade product intro	13
Spec Grade Architectural collection	14
Table of contents	15
Lux-Ray™ LED Series	16
Revelation™ Series	18
Mini-Revelation™ Series	20
RS Series	22
TS Series	24
Prestige™ Edge-Lit Series	26
Prestige™ X40 Series	28
Prestige™ DX Series	30
Prestige™ Floor Proximity Series	32
Prestige™ Edge-Lit Accessibility Series	34
Spec Grade Commercial collection	36
Table of contents	37
Premier™ Compact Series	38
Premier™ Series	40
Premier™ Combination Series	42
Premier™ Exit Series	44
Provider™ PRO-2N/PRO-3N Series	46
JS-HP Series	48
JS Series	50
LC Series	52
LS Series	54
X10 LED Series	56
Prestige™ Economizer Recessed	58
Prestige™ Economizer Slim profile	59
Prestige™ Accessibility Series	60
Preceptor™ Series	62
Preceptor™ Recessed Series	63
Preceptor™ Remote Capacity Series	64
Special Wording Series	66

	Page
Spec Grade Industrial collection	68
Table of contents	69
Hazardous locations important info	70
NEMA enclosures – various types	71
HP Series	72
HPRL Series	74
Survive-All™ SV Series	76
Survive-All™ SVX Combination Series	78
Survive-All™ SVX Series	80
Survive-All™ EF39 Series	82
HPH Series	84
HPHRL Series	86
Survive-All™ SVH Series	88
Survive-All™ SVXH Series	90
Survive-All™ SVX-HZ Series	92
Survive-All™ EF41 Series	94
EverLite™ Series	95
EXC LED Series	96
EFEP Series	98
EFXP Series	100
Remote fixtures	102
Table of contents	103
Lux-Ray™ LED Series	104
Literay™ Series	106
Revelation™ DC Series	107
Distinction™ DC Series	108
Distinction™ EF150 Series	110
EF10 & EF10D Series	111
EF12D-LED Series	112
HPRL Series	113
Survive-All™ EF39 & EF40 Series	114
HPHRL Series	116
Survive-All™ EF41 Series	117
Distributor select products	118
Table of contents	119
Radiance Series	120
EL-2RHL Series	122
Prestige™ Thin Die-Cast Series	124
Total™ Edge Series	125
EL-2LED Series	126
ELXN400 LED Series	128
EF43D Series	129
EF44D Series	129
EL-2SQL LED	130
ELX400 SQL LED Series	132
ELX Remote Capable Exit Series	134
EF47DSQL Series	135
EF12D-LED Series	135
DLM-2 Series	136
GS Series	137

	Page
Battery packs	138
Table of contents	139
About emergency ballasts	140
Ballast/lamp reference chart	141
LEDDR Series	142
FPDL Series	143
FPDL 4 Pin Series	144
EPC Series	145
EPC-FM Series	146
EPC-2 Series	148
Central & inverter systems	150
Table of contents	151
Low Capacity Mini Inverter Series	152
Mini Inverter Series	154
1000W Mini Inverter Series	156
Emerg-Power Systems	158
Compact Series	160
IPS Single Phase Series	162
FTC Single Phase Series	164
3FTC Three Phase Series	166
FTC3R & 3FTC3R Series	168
Options Details	169
Control Panel & Display	170
Central Systems Request Data	171
Accessories	172
Table of contents	173
Wire guards	174
Accessories	176
General information	
Lamp data	178
National Electrical Code	180
Life Safety Code	184
Warranty information	188
Product index	190

Partner with Emergi-Lite®

for expertise, reliability, and innovation

Safety you can trust. Depend on outstanding service from the experts at our North American manufacturing center of excellence.

The Emergi-Lite® Global Emergency Lighting Research & Innovation Center in Canada is part of the ABB Group, a pioneering technology leader.

Emergency lighting experts

Engineering teams with complementary expertise work together under one roof, giving you unparalleled access to our capabilities in design, innovation, quality, final assembly, testing, and service.

Our highly skilled mechanical, electrical and software engineers and product designers are specialists with proven expertise in the emergency lighting industry.

Product reliability

Rest easy knowing that our high internal quality and performance standards are met at every step, from design to production to order fulfillment.

Quality, safety, ease of installation, and long-term reliability are designed into each product from the beginning, ensuring excellence. All products undergo functional testing using our specialized quality inspection facilities.

Fast delivery

With over 150 people on our North American manufacturing team, we have complete control over lead time, service, and quality. We can produce exactly what we need without waiting for a large production run or overseas shipment. For express service, we keep ready-to-ship stock in warehouses across the U.S.

Innovative solutions

Our product designers are on the forefront of new lighting design applications. The newest high-capacity mini inverters have expanded opportunities to transform existing lighting into emergency lighting. Our high-performance LED fixtures have low energy requirements, allowing fewer units to provide necessary lighting.

The Nexus® system puts the power of automation in your hands to manage your entire emergency lighting system from one central location. At a glance, you can see the status of every unit, even in multiple locations.

Our dedicated, experienced North American service team works with you as emergency lighting partners to ensure your satisfaction.

Peace of mind

With Emergi-Lite®, you have

- Reliable safety solutions
- A dependable business partner
- Industry expertise
- Dedicated service
- North American manufacturing
- A known, trusted reputation



— The ABB North American facility is an emergency lighting center of excellence thanks to the commitment, expertise, and creativity of every employee.

Nexus®

Emergency lighting monitoring system

Building & Life Safety Codes oblige building owners/managers to ensure the safe evacuation of a building in the event of an emergency.

—
01 Nexus® is a proven system supported by a 5-year warranty, and can contribute to LEED certification and support green building initiatives.

Are you prepared for a safety inspection?

In the interest of public safety, building owners/managers must meet the outlined requirements for exit signs and emergency lighting equipment, including the following:

- Conduct a discharge test every month.
- Conduct functional tests annually.
- Keep a log book of maintenance information.

Complying with these requirements can be labor intensive and costly, especially in large buildings where testing every emergency light requires many man-hours. Disrupting the power supply during lengthy inspections can also put public safety at risk.

Manage testing with Nexus® to save time and costs

Nexus® is a real-time monitoring system that manages the status of your entire emergency lighting and Exit Sign system from a central control unit. Nexus® runs diagnostics, performs required monthly and annual functional tests, generates maintenance logs and runs compliance reports. Available in wired or wireless (RF) versions, Nexus® installations often pay for themselves in less than two (2) years. In addition to operational savings, Nexus® helps increase system reliability and performance and reduces the risk of failed inspections. One building or a group of properties under the same management can be monitored with Nexus®.

Maximize system availability

By allowing maintenance personnel to easily maintain and monitor the emergency lighting system without having to manually check each unit, Nexus® reduces the hours required to disrupt the power supply for inspections. With Nexus®, monthly tests and reports on the status of all emergency lights and exit signs can be done individually, in groups, or together.

Advantages of the Nexus® system include saving labor; maximizing system availability by testing units in groups and stages rather than setting all units in recovery mode; and the convenience of self-monitoring. Nexus® indicates the location of a faulty unit and reports it instantly without requiring a manual search.



One building or a group of properties under the same management can be monitored with Nexus®.

Update status instantly

Nexus® passes messages both to and from the emergency units to instruct the units to perform all mandatory testing by communicating between the emergency units and a centrally located controller. Nexus® is a proven system supported by a 5-year warranty, and can contribute to LEED certification and support green building initiatives.



Small system example

In a system of less than 100 units it is most likely that the only hardware required, other than the emergency units themselves, is a controller. All communication would occur wirelessly and installation would not vary greatly from a nonmonitored system. Once the units are in place, the system will establish the mesh network. The building itself could be quite large as each unit only needs to be able to communicate with its close neighbors and does not need to communicate directly with the controller.

Large system example

The Nexus® RF system has been designed to be extremely flexible and provides for a range of system options. Each large site will need to be assessed for the best system solution with the assistance of ABB technical staff. The basic Nexus® RF system is designed to run on an Ethernet network which is present in most modern buildings however through a range of interface cards the backbone of the network could be WLAN.

As with the small system example, site performance will be optimized through the careful selection and placement of area controller routers and the area controller to form efficient clusters. Building layout and materials will also play some role in determining the best solution to deliver a highly effective means of testing and maintenance requirements.

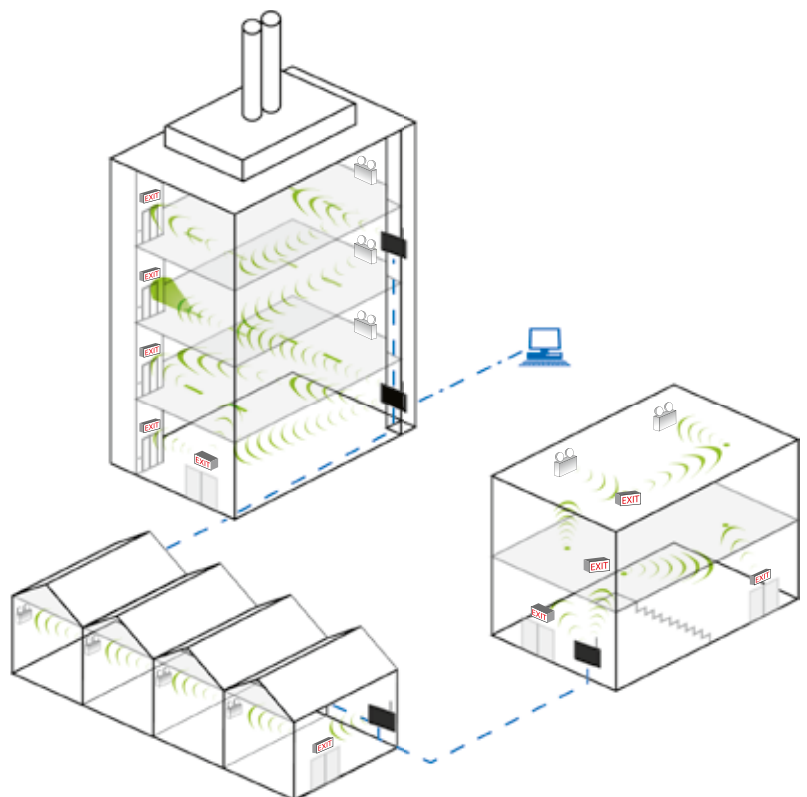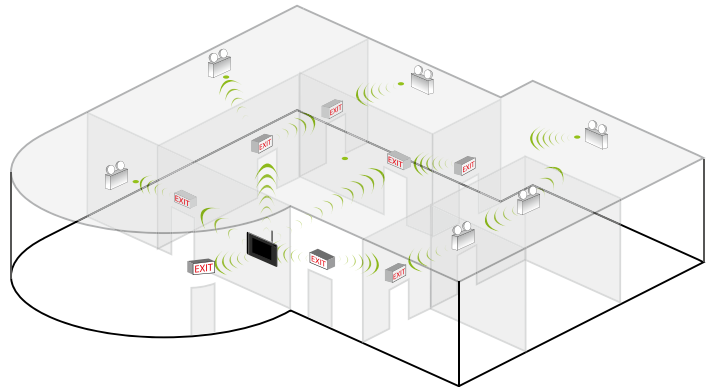

For Nexus® compatibility please refer to individual product pages for complete details.

High output MR16 LED

Emergency lighting


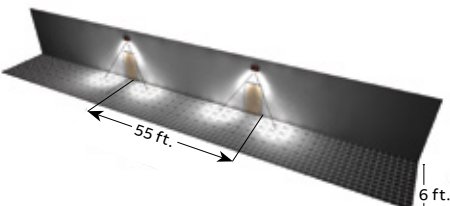

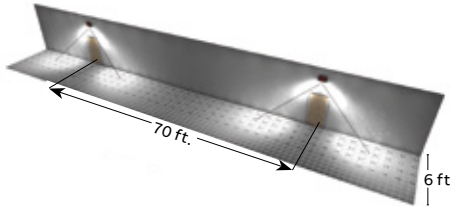

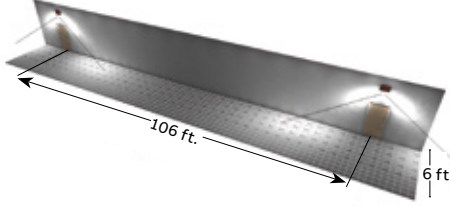
MR16 LED illumination

With the remarkable technology development in the last decade, the lightemitting diode (LED) is becoming the preferred solution in lighting applications. The emergency lighting industry is no exception: today virtually every new product introduced to market includes “white light” light LEDs for emergency illumination. Extremely efficient and long-lasting, LED lamps become the natural alternative to incandescent lamps due to three main advantages:


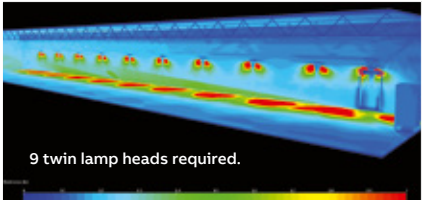

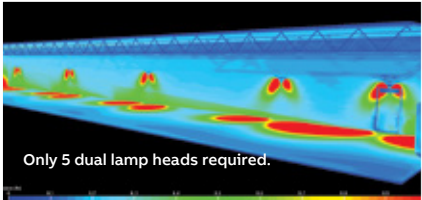

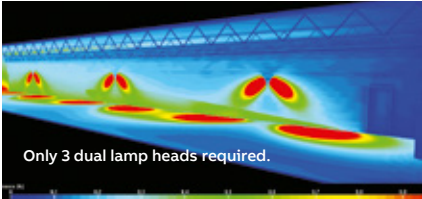

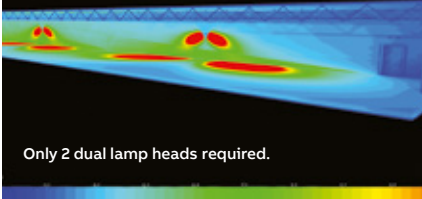

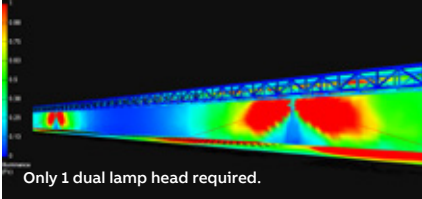
- **Lamp efficacy:** 50–100 lumens per watt compared to 15–30 lumens per watt of the best halogen lamp. Allowing for smaller batteries and units and/ or remote capacity
- **Operational life:** 30,000+ hours, equivalent to a lifetime warranty in emergency lighting.
- **Lower lamp temperature:** 80–120°C (176–248°F) is a huge benefit for lighting in hazardous locations.

MR16 LED lamp benefits

- Reduces total cost of ownership, uses few fixture due to superior illumination, thus reducing installations cost and future maintenance of the entire system.
- UL-recognized components.
- Available for standard battery voltages 6V, 12V and 24V as well as 120V operation.
- Energy-efficient LED MR16 lamp provides equivalent lighting performance to a much higher watt halogen MR16 lamp.
- Reduces required battery capacity by 75%, for battery units and remote heads.
- Small profile, compact white lighting is ideal for architectural applications.
- Typical 30,000 hours of operational life.
- Vibration-resistant LED stands up to industrial environments.
- Ideal for indoor and outdoor use.

Lamp	Description	Photometry
	200-220-Lumen 4W MR16 LED Leading the technology trend, Emergi-Lite® offers a complete series of 4W MR16 LED lamps available for all the standard battery voltages: 6V, 12V, 24V and 120V. With up to 30,000 hours of operational life and a luminous flux of typically 200 to 220 lumens, they are available with most emergency heads designed to hold an MR16 lamp and meet the majority of illumination specifications. For example: one pair of LED emergency heads installed at a height of 7.5ft illuminates a 55ft path of egress.	 <p>55-ft. path of egress 2 X 4W MR16 LED Based on an average of 1 foot candle</p>
	340-Lumen 5W MR16 LED Keeping pace with technology, in 2012 we introduced a 12V-5W MR16 LED lamp. With a typical luminous flux of 340 lumens, this lamp has the same lighting performance as a 20W high-output halogen MR16. A twin emergency head installed at a height of 7.5ft illuminates 70ft path of egress	 <p>70-ft. path of egress 2 X 5W MR16 LED Based on an average of 1 foot candle</p>
	540-590 Lumen 6W MR16 LED A 6W MR16 LED lamp delivers up to 590 lumens for an average spacing in emergency lighting of 106 feet with an efficacy of 98.3 Lm/w, it is over 6 times the efficacy of a MR16 35W halogen with similar light output. This lamp can deliver the highest linear foot of illumination per watt on a path of egress! (spacing in feet / watt) 8.83ft compare to 1.37ft for a MR16 35W.	 <p>106-ft. path of egress 2 X 6W MR16 LED Based on an average of 1 foot candle</p>

Highly efficient LEDs provide many cost-saving benefits

Series	Thermal imagery – 150 foot hallway	
<p>EL-2LED Series – Commodity LED Low energy, low maintenance emergency lighting for moderate budget applications</p>		 <p>9 twin lamp heads required.</p>
<p>Provider™ PRO-2N-LA Series – 4W LED 6V thermoplastic housing protected lamps</p>		 <p>Only 5 dual lamp heads required.</p>
<p>Premier™ Compact 12MPR20M2LG Series – 5W LED Thermoplastic housing 12V–20W emergency light</p>		 <p>Only 3 dual lamp heads required.</p>
<p>Premier™ Compact 12MPR20M2LJ Series – 6W LED Thermoplastic housing 12V–20W emergency light</p>		 <p>Only 2 dual lamp heads required.</p>
<p>JS-HP Series JSM36-2L15FM – 15W Thermoplastic housing 12V–72W capacity emergency light</p>		 <p>Only 1 dual lamp head required.</p>

Circuitry

Advanced Diagnostics circuitry

Self-testing & monitoring diagnostic circuitry

- By incorporating diagnostics features with a high-powered 8-bit microprocessor, our Advanced Diagnostics system ensures unsurpassed reliability in one, totally contained system. In the event of a unit malfunction, the Advanced Diagnostics system produces an audible warning in the form of an intermittent beep and the LED indicator associated with the fault will illuminate continuously. When the problem is acknowledged by depressing the alarm/silence/test button, the alarm is silenced and the LED indicator changes to a flashing mode until the problem is corrected.
- Continually monitors system parameters
- Incorporates state-of-the-art microprocessor technology
- D includes audio and visual service alarms
- DNA non-audible version for visual service alarms only
- Self-testing in accordance with NFPA101, Life Safety Code minimum 30 seconds every 30 days, 30 minutes every six months and 90 minutes annually.

Features

Battery failure

- (Red) Illuminates if the battery is shorted or battery voltage drops below preset value. Will also detect incorrect battery (ie. 6VDC vs. 12VDC)

Battery disconnect

- (Red) Illuminates if the battery circuit is open.

Charger failure

- (Red) Illuminates when charger is not functioning properly by monitoring the charger current.

Lamp failure

- (Red) Illuminates when one or more emergency lamps fail. Also monitors remote lamps.

Service alarm

- (Red) Illuminates when a fault is detected that requires a qualified service technician.

AC-on

- (Green) Lit when line voltage is present.

Charger on

- (Amber) Illuminates when charger is recharging the battery.

Alarm silence / manual test switch

- Button is used to acknowledge and silence audible alarms.
- Also functions as a manual test switch to simulate a power failure.

Self testing

- Unit tests itself every thirty days for a minimum 30 seconds, thirty minutes on the sixth month and ninety minutes annually.
- Advanced Diagnostics (AD or ADNA) includes a time delay function, if needed it can be enabled/disabled in the field (15 min) or it can be preset at the factory by including the suffix AD-D* or ADNA-D* (*5 min., or *10 min., or *15 min.)

Pulse Type circuitry

Prolongs the life of a battery through pulse charging

- **Emergi-Lite®** PulseType circuitry utilizes the latest in solid state design to provide a technically advanced charger combined with features and functions that promote long reliable battery life and excellent unit performance.
- The design of the PulseType circuit takes into account the long periods of inactivity typical of standby emergency equipment. Batteries are kept at full capacity by a pulse charge that allows the battery to cycle continuously. This greatly reduces the problem of grid corrosion and dramatically increases battery performance.
- **Emergi-Lite®** computer-tests all active components on the circuit boards during assembly. Critical functions such as brownout, low voltage disconnect, and charge voltage are individually monitored and adjusted at the factory.

Features

120/277V input

- Capability to operate with 120V or 277V input.

Fused output circuit for units with remote capacity

- Emergency units up to 54W have a single fused output circuit. Units over 54W have two fused output circuits supplied standard.

Dual diagnostic indicator lights

- Dual indicators, red and amber continuously monitor the condition of the battery, charge circuit and presence of AC.

Temperature compensation

- At high ambient temperatures, batteries need less charge voltage to recharge.
- At cold temperatures, batteries require a higher charge to maintain full capacity.
- The PulseType charger automatically adjusts the charge voltage to precisely what the batteries require at a given temperature.

Sealed relay

- Sealed relay protects against environmental contaminants.

Low voltage battery disconnect

- The lighting load is disconnected from the battery at 87.5% of nominal battery voltage. This prevents deep discharge damage to the battery.

Brownout protection

- Emergency lamps energized when AC voltage falls to approx. 80% of nominal voltage, the level at which most fluorescent and HID fixtures extinguish.

Battery lockout

- This labor saving feature prevents the battery from discharging when the unit is installed to a non-energized circuit. The battery is electronically locked out until the unit is energized with AC power. Contractors do not have to return to a job site to connect batteries when the building's main power is turned on. They can install the unit and connect the battery in one convenient operation.

Reverse polarity protection

- A polarized plug is used to connect the battery to the circuit board, thus preventing damage from occurring to the system.

Current limited output (not available on all items, see specification sheet)

- Extends battery life by preventing overheating and battery gassing during recharge.

Popular options

Emergi-Lite® Emergency Lighting Units and Exit Signs are available with a range of options that can be added to enhance performance, simplify testing or adapt emergency battery units or exit signs for use in specific environments. Please refer to individual product pages to verify availability of individual options on specific equipment.

Voltmeter

Option provides a visual indication, in the test mode, of the unit's battery voltage. The good/check meter face allows maintenance personnel to recognize charger and battery function.

Add suffix: -V

Ampmeter

Option provides an indication of charge current when the unit is in the equalize mode. This verifies charger capability and the current acceptance of the battery.

Add suffix: -A

Dual circuit (exit signs)

Option provides two AC input circuits to permit 2 separate AC sources to energize the sign.

Add suffix: -2CKT

Tamper proof/vandal resistant screws

Tamper proof screws may be used on certain units to avoid unauthorized entry to circuitry or vandalism.

Add suffix: -VR

Lamp Disconnect switch

Option will disconnect lamp load when area is not in use during prolonged power failure. The switch may also be used to reactivate emergency power to remote or unit heads.

Add suffix: -K

Photocell test switch

Allows for testing of an emergency battery unit, a self-powered battery back-up exit sign or combination unit by means of illuminating, with a flashlight, a photocell mounted in the bottom of the battery unit.

For product compatibility please contact the factory.

Add suffix: -P or -PST depending on series

Flasher

The flasher option is used within exit signs to draw additional attention to the exit discharge area. When there is an emergency situation, the exit legend will illuminate as well as begin to flash thus drawing additional attention to the exit sign leading to a exit discharge.

Add suffix: -FA

Flasher/buzzer

The flasher/buzzer option is used within exit signs to draw additional attention to the exit discharge area. When there is an emergency situation, the exit legend will illuminate as well as begin to flash and admit an audible buzzer thus drawing additional attention to the Exit Sign leading to a exit discharge.

Add suffix: -FZ

Fire alarm activated flasher

Fire alarm activated flasher option is for an exit sign that is wired into the fire alarm system of a building via 24 volt wire. When the fire alarm is activated the exit legend will flash to draw additional attention to the exit discharge area. This flashing option will only activate when the fire system is activated.

Add suffix: -FA

Fire alarm activated flasher/buzzer

Fire alarm activated flasher/buzzer option is for an exit sign that is wired into the fire alarm system of a building via 24 volt wire. When the fire alarm is activated, the exit legend will flash and the exit sign will buzz to draw additional attention to the exit discharge area. This option will only activate when the fire system is activated.

Add suffix: -FBF

Time delay

Option is designed to be used in areas where HID type lamps are used for normal lighting. As these lamps require several minutes to re-strike and to produce their nominal lighting output, it is necessary to also hold the emergency lighting on for this period, even after the AC utility has been restored. A time delay unit can be helpful in areas where it is difficult to directly access an emergency lighting unit's test switch. The power to the unit can be briefly switched off and on at the breaker panel, and the maintenance person can then return to the unit and observe a timed emergency operation.

Add suffix: -D3 (15 minutes)

Damp location

Option for environments that are subject to moderate amounts of moisture (humidity), and a temperature range between 10°C (50°F) and 40°C (104°F). Example: partially protected exterior areas such as canopies, stairwells, etc.

Add suffix: -DL

Advanced Diagnostic circuitry (for exit signs)

Option is designed to continuously monitor the charger assembly, battery and LED assembly current. If a fault is indicated, the external service required indicator will illuminate. The diagnostic/self test will self test for minimum 30 seconds every 30 days, 30 minutes every six months and 90 minutes annually. Meets NFPA 101 Life Safety Code requirements for periodic testing.

Advanced Diagnostic (audible) **Add suffix:** -AD

Advanced Diagnostic (non-audible) **Add suffix:** -ADNA

For complete details refer to page 8.

Spec Grade products

Table of contents

Architectural collection



Lux-Ray™ LED Series

16



Revelation™ Series

18



Mini-Revelation™ Series

20



RS Series

22



TS Series

24



Prestige™ Edge-Lit Series

26



Prestige™ X40 Series

28



Prestige™ DX Series

30



Prestige™ Floor Proximity Series

32



Prestige™ Edge-Lit Accessibility Series

34

Commercial collection



Premier™ Compact Series

38



Premier™ Series

40



Premier™ Combination Series

42



Premier™ Exit Series

44



Provider™ PRO-2N/PRO-3N Series

46



JS-HP Series

48



JS Series

50



LC Series

52



LS Series

54



X10 LED Series

56



Prestige™ Economizer Recessed ceiling mount

58



Prestige™ Economizer Slim profile surface mount

59



Prestige™ Accessibility Series

60



Preceptor™ Series

62



Preceptor™ Recessed Series

63



Preceptor™ Remote Capacity Series

64



Special Wording Series

66

Spec Grade products

Table of contents

Industrial collection

				
Hazardous locations Important information 70	NEMA enclosures Various types 71	HP Series 72	HPRL Series 74	Survive-All™ SV Series 76
				
Survive-All™ SVX Combination Series 78	Survive-All™ SVX Series 80	Survive-All™ EF39 Series 82	HPH Series 84	HPHRL Series 86
				
Survive-All™ SVH Series 88	Survive-All™ SVXH Series 90	Survive-All™ SVX-HZ Series 92	Survive-All™ EF41 Series 94	EverLite™ Series 95
				
		EXC LED Series 96	EFEP Series 98	EFXP Series 100

SPEC GRADE PRODUCTS

To meet the different needs of applications ranging from high-visibility areas in retail spaces, high-traffic areas in hotel lobbies, and extreme conditions in industrial facilities, Emergi-Lite® Specification Grade products provide a range of specialty emergency lighting equipment and exit signs.

Specification Grade Emergency Lighting Equipment

Meets specific requirements in retrofit installations, major renovations, and new construction in architectural, commercial, and industrial applications.

- 01 Architectural lighting
- 02 Commercial lighting
- 03 Industrial lighting

- Provide code-compliant path of egress lighting
- Meet photometric requirements with a selection of battery options, lamp types, and configurations
- Maintain aesthetics with elegant designs available in a variety of finishes
- Accommodate challenging installations with flexible mounting options
- Provide NEMA-certified models, NSF-approved products, and explosion-proof units for heavy-duty industrial spaces and highly demanding environments.

The Spec Grade product range includes:

- Architectural lighting
- Commercial lighting
- Industrial lighting

Make Emergi-Lite® your source for modern, stylish, high performance emergency lighting equipment and exit signs.



01



02



03

Spec Grade

Architectural collection

For specifiers and designers who need code-compliant emergency lighting that complements lighting plans and decor

- Use fewer fixtures to provide path of egress lighting with highly efficient LED lamps
- Hide battery units with recessed emergency lighting
- Accommodate challenging installations with T-Bar mounting options
- Complement decor with elegant edge-lit and brushed metal exit signs available in a variety of finishes

01 Prestige™
Edge-Lit Series –
Preserve design
continuity with elegant
die-cast exit signs in
a range of finishes

See page 26 for
more information
about this product

01



For more architectural lighting options, see the full section of Remote Fixtures in this catalog.
To use existing lighting as emergency lighting, see Mini Inverters in this catalog.



Table of contents

Spec Grade Architectural

				
Lux-Ray™ LED Series	Revelation™ Series	Mini-Revelation™ Series	RS Series	TS Series
16	18	20	22	24
				
Prestige™ Edge-Lit Series	Prestige™ X40 Series	Prestige™ DX Series	Prestige™ Floor Proximity Series	Prestige™ Edge-Lit Accessibility Series
26	28	30	32	34

Lux-Ray™ LED Series

Die-cast aluminum LED emergency lighting – interior or exterior



NEMA-3R



Patent-Pending

Housing

- Indoor/outdoor suitable for wet location
- Die-cast aluminum housing
- UV-resistant (3" x 1.5") polycarbonate lens

Mounting

- Wall mount
- 1/2" rigid conduit top entry
- Universal J-box mounting pattern

Lamp type

- Patent-pending light engine: four power LEDs with redundant connections
- 400-640 Lumens
- Color temperature: 5000K
- Optional forward-throw light distribution, for applications of outdoor egress
- Optional high-lumen outputOptional dual-mode operation: normal and emergency LED lighting with separate AC inputs

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Standard Advanced Diagnostics
- 120/277 60Hz

Approval

- UL 924 listed
- NEMA-3R rated for indoor/outdoors cold-weather wet and damp locations: -20 to 40°C (-4 to 104°F)

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Power consumption


Model	AC Specs: 120/277VAC				
	Normal lighting		Emergency lighting		6-12VDC remote
	Current (max)	Power (max)	Current (max)	Power (max)	Power (max)
AC, 2AC, ACDC, DC (remote)	0.12/0.08A	12W	0.12/0.08A	12W	8W
AC-H, 2AC-H, ACDC-H, DC-H	0.18/0.11A	18W	0.18/0.11A	18W	14W
ACSD, SD, SD-H	0.12/0.06A	12W	0.05/0.02A	12W	–
SD-CW	–	–	0.15/0.07A	16W	–
ACSD-CWP, -CWRC ¹	–	–	0.22/0.10A	24W	–

¹Note: ACSD cold weather models must be powered only from the unswitched emergency AC line

Colors



Black

Dark bronze
(painted)


Off-white



Platinum gray

Dimensions

Dimensions are approximate and subject to change.

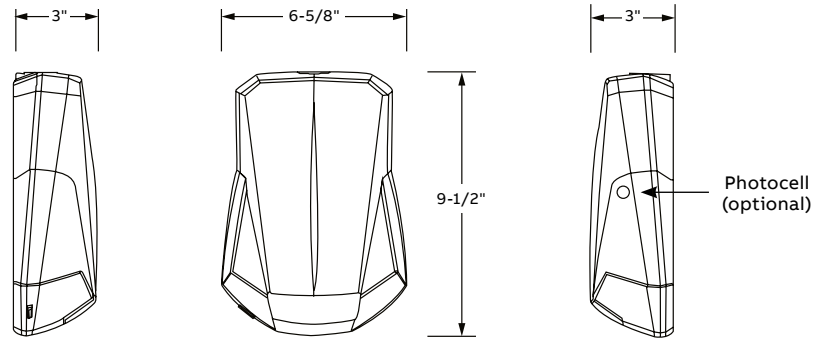

Photometric performance – Forward throw

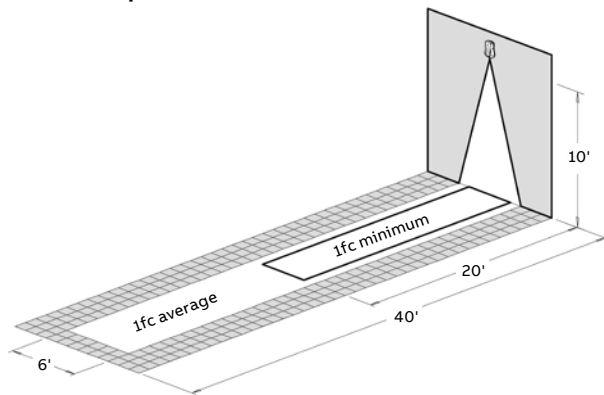


Table A – Spacing for minimum illumination = 1FC (1 foot-candle)

Model type	Mounting height	Lumen	Color temperature	Width X length (ft)	
				Single unit	Center-to-center
Standard	9'	400	5000K	4' x 28'	4' x 32'
With option -H	11'	550		4' x 32'	4' x 40'
With option -FT	12'	460		4' x 22'	–
With option -FTH	15'	640		4' x 27'	–

Photometric performance – Wide beam

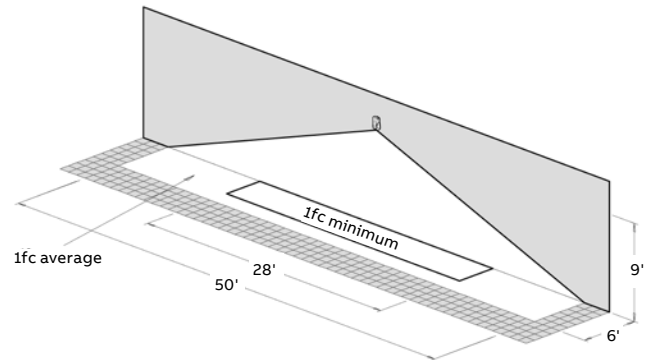


Table B – Spacing for NFPA101 – Average = 1FC (1 foot-candle)

Model type	Mounting height	Lumen	Color temperature	Width X length (ft)	
				Single unit	Center-to-center
Standard	9'	400	5000K	6' x 50'	4' x 32'
With option -H	11'	550		6' x 60'	4' x 40'
					3' x 70'
With option -FT	12'	460		6' x 40'	–
With option -FTH	15'	640		6' x 50'	–

How to order

Color	Series	Model	Options
B = Black	LUX = Lux-Ray LED	SD = Self-powered & diagnostic [–4–122°F (–20–50°C)] ACSD = Dual-mode AC / self-powered & diagnostic –4–104°F (–20–40°C)	–CW = Cold weather [–40–86°F (–40–30°C) not available with option -H]
BZ = Dark bronze			–D3 = Time delay (15 minutes)
OW = Off-white			–FT = Forward throw lighting
PG = Platinum gray			–H = High lumen output (max. 86°F/30°C; model SD only)
			–P = Photocell (ACSD only)
			–RC = Remote control test switch - infrared ¹
Example: BZLUXACSD-RC			

¹For ACSD model only, remote control keypad (TB-RC1-E) ordered separately

Revelation™ Series

The unseen solution – generator capable 12V up to 100W capacities



Housing

- Galvanized steel back-box
- Easy access to internal components
- Head assembly door and trim plate powder coated in a white finish
- Finish can be customized on site with paint or wallpaper
- Choice of various 12 volt MR16 LED lamp wattages
- Complete 360° head assembly door rotation
- Slip gear mechanism protects unit and objects against forcible stops

Mounting

- Recessed mount into ceiling or wall with cavities
- Special bar hangers included for installation in sheet rock or T-bar ceilings
- Can be installed on the wall stud or ceiling beam with simple, U-shape bracket
- Head assembly includes keyhole slot and quick-connect plugs for easy installation

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Standard Advanced Diagnostics
- 120/277 60Hz

Choice of sealed maintenance-free battery

- 12V lead-calcium battery
- 12V nickel-cadmium battery

Approvals


- CSA-US (to UL 924 standards)
- NYC approved

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LG	55'	43'
LI	71'	56'
LJ	100'	85'
50H	160'	171'

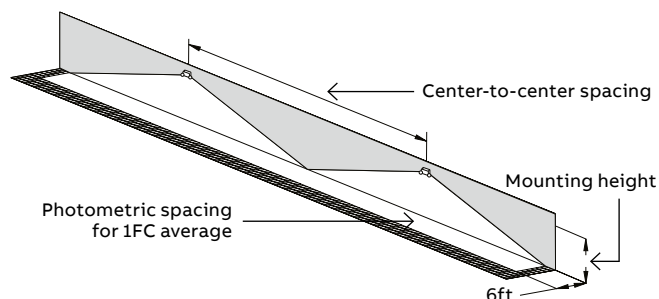


Dimensions

Dimensions are approximate and subject to change.

Charger & battery compartment:

For use in walls or ceilings with a cavity, not for use in block walls or solid ceilings.

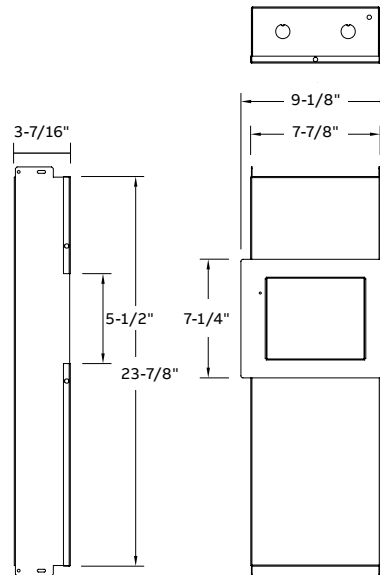

Power consumption

Model	Input current	Maximum		Stand-by ¹
		Input power	Input current	
120V	0.25A	30W	0.1A	11W
277V	0.12A	30W	0.05A	11W

¹Stand-by power consumption is 50% lower for lead-calcium batteries

Unit rating

Model	Watts to 87-1/2% of rated battery voltage ¹			
	1-1/2 hrs	2 hrs	4 hrs	8 hrs
RTM40, RTN40	40	30	24	–
RTM70, RTN70	70	50	40	24
RTM100, RTN100	100	70	50	40

¹National Electrical Code specification

Accessories (order as a separate item)

Description	Suffix
Remote test switch (metal face plate)	RTS
Remote test switch (plastic face plate)	RTS-1

How to order – Battery unit / AC remote fixture

Series	Battery type	Unit capacity	Lamp type/wattage	Options
RT	M= Lead-cadmium	40= 12V-40W	-2 (LG)= 12V-4W, MR16 LED	AD= Advanced Diagnostics (audible) ¹
	N= Ni-Cd	70= 12V-70W	-2 (LI)= 12V-5W, MR16 LED	ADNA= Advanced Diagnostics (non-audible) ¹
		100= 12V-100W	-2 (LJ)= 12V-6W, MR16 LED	DL= Damp location ²
			-2 (50H)= 50W, MR16 high lumen output	D3= Time delay (15 minutes)
Example: RTM100-2(LJ)-D3			X= Back box shipped separately	

Series	Input voltage	Lamp type/wattage	Options
RTG= Remote AC generator	1= 120VAC, 60Hz	-2(LG)= 12V-4W, MR16 LED	DL= Damp location
	2= 277VAC, 60Hz	-2(LI)= 12V-5W, MR16 LED	X= Back box shipped separately
		-2(LJ)= 12V-6W, MR16 LED	
		-2(50H)= 50W, high lumen output	
Example: RTG2-2(LG)-DL			

¹AD & ADNA include a time delay feature that can be enabled/disabled in the field or set by the factory

²Available on all models except Ni-Cd 100W

Mini-Revelation™ Series

The full retrofit unseen solution – 12V-40W capacities



Housing

- Galvanized steel back-box
- Easy access to internal components
- Head assembly door and trim plate powder coated in a white finish
- Finish can be customized on site with paint or wallpaper
- Choice of various 12 volt MR16 LED lamp wattages
- Complete 360° head assembly door rotation
- Slip gear mechanism protects unit and objects against forcible stops

Mounting

- Recessed wall with cavity mount (retrofit into finished wall)
- Designed to install into an 8-1/4" by 5-3/4" inch opening
- Key-hole slot for ease of installation

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Standard Advanced Diagnostics
- 120/277 60Hz

Choice of sealed maintenance-free battery

- 12V lead-calcium battery
- 12V nickel-cadmium battery

Approvals


- CSA-US (to UL 924 standards)
- NYC approved

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LG	55'	43'
LI	71'	56'
LJ	100'	85'
50H	160'	171'

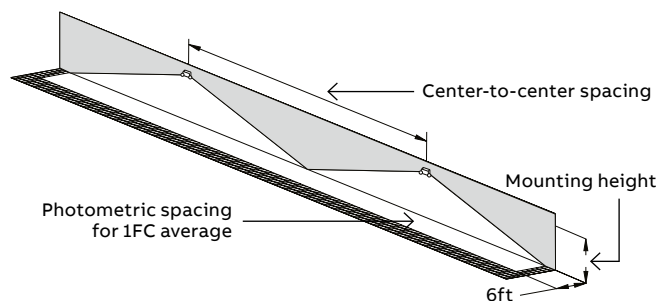

Dimensions

Dimensions are approximate and subject to change.

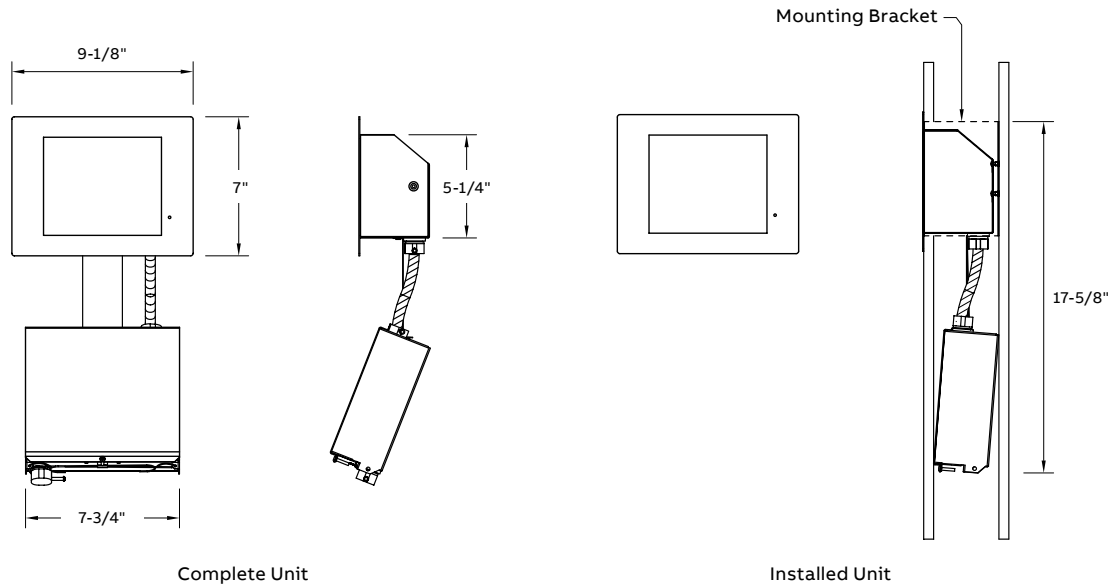

Power consumption

Model	AC input	Input current	Maximum	Stand-by (Ni-Cd, NiMH) ¹	
			Input power	Input current	Input power
MRT40	120VAC	0.25A	30W	0.1A	11W
	277VAC	0.12A	30W	0.05A	11W
MRTG	120VAC	0.95A	110W ²	–	–
	277VAC	0.45A	110W ²	–	–

¹Stand-by power consumption is 50% lower for lead-calcium batteries

²Maximum power when equipped with 2 x 50W lamps (generator unit)

Unit rating

Model	Watts to 87-1/2% of rated battery voltage ¹			
	1-1/2 hrs	2 hrs	4 hrs	8 hrs
MRT-40	40	30	24	–

¹National Electrical Code specification

Accessories (order as a separate item)

Description	Suffix
Remote test switch (metal face plate)	RTS
Remote test switch (plastic face plate)	RTS-1

How to order

Series	Battery type	Unit capacity	AC input	Lamp type/wattage	Options
Battery unit= MRT	M= Lead-calcium	40= 12V-40W	Blank= 120/277VAC	-2 (LG)= MR16 LED, 12V-4W	-AD= Advanced Diagnostics (audible) ¹
	N= Nickel-cadmium			-2 (LI)= MR16 LED, 12V-5W	-ADNA= Advanced Diagnostics (non-audible) ¹
				-2 (LJ)= MR16 LED, 12V-6W	-D3= Time delay (15 minutes)
					-DL= Damp location (only MRTN40, MRTH40) ²
Generator unit= MRT	G= Remote AC generator	Blank= Max. 100W	1= 120VAC 2= 277VAC	-2 (LG)= 12V-4W, MR16 LED	-DL= Damp location
				-2 (LI)= 12V-5W, MR16 LED	
				-2 (LJ)= 12V-6W, MR16 LED	
				-2 (50H)= 50W, high lumen output	

Example: MRTM40-2(LJ)-ADNA

¹AD & ADNA include a time delay feature that can be enabled/disabled in the field or set by the factory

²Available on all models except Ni-Cd 100W

RS Series

Designed for fully recessed installation in walls or ceilings



Housing

- Steel housing
- Standard off-white finish, optional black finish
- Lighting heads, available in thermoplastic or decorative die-cast aluminum
- Choice of MR16 LED lamp wattages

Mounting

- Fully recessed ceiling or wall-mount
- Hanger bars included for lay-in installation in T-bar grid
- Suitable for sheet rock installation

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Optional Advanced Diagnostics
- 120/277 60Hz

Choice of sealed maintenance-free battery

- 6V or 12V lead-calcium battery
- 6V or 12V nickel-cadmium battery

Approvals


- UL 924 listed
- NYC approved

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	43'	36'
LG	55'	43'
LI	71'	56'
LJ	100'	85'

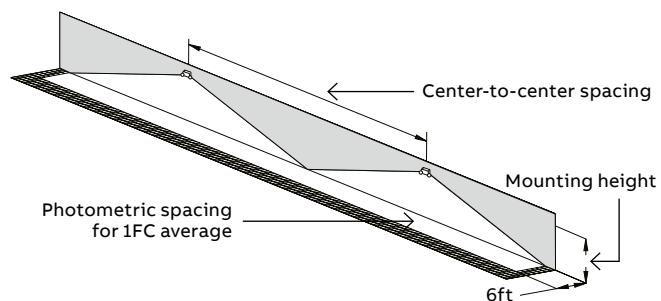

Dimensions

Dimensions are approximate and subject to change.

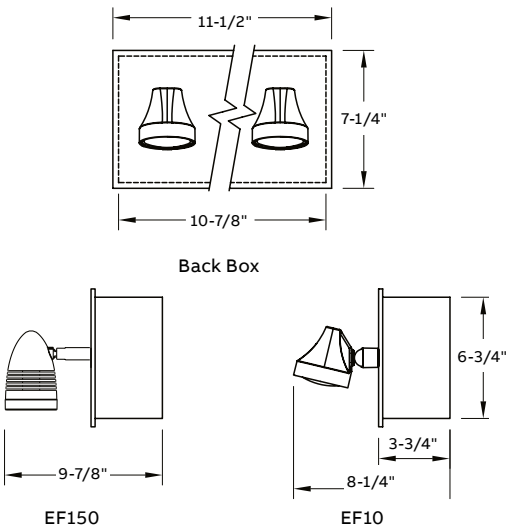

Unit rating

Sealed maintenance-free battery types	DC voltage	Model number	Battery capacity in watts			
			1 1/2 hrs	2 hrs	3 hrs	4 hrs
Lead-calcium	6	RSM18	18	12	9	–
	6	RSM27	27	18	14	10
	6	RSM36	36	25	20	14
	12	12RSM36	36	25	20	14
Nickel-cadmium	6	RSC18	18	12	10	–
	6	RSC25	25	18	12	9
	12	12RSC36	36	21	15	12
	12	12RSC50	50	36	25	18

Accessories (order as a separate item)

Description	Suffix
Wire guard	WG6-E
Remote test switch (metal face plate)	RTS
Remote test switch (plastic face plate)	RTS-1

How to order

Color	Series/battery type	# of heads	Head style	Lamp type/wattage	Options
Blank= Factory white enclosure	Lead-calcium	-0= No head	10= EF10 mini plastic MR16	LA= 6V-4W, MR16 LED	Blank= No options
	RSM18= 6V-18W	-1= One head		LG= 12V-4W, MR16 LED	-AD= Advanced Diagnostics (audible)
	RSM27= 6V-27W	-2= Two heads	150= EF150 deco heads MR16	LI= 12V-5W, MR16 LED	-ADNA= Advanced Diagnostics (non-audible)
	RSM36= 6V-36W			LJ= 12V-6W, MR16 LED	-D3= Time delay (15 minutes)
	12RSM36= V12V-36W				
	Nickel-cadmium				
	RSC18= 6V-18W				
	RSC25= 6V-25W				
	12RSC36= 12V-36W				
	12RSC50= 12V-50W				

Example: BRSC18-210LA-AD

TS Series

Designed for unobtrusive use in T-bar ceilings



nexus



Housing

- Steel housing
- Standard off-white finish, optional black finish
- Lighting heads, available in thermoplastic or decorative die-cast aluminum
- Choice of MR16 LED lamp wattages

Mounting

- Fully recessed ceiling
- Hanger bars included for lay-in installation in t-bar grid

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Choice of sealed maintenance-free battery

- 6V, 12 or 24V lead-calcium battery
- 6V, 12 or 24V nickel-cadmium battery

Approvals


- UL 924 listed
- NYC approved

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometry performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	43'	36'
LG	55'	43'
LI	71'	56'
LJ	100'	85'
LL	56'	44'

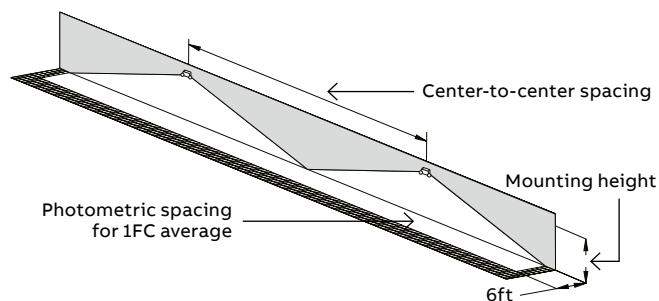


Dimensions

Dimensions are approximate and subject to change.

Cabinet information

		Dimensions
Cabinet size	A	B
S	3-1/4"	4-5/8"
L	5-5/8"	7-1/8"

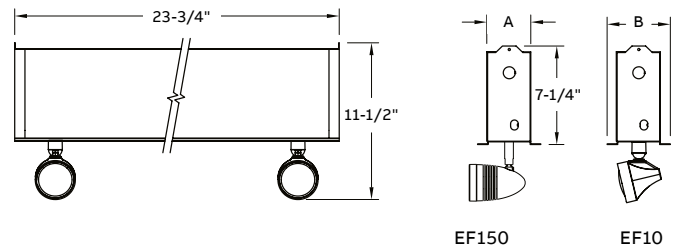**Unit rating**

Sealed maintenance-free battery types	DC voltage	Model number	Battery capacity in watts				Cabinet size
			1 1/2 hrs	2 hrs	3 hrs	4 hrs	
Lead-calcium	6	TSM18	18	12	10	7	S
	6	TSM27	27	18	14	10	S
	6	TSM36	36	25	20	14	S
	6	TSM54	54	37	28	21	S
	6	TSM81	81	54	42	30	L
	6	TSM110	110	72	56	40	L
	12	12TSM36	36	25	20	14	S
	12	12TSM54	54	37	28	21	S
	12	12TSM110	110	72	56	40	L
Nickel-cadmium	24	24TSM110	110	72	56	40	L
	6	TSC18	18	12	9	6	S
	6	TSC25	25	18	12	9	S
	12	12TSC36	36	21	15	12	S
	12	12TSC50	50	36	25	18	S
	24	24TSC100	100	73	50	37	L

Accessories (order as a separate item)

Description	Suffix
Remote test switch (metal face plate)	RTS
Remote test switch (plastic face plate)	RTS-1

How to order

Series	Series/battery type/capacity	# of heads	Head style	Lamp type/wattage	Options
Blank= Factory white enclosure B= Black enclosure	Lead-calcium	-0= No head	10= EF10 mini	LA= 6V-4W,	-AD= Advanced Diagnostics (audible) ¹
	TSM18= 6V-18W lead-calcium	-1= One head	plastic MR16	MR16 LED	-ADNA= Advanced Diagnostics (non-audible) ¹
	TSM27= 6V-27W lead-calcium	-2= Two heads	150= EF150	LG= 12V-4W,	-D3= Time delay (15 minutes)
	TSM36= 6V-36W lead-calcium	-3= Three heads	heads MR16	MR16 LED	-NEX= Nexus® wired (consult your sales representative)
	TSM54= 6V-54W lead-calcium			LI= 12V-5W,	-NEXRF= Nexus® wireless (consult your sales representative)
	TSM81= 6V-81W lead-calcium			MR16 LED	
	TSM110= 6V-110W lead-calcium			LJ= 12V-6W,	
	12TSM36= 12V-36W lead-calcium			MR16 LED	
	12TSM54= 12V-54W lead-calcium			LL= 24V-4W,	
	12TSM110= 12V-110W lead-calcium			MR16 LED	
	24TSM110= 24V-110W lead-calcium				
	Nickel-cadmium				
	TSC18= 6V-18W nickel-cadmium				
	TSC25= 6V-25W nickel-cadmium				
	12TSC36= 12V-36W nickel-cadmium				
	12TSC50= 12V-50W nickel-cadmium				
	24TSC100= 24V-100W nickel-cadmium				

Example: BRSC18-210LA-AD

¹Minimum lamp load required: 20% of unit capacity. Not available with 100W Ni-Cd 24V.

Prestige™ Edge-Lit Series

Premium die-cast aluminum exit sign



Construction

- Housing, trim plate, trim ring and canopy made of die-cast aluminum
- U-shaped clear acrylic Legend panel features laser-etched letters and chevrons
- 6 inch EXIT lettering legend, available in red or green
- 8 inch EXIT lettering legend, available in red
- Choice of finishes: white, black or brushed aluminum, polished brass, polished chrome or bronze

Mounting

- Modular design allows for surface or recessed mount
- Canopy included for surface wall, end or ceiling mount applications
- Trim ring included for recessed wall or ceiling mount applications.
- Housing provided with conduit knock-out 1/2", top, back and end
- (C) circular or (A) angular trim plate used for surface or recessed wall or ceiling mount applications
- Hanger bars included for lay-in installation in T-bar grid

Special wording panels

- Available. Contact your sales representative with your design requirements

Electronics

- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120-277 60Hz


Approvals

- UL 924 listed
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards


Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Mounting configurations

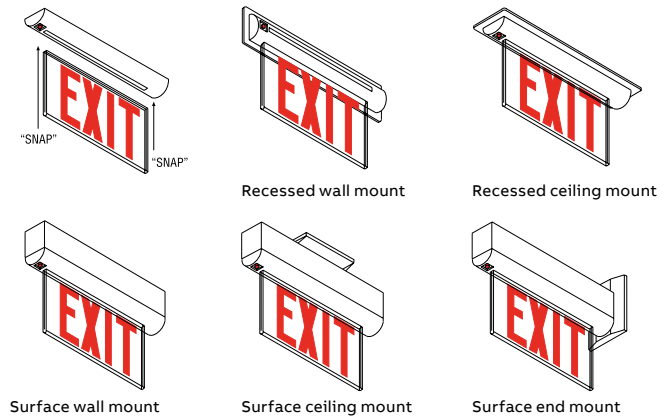


Trim plates




Circular trim plate

Angular trim plate

Recessed models

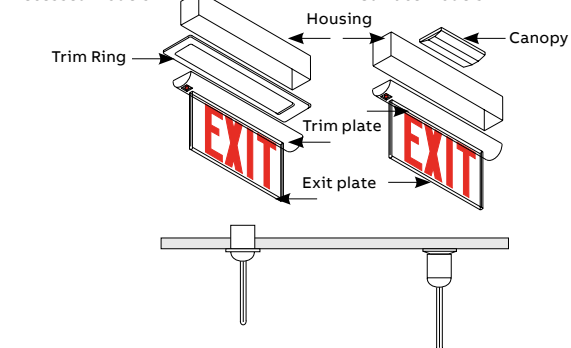


Arrow (chevron) designation




Wording and chevrons not to scale. For illustration purposes only.

Housing color

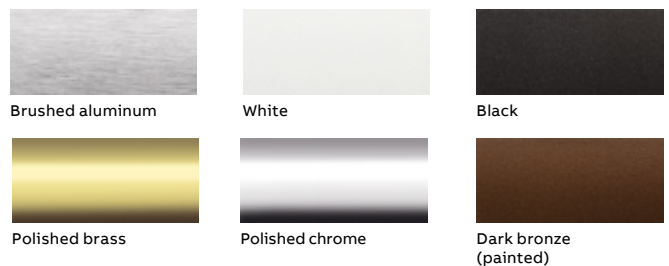

Dimensions

Dimensions are approximate and subject to change.

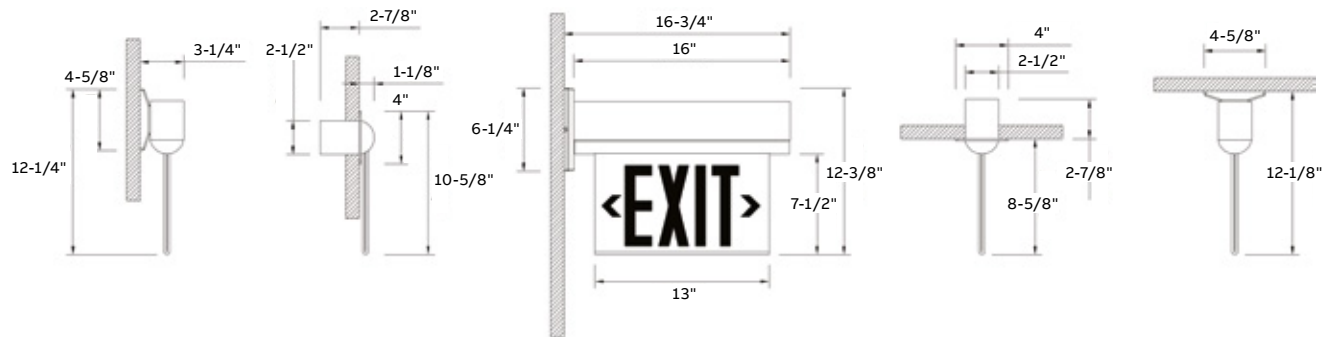

Power consumption

Model	AC specs		DC specs	
AC-only	120 to 277VAC, 50/60Hz	Less than 1.4W	–	–
AC/DC-remote	120 to 277VAC, 50/60Hz	Less than 1.4W	6 to 24VDC	Less than 1.4W
Self-powered	120 to 277VAC, 50/60Hz	Less than 2.3W	Ni-Cd battery	Min. 90 minutes
Self-powered diagnostic	120/277VAC, 50/60Hz	Less than 2.3W	Ni-Cd battery	Min. 90 minutes

Accessories (order as a separate item)

Description	Suffix ¹
White pendant	P*-WT
Black pendant	P*-BK
Gray pendant	P*-GY

¹Custom pendant lengths and colors available, specify (12", 24", 36", etc.)

How to order

Housing color	Series	Faces	Designation	Legend color	Background color	Arrows
Blank = Brushed aluminum W = White B = Black PB = Polished brass CH = Polished chrome BR = Bronze	LX = AC-only LXN = Self-powered	1 = Single face 2 = Double face	N = New design	R = Red G = Green	C = Clear (single face only) W = White M = Mirror	Blank = No arrow D = Double arrow L = Arrow left R = Arrow right RL = Right & left (double face) UA = Universal field installed arrows
Trim	Mounting	Options		Legend size		
-C = Circular -A = Angular	Blank = Universal mount	Blank = No option -NEX = Nexus® wired ¹ (consult your sales representative) -NEXRF = Nexus® wireless ¹ (consult your sales representative) -D = Self-test and diagnostic ¹ -DC = AC/DC remote 6-24 VDC -FA = Fire alarm ¹ -FZ = Flasher & buzzer ¹ -2CKT = Two circuit, AC only		Blank = 6" EXIT legend -8 = 8" EXIT legend (red only) -LP = Panel shipped separately -X = Back box shipped separately		

Example: WLXN2NRWRL-A-D

¹Self-powered only

Prestige™ X40 Series

Edge-lit recessed ceiling-mount exit sign



Construction

- Trim plate, trim ring and canopy made of die-cast aluminum
- U-shaped clear acrylic Legend panel features laser-etched letters and chevrons
- 6 inch EXIT lettering legend, available in red or green
- 8 inch EXIT lettering legend, available in red
- Choice of finishes: white, black or brushed aluminum, polished brass, polished chrome or bronze

Mounting

- Hanger bars included for lay-in installation in t-bar grid
- Housing provided with conduit knock-out 1/2", top, back and end
- Flat trim plate used for recessed ceiling mount only applications

Special wording panels

- Available. Contact your sales representative with your design requirements

Electronics

- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120-277 60Hz

Approvals

- UL 924 listed
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf


Power consumption

Model	AC specs			DC specs
AC-only	120 to 277VAC, 60Hz	Less than 1.4W	–	–
AC/DC-remote	120 to 277VAC, 60Hz	Less than 1.4W	6 to 24VDC	Less than 1.4W
Self-powered	120 to 277VAC, 60Hz	Less than 2.3W	Ni-Cd battery	Min. 90 minutes
Self-powered diagnostic	120/277VAC, 60Hz	Less than 2.3W	Ni-Cd battery	Min. 90 minutes

Housing color



Brushed aluminum



White



Black



Polished brass




Polished chrome



Dark bronze
(painted)

Dimensions

Dimensions are approximate and subject to change.

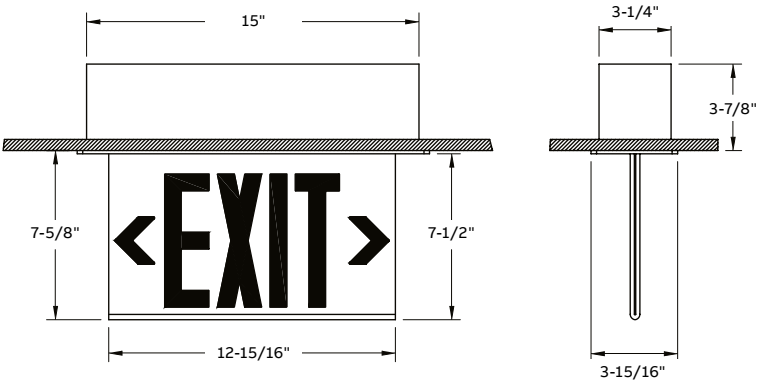

Arrow (chevron) designation

EXIT>

Arrow right (R)

<EXIT

Arrow left (L)

<EXIT>

Double arrow (D)

EXIT>

Arrow right & left (RL) represents each side of a double face panel

<EXIT

Arrow right & left (RL) represents each side of a double face panel

Wording and chevrons not to scale. For illustration purposes only.

Accessories (order as a separate item)

Description	Suffix ¹
Special wording	Contact your sales representative
Two 27-inch adjustable bar hangers ¹	TBH

¹Bar hangers supplied with unit, order as replacement only

How to order

Housing	Series	Faces	Designation	Legend color	Background color
Blank= Brushed aluminum	LX= AC-only	40= Less panel	N= New design	R= Red	C= Clear (single face only)
W= White	LSNX= Self-powered	42= Single face		G= Green	W= White
B= Black		43= Double face			M= Mirror
PB= Polished brass					
CH= Polished chrome					
BR= Bronze					
Arrows		Options		Legend size	
Blank= No arrow		Blank= No option		Blank= 6" EXIT legend	
D= Double arrow		-AD= Advanced Diagnostics (non-audible) ¹		-8= 8" EXIT legend (red only)	
L= Arrow left		-NEX= Nexus® wired ¹		-LP= Panel shipped separately	
R= Arrow right		-NEXRF= Nexus® wireless ¹		-X= Back box shipped separately	
RL= Right & left (double face)		-DC= AC/DC remote 6-24 VDC			
UA= Universal field installed arrows		-FA= Fire alarm ¹			
		-FZ= Flasher & buzzer ¹			
		-2CKT= Two circuit, AC only			

Example: WLSNX42NRWR-AD

¹Self-powered only

Prestige™ DX Series

Die-cast exit sign



Construction

- Faceplate, backplate and canopy are made of die-cast aluminum
- 6 inch EXIT lettering legend, available in red or green
- 8 inch EXIT lettering legend, available in red
- Choice of finishes: white, black, brushed aluminum or dark bronze

Mounting

- Surface mount
- Canopy included for end or ceiling mount applications
- Universal J-box mounting

Special wording panel

- Available. Contact your sales representative with your design requirements

Electronics

- Standard Advanced Diagnostics on DXN
- Optional Nexus® monitoring system
- 120-277 60Hz
- **Approvals**
 - CSA-US (To UL 924 standards)
 - Damp location optional (50°F to 104°F)
 - Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards


Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

Power consumption


Model 6"	AC specs	DC specs
AC-only	120 to 277VAC, 50/60Hz	–
AC/DC-remote	120 to 277VAC, 50/60Hz	6 to 48VDC
Self-powered	120 to 277VAC, 50/60Hz	Nickel-cadmium battery
Model 8"	AC specs	DC specs
AC-only	120 to 277VAC, 50/60Hz	–
AC/DC	120 to 277VAC, 50/60Hz	6 to 24VDC
Self-powered	120 to 277VAC, 50/60Hz	Nickel-cadmium battery

Color frame/faceplate colors

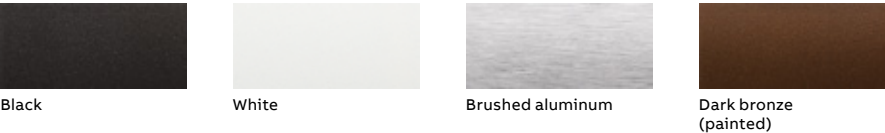

Dimensions

Dimensions are approximate and subject to change.

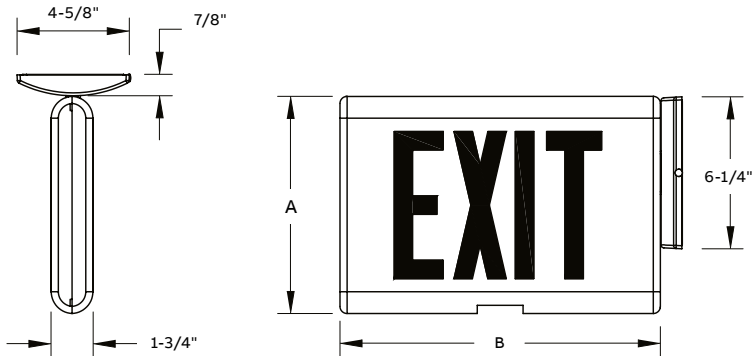

Cabinet information

Letters	Dimensions	
	A	B
6"	8-7/8"	13-1/16"
8"	10-1/2"	15-1/4"

Accessories (order as a separate item)

Description	Suffix
White pendant	PDW ¹
Black pendant	PDB ¹
Pendant mount gray	PDGY ¹
Wire guard (wall mount) (6 in.)	WG12-E
Wire guard (ceiling mount) (6 in.)	WG5-E
Wire guard (end mount) (6 in.)	WG5-E

¹Specify pendant length (12", 24", 36", etc.)

How to order

Color frame/faceplate	Series	# of faces	Legend color	Letters
Blank = Black/brushed aluminum	DXN = Self-powered unit	1 = Single face	R = Red	Blank = 6" letters
WW = White/white	DX = AC/DC ¹	2 = Double face	G = Green	8 = 8" letters
WA = White/brushed aluminum			Open face ²	
BZ = Bronze/bronze			RW = Red on white	
BB = Black/black			GW = Green on white	
AA = All brushed aluminum				
Diagnostic options		Options	Version	
Blank = Standard		Blank = Standard	-N = New design ³	
NEX = Nexus® wired		DL = Damp location		
		VR = Vandal resistant screws		
		VR1 = Polycarbonate shield with tamper proof screws		
		2CKT = 2 Circuit (120/120 or 277/277, AC only) ³		

Example: DXN1R-N

¹Not available with Nexus® wired option
²Open face required for special wording
³Not required for 8" letters

Prestige™ Floor Proximity Series

Master with remote floor proximity LED exit



Prestige™ DX, DXN “Master” & LL “Floor Proximity” Tandem Exit Signs (must be ordered together)

Construction

- **DX, DXN** “Master” exit faceplate, backplate and canopy are made of die-cast aluminum
- **DX, DXN** offers 6 inch EXIT lettering legend, available in Red or Green
- **LL** “Floor Proximity” exit faceplate is made of die-cast aluminum; backbox is made of steel
- **LL** offers 6 inch EXIT lettering legend, available in red or green
- Choice of finishes: white, black or brushed aluminum
- Red or green long-life light emitting diodes (LED) illumination

Mounting

- **DX, DXN** surface mount only
- Canopy included for ceiling mount applications
- Backplate features universal knockouts for a standard 4 inch junction box, used in wall mount applications
- **LL** surface mount or recessed mount
- Single face model only


Power consumption

Color	Model	AC specs		DC specs	
Red	AC-only	120/277VAC	1.3W	—	—
	AC-2 circuit	120/277 and 277/277VAC	2.6W	—	—
	Self-powered	120/277VAC	3.8W	Ni-Cd battery	Min. 90 minutes
Green	AC-only	120/277VAC	1W	—	—
	AC-2 circuit	120/277 and 277/277 VAC	3.3W	—	—
	Self-powered	120/277VAC	5W	Ni-Cd battery	Min. 90 minutes

Housing colors



Brushed aluminum



White



Black

Chevrons

- **DX, DXN** faceplate includes two field-selectable, knock-out chevron indicators
- **LL** faceplate does not include chevron indicators

Self-Diagnostics

- **DXN** self-powered model standard with Advanced Diagnostics

Special wording panel

- Not available

Electronics

- Standard Advanced Diagnostics on **DXN**
- Optional Nexus® monitoring system
- 120-277 60Hz

Approvals

- CSA-US (to UL 924 standards)
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards


Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Dimensions

Dimensions are approximate and subject to change.


Self-powered/AC-only master DXN1G-M-N DX1G-M-N



Floor proximity slave surface mount LLGS LLRS

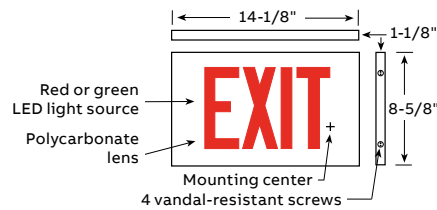


Floor proximity slave recessed mount LLGR LLRR

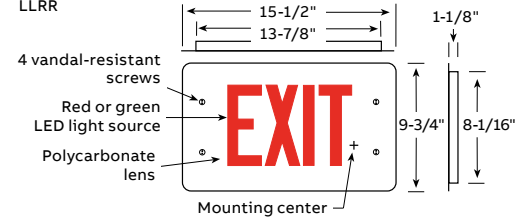


How to order for a typical application:

Self-powered master with floor proximity unit

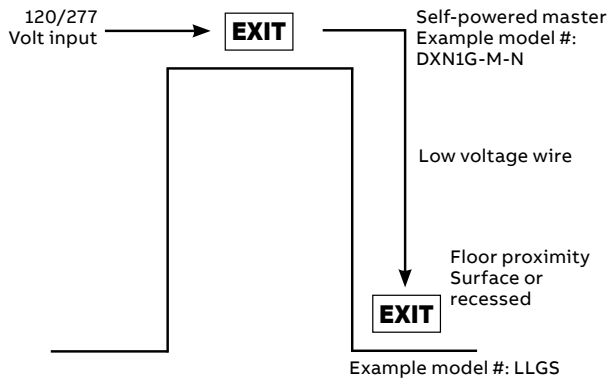

AC-only master with floor proximity unit 2 circuit application

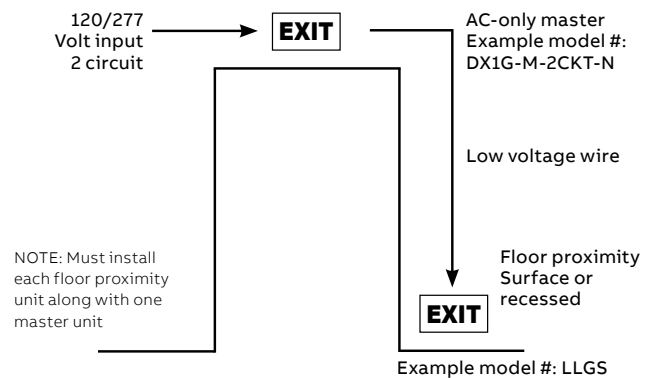

Features (optional)

Description	Suffix
Vandal-resistant shield and screws	VR1

Accessories (order as a separate item)

Description	Suffix
Wire guard (for floor proximity recessed)	WG11-E

How to order – self-powered master (unit for above door)

Color option prefix	Series	Faces	Stencil face lamp color	Master unit	Standard series designator
Blank = Brushed alum. face, black body	DXN	1= Single face 2= Double face	R = Red G = Green RW = Red/white GW = Green/white	-M	-N
WW = All white					
BB = All black					

Example: DXN1G-M-N

How to order – AC-only master (unit for above door)

Color option prefix	Series	Faces	Stencil face	Master unit	Option	Standard series designator
Blank = Brushed alum. face, black body	DX	1= Single face 2= Double face	R = Red G = Green RW = Red/white GW = Green/white	-M	Blank = AC only	-N
WW = All white						
BB = All black						

Example: DX1G-M-2CKT-N

How to order – floor proximity unit (unit on side of door)

Color option prefix	Series	Stencil face lamp color ¹	Mounting	Option
Blank = Brushed alum. face, black body	LL	R = Red G = Green RW = Red/white GW = Green/white	R = Recessed S = Surface	-VR1 = Vandal-resistant screws/ polycarbonate shield
W = All white				
B = All black				

Example: LLGS-VR1

¹Open face required for special wording (please contact your sales representative)

Prestige™ Edge-Lit Accessibility Series

Premium die-cast aluminum exit sign with international symbol of accessibility



Construction

- Housing, trim plate, trim ring and canopy made of die-cast aluminum
- U-shaped clear acrylic Legend panel features laser-etched letters
- 6 inch EXIT lettering legend, with accessibility sign in green
- Choice of finishes: white, black or brushed aluminum, polished brass, polished chrome or bronze

Mounting

- Modular design allows for surface or recessed mount
- Canopy included for surface wall, end or ceiling mount applications
- Trim ring included for recessed wall or ceiling mount applications.
- Housing provided with conduit knock-out 1/2", top, back and end
- (C) circular or (A) angular trim plate used for surface or recessed wall or ceiling mount applications
- Hanger bars included for lay-in installation in T-bar grid

Special wording panels

- Available. Contact your sales representative with your design requirements

Electronics

- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120-277 60Hz

Approvals

- UL 924 listed
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards


Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Housing color



Brushed aluminum



White



Black






Polished brass



Polished chrome


Dark bronze
(painted)

Mounting configurations




Recessed wall mount


Recessed ceiling mount



Surface wall mount



Surface ceiling mount



Surface end mount

Trim plates




Circular trim plate




Angular trim plate

Recessed models

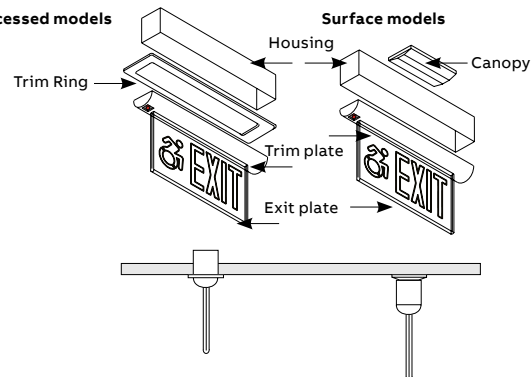

Dimensions

Dimensions are approximate and subject to change.

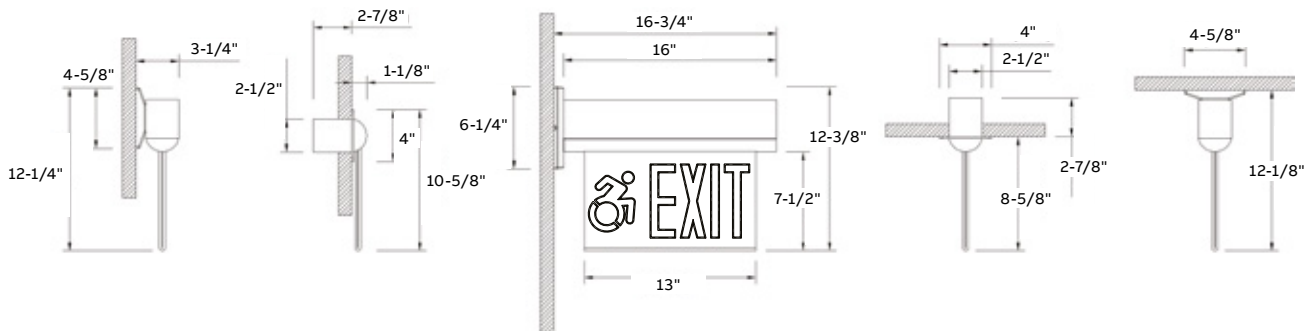

Power consumption

Model	AC specs		DC specs	
AC-only	120 to 277VAC, 50/60Hz	Less than 2.5W	–	–
AC/DC-remote	120 to 277VAC, 50/60Hz	Less than 2.5W	6 to 24VDC	Less than 2.5W
Self-powered	120 to 277VAC, 50/60Hz	Less than 3.5W	Ni-Cd battery	2 Hours
Self-powered diagnostic	120/277VAC, 50/60Hz	Less than 3.5W	Ni-Cd battery	2 Hours

Accessories (order as a separate item)

Description	Suffix ¹
White pendant	P*-WT
Black pendant	P*-BK
Gray pendant	P*-GY

¹Custom pendant lengths and colors available, specify (12", 24", 36", etc.)

How to order panel (order panel as a separate item)

Description	Part number	
Single face green on clear symbol on the right	014145-E	PNL GC 6" "EXIT+HCP-R""U"
Single face green on white symbol on the right	014150-E	PNL GW 6" "EXIT+HCP-R""U"
Single face green on mirror symbol on the right	014147-E	PNL GM 6" "EXIT+HCP-R""U"
Double face green on white symbol on the right	014151-E	PNL GW 6" "EXIT+HCP-R""U" DBL
Double face green on mirror symbol on the right	014152-E	PNL GM 6" "EXIT+HCP-R""U" DBL
Single face green on clear symbol on the left	014148-E	PNL GC 6" "EXIT+HCP-L""U"
Single face green on white symbol on the left	014153-E	PNL GW 6" "EXIT+HCP-L""U"
Single face green on mirror symbol on the left	014154-E	PNL GM 6" "EXIT+HCP-L""U"
Double face green on white symbol on the left	014155-E	PNL GW 6" "EXIT+HCP-L""U" DBL
Double face green on mirror symbol on the left	014149-E	PNL GM 6" "EXIT+HCP-L""U" DBL

How to order housing (order housing as a separate item)

Housing color	Custom specification	Model	Legend and panel	Trim plate
Blank= Brushed aluminum	CC= City of Chicago	PLX= AC only	LP= Panel shipped separately	A= Angular
W= White		PLXDC= AC/DC-Remote 6-24V		C= Circular
B= Black		PLX2CKT= AC-Dual circuit		
BR= Dark bronze (painted)		PLXN= Self-Powered		
PB= Polished brass		PLXND= Self-Powered Diagnostic		
CH= Polished Chrome				

Example: WCCPLXLPA

Spec Grade Commercial collection

Ideal for contractors, the commercial collection includes emergency lighting that meets performance and design criteria

- Provide a cohesive look with coordinating emergency lights, exit signs, and combination units in the same design series
- Offer durability and vandal resistance with thermoplastic housings and steel battery enclosure units
- Accommodate challenging installations with multiple mounting options
- Complement decor and meet specialized requirements with elegant die-cast exit signs and special wording custom signage

01 JS-HP Series –
Steel housing 12V
up to 40W capacities
lead-calcium or
nickel-cadmium battery
high performance
LED heads, suitable
for NEMA 1 location

See page 48 for
more information

01



Ideal for commercial
spaces such as

- Convenience stores
- Storage rooms
- Lobbies
- Offices
- Schools

For more commercial lighting options, see the full section of Remote Fixtures in this catalog.
To use existing lighting as emergency lighting, see Mini Inverters in this catalog.



Table of contents

Spec Grade Commercial

				
Premier™ Compact Series 38	Premier™ Series 40	Premier™ Combination Series 42	Premier™ Exit Series 44	Provider™ PRO-2N/ PRO-3N Series 46
				
JS-HP Series 48	JS Series 50	LC Series 52	LS Series 54	X10 LED Series 56
				
Prestige™ Economizer Recessed ceiling mount 58	Prestige™ Economizer Slim profile surface mount 59	Prestige™ Accessibility Series 60	Preceptor™ Series 62	Preceptor™ Recessed Series 63
				
			Preceptor™ Remote Capacity Series 64	Special Wording Series 66

Premier™ Compact Series

Thermoplastic Compact Housing



Housing

- White or black UV stabilized thermoplastic enclosure
- Clear polycarbonate lens covers
- Choice of MR16 LED lamp wattages

Mounting

- Wall mount
Optional: ceiling mount and pendant mount
- Universal J-box mounting

Lamp type

- Two MR16 LED lamps

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Choice of battery

- 6V or 12V lead-calcium battery
- 6V or 12V nickel-metal hydride battery

Approvals

- UL 924 listed
- UL 94-5VA flame rated thermoplastic housing
- Damp location listed (50°F to 104°F)
(10°C to 40°C)


Warranty

- Unit has a five-year warranty (excluding lamps and fuses)¹
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


¹For LED lamps warranty, refer to page 188 paragraph 3.3

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'

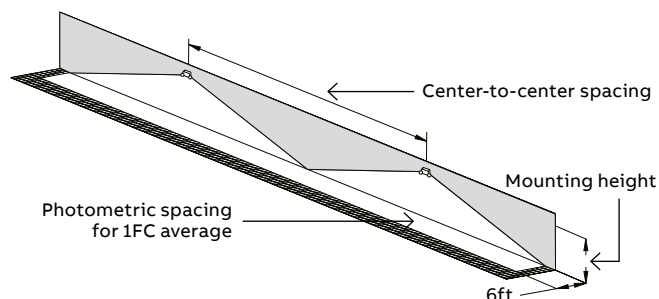

Housing color




White



Black

Dimensions

Dimensions are approximate and subject to change.

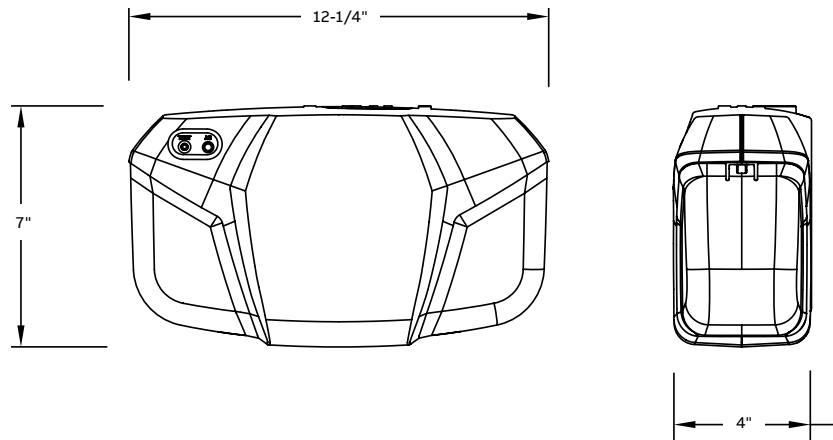

Unit rating

Series	AC Specs		Battery type	Voltage	Battery capacity in watts			
	AC input	Maximum			1-1/2 hrs	2 hrs	3 hrs	4 hrs
MPR10M	120/277	0.12 / 0.5A	Lead-calcium	6V-10W	10W	7.5W	5W	3.3W
12MPR12M		0.20 / 0.09A		12V-12W	12W	9W	6W	4W
12MPR20M		0.20 / 0.09A		12V-20W	20W	15W	10W	6.5W
MPR12H		0.21 / 0.5A	Nickel-metal hydride	6V-12W	12W	9W	6W	4W
12MPR12H		0.12 / 0.5A		12V-12W	12W	9W	6W	4W
12MPR24H		0.12 / 0.5A		12V-24W	24W	18W	12W	8W

How to order

Housing color	Series/capacity	# of lamps	Lamp type/wattage	Unit type	Options
Blank= White B= Black	MPR10M= 6V-10W lead-calcium 12MPR12M= 12V-12W lead-calcium 12MPR20M= 12V-20W lead-calcium MPR12H= 6V-12W nickel-metal hydride 12MPR12H= 12V-12W nickel-metal hydride 12MPR24H= 12V-24W nickel-metal hydride	Blank= No head 2= 2 heads	LA= 2 X 6V-4W, MR16 LED LG= 2 X 12V-4W, MR16 LED LI= 2 X 12V-5W, MR16 LED LJ= 2 X 12V-6W, MR16 LED	Blank= Standard -D= Advanced Diagnostics (non-audible) -DA= Advanced Diagnostics (audible) -NEX= Nexus® wired -NEXRF= NEXUS® wireless	Blank= No option -CM= Ceiling mount -DL= Damp location ¹ -D3= Time delay (15 minutes) -PM= Pendant mount ² -LC= Line cord (maximum 120V only) -15= 120/208/220-240V 50/60Hz input ³

Example: 12MPR12M2LJ

¹Not available in MPR10M

²-PM sold separately

³Not available with -NEX and -NEXRF

Premier™ Series

Designed with aesthetics, ease of installation and performance in mind



Housing

- White or black UV stabilized thermoplastic enclosure
- Clear polycarbonate lens covers
- Choice of MR16 LED lamp wattages

Mounting

- Wall mount, ceiling mount and pendant mount (optional)
- Universal J-box mounting

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Choice of battery

- 6V or 12V lead-calcium battery
- 6V or 12V nickel-cadmium battery

Approvals


- UL 924 listed
- UL 94, 5VA flame rated thermoplastic housing
- Damp location optional (50°F to 104°F)

Warranty


- Unit has a five-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'

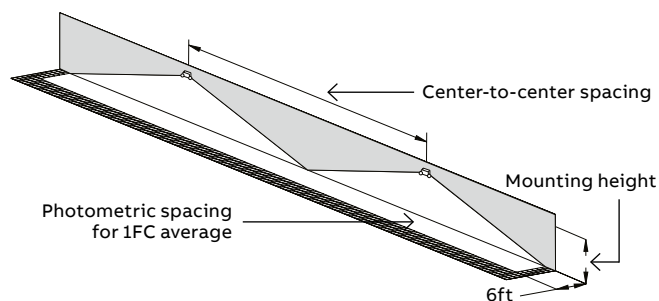

Housing color




White



Black

Dimensions

Dimensions are approximate and subject to change.

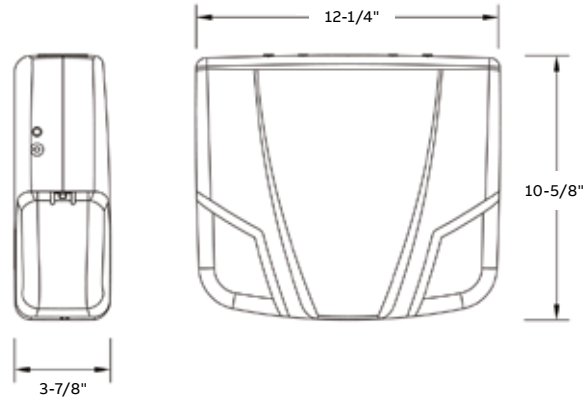

Wire guards

Catalog number	Mounting
WG1-E	Wall mount
WG5-E	Ceiling mount

Power consumption and unit rating

Model	AC specs	Battery capacity in watts			
		1-1/2 hrs	2 hrs	3 hrs	4 hrs
60M	6V	60	40	30	20
40M	12V	40	30	20	15
72M	12V	72	54	36	27
20NC	6V	20	15	10	8
40NC	12V	40	30	20	15

How to order

Housing color	Series/capacity	# of lamps	Lamp type/wattage	Unit type	Options
Blank= White	Lead-calcium	Blank= No head	LA= 6V-4W, MR16 LED	Blank= Standard	Blank= No option
B= Black	PR60M= 6V-60W lead-calcium	2= 2 heads	LG= 12V-4W, MR16 LED	-D= Advanced Diagnostics (non-audible) ¹	-CM= Ceiling mount
	12PR40M= 12V-40W lead-calcium		LI= 12V-5W, MR16 LED	-DA= Advanced Diagnostics (audible) ¹	-DL= Damp location ² 50°F to 104°F (10°C to 40°C)
	12PR72M= 12V-72W lead-calcium		LJ= 12V-6W, MR16 LED	-NEX= Nexus® wired (contact your sales representative) ¹	-PM= Pendant mount
	Nickel-cadmium			-NEXRF= NEXUS® wireless (contact your sales representative) ¹	
	PR20NC= 6V-20W nickel-cadmium				
	12PR40NC= 12V-40W nickel-cadmium				

Example: PR60M2LA

¹Minimum lamp load required: 20% of unit capacity

²Not available with -AD, ADNA, NEX and NEXRF.

Premier™ Combination Series

Specification-grade, LED, thermoplastic, snap-together combination unit



nexus



Construction

- White or black UV stabilized thermoplastic enclosure
- Clear polycarbonate lens covers
- Choice of MR16 LED lamp wattages
- 6 inch EXIT lettering legend, available in red or green
- Field-selectable chevrons

Mounting

- Surface mount
- Canopy included for ceiling mount applications
- Universal J-box mounting

Choice of battery

- 6V or 12V lead-calcium battery
- 6V or 12V nickel-metal hydride battery

Special wording panels

- Available, contact your sales representative with your design requirements

Electronics

- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Approvals


- UL 924 standards listed
- Nickel-metal hydride battery combination units UL listed for damp location (50°F to 104°F, 10°C to 40°C)
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards

Warranty


- Unit has a five-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'

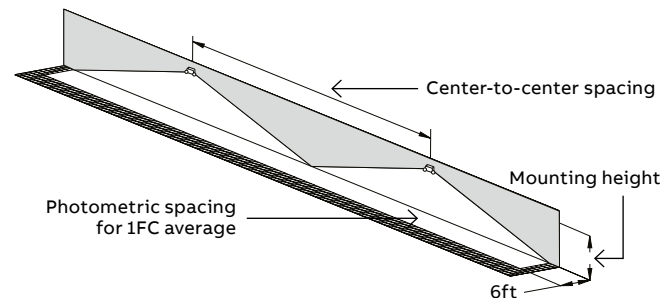

Housing color



White



Black


Double face configurations

Convert single face to double face in the field

Red/white	005715-E
Red/black	005716-E
Green/white	005717-E
Green/black	005718-E

Dimensions

Dimensions are approximate and subject to change.

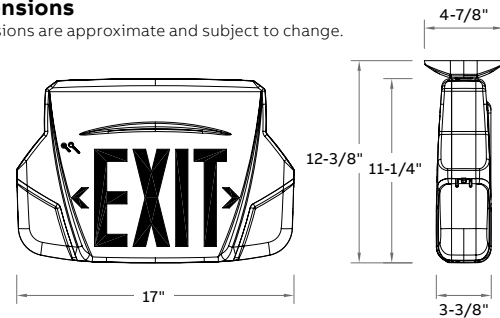

Power consumption and unit rating

			Battery capacity in watts				
Model		AC specs		1-1/2 hrs	2 hrs	3 hrs	4 hrs
Exit sign module	Battery type	120/277VAC	Less than 2W	–	–	–	–
612M	Lead-calcium	120/277VAC	0.11 / 0.05 A	12	8	–	–
624M	Lead-calcium	120/277VAC	0.11 / 0.05 A	24	16	12	9
1224M	Lead-calcium	120/277VAC	0.22 / 0.08 A	24	16	12	9
612H	Nickel-metal hydride	120/277VAC	0.11 / 0.05 A	12	9	–	–
1224H	Nickel-metal hydride	120/277VAC	0.22 / 0.08 A	24	18	12	9
1240H	Nickel-metal hydride	120/277VAC	0.22 / 0.08 A	40	30	20	15
1250H	Nickel-metal hydride	120/277VAC	0.22 / 0.08 A	50	36	24	18

Accessories (order as a separate item)

Description	Suffix
Wire guard (wall mount)	WG2-E
Pendant white	PRE-P-WH ¹
Pendant black	PRE-P-BK ¹

¹Specify pendant length in inches

How to order

Housing color	Series	Voltage/capacity/battery	Faces	Legend color
W= White B= Black	PR= Series	Lead-calcium 612M= 6V-12W, lead-calcium 624M= 6V-24W, lead-calcium 1224M= 12V-24W, lead-calcium Nickel-metal hydride 612H= 6V-12W, NiMH, rated damp location 1224H= 12V-24W, NiMH, rated damp location 1240H= 12V-40W, NiMH, rated damp location 1250H= 12V-50W, NiMH, rated damp location	1= Single face (ceiling or wall mount) 2= Double face (ceiling mount) 1N= Single face no canopy (wall mount) 4= Universal (2 faces, back plate and canopy)	G= Green legend R= Red legend

# of heads	Lamp type/wattage	Options
Blank= No heads 2= Two heads	LA= 6V-4W, MR16 LED LG= 12V-4W, MR16 LED LI= 12V-5W, MR16 LED LJ= 12V-6W, MR16 LED	Blank= No option -AD= Advanced Diagnostics (audible) ¹ -ADNA= Advanced Diagnostics (non-audible) ¹ -NEX= Nexus® wired (contact your sales representative) ¹ -NEXRF= NEXUS® wireless (contact your sales representative) ¹ -BA= Brushed aluminum exit stencil -D3= Time delay (15 minutes) -FA= Fire alarm activated flasher -FBF= Flasher buzzer + fire alarm activated flasher -FL= Flasher -FZ= Flasher buzzer -VR= Tamper-proof screws ² -VR1= Polycarbonate shield with tamper-proof screws ²

Example: WPR612M1R2LA

¹Not available with 1250H, must connect minimum 20% load capacity

²Not available with universal faces

Premier™ Exit Series

Specification-grade, LED, thermoplastic, snap together exit sign



Construction

- White or black UV stabilized thermoplastic enclosure
- 6 inch EXIT lettering legend, available in red or green
- Field-selectable chevrons

Mounting

- Surface mount
- Canopy included for end or ceiling mount applications
- Universal J-box mounting

Special wording panels

- Available. Contact your sales representative with your design requirements

Electronics

- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Approvals

- UL 924 listed
- Damp location (50°F to 104°F)
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards


Warranty

- Unit has a five-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Power consumption

Model		AC specs		DC specs
AC-only	120/277VAC, 60Hz	Less than 2.5W	–	–
AC/DC-remote	120/277VAC, 60Hz	Less than 2W	6 to 48VDC	Less than 1.5W
Self-powered	120/277VAC, 60Hz	Less than 3.3W	Ni-Cd battery	Min. 90 minutes
Self-powered diagnostic	120/277VAC, 60Hz	Less than 2.8W	Ni-Cd battery	Min. 90 minutes

Housing color




White



Black

Dimensions

Dimensions are approximate and subject to change.

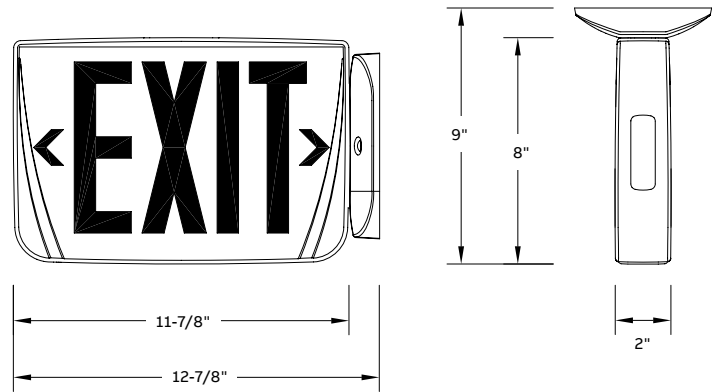

Wire guards

Wall	Ceiling	End
WG1-E	WG5-E	WG5-E

Accessories (order as a separate item)

Description	Suffix
Pendant white	PRE-P-WH ¹
Pendant black	PRE-P-BK ¹
Wire guard (wall mount)	WG1-E
Wire guard (ceiling mount and end mount)	WG5-E

¹Specify pendant length in inches

How to order

Housing color	Series	Unit type	Color	Options
W= White B= Black	PREM= LED plastic EXIT	AC= AC only (120/277V) 2C1= Dual AC circuit (2x120V) 2C2= Dual AC circuit (2x277V) U= 120/277VAC & 6 to 48VDC SNX= Self-powered Ni-Cd DN= Self-powered advanced diagnostic circuitry NEX= NEXUS® wired NEXRF= NEXUS® wireless	R= Red universal G= Green universal Open face RW= Red on white GW= Green on white (Open face required with special wording legends)	Blank= No option BA= Brushed aluminum exit stencil FA= Fire alarm activated flasher (AC, U, 2C1, 2C2 and DN models only) FBF= Flasher buzzer + fire alarm activated flasher (DN model only) FL= Flasher FZ= Flasher buzzer (DN model only) 1-VR= Single face vandal-resistant screws ¹ 2-VR= Double face vandal resistant screws ¹ 1-VR1= Single face polycarbonate shield with tamper proof screws ¹ 2-VR1= Double face polycarbonate shield with tamper proof screws ¹

Example: WPREMACR

¹Please specify single or double face, red or green

Provider™ PRO-2N/PRO-3N Series

6V thermoplastic housing protected LED lamps



nexus



Housing

- White or black UV stabilized thermoplastic enclosure
- Clear polycarbonate lens covers
- 6V 4W MR16 LED lamps

Mounting

- Surface mount
- Universal J-box mounting

Lamp type

- MR16 LED Lamp, 6V-4W

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Battery

- 6V lead-calcium battery

Approvals


- UL 924 listed
- Damp location optional (50°F to 104°F)

Warranty


- Unit has a three-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'

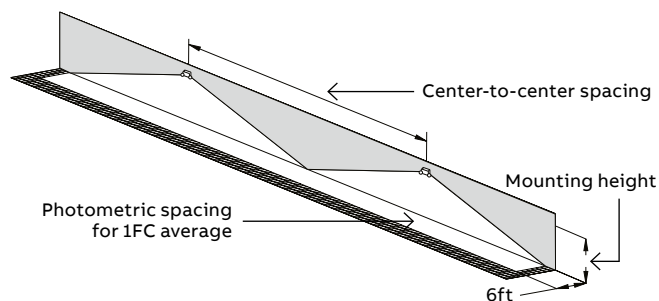

Housing color




Off white




Black

Dimensions

Dimensions are approximate and subject to change.

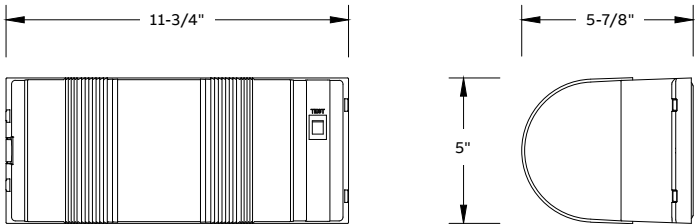

Fast and easy installation

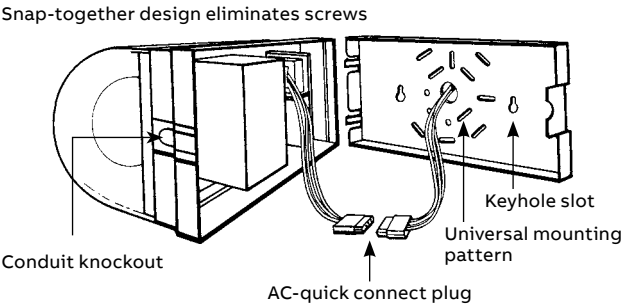

Power consumption and unit rating – each unit furnished with one LED lamp per head

Sealed maintenance-free battery types	DC voltage	Model number	Battery capacity in watts			
			1-1/2 hrs	2 hrs	3 hrs	4 hrs
Lead-calcium	6V	PRO-2N	10	8	–	–
	6V	PRO-3N	18	12	10	7

Accessories (order as a separate item)

Description	Suffix
Additional special bit for tamper-proof screws	690.0454-E
Replacement lamps	
580.0097-E	MR16 LED 6V-4W

How to order

Color	Series	Lamp type	Unit type	Options
Blank= Off white B= Black	PRO-2N= 6V-10.8W PRO-3N= 6V-18W	-LA= 6V-4W, MR16 LED	Blank= Standard unit -AD= Advanced Diagnostics (audible) -ADNA= Advanced Diagnostics (non-audible) NEX= NEXUS® wired ¹ NEXRF= NEXUS® wireless ¹	C= Line cord 120V 3 feet CM= Ceiling mount - supplied with metal harness DL= Damp location VR= Vandal-resistant screws

Example: BPRO-2N-LADL

¹Available with PRO-2N only

JS-HP Series

High performance and labor saving features normally found in higher voltage units



nexus



Housing

- Steel housing
- Standard gray finish, optional black finish

Lamp heads

- 6W (L6 lamp suffix), 10W (L10 lamp suffix) and 15W (L15 lamp suffix) high efficacy LED emergency heads outperform traditional 50W MR16-IR halogen
- Black heads available in 15W (L15 lamp suffix) only
- Innovative head design: four-LED and dual-driver provide illumination even in case of unexpected component failure
- Die-cast aluminum, LED heads

Mounting

- Wall or ceiling mount
- Universal J-box mounting

Electronics

- Pulse plus charger
- Low voltage disconnect

- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Choice of battery

- 12V lead-calcium battery
- 12V nickel-cadmium battery

Approvals

- UL 924 listed
- NYC approved

Warranty


- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Unit rating – equipment with remote capability

Sealed maintenance-free battery types	DC voltage	Model number	Battery capacity in watts				Cabinet size
			1 1/2 hrs	2 hrs	3 hrs	4 hrs	
Lead-calcium	12	12JSM36-2	36	25	20	14	S
Nickel-cadmium	12	12JSC30-2	30	21	15	12	S
	12	12JSC40-2	40	36	25	18	S

Dimensions

Dimensions are approximate and subject to change.

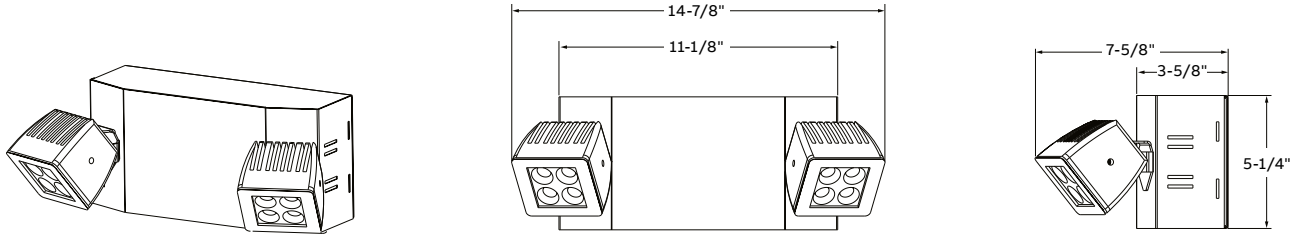


Photometric performance

The JS-HP Series of LED emergency lights deliver a stable and consistent illumination on the path of egress for a wide range of mounting heights. Depending on the application, one may select and specify among three level of lumen output and cross reference to traditional incandescent emergency lights below.

Illumination

LED head	Power	Total lumens	Out-perform spacing of the incandescent
L6	6W	565	35W PAR36, MR16 halogen
L10	10W	1000	50W PAR36, MR16 halogen
L15	15W	1300	50W MR16-IR halogen

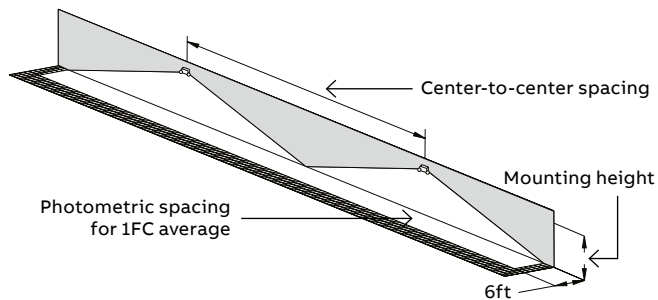

NEMA 1 environment: wall mounted equipment, reflectances: 10/10/10; 6-ft wide illumination path. 200 ft X 200 ft X 30 ft space.

Illumination as per NFPA101;
Average: 1fc; Min: 0.1fc; Max/min < 40:1

NEMA 1 environment – wall mounted equipment

Mounting height	Spacing center-to-center (feet)		
	Lamp l6 / 6w, 565lm	Lamp l10 / 10w, 1000lm	Lamp l15 / 15w, 1300lm
10 ft	80	110	140
15 ft	70	105	135
20 ft	60	100	130
25 ft	50	95	120

Accessories (order as a separate item)

Description	Suffix
Mounting bracket	BJ-E
Wire guard (front mounted heads)	WG10-E

How to order

Color	Series/capacity	# of lamps	Head style	Head mounting	Options
B= Black ¹	Lead-calcium	-2= Two heads	L6= 12V-6W (565 lumens)	FM= Front mount	-AD= Advanced Diagnostics (audible)
G= Gray	12JSM36= 12V-36W, lead-calcium		L10= 12V-10W (1000 lumens)		-ADNA= Advanced Diagnostics (non-audible)
	Nickel-cadmium		L15= 12V-15W (1300 lumens)		-NEX= NEXUS® wired
	12JSC30= 12V-30W, nickel-cadmium				-NEXRF= NEXUS® wireless
	12JSC40= 12V-40W, nickel-cadmium				-C= Line cord 120V 3 feet
					-D3= Time delay (15 minutes)

Example: G12JSC30-2L15FM-AD

¹Available with 15 watt heads only

JS Series

Steel housing 6V & 12V up to 54W capacities



nexus



Housing

- Steel housing
- Standard off-white finish, optional black finish
- Choice of MR16 LED lamp wattages
- Heads available in thermoplastic or decorative die-cast aluminum

Mounting

- Ceiling or wall mount
- Universal J-box mounting

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Choice of battery

- 6V or 12V lead-calcium battery
- 6V or 12V nickel-cadmium battery

Approvals


- UL 924 standard
- NYC approved

Warranty


- Unit has a three-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	43'	36'
LG	55'	43'
LI	71'	56'
LJ	100'	85'

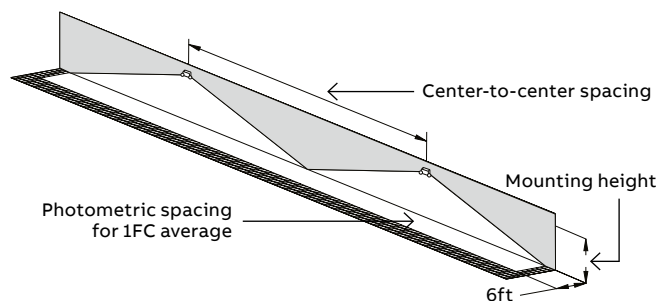

Housing color




Off white



Black

Dimensions

Dimensions are approximate and subject to change.

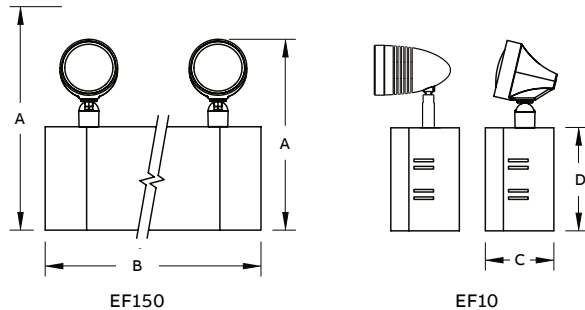

Cabinet information

Cabinet size	Dimensions			
	A	B	C	D
S	11-3/8" // 9-3/4"	11"	3-1/2"	5-1/4"
L	12-3/8" // 10-3/4"	12-3/4"	4"	6-1/4"

Unit rating

Sealed maintenance-free battery types	DC voltage	Model number	Battery capacity in watts				Cabinet size
			1 1/2 hrs	2 hrs	3 hrs	4 hrs	
Lead-calcium	6	JSM9	9	6	–	–	S
	6	JSM18	18	12	10		S
	6	JSM27	27	18	14	10	S
	6	JSM36	36	25	20	14	S
	6	JSM54	54	37	28	21	L
	12	12JSM36	36	25	20	14	S
Nickel-cadmium	12	12JSM54	54	37	28	21	L
	6	JSC18	18	12	–	–	S
	6	JSC25	25	18	12	9	S
	12	12JSC36	36	21	15	12	S
	12	12JSC50	50	36	25	18	S

Accessories (order as a separate item)

Description	Suffix
Mounting bracket (S cabinet only)	BJ-E
Wire guard (S cabinet only)	WG1-E
Wire guard (L cabinet only)	WG2-E
Wire guard (front mounted heads)	WG10-EG

¹S cabinet only, order on separate line

How to order

Color	Series/capacity	# of lamps	Head style	Lamp type/wattage	Options
Blank= Off white B= Black	Lead-calcium JSM9= 6V-9W, lead-calcium JSM18= 6V-18W, lead-calcium JSM27= 6V-27W, lead-calcium JSM36= 6V-36W, lead-calcium JSM54= 6V-54W, lead-calcium 12JSM20= 12V-20W, lead-calcium 12JSM36= 12V-36W, lead-calcium 12JSM54= 12V-54W, lead-calcium Nickel-cadmium JSC18= 6V-18W, nickel-cadmium JSC25= 6V-25W, nickel-cadmium 12JSC36= 12V-36W, nickel-cadmium 12JSC50= 12V-50W, nickel-cadmium	-0= No head -1= One head -2= Two heads -3= Three heads	10= Mini plastic MR16 150= EF150 lamp heads	LA= 6V-4W, MR16 LED LG= 12V-4W, MR16 LED LI= 12V-5W, MR16 LED LJ= 12V-6W, MR16 LED	-AD= Advanced Diagnostics (audible) -ADNA= Advanced Diagnostics (non-audible) -NEX= Nexus® wired (contact your sales representative) -NEXRF= NEXUS® wireless (contact your sales representative) -C= Line cord 120V 3 feet -D3= Time delay (15 minutes) -FM= Front mounted heads

Example: JSC18-110LA

LC Series

Steel housing – 6V up to 200W, 12V up to 400W and 24V up to 400W capacities



nexus



Housing

- Steel housing
- Standard off-white finish, optional black finish
- Choice of MR16 LED lamp wattages
- Heads available in thermoplastic or decorative die-cast aluminum

Mounting

- Ceiling or wall mount
- Universal J-box mounting

Electronics

- Pulse plus charger
- Low voltage disconnect

- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Choice of battery

- 6V, 12V or 24V lead-calcium (sealed electrolyte) battery

Approvals


- UL 924 standard
- NYC approved

Warranty


- Unit has a three-year limited warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	43'	36'
LG	55'	43'
LI	71'	56'
LJ	100'	85'
LL	56'	44'

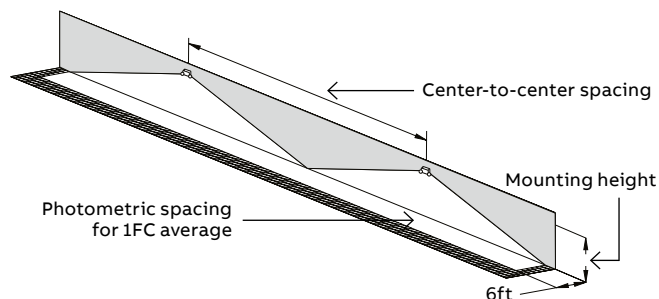

Housing color




Off white



Black

Dimensions

Dimensions are approximate and subject to change.

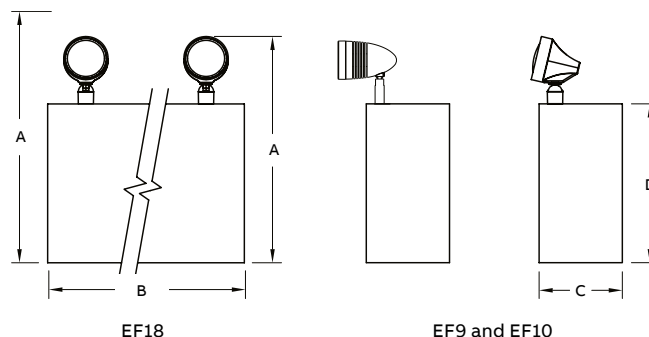

Cabinet information

Cabinet size	Dimensions			
	A	B	C	D
B	16-3/8" // 14-3/4"	16-1/8"	5-7/16"	10-1/4"
C	18-3/8" // 16-3/4"	16-1/2"	7-1/4"	12-1/4"
D	18-3/8" // 16-3/4"	27"	7-1/4"	12-1/4"

Unit rating

Sealed maintenance-free battery types	DC voltage	Model number	Battery capacity in watts				# of load fuses	Cabinet size
			1 1/2 hrs	2 hrs	3 hrs	8 hrs		
Lead-calcium (immobilized electrolyte)	6	LC87	87	70	41	24	2	B
	6	LC100	100	77	47	24	2	C
	6	LC175	175	140	82	48	2	C
	6	LC200	200	168	96	48	2	C
	12	12LC150	150	120	66	36	2	C
	12	12LC175	175	140	85	48	2	C
	12	12LC200	200	168	96	48	2	C
	12	12LC300	300	240	132	72	2	D
	12	12LC350	350	280	170	96	2	D
	12	12LC400	400	336	192	95	2	D
	24	24LC300	300	240	132	72	2	D
	24	24LC350	350	280	168	96	2	D
	24	24LC400	400	336	192	96	2	D

Accessories (order as a separate item)

Description	Suffix
Mounting bracket (cabinet B)	B2
Mounting shelves (cabinet B)	MP3-EG
Mounting shelves (cabinet C)	MP6-EG
Mounting shelves (cabinet D)	MP12
Wire guard (cabinet B & cabinet C)	WG3-E
Wire guard (cabinet D)	WG4-E

How to order

Color	Series/capacity	# of lamps	Head style	Lamp type	Options
Blank= Off white B= Black	LC87= 6V-87W lead-calcium	-0= No head	10= EF10 (small plastic MR16)	LA= 6V-4W, LED MR16	Blank= No options
	LC100= 6V-100W lead-calcium	-1= 1 head	150= EF150 (MR16 lamp heads)	LG= 12V-4W, LED MR16	-AD= Advanced Diagnostics (audible) ¹
	LC175= 6V-175W lead-calcium	-2= 2 heads		LI= 12V-5W, LED MR16	-ADNA= Advanced Diagnostics (non-audible) ¹
	LC200= 6V-200W lead-calcium	-3= 3 heads		LJ= 12V-6W, LED MR16	-NEX= Nexus® wired (contact your sales representative) ¹
	12LC150= 12V-150W lead-calcium			LL= 24V-4W, LED MR16	-NEXRF= NEXUS® wireless (contact your sales representative) ¹
	12LC175= 12V-175W lead-calcium				-C= Line cord 120V 3 feet
	12LC175= 12V-200W lead-calcium				-D3= Time delay (15 minutes)
	12LC300= 12V-300W lead-calcium				
	12LC350= 12V-350W lead-calcium				
	12LC400= 12V-400W lead-calcium				
	24LC300= 24V-300W lead-calcium				
	24LC350= 24V-350W lead-calcium				
	24LC400= 24V-400W lead-calcium				

Example: LC87-310LA

¹Minimum load required: 20% of unit load capacity

LS Series

6 and 12 volt steel enclosure



nexus



Housing

Steel housing

- Standard off-white finish, optional black finish
- Choice of MR16 LED lamp wattages
- Heads available in thermoplastic or decorative die-cast aluminum

Mounting

- Ceiling or wall mount
- Universal J-box mounting

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection

- Battery lock-out
- Fused output circuit
- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Choice of battery

- 6V, 12V or 24V lead-calcium battery
- 6V, 12V or 24V nickel-cadmium battery

Approvals


- UL 924 standard
- NYC approved

Warranty


- Unit has a three-year limited warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	43'	36'
LG	55'	43'
LI	71'	56'
LJ	100'	85'
LL	56'	44'

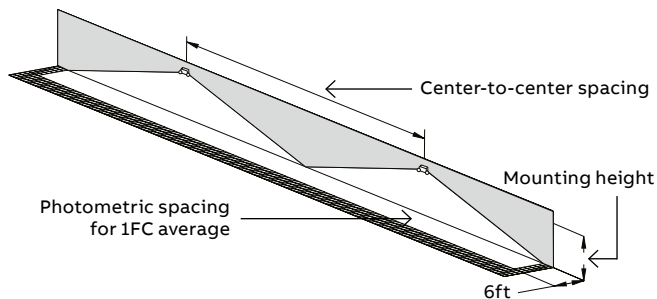

Housing color




Off white



Black

Dimensions

Dimensions are approximate and subject to change.

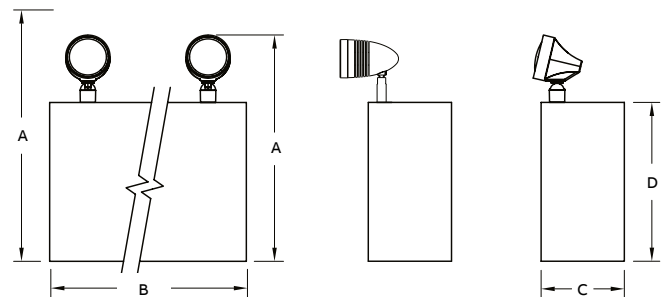

EF150 and EF10

Cabinet information

Cabinet size	Dimensions			
	A	B	C	D
A	14-5/8" // 13"	12-3/4"	3-1/8"	8-1/2"
B	16-3/8" // 14-3/4"	16-1/8"	5-7/16"	10-1/4"
C	18-3/8" // 16-3/4"	16-1/2"	7-1/4"	12-1/4"

Unit rating

Sealed maintenance-free battery types	DC voltage	Model number	Battery capacity in watts					# of load fuses	Cabinet size
			1 1/2 hrs	2 hrs	3 hrs	4 hrs			
Lead-calcium	6	LSM18	12	12	10	7	1	A	
Nickel-cadmium	6	LSC18	18	12	9	6	1	A	
Lead-calcium			1 1/2 hrs	2 hrs	3 hrs	8 hrs			
	6	LSM27	27	18	10	6	1	A	
	6	LSM36	36	25	14	7	1	A	
	6	LSM54	54	37	21	12	1	A	
	6	LSM81	81	54	36	18	2	B	
	6	LSM110	110	72	40	24	2	B	
	6	LSM162	162	108	60	48	2	C	
	6	LSM200	200	144	80	48	2	C	
	12	12LSM36	36	25	14	7	1	A	
	12	12LSM54	54	37	21	12	1	A	
	12	12LSM110	110	72	40	24	2	B	
	12	12LSM162	162	108	60	36	2	C	
	12	12LSM220	220	144	80	48	2	C	
	24	24LSM110	110	72	40	24	2	B	
	24	24LSM220	220	144	80	48	2	C	
Nickel-cadmium	6	LSC25	25	18	9	—	1	A	
	12	12LSC36	36	21	12	6	1	A	
	12	12LSC50	50	36	18	10	1	A	
	24	24LSC100	100	73	37	20	2	B	
	24	24LSC72	72	42	24	12	2	B	
	24	24LSC100	100	73	37	20	2	B	

Accessories (order as a separate item)

Description	Suffix
Mounting bracket (cabinet A)	B1
Mounting bracket (cabinet B)	B2
Mounting shelves (cabinet B)	MP3-EG
Mounting shelves (cabinet C)	MP6-EG
Wire guard (cabinet A)	WG2-E
Wire guard (cabinet B & cabinet C)	WG3-E

How to order

Color	Series/capacity	# of lamps	Head style	Lamp type/wattage	Options
Blank= Off white B= Black	LSM Series LSM18 = 6V-18W lead-calcium LSM27 = 6V-27W lead-calcium LSM36 = 6V-36W lead-calcium LSM54 = 6V-54W lead-calcium LSM81 = 6V-81W lead-calcium LSM110 = 6V-110W lead-calcium LSM162 = 6V-162W lead-calcium LSM200 = 6V-200W lead-calcium 12LSM36 = 12V-36W lead-calcium 12LSM54 = 12V-54W lead-calcium 12LSM110 = 12V-110W lead-calcium 12LSM162 = 12V-162W lead-calcium 12LSM220 = 12V-220W lead-calcium 24LSM110 = 24V-110W lead-calcium 24LSM220 = 24V-220W lead-calcium LSC Series LSC18 = 6V-18W nickel-cadmium LSC25 = 6V-25W nickel-cadmium 12LSC36 = 12V-36 nickel-cadmium 12LSC50 = 12V-50W nickel-cadmium 12LSC72 = 12V-72W nickel-cadmium 24LSC72 = 24V-72W nickel-cadmium 24LSC100 = 24V-100W nickel-cadmium	-0 = No head -1 = 1 head -2 = 2 heads -3 = 3 heads	10 = EF10 (small plastic MR16) 150 = EF150 (MR16 lamp heads)	LA = 6V-4W, MR16 LED LG = 12V-4W, MR16 LED LI = 12V-5W, MR16 LED LJ = 12V-6W, MR16 LED LL = 24V-4W, MR16 LED	Blank = No options -AD = Advanced Diagnostics (audible) ¹ -ADNA = Advanced Diagnostics (non-audible) ¹ -NEX = Nexus® wired (contact your sales representative) -NEXRF = NEXUS® wireless (contact your sales representative) -C = Line cord 120V 3 feet -D3 = Time delay (15 minutes)

Example: BLSC18-110LA-AD

¹Minimum load required: 20% of load capacity

X10 LED Series

Steel LED exit and mini-system combination units



Construction

- Steel housing
- Standard off-white finish, optional black finish
- Choice of MR16 LED lamp wattages
- Heads available in thermoplastic or decorative die-cast aluminum
- 6 inch EXIT lettering legend, available in red or green
- Field-selectable chevrons

Mounting

- Surface mount
- Canopy included for end or ceiling mount applications
- Universal J-box mounting

Combo units

- SBX14 model, lead-calcium battery, 6V-30W total battery capacity
- STX14 model, nickel-cadmium battery, 6V-24W total battery capacity

Exit sign

- X14 model, exit sign, AC-Only, 120/277VAC, 50/60Hz
- SNX14 model, nickel-cadmium battery

Lamp head source

- MR16 LED 6V 4W

Electronics

- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Special wording panels

- Available. Contact your sales representative with your design requirements

Approvals


- UL 924 listed
- Meets NFPA101 (Life Safety Code), NFPA 70-NEC and OSHA illumination standards

Warranty


- Unit has a three-year limited warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	43'	36'

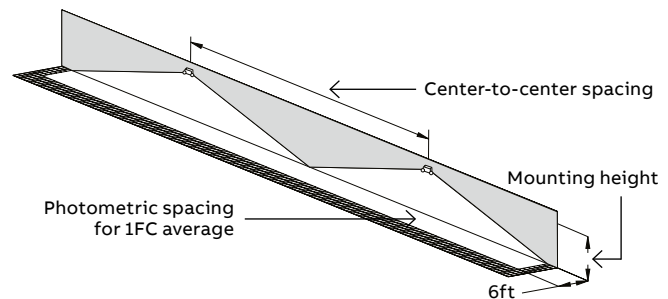

Housing color



White




Black




Textured aluminum

Dimensions

Dimensions are approximate and subject to change.

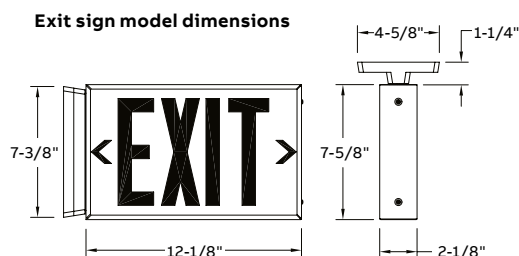

Mini system model dimensions

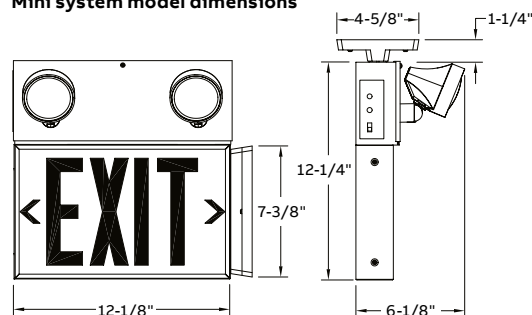

Power consumption – LED exit signs

Model	AC specs		DC specs	
AC-only	120 to 277 VAC	Less than 1.5W	-	-
AC/DC	120 to 277 VAC	Less than 1.5W	6 to 24 VDC	Less than 1.5W
Self-powered	120 to 277 VAC	Less than 3W	Nickel-cadmium	Min. 90 minutes
Mini-system combo	120/277VAC	0.3/0.15 Amp	-	-

Power consumption – Mini-system combination units¹

Battery type	DC voltage	Model number	Battery capacity in watts			
			1-1/2 hrs	2 hrs	3 hrs	4 hrs
Lead-calcium	6	SBX14	30	20	15	10
Nickel-cadmium	6	STX14	24	18	12	9

¹120/277VAC 60Hz, 0.3/0.15 Amp.

Unit rating - Total DC power available for local and remote emergency lights.

Accessories (order as a separate item)

Description	Suffix
White pendant	P-WT ¹
Black pendant	P-BK ¹
Wire guard ceiling mount (exit only)	WG5-E
Wire guard end mount (exit only)	WG5-E
Wire guard for wall mount (AC only, AC/DC & self-powered exit signs)	WG12-E
Wire guard for wall mount (mini system or combo)	WG6-E

¹Specify pendant length in inches

How to order

DC input	Series	Housing color	Battery type	Legend colors
Blank = No DC input	L = LED exit sign	W = White	Exit sign models	R = Red
DC = 6V to 24VDC ¹		B = Black	X14 = AC only or AC/DC	G = Green
		A = Textured aluminum	SNX14 = Ni-Cd 120/277VAC	
			Mini system combination units	Open face³
			SBX14 = 6V-30W lead-calcium	RW = Red/white
			STX14 = 6V-24W nickel-cadmium ²	WR = White/red
			SXX14 = 6V-20W nickel-cadmium ²	GW = Green/white
				WG = White/green
# of heads for mini system	Head style	Lamp type	Options	
Blank = No head	10 = EF10	LA = 6V-4W, MR16 LED ⁴	Blank = No option	
-1 = 1 head	150 = EF150		-AD = Advanced Diagnostics (audible) ⁵	
-2 = 2 heads			-ADNA = Advanced Diagnostics (non-audible) ⁵	
			-NEX = NEXUS [®] wired ⁵	
			-NEXRF = NEXUS [®] wireless ⁵	
			-D3 = Time delay (15 minutes)	
			-VR = Tamper-proof screws	
			-VR1 = Polycarbonate shield with tamper-proof screws	

Example: DCLWX14R-VR

¹Only available on exit sign models

²Available with -AD, -ADNA, -NEX or -NEXRF only

³Open face required with special wording legends

⁴Available with 10 & 150 lamp head only - NOTE: For a complete list of available lamp types, please refer to the lamp data on page 168

⁵Available only in SNX14, SBX14 & SXX14

Prestige™ Economizer Series – Recessed ceiling mount

Edge-lit exit sign



Construction

- Steel housing with extruded aluminum trim plate
- Panel features a curved contour for maximum illumination and clarity
- 6 inch EXIT lettering legend available in red or green
- Field installed stick-on chevrons
- Choice of housing and trim plate finishes, off white or textured aluminum

Mounting

- Fully recessed ceiling mount
- Hanger bars included for lay-in installation in T-bar grid

Special wording panels

- Available. Contact your sales representative with your design requirement

Electronics

- 120/277 60Hz


Approvals

- UL 924 listed
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards

Warranty

- Unit has a five-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Housing color




Off white



Textured aluminum

Dimensions

Dimensions are approximate and subject to change.

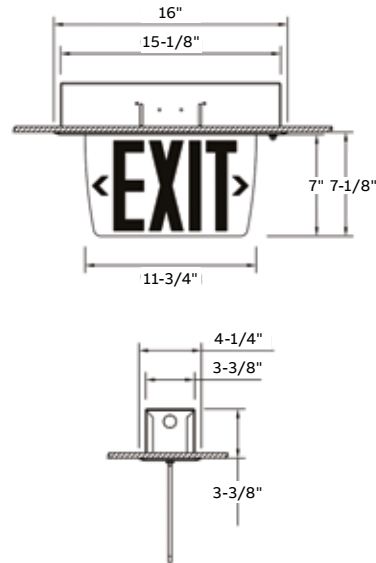

Power consumption

Model		AC specs		DC specs
AC-only	120 to 277VAC	Less than 1.5W	–	–
AC/DC-remote	120 to 277VAC	Less than 1.5W	6 to 24VDC	Less than 1.5W
Self-powered	120 to 277VAC	Less than 2.5W	Ni-Cd battery	Min. 90 minutes

How to order – Recessed mount series

Housing color	Series	Trim	Face	Legend color
TA= Textured aluminum	PE= AC	F= Recessed flat trim	1= Single face	RC= Red on clear ¹
OW= Off white	PES= AC/DC		2= Double face	RW= Red on white
	PEN= Self-powered			RM= Red on mirror
				GC= Green on clear ¹
				GM= Green on mirror

Example: TAPEF1RC

¹Single face only

Prestige™ Economizer Series – Slim profile surface mount

LED edge-lit exit sign



Construction

- Die-cast aluminum housing
- Panel features a curved contour for maximum illumination and clarity
- 6 inch EXIT lettering legend available in red or green
- Field installed stick-on chevrons
- Choice of housing and trim plate finishes, off white or textured aluminum

Mounting

- Surface mount
- Canopy included for wall, end or ceiling mount applications

Special wording panels

- Available. Contact your sales representative with your design requirement

Electronics

- 120/277 60Hz


Approvals

- UL 924 listed
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards

Warranty

- Unit has a five-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Housing color



Off white



Textured aluminum

How to order – Surface mount series


Housing color	Series	Face	Legend color
TA= Textured aluminum	PE= AC	1= Single face	RC= Red on clear ¹
OW= Off white	PES= AC/DC	2= Double face	RW= Red on white
	PEN= Self-powered		RM= Red on mirror
			GC= Green on clear ¹
			GM= Green on mirror

Example: TAPE1RC

¹Single face only

Dimensions

Dimensions are approximate and subject to change.

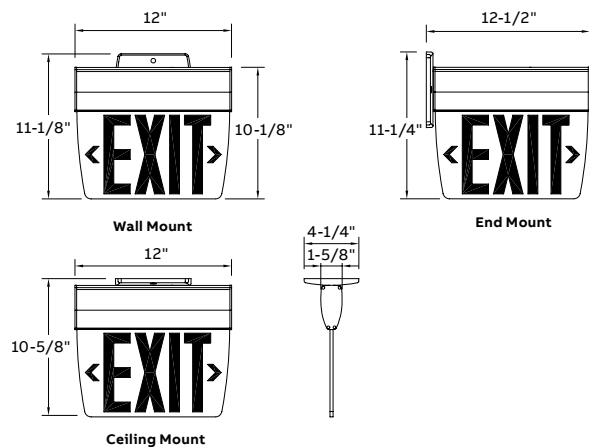

Power consumption

Model	AC specs		DC specs	
AC-only	120 to 277VAC	Less than 2W	–	–
AC/DC	120 to 277VAC	Less than 2W	6 to 24VDC	Less than 1.5W
Self-powered	120 to 277VAC	Less than 3W	Ni-Cd battery	Min. 90 minutes

Accessories (order as a separate item)

Description	Suffix
White pendant	PE-P-WH ¹
Black pendant	PE-P-BK ¹

¹Specify pendant length

Prestige™ Accessibility Series

Slim Profile LED Edge-Lit Exit Sign



Construction

- Housing made of extruded aluminum, canopy made of die-cast aluminum
- Legend panel features a curved contour for maximum illumination and clarity
- 6 inch EXIT lettering legend available in red with accessibility symbol
- Universal field selectable chevrons
- Choice of housing and trim plate finishes, off white or textured aluminum
- Choice of legend panel colors, red on clear, red on white, red on mirror

Mounting

- Canopy included for wall, end or ceiling mount applications

Special Wording Panels

- Available. Contact your sales representative with your design requirements

Approvals

- UL 924 listed
- RoHs compliant
- Connecticut State Fire Safety Code

PARA 1011.1.2:

1011.1.2 Accessible exits. Where exit signs are required by Section 1011.1 of this code, accessible exit doors at the level of exit discharge that lead directly to accessible paths of exit discharge shall additionally be marked by the International Symbol of Accessibility. Such symbol shall be not less than 6 inches high and shall be incorporated into the required exit sign or shall be located directly adjacent to it. Such symbol shall meet the requirements of Section 1011.

Warranty (subject to proper installation and maintenance)

- Five-year warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

Panel configuration

Symbol Left



Symbol Right



Housing color




Off white



Textured aluminum

Dimensions

Dimensions are approximate and subject to change.

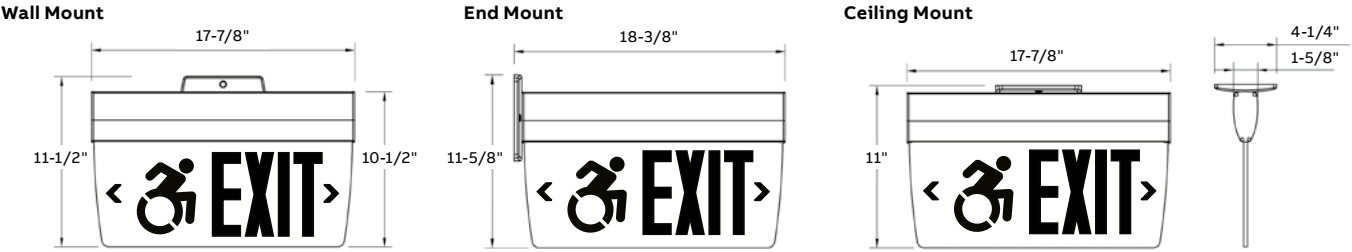

Power consumption

Model	AC specs		DC specs	
AC only	120 to 277 VAC	Less than 2W	–	–
AC/DC	120 to 277 VAC	Less than 2W	6 to 24 VDC	Less than 1.5W
Self-powered	120 to 277 VAC	Less than 3W	Ni-Cd battery	Min. 90 minutes

How to order

Housing color	Series	Face	Legend color	Panel configuration
OW= Off white	PE= AC only	1= Single face	RC= Red on clear ¹	RISA= Right side, 6" letters & International Symbol of Accessibility
TA= Textured aluminum	PES= AC/DC	2= Double face	RW= Red on white	LISA= Left side, 6" letters & International Symbol of Accessibility
	PEN= Self-powered, minimum 90 minutes		RM= Red on mirror	

Example: OWPEN1RWLISA

¹Single face only

Preceptor™ Series

Die-cast aluminum LED exit sign



Construction

- Die-cast aluminum housing
- Panel features a curved contour for maximum illumination and clarity
- 6 inch EXIT lettering legend available in red or green
- Field-selectable chevrons
- Choice of finishes: white, black or brushed aluminum

Mounting

- Surface mount
- Canopy included for end or ceiling mount applications
- Universal J-box mounting


Power consumption

Model		AC specs		DC specs
AC-only	120/277VAC	Less than 2.5W	–	–
AC/DC-remote	120/277VAC	Less than 2W	6 to 48VDC	Less than 1.5W
Self-powered	120/277VAC	Less than 3W	Ni-Cd battery	Min. 90 minutes
Self-powered with diagnostic	120/277VAC	Less than 2.8W	Ni-Cd battery	Min. 90 minutes

Housing color



Black



White



Brushed aluminum

How to order

Housing color	Series/models	# of faces	Legend color	Options
BA = Black body/aluminum face	P = AC only (120/277 volts)	1 = Single face	R = Red	Blank = No options
WW = White body/white face	P2C1 = Dual AC circuit (2 x 120V)	2 = Double face	G = Green	DL = Damp location
WA = White body/aluminum face	P2C2 = Dual AC circuit (2 x 277V)			FA = Fire alarm activated flasher (Not available with PDN)
BB = Black body/black face	PU = 120/277VAC & 6 to 48VDC			FBF = Flasher buzzer + fire alarm activated flasher ²
AA = Brushed aluminum body and face	PDN = Self-powered, No Advanced Diagnostics		Open face ¹	FL = Flasher ²
	PXN = Self-powered Advanced Diagnostics		RW = Red on white	FZ = Flasher buzzer ²
	NEX = Nexus® wired (contact your sales representative)		GW = Green on white	VR = Tamper-proof screws
	NEXRF = NEXUS® wireless (contact your sales representative)			VR1 = Polycarbonate shield with tamper-proof screws

Example: BAPU2R

Electronics

- Optional Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Special wording panels:

- Available. Contact your sales representative with your design requirements

Approvals


- UL 924 listed
- Damp location optional (50°F to 104°F)
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

Dimensions

Dimensions are approximate and subject to change.

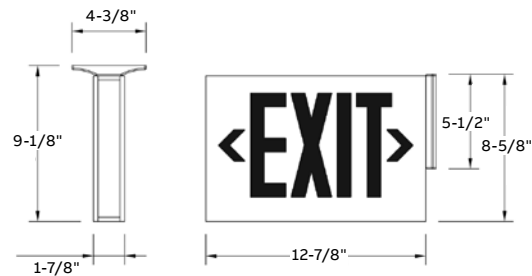

¹Note: Open face required with special wording legends

²PXN, PNEX and PNEXFR models only

Preceptor™ Recessed Series

Die-cast LED exit sign



Construction

- Die-cast aluminum faceplate
- Panel features a curved contour for maximum illumination and clarity
- 6 inch EXIT lettering legend available in red or green
- Field-selectable chevrons
- Choice of finishes: white, black or brushed aluminum

Mounting

- Fully recessed mount


Electronics

- Standard Advanced Diagnostics (self-powered models)
- 120/277 60Hz

Power consumption

Model	AC specs			DC specs	
AC-only	120/277VAC	1.4W	–	–	–
Self-powered	120/277VAC	1.7W	Ni-Cd battery	Min. 90 minutes	

Housing color



How to order

Recessed	Face color	Series	# of faces
FR= Fully recessed	Blank= Aluminum face B= Black face W= White face	LEDP= AC only LEDPXN= Self-powered Ni-Cd	1= Single face

Legend color	Options	Version
R= Red G= Green RW= Red on white (open face) GW= Green on white (open face)	DL= Damp location FA= Fire alarm activated flasher (self-powered) FZ= Flasher buzzer (self-powered) VR= Vandal-resistant screws VR1= Polycarbonate shield with tamper-proof screws -2CKT= Dual circuit operation (AC models only)	-N= New design
		Example: FRBLEDP1R-VR1-N

Special wording panels:

- Available. Contact your sales representative with your design requirements

Approvals


- UL 924 listed
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Dimensions

Dimensions are approximate and subject to change.

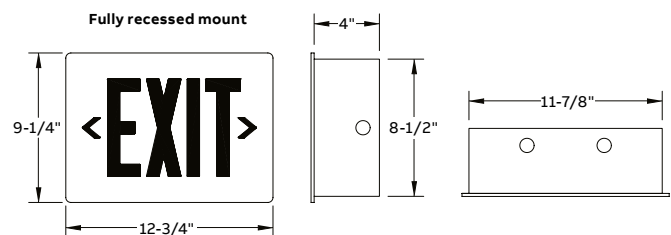

Preceptor™ Remote Capacity Series

Die-cast aluminum remote capacity exit sign



Construction

- Die-cast aluminum housing
- Panel features a curved contour for maximum illumination and clarity
- 6 inch EXIT lettering legend available in red or green
- Field-selectable chevrons
- Choice of finishes: white, black or brushed aluminum

Mounting

- Surface mount
- Canopy included for end or ceiling mount applications
- Universal J-box mounting

Electronics

- Optional Advanced Diagnostics
- 120/277 60Hz

Choice of battery

- RCL model, (lead-calcium battery) 6V-9W remote load capacity

- RCN model, (nickel-metal hydride battery) 6V-12W remote load capacity
- RCX model, (nickel-metal hydride battery) 6V-24W remote load capacity

Special wording panels

- Available. Contact your sales representative with your design requirements

Approvals

- UL 924 listed
- Damp location optional (50°F to 104°F)
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards

Warranty

- Unit has a five-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Power consumption

Series	AC input	AC specs		Battery capacity in watts				
		Maximum	Voltage	Battery	1-1/2 hrs	2 hrs	3 hrs	4 hrs
RCL	120/277VAC, 60Hz	0.13/0.06A 15W	6V	Lead-calcium	9	–	–	–
RCN			6V	NiMH	12	9	–	–
RCX			6V	NiMH	24	18	12	9

Housing color



Black



White




Brushed aluminum


Dimensions

Dimensions are approximate and subject to change.


Ceiling mount

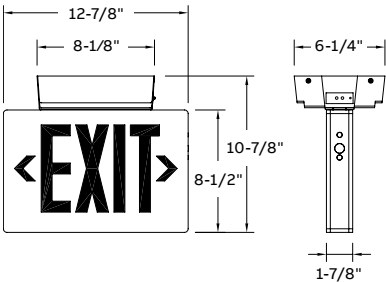

Back mount

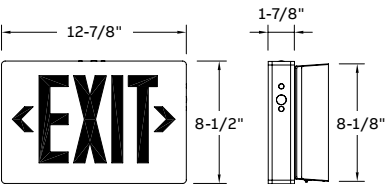

End mount

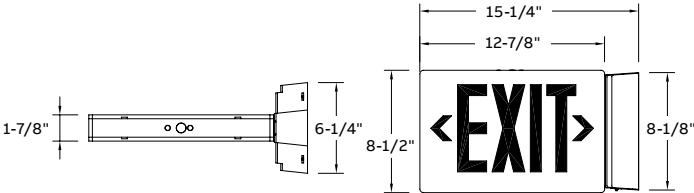

Accessories (order as a separate item)

Description	Suffix
Wire guard, back mount	WG13-E
Wire guard, ceiling mount	WG14-E

How to order

Housing color	Series	Battery type	# of faces	Legend color	Options
BA = Black body/ aluminum face	P = Preceptor	RCL = Sealed lead-calcium, 9W remote capacity	1 = Single face 2 = Double face	R = Red G = Green RW = Red on white (Open face required for special wording)	AD = Advanced Diagnostics (audible) ADNA = Advanced Diagnostics (non-audible) D3 = Time delay (15 minutes) DL = Damp location FA = Fire alarm activated flasher FZ = Flasher buzzer VR = Vandal-resist screws VR1 = Vandal-resistant polycarbonate lens and screws
BB = Black body/ black face		RCN = Sealed nickel-metal hydride, 12W remote capacity		GW = Green on white (Open face required for special wording)	
WW = White body/ white face		RCX = Sealed nickel-metal hydride, 24W remote capacity			
WA = White body/ aluminum face					
AA = Brushed aluminum body and face					

Example: BAPRCL2R

Special Wording Series

Custom illuminated signage



Features

- The same sturdy construction and electrical design used in our exit signs is used to produce our custom-worded, illuminated signage
- Sign bodies are available in steel, extruded and die-cast aluminum, weatherproof, flame-retardant polycarbonate, high impact thermoplastic and recessed housing
- Also available with combination units
- Custom wording with available in any style of lettering, any language, and alphabet, any special characters
- Graphics can include logos, standard symbols and custom art
- Color choices for sign bodies, message and faceplate panel
- Illumination from LED (light-emitting diodes); other light sources available
- Contact your local **Emergi-Lite®** sales representative to discuss your specific requirements

Illuminated Signage

- Custom-worded, illuminated signage is available using the same sturdy construction and electrical design as **Emergi-Lite®** exit signage. A wide range of sign body options and color choices are available to suit any application.



SPECIFICATION GRADE COMMERCIAL APPLICATIONS

We deliver highly versatile emergency lighting solutions to a wide range of industries, with the protection and safety of human life being paramount.

Spec Grade Industrial collection

Our high-performance emergency lighting units with NEMA-4X or classified location certifications are designed to withstand harsh, demanding environments.

- Meets specification criteria for humidity, corrosion, dust, water infiltration, and the risk of vandalism
- Uses highly efficient LED light sources for impressive, reliable illumination
- Available for the Nexus® emergency lighting management system

01 HPH Series –
High-performance
battery unit NEMA-4X
for hazardous, damp
& wet locations

See page 84 for
more information

01



Ideal for spaces with strict requirements such as:

- Chemical plants
- Warehouse and cold storage facilities
- Heavy industrial plants
- Marine locations
- Hosedown areas
- Car washes
- Parking garages
- Transit platforms

See the full selection of Survive-All™, HP Series, and more industrial emergency lighting products in this catalog.



Table of contents

Spec Grade Industrial

				
Hazardous locations Important information 70	NEMA enclosures Various types 71	HP Series 72	HPRL Series 74	Survive-All™ SV Series 76
				
Survive-All™ SVX Combination Series 78	Survive-All™ SVX Series 80	Survive-All™ EF39 Series 82	HPH Series 84	HPHRL Series 86
				
Survive-All™ SVH Series 88	Survive-All™ SVXH Series 90	Survive-All™ SVX-HZ Series 92	Survive-All™ EF41 Series 94	EverLite™ Series 95
				
		EXC LED Series 96	EFEP Series 98	EFXP Series 100

Hazardous locations

Important information

Hazardous locations are areas where a potential for explosion or fire exists due to the presence of certain gases, liquid vapors, combustible dusts or fiber particles suspended in the air. The National Electrical Code®, NEMA, OSHA, UL, NFPA Life Safety Standards, as well as State and Local codes prescribe the use of emergency lighting equipment. This equipment itself must not contribute to the ignition of flammable or explosive substances present in the location. Emergi-Lite® offers a complete line of emergency lighting equipment for use in hazardous locations.

Hazardous location classifications

Class I (NEC-500-5)	Areas in which flammable gases or vapors may be present in sufficient quantities to be explosive or ignitable.
Class II (NEC-500-6)	Areas made hazardous by the presence of combustible dust.
Class III (NEC-500-7)	Areas in which there are easily ignitable fibers or flyings present, due to the type of material being handled, stored or processed-but in which such fibers or flyings are not likely to be in suspension in the air in quantities sufficient to produce ignitable mixtures.
Division 1 (NEC-500-5,6 & 7)	Normal Situation: A hazard is present in the everyday normal production operation or during frequent repair and/or maintenance activity.
Division 2 (NEC-500-5,6 & 7)	Abnormal Situation: Potentially hazardous material is expected to be safely confined within closed containers or closed systems, and will be present in the atmosphere only through accidental rupture, breakage, or abnormal operation.
Group A, B, C & D (NEC-500-3)	Gases and vapors in Class I locations are classified into four groups, by the code A, B, C, and D. These materials are grouped according to the ignition temperature of the substance, its explosion pressure and other flammability characteristics.
Groups E F & G (NEC-500-3)	Combustible dust in Class II locations are classified according to ignition temperature and the conductivity of the hazardous substance.

Typical Class I locations:

- Petroleum refineries, and gasoline storage and dispensing areas.
- Industrial firms that use flammable liquids in dip tanks for cleaning parts or other operations.
- Petrochemical companies that manufacture chemicals from gas and oil.
- Dry cleaning plants where vapors from cleaning fluids can be present.
- Companies that have areas dedicated for spraying products with paint or plastics.
- Aircraft hangars and fuel servicing areas.
- Utility gas plants, and operations involving storage and handling of liquified petroleum gas or natural gas.

Typical Class II locations:

- Grain elevators, flour and feed mills.
- Plants that manufacture, use or store magnesium or aluminum powders.
- Plants that have chemical or metallurgical processes, producers of plastics, medicines, and fireworks etc.
- Producers of starch or candies.
- Spice grinding plants, sugar plants and cocoa plants.
- Coal preparation plants and other carbon handling or processing areas.

Typical Class III locations:

- Textile mills, cotton gins, cotton seed mills and flax processing plants.
- Clothing manufacturing plants.
- Any plant that shapes pulverizes or cuts wood and creates saw dust or shavings.

For more information consult the NEC Code.



NEMA enclosure

Type 1	Intended for use indoors primarily to prevent accidental contact of personnel with the enclosed equipment.
Type 2	Intended for use indoors to protect the enclosed equipment against falling non-corrosive liquids and falling dirt.
Type 3	Intended for use outdoors to protect the enclosed equipment against rain, windblown dust, sleet and external ice formation.
Type 3R	Intended for use outdoors to protect the enclosed equipment against falling rain, sleet and external ice formation.
Type 4	Intended for use indoors and outdoors to protect the enclosed equipment against windblown dust, rain, splashing water and hose directed water.
Type 5	Intended for indoor use primarily to protect against dust and falling dirt.
Type 6	Intended for indoor or outdoor use primarily to provide a degree of protection against the entry of water during occasional temporary submersion at a limited depth.
Type 6P	Intended for indoor or outdoor use primarily to provide a degree of protection against the entry of water during prolonged submersion at a limited depth.
Type 7	Intended for use indoors in locations classified as Class I, Groups A, B, C, or D as defined in the National Electrical Code®.
Type 8	Intended for indoor or outdoor use in locations classified as Class I, Groups A, B, C, & D as defined in the National Electrical Code®.
Type 9	Intended for indoor locations classified as Class II, Groups E, F & G, as defined in the National Electrical Code®.
Type 10	Enclosures are constructed to meet the applicable requirements of the Mine Safety and Health Administration.
Type 11	Intended for indoor use primarily to provide, by oil immersion, a degree of protection to enclosed equipment against the corrosive effects of liquids and gases.
Type 12	Intended for indoor use primarily to provide a degree of protection against dust, falling dirt, and dripping noncorrosive liquids.
Type 12K	Enclosure with knockouts intended for indoor use primarily to provide a degree of protection against dust, falling dirt, and dripping non-corrosive liquids other than at knockouts.
Type 13	Intended for indoor use primarily to provide a degree of protection against dust, spraying of water, oil, and noncorrosive coolant.

HP Series

NEMA-4X, high-performance industrial battery unit



Housing

- Compact gray fiberglass housing with captive screws
- NEMA-4X rated
- All external fasteners and hardware are constructed of stainless steel
- Die-cast aluminum LED heads

Mounting

- Simple and easy to install on walls, poles, columns, struts also on vertical
- Pole or column installation bracket sold separately (order catalog number: PMK1-E)
- 1/2" NPT conduit entry on top or side

Performance

- High temperature lead-calcium battery operates 32°F to 122°F (0°C to 50°C) optional cold-weather -40°F to 122°F (-40°C to 50°C)
- Nickel-cadmium battery operates 50°F to 104°F (10°C to 40°C)
- 6W, 10W and 15W high efficacy LED emergency heads outperform traditional 50W MR16-IR halogen
- Innovative head design: four-LED and dual-driver provide illumination even in case of unexpected component failure

Electronics

- Infra-red remote control included in all models: allows testing the equipment without the need to climb a ladder. Distance range up to 30 ft. Universal, one remote control may test all the units on the job
- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Standard Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Approvals

- UL 924 listed

Warranty

- 5-year limited warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

Remote test control



Power consumption - Maximum current draw

Temperature	Specs
Standard temperature range	120/277VAC, 60Hz, 0.30/0.15A
Cold-weather option	120/277VAC, 60Hz, 0.70/0.35A


Unit rating

Model	Battery capacity in watts ¹			
	1-1/2 hrs	2 hrs	3 hrs	4 hrs
12HPHM30	30	20	15	10
12HPHM60	60	40	30	20
12HPHN40	40	36	24	18
24HPHN90	90	72	48	36

¹The cold-weather option is only rated for 90 minutes

Dimensions

Dimensions are approximate and subject to change.

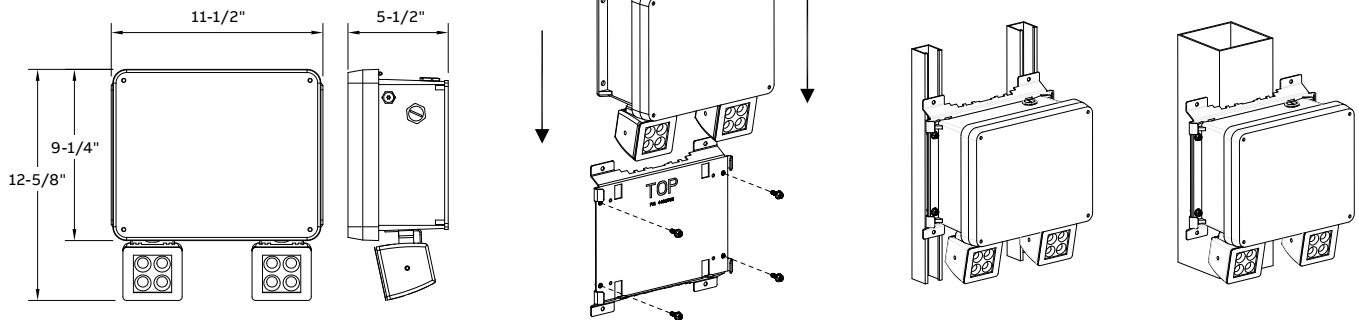


Photometric performance

Whether installed indoors or outdoors, the **HP Series** of LED emergency lights deliver a stable and consistent illumination on the path of egress for a wide range of mounting heights. Depending on the application, one may select and specify among three levels of lumen output. See cross reference to traditional incandescent emergency lights in table to the right.

LED head	Power	Total lumens	Out-perform spacing of incandescent lamps
L6	6W	565	35W PAR36, MR16 halogen
L10	10W	1000	50W PAR36, MR16 halogen
L15	15W	1300	50W MR16-IR halogen

Mounting height	Spacing center-to-center (feet)		
	Lamp L6 / 6W, 565LM	Lamp L10 / 10W, 1000LM	Lamp L15 / 15W, 1300LM
10 ft.	80	110	140
15 ft.	70	105	135
20 ft.	60	100	130
25 ft.	50	95	120

Industrial environment: wall mounted equipment,
reflectances: 10/10/10; 6-ft. wide illumination path.
200 ft. X 200 ft. X 30 ft. space.
Illumination as per NFPA101;
Average: 1fc; Min: 0.1fc; Max/min < 40:1

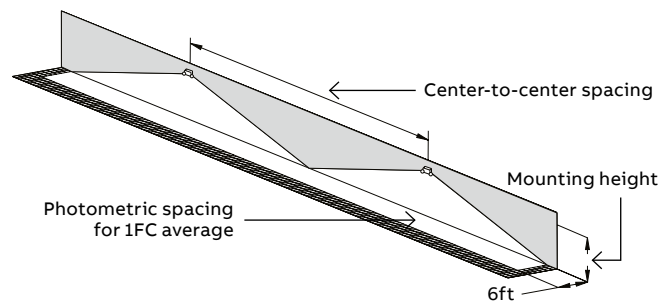

How to order

Series	Battery type and capacity	# of heads	LED heads	Diagnostic	Options
12HP= High-performance	Lead-calcium	0= No head	L6 = 12-24V, 6W (565 Lumens)	D = Advanced Diagnostic, non-audible ¹	CW4 = Cold-weather - 40°F [-40°C] ²
	M30 = 12V-30W, high temperature lead-calcium battery, temperature= 32°F to 122°F [0...50°C]	1= One head	L10 = 12-24V, 10W (1000 Lumens)	DA = Advanced Diagnostic, audible ¹	D3 = Time delay 15 minutes
	M60 = 12V-60W, high temperature lead-calcium battery, temperature= 32°F to 122°F [0...50°C]	2= Two heads	L15 = 12-24V, 15W (1300 Lumens)	-NEX = Nexus® wired (contact your sales representative) ¹	RFI = Radio frequency interference filter
24HP= 24V high-performance	Nickel-cadmium			-NEXRF = NEXUS® wireless (contact your sales representative) ¹	
	N40 = 12V-40W, nickel-cadmium battery, temperature= 50°F to 104°F [10...40°C]				
	N90 = 24V-90W, nickel-cadmium battery, temperature= 50°F to 104°F [10...40°C]				

Example: 12HPN402L6DRFI

¹Standard - minimum load required: 20% of load capacity

²Only 12V equipment

HPRL Series

NEMA-4X, high-performance industrial remote unit



Housing

- Lightweight polycarbonate gray housing with captive screws
- NEMA-4X protection grade
- All external fasteners and hardware are constructed of stainless steel
- Die-cast aluminum LED heads

Mounting

- Simple and easy to install on walls, poles, columns, struts also on vertical
- Pole or column installation bracket sold separately (order catalog number: PMK1-E)
- 1/2 NPT NPT conduit entry on top or side

Performance

- 6W, 10W and 15W high efficacy LED emergency heads outperform traditional 50W MR16-IR halogen
- Innovative head design: four-LED and dual-driver provide illumination even in case of unexpected component failure

Approvals


- UL 924 Listed
- Can be installed in wide temperature range:
- -40°F to 131°F (-40°C to 55°C)

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Dimensions

Dimensions are approximate and subject to change.

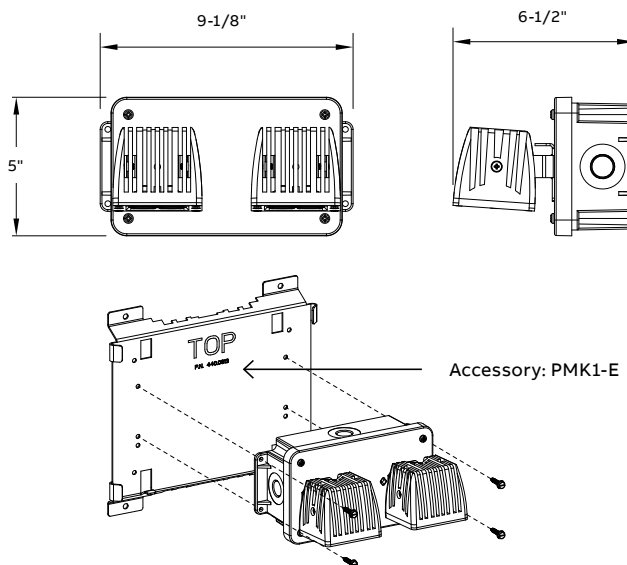


Photometric performance

Whether installed indoors or outdoors, the **HP Series** of LED emergency lights deliver a stable and consistent illumination on the path of egress for a wide range of mounting heights. Depending on the application, one may select and specify among three levels of lumen output. See cross reference to traditional incandescent emergency lights below.

LED head	Power	Total lumens	Out-perform spacing of incandescent lamps
L6	6W	565	35W PAR36, MR16 halogen
L10	10W	1000	50W PAR36, MR16 halogen
L15	15W	1300	50W MR16-IR halogen

Industrial environment: wall mounted equipment,
reflectances: 10/10/10; 6-ft. wide illumination path.
200 ft. X 200 ft. X 30 ft. space.
Illumination as per NFPA101;
Average: 1fc; Min: 0.1fc; Max/min < 40:1

Mounting height	Spacing center-to-center (feet)		
	Lamp L6 / 6W, 565LM	Lamp L10 / 10W, 1000LM	Lamp L15 / 15W, 1300LM
10 ft.	80	110	140
15 ft.	70	105	135
20 ft.	60	100	130
25 ft.	50	95	120

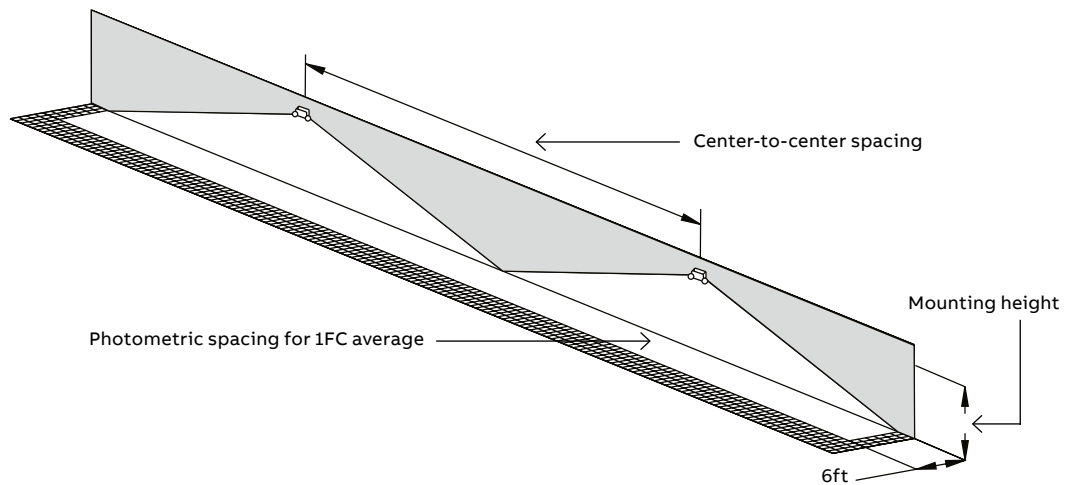

How to order

Series	Number of heads	LED head
HPRL= High-performance remote lightweight	Blank= Single head D= Double head	L6= 12-24V – 6W (565 lumens) L10= 12-24V – 10W (1000 lumens) L15= 12-24V – 15W (1300 lumens)

Example: HPRLDL10

Survive-All™ SV Series

NEMA-4X, NSF, vandal-resistant housing – 6V-18W & 12V up to 60W capacities



nexus NEMA-4X



Housing

- Full gasketed NEMA-4X housing
- Vandal-resistant UV stabilized polycarbonate cover
- Comes with both Phillips head for NSF location and tamper-proof screws

Mounting

- Universal J-box mounting
- Strut or I-beam installation bracket sold separately (order catalog number: PMK-E)

Lamp type

- Choice of MR16 LED lamp wattages

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Magnetic test switch
- Standard Advanced Diagnostics (non-audible)
- Standard 15 minutes time delay
- Optional Nexus® monitoring system
- 120/277 60Hz

Choice of battery

- 6V or 12V lead-calcium battery
- 12V nickel-cadmium battery
- 12V nickel-metal hydride battery

Approvals

- UL 924 listed
- UL listed for wet and damp location (50°F to 104°F)
- UL listed for cold weather option (-40°C to +40°C/-40°F to +104°F)
- CSA-US (to UL 924 standard) listed for Nexus® option
- NSF certified for use in food processing plants
- NEMA-4X rated

Warranty

- Unit has a five-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'


Housing color




Black



Gray




White

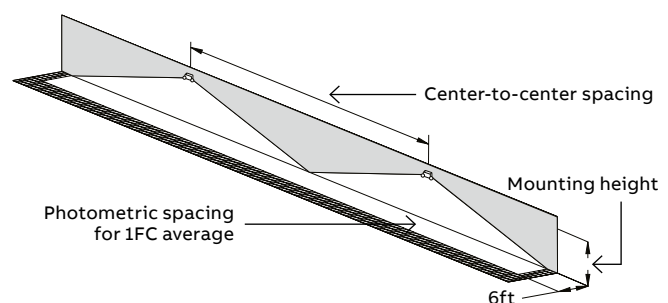


Dimensions


Dimensions are approximate and subject to change.

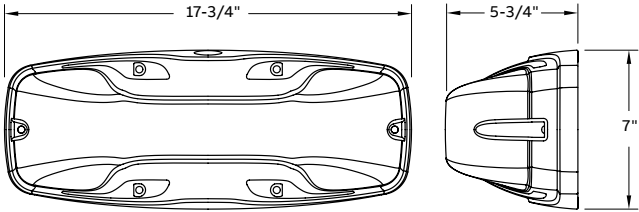


Universal bracket



PMK kit (screws included)



Beam mounting



Strut mounting

Unit rating - equipment with remote capability

Sealed maintenance-free battery types	Battery capacity in watts			
	1-1/2 hrs	2 hrs	3 hrs	4 hrs
Lead-calcium	18	12	8	–
	24	16	12	8
	36	24	20	14
	54	36	27	20
Nickel-cadmium	24	18	12	8
	40	27	20	14
Nickel-metal hydride	60	40	30	20

Accessories (order as a separate item)

Description	Part number
Additional special bit for tamper-proof screws	690.0454-E
Universal bracket (for mounting on poles, I-beams or strut metal framing)	PMK-E

How to order

Color	Series	# of lamps	Lamps	Diagnostics	Options
B= Black	Lead-calcium	-2= 2 Lamps	LA= 6V-4W, MR16 LED	-DA= Advanced Diagnostics (audible) ² -D= Advanced Diagnostics (non-audible) ² -NEX= Nexus® wired (contact your sales representative) ² -NEXRF= NEXUS® wireless (contact your sales representative) ²	Blank= No options CW4= Cold weather -40°F to 104°F (-40°C to +40°C) ³ -SMC= Surface ceiling mount
G= Gray	SV18M= 6V-18W lead-calcium		LG= 12V-4W, MR16 LED		
W= White	12SV24M= 12V-24W lead-calcium		LI= 12V-5W, MR16 LED		
	12SV36M= 12V-36W lead-calcium		LJ= 12V-6W, MR16 LED		
	12SV54M= 12V-54W lead-calcium				
	Nickel-cadmium				
	12SV24N= 12V-24W nickel-cadmium ¹				
	12SV40N= 12V-40W nickel-cadmium ¹				
	Nickel-metal hydride				
	12SV60H= 12V-60W NiMH ¹				

Example: B12SV36M-2LG-DCW4

¹Suitable for damp-locations 50°F to 104°F (10°C to 40°C)
²Minimum lamp load: 20% of unit capacity
³Only available with: 12SV24M & 12SV36M and NEX & NEXRF 12SV24M & 12SV36M

Survive-All™ SVX Combination Series

NEMA-4X, vandal resistant and harsh environment combination unit



nexus NEMA-4X



Construction

- Full gasketed NEMA-4X housing
- Faceplate: heavy-duty, vandal-resistant polycarbonate
- Backplate: heavy-duty aluminum
- Heads protected by clear polycarbonate lens
- Comes with both Phillips head for NSF location and tamper-proof screws
- 6 inch EXIT lettering legend, available in red or green
- Field-selectable chevrons
- Choice of finishes: white, black or gray

Lamp type

- Choice of MR16 LED lamp wattages

Mounting

- Surface mount
- Canopy included for end or ceiling mount applications
- Universal J-box mounting
- 1/2 inch conduit entry on top and sides


Choice of battery

- SVX12N model, nickel-cadmium battery, 6V-12W total battery capacity
- SVX24N model, nickel-cadmium battery, 12V-24W total battery capacity

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'

Housing color



White



Black



Brushed aluminum



Gray

Special wording panels

- Available. Contact your sales representative with your design requirements

Electronics


- Magnetically operated test switch
- Standard Advanced Diagnostics (non-audible)
- Standard 15 minutes time delay
- Optional Nexus® monitoring system
- 120/277 60Hz

Approvals

- UL 924 listed
- UL listed for wet and damp location (50°F to 104°F)
- UL listed for cold weather option (-40°C to +40°C/-40°F to +104°F)
- CSA-US listed for Nexus® option
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards


Warranty

- Five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

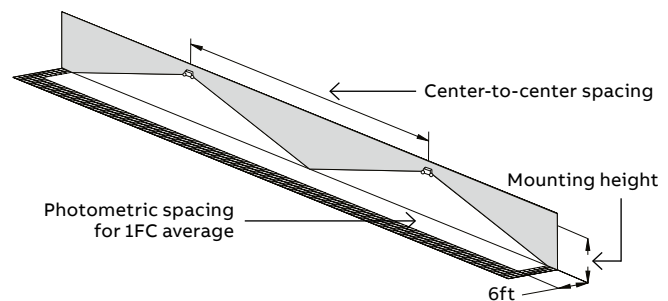

Dimensions

Dimensions are approximate and subject to change.

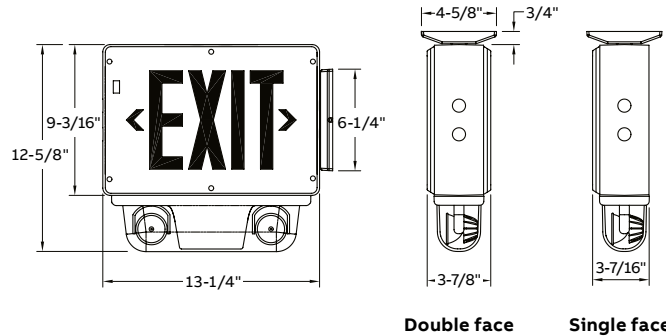

Unit rating

Sealed maintenance-free battery types	Battery capacity in watts			
	1-1/2 hrs	2 hrs	3 hrs	4 hrs
Nickel-cadmium	12	9	–	–
	24	18	12	9

Power consumption

Model	AC specs		DC specs (90 minutes)	
SVX12N	120/277VAC	0.12/0.06A 13W	6V	12W
SVX24N	120/277VAC	0.17/0.08A 19W	12V	24W

Accessories (order as a separate item)

Description	Part number
Additional special bit for tamper-proof screws	690.0454-E
Additional test magnet	199.0133-E

How to order

Housing/face color	Series/capacity	Faces	Legend color	Diagnostics	Housing
WW = White/white	SVX12N = 6V-12W	1 = Single face	R = Red legend	DA = Advanced Diagnostics (audible)	4X = Wet/damp locations
WB = White/black	SVX24N = 12V-24W	2 = Doubleface	G = Green legend	D = Advanced Diagnostics (non-audible)	
WA = White/aluminum				-NEX = Nexus® wired (contact your sales representative) ¹	
BB = Black/black				-NEXRF = NEXUS® wireless (contact your sales representative) ¹	
BW = Black/white					
BA = Black/aluminum					
GA = Gray/aluminum					
GW = Gray/white					
GB = Gray/black					

# of heads	Lamp type/wattage	Options
Blank = 0 heads ²	LA = 6V-4W, MR16 LED	Blank = No options
2 = Two heads	LG = 12V-4W, MR16 LED	CW4 = Cold weather (-40°F/-40°C) ³
	LI = 12V-5W, MR16 LED	FA = Flasher (fire alarm activated)
	LJ = 12V-6W, MR16 LED	FB = Flasher/buzzer (AC power failure)
		FL = Flasher (AC power failure)
		-208V = 208VAC, 60Hz input
		-240V = 240VAC, 60Hz input
		-208V50HZ = 208VAC, 50Hz input
		-CM = Canopy pendant mount

Example: WWSVX12N1RD4X2LGCW4

¹CSA US approved only, consult your sales representative

²Minimum load required: 20% of load capacity

³Single face only

Survive-All™ SVX Series

NEMA-4X, vandal resistant and harsh environment exit sign



Construction

- Full gasketed NEMA-4X housing
- Frame: polyvinyl chloride enclosure, fully gasketed around the lens, backplate and canopy to prevent water infiltration
- Faceplate: heavy-duty, vandal-resistant polycarbonate
- Backplate: heavy aluminum
- Comes with both Phillips head for NSF location and tamper-proof screws
- 6 inch EXIT lettering legend, available in red or green
- Field-selectable chevrons
- Choice of finishes: black, white, gray or brushed aluminum

Mounting

- Surface mount
- Ceiling and wall mount are NEMA-4X
- End and pendant mount are not NEMA-4X
- Canopy included for end or ceiling mount applications
- Universal J-box mounting
- 1/2 inch conduit entry on top and sides

Special wording panels

- Available. Contact your sales representative with your design requirements

Electronics

- Magnetically operated test switch
- Standard Advanced Diagnostics (non-audible)
- Optional Nexus® monitoring system
- 120/277 60Hz
- UL 924 listed
- UL listed for wet and damp location (50°F to 104°F)
- UL listed for cold weather option (-40°C to +40°C/-40°F to +104°F)
- Meets NFPA101 (Life Safety Code), NFPA 70 NEC, OSHA illumination standards

Warranty

- Five-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Power consumption

Model	AC specs	DC specs
AC-only	120-277VAC, 50/60Hz (1.2W)	—
AC/DC	120-277VAC, 50/60Hz (1.2W)	6 to 24VDC (less than 1.5W)
Self-powered	120-277VAC, 50/60Hz (3.7W)	Ni-Cd battery (min. 90 minutes)

Housing color



Black



White




Gray



Brushed aluminum

Dimensions

Dimensions are approximate and subject to change.

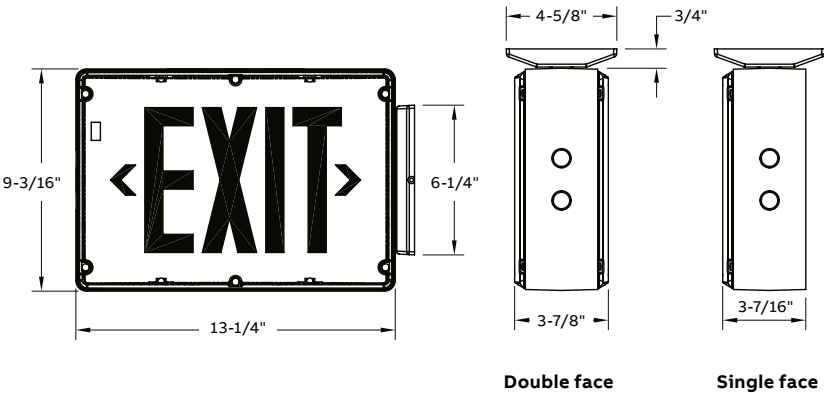

Accessories (order as a separate item)

Description	Part number
Tamper-proof bit	690.0454-E
Convert single to double face, red	DFKR ¹
Convert single face to double face, green	DFKG ¹
Additional test magnet	199.0133-E

¹Colors available AL-BK-WT

How to order

Housing color	Series	Face	Legend	Diagnostic	Housing	Options
BB = Black/black	SVX = AC only	1 = Single	R = Red	Blank = AC only	4X = Wet/damp	Blank = No options
BW = Black/white	SVXN = Self-	2 = Double	G = Green	D = Diagnostic	locations ¹	2CKT = Dual circuit (AC only) ²
BA = Black/aluminum	powered Ni-Cd			(Self-powered		CW = Cold weather
GB = Gray/black				only)		(Self-powered -4°F to 104°F / -20°C to 40°C)
GW = Gray/white				NEX = NEXUS®		(AC/DC -40°F to 104°F, -40°C to 40°C) ⁴
GA = Gray/aluminum				wired		-CM = Canopy pendant mount ⁵
WB = White/black				NEXRF = NEXUS®		DC = 6 to 24VDC ³
WW = White/white				wireless		FA = Fire alarm activated flasher ²
WA = White/aluminum						FL = Flasher only ²
						FZ = Flasher/buzzer (self-powered only) ²

Example: BBSVXN1RD4X-FA

¹NEMA 4X rated for wall or ceiling mount only
²Not available with Nexus® option
³Not available with self-power
⁴Not available on AC only, must order self-powered or AC-DC
⁵Not Nema-4X rated

Survive-All™ EF39 Series
NEMA-4X & NSF Certified



Construction

- Choice of cast aluminum or plastic back plate
- Vandal resistant comes standard with Phillips head screws, optional tamper proof screws
- Available as single or double MR16 lamp size remote lighting fixture
- Includes clear polycarbonate UV and impact resistant cover
- Tool-less, fully adjustable, aiming swivel head and easy lamp replacement

Finish

- White, black or gray

Mounting

- Surface mount
- Includes a back plate for mounting to a standard 4" octagonal electrical box

Approvals


- UL listed
- NSF rated for food processing areas
- NEMA-4X certified

Warranty


- Five-year limited warranty.
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometry performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'
LL	51'	39'

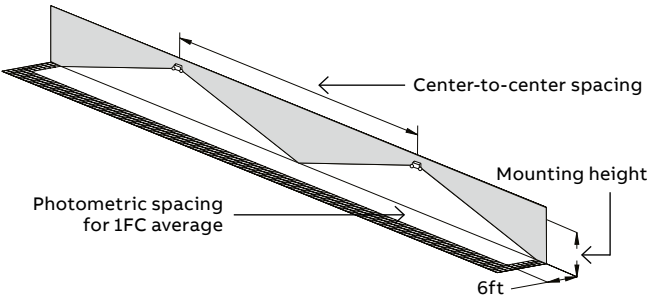

Housing color



White




Black



Gray

Dimensions

Dimensions are approximate and subject to change.

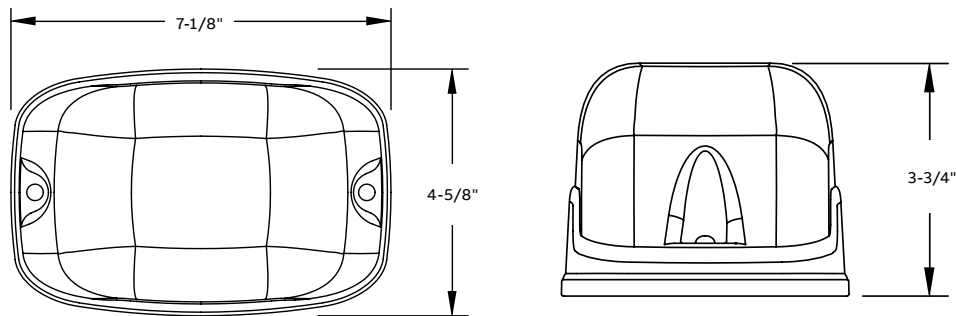

Accessories (order as a separate item)

Description	Part number
Additional special bit for tamper-proof screws	690.0454-E

How to order

Series	Lamp type/wattage	Color	Option
EF39P= All polycarbonate single head NEMA-4X	(LA)= 6V-4W, MR16 LED	Blank= White	SM= Mounting plate
EF39PD= All polycarbonate double head NEMA-4X	(LG)= 12V-4W, MR16 LED	-BK= Black	
	(LI)= 12V-5W, MR16 LED	-GY= Gray	
	(LJ)= 12V-6W, MR16 LED		
	(LL)= 24V-4W, MR16 LED		
	(LW)= 120V-4W, MR16 LED (2 wire)		

Example: EF39P(LG)-BK

Series	Lamp type/wattage	Color
EF39= Die-cast back plate single head NEMA-4X	(LA)= 6V-4W, MR16 LED	Blank= White
EF39D= Die-cast back plate double head NEMA-4X	(LG)= 12V-4W, MR16 LED	-BK= Black
	(LJ)= 12V-6W, MR16 LED	-GY= Gray
	(LI)= 12V-5W, MR16 LED	
	(LL)= 24V-4W, MR16 LED	
	(LW)= 120V-4W, MR16 LED (2 wire)	

Example: EF39(LG)-BK

HPH Series

Class I Division 2, Groups A, B, C and D, Class II Division 2 Groups F and G & Class III.
NEMA-4X High-performance unit equipment for hazardous, damp and wet locations.



Housing

- Class I, Div. 2, Groups A, B, C & D, Class II Div. 2, Groups F & G, Class III
- Compact gray fiberglass housing with captive screws
- NEMA-4X rated
- All external fasteners and hardware are constructed of stainless steel
- Die-cast aluminum LED heads

Mounting

- Simple and easy to install on walls, columns and struts
- Column installation bracket sold separately (order catalog number: PMK1-E)
- 1/2" NPT conduit entry on top or side

Performance

- High temperature lead-calcium battery operates 32°F to 122°F (0°C to 50°C) and nickel-cadmium battery operates 50°F to 104°F (10°C to 40°C) ; optional cold-weather -40°F to 122°F (-40°C to 50°C)
- 15W high efficacy LED emergency heads outperform traditional 50W MR16-IR halogen
- Innovative head design: four-LED and dual-driver provide illumination even in case of unexpected component failure

Electronics

- Infra-red remote control included in all models: allows testing the equipment without the need to climb a ladder. Distance range up to 30 ft. Universal, one remote control may test all the units on the job
- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Standard Advanced Diagnostics
- Optional Nexus® monitoring system
- 120/277 60Hz

Approvals

- UL 924 listed
- Listed to the UL844 Standard for Class I, Division 2, Groups A, B, C & D, Class II, Division 2, Groups F & G and Class III

Warranty

- Unit has five-year limited warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

Remote test control



Classification for hazardous locations

Lamp rating	Temperature code	Maximum temperature	Replacement part #
		Nickel-cadmium Ta= 104°F/40°C	Lead-acid Ta= 122°F/50°C
L15 (15W)	Class I Division 2 Groups A, B, C and D	T3C	T3A
	Class II Division 2 Groups F and G; Class III	T5	T5
No heads	Class I Division 2 Groups A, B, C and D		T4A
	Class II Division 2 Groups F and G; Class III		T6

Power consumption

Temperature	Specs
Standard temperature range	120/277VAC, 60Hz, 0.30/0.15A
Cold-weather option	120/277VAC, 60Hz, 0.70/0.35A


Unit rating

Model	Battery capacity in watts ¹			
	1-1/2 hrs	2 hrs	3 hrs	4 hrs
12HPHM30	30	20	15	10
12HPHM60	60	40	30	20
12HPHN40	40	36	24	18
24HPHN90	90	72	48	36


¹The cold-weather option is only rated for 90 minutes

Dimensions

Dimensions are approximate and subject to change.

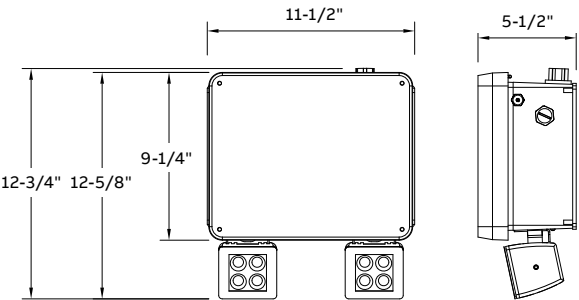

Installation

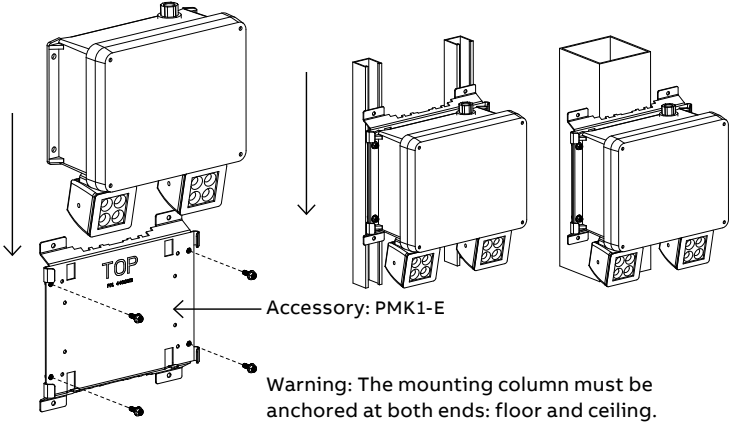


Photometric performance

Whether installed indoors or outdoors, the **HPH Series** of LED emergency lights deliver a stable and consistent illumination on the path of egress for a wide range of mounting heights.

Spacing center-to-center (feet)	
Mounting height	Lamp L15 / 15W, 1300LM
10 ft.	140
15 ft.	135
20 ft.	130
25 ft.	120

Industrial environment: wall mounted equipment, reflectances: 10/10/10; 6-ft. wide illumination path. Illumination as per NFPA101; Average: 1fc; Min: 0.1fc; Max/min< 40:1

LED head	Power	Total lumens	Out-perform spacing of incandescent lamps
L15	15W	1300	50W MR16-IR halogen

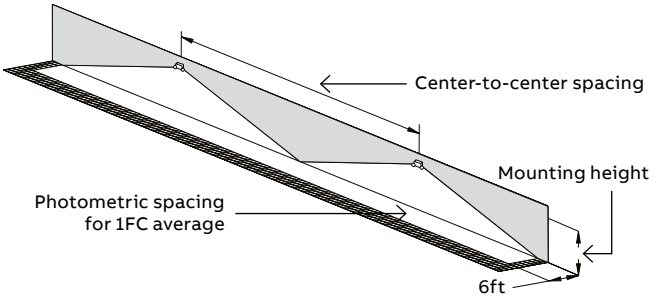

How to order

Series	Battery type and capacity	# of heads	LED heads	Diagnostic	Options
12HPH = 12V high-performance Cl. I Div.2, Cl. II Div.2, Cl. III	Lead-calcium M30 = 12V-30W, lead-calcium battery 32°F to 122°F [0... 50°C]	0 = No head 1 = One head 2 = Two heads	L15 = 12-24V, 15W (1300 Lumens)	D = Advanced Diagnostic, non-audible ¹ DA = Advanced Diagnostic, audible ¹ -NEX = Nexus® wired (contact your sales representative) ¹ -NEXRF = NEXUS® wireless (contact your sales representative) ¹ ND = No Advanced Diagnostic	D3 = Time delay 15 min. RFI = Radio frequency interference filter CW4 = Cold-weather package -40°C / -40°F
	Nickel-cadmium N40 = 12V-40W, nickel-cadmium battery 50°F to 104°F [10... 40°C]				
	N90 = 24V-90W, nickel-cadmium battery, temperature= 50°F to 104°F [10...40°C]				
24HPH = 24V high-performance					

Example: 12HPN402L15DRFI

To order separately: Universal mounting bracket: PMK1-E

¹Minimum load required: 20% of load capacity

HPHRL Series

Class I, Division 2, Groups A, B, C & D, Class II, Division 2, Groups F & G and Class III, NEMA-4X, damp & wet locations



Housing

- Light weight polycarbonate gray housing and die-cast fully adjustable heads
- Class I, Div. 2, Groups A, B, C & D, Class II Div. 2, Groups F & G, Class III
- NEMA-4X protection grade
- All external fasteners and hardware are constructed of stainless steel

Mounting

- Simple and easy to install on walls, columns and struts
- Column installation bracket sold separately (order catalog number: PMK1-E)
- 1/2" NPT conduit entry on top or side

Performance

- 15W high efficacy LED emergency heads outperform traditional 50W MR16-IR halogen
- Innovative head design: four-LED and dual- driver provide illumination even in case of unexpected component failure

Approvals

- UL 924 listed
- Can be installed in wide temperature range: -40°F to 131°F (-40°C to 55°C)
- Listed to the UL 844 Standard for Class I, Division 2, Groups A, B, C & D, Class II, Division 2, Groups F & G and Class III

Warranty


- Unit has a five-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Classification for hazardous locations

Lamp suffix	Voltage	Power	Lumen flux	Ambient	Classification	Temp. code
L15	12-24VDC	15W	1,300 Lm	131°F / 55°C	Class I Division 2 Groups A, B, C and D	T3C
					Class II Division 2 Groups F and G; Class III	T5

Dimensions

Dimensions are approximate and subject to change.

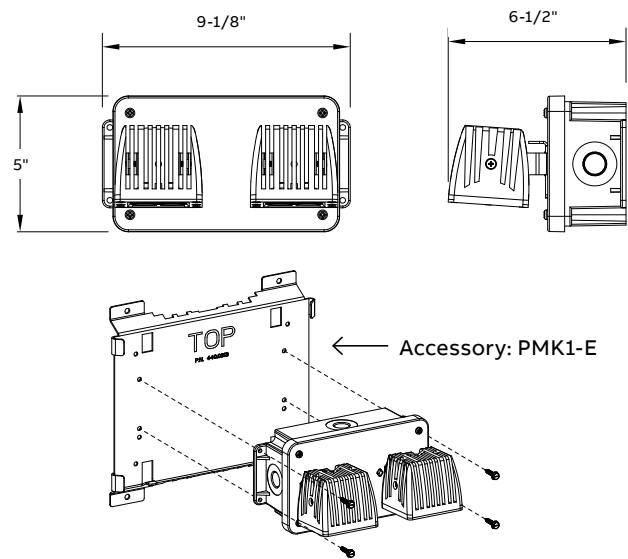


Photometric performance

Whether installed indoors or outdoors, the **HPHRL Series** of LED remote emergency lights deliver a stable and consistent illumination on the path of egress for a wide range of mounting heights.

LED head	Power	Total lumens	Out-perform spacing of incandescent lamps
L15	15W	1300	50W MR16-IR halogen

Mounting height	Spacing center-to-center (feet)	
	Lamp L15 / 15W, 1300LM	
10 ft.	140	
15 ft.	135	
20 ft.	130	
25 ft.	120	

Industrial environment: wall mounted equipment, reflectances: 10/10/10; 6-ft. wide illumination path. Illumination as per NFPA101; Average: 1fc; Min: 0.1fc; Max/min< 40:1

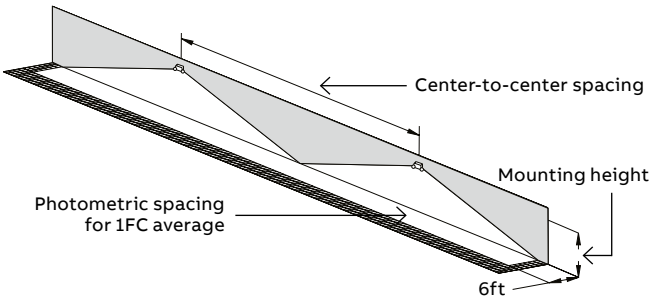

How to order

Series	Number of heads	LED head
HPHRL= High-performance hazardous location remote	Blank= Single head D= Double head	L15 = 12-24V – 15W (1300 Lumens)

Example: HPHRLDL15

Survive-All™ SVH Series

Class I, Division 2 housing 6V-18W & 12V up to 72W capacities



Housing

- Class I Division 2, Groups A, B, C and D
- Vandal-resistant UV stabilized polycarbonate lamp cover
- Front and back plates are of a heavy duty aluminum
- Stainless steel tamper-proof screws

Mounting:

- Surface wall mount only
- Includes mounting lugs on each side of the housing
- Universal J-box mounting
- 1/2 inch entry on both sides and top of housing

Lamp type

- Choice of MR16 LED lamp wattages

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit

- Magnetic test switch
- Standard Advanced Diagnostics (non-audible)
- Optional Nexus® monitoring system
- 120/277 60Hz

Battery type

- 6 or 12V lead-calcium battery

Approvals


- CSA-US (to UL 924 standards)
- Evaluated to the UL 844 Standard for Class I Division 2, Groups A, B, C and D
- NEC, OSHA and NEMA compliant for above Classes and Groups
- Damp and wet location (50°F to 104°F)

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'

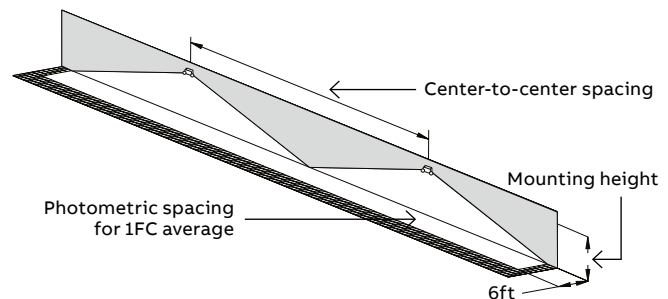

Dimensions

Dimensions are approximate and subject to change.

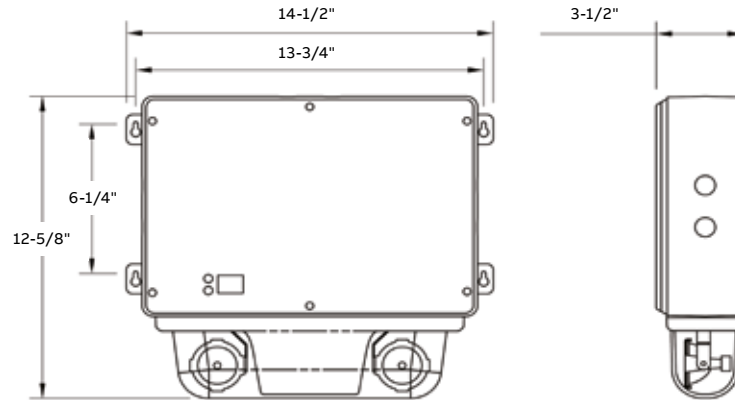

Temperature codes

Lamp rating ¹	Temperature code	Max. temperature	Replacement part #
6V-4W	T4A	120°C	580.0097
12V-4W	T4A	120°C	580.0080
12V-5W	T4A	120°C	580.0104

¹Use qualified replacement lamps to avoid risk of over-heating

Power consumption and unit rating

		Battery capacity in watts					
Model		AC specs	1-1/2 hrs	2 hrs	3 hrs	4 hrs	8 hrs
SVH18	120/277VAC	0.17 / 0.09 Amp	18	12	9	–	–
12SVH36		0.30 / 0.15 Amp	36	27	18	14	–
12SVH60		0.30 / 0.15 Amp	60	45	30	24	12
12SVH72		0.30 / 0.15 Amp	72	54	36	28	14

How to order

Color	Voltage and power	# of heads	Lamps	Options
G= Gray	SVH18M= 6V-18W, lead-calcium 12SVH36M= 12V-36W, lead-calcium 12SVH60M= 12V-60W, lead-calcium 12SVH72M= 12V-72W, lead-calcium	-2= Two heads -0= No heads	LA= 6V-4W, MR16 LED LG= 12V-4W, MR16 LED LI= 12V-5W, MR16 LED LJ= 12V-6W, MR16 LED	Blank= Advanced Diagnostics (non-audible) ¹ -DA= Advanced Diagnostics (audible) ¹ -D3= Time delay (15 minutes) -NEX= NEXUS® wired (consult your sales representative) ¹ -NEXRF= NEXUS® wireless (consult your sales representative) ¹

Example: G12SVH72M-2MK-DA

¹Minimum lamp load required: 20% of unit capacity

Survive-All™ SVXH Series

Class I Division 2, Groups A, B, C and D hazardous location combination unit



Construction

- Fully gasketed housing frame
- Faceplate: heavy-duty, vandal-resistant polycarbonate
- Backplate: heavy-duty aluminum
- Vandal-resistant UV stabilized polycarbonate lamp cover
- Stainless steel tamper-proof screws
- 6 inch EXIT lettering legend, available in red or green
- Field-selectable chevrons

Mounting

- Surface wall mount only
- Backplate features universal knockouts for a standard 4 inch junction box, and four mounting eyelets used in wall mount applications
- 1/2 inch conduit entry on top and sides.

Lamp type

- Choice of MR16 LED lamp wattages

Battery type

- SVXH Model, nickel-cadmium battery, 6V-20W total battery capacity
- SVXH12N Model, nickel-cadmium battery, 12V-24W total battery capacity

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'

Special Wording Panels

- Available. Contact your sales representative with your design requirements

Electronics


- Magnetic test switch
- Standard Advanced Diagnostics (non-audible)
- Optional Nexus® monitoring system
- 120/277 60Hz

Approvals

- CSA-US (to UL 924 standards)
- Evaluated to the UL 844 Standard for Class I Division 2, Groups A, B, C and D
- NEC, OSHA and NEMA compliant for above Classes and Groups
- Damp and wet location (50°F to 104°F)
- Temperature code T4A (Max. temperature 248°F/120°C)
- Meets NFPA101 (Life Safety Code), NFPA 70-NEC and OSHA illumination standards


Warranty

- Five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

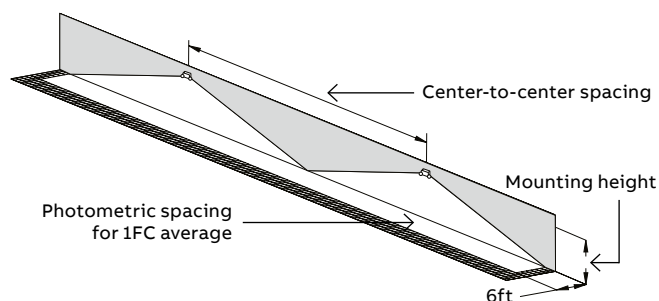

Dimensions

Dimensions are approximate and subject to change.

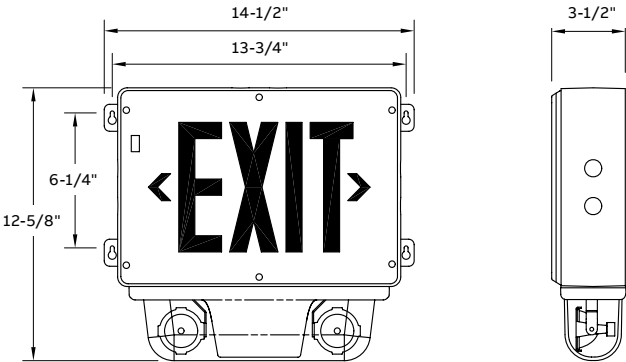

Power consumption and unit rating

Model	AC Input	Current	Power	Maximum	Stand-by	Battery capacity in watts			
				Current	Power	1-1/2 hrs	2 hrs	3 hrs	4 hrs
SVXH	120/277VAC	0.15/0.07A	16W	0.09/0.03A	8W	20	15	–	–
SVXH12N	120/277VAC	0.30/0.08A	29W	0.13/0.05A	10W	24	18	12	–

Accessories (order as a separate item)

Description	Part number
Additional special bit for tamper-proof screws	690.0454-E

How to order

Housing/face color	Series/capacity	Legend color	Diagnostics	# of heads	Lamp type/wattage ¹
GG= Gray/gray	SVXH= 6V-20W, Ni-Cd	R= Red	DA= Advanced Diagnostics (audible)	Blank= 0 head ³	LA= 6V-4W, MR16 LED
	SVXH12N= 12V-24W, Ni-Cd	G= Green	D= Advanced Diagnostics (non-audible)	2= Two heads	LG= 12V-4W, MR16 LED
			NEX= NEXUS® wired ²		LI= 12V-5W, MR16 LED
			NEXRF= NEXUS® wireless ²		LJ= 12V-6W, MR16 LED

Example: GGSVXHRD2LG

¹No other lamp option available
²Consult your sales representative
³Minimum load required: 20% of load capacity

Survive-All™ SVX-HZ Series

Class I Division 2, Groups A, B, C and D, hazardous location exit sign



Construction

- Fully gasketed housing frame
- Faceplate: heavy-duty, vandal-resistant polycarbonate
- Backplate: heavy-duty aluminum
- Stainless steel tamper-proof screws
- 6 inch EXIT lettering legend, available in red or green
- Field-selectable chevrons

Mounting

- Surface mount
- Junction box included for wall, end or ceiling mount applications
- 1/2 inch conduit knock-out entry on top and sides.

Special wording panels

- Available. Contact your sales representative with your design requirements

Electronics

- Magnetic test switch
- Standard Advanced Diagnostics (non-audible)
- Optional Nexus® monitoring system
- 120/277 60Hz

Approvals

- CSA-US (To UL 924 standards)
- Evaluated to the UL 844 Standard for Class I Division 2, Groups A, B, C and D
- NEC, OSHA and NEMA compliant for above Classes and Groups
- Damp and wet location (50°F to 104°F)
- Meets NFPA101 (Life Safety Code), NFPA 70-NEC and OSHA illumination standards

Warranty

- Five-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Power consumption¹

Model	AC specs		DC specs	
AC-only red	120 to 277VAC	Less than 2W	–	–
AC-only green	120 to 277VAC	Less than 1.5W	–	–
Self-powered red	120 to 277VAC	Less than 2W	Ni-Cd battery	Min. 90 minutes
Self-powered green	120 to 277VAC	Less than 2.5W	Ni-Cd battery	Min. 90 minutes

¹Cold-weather option does not consume additional power

Dimensions

Dimensions are approximate and subject to change.

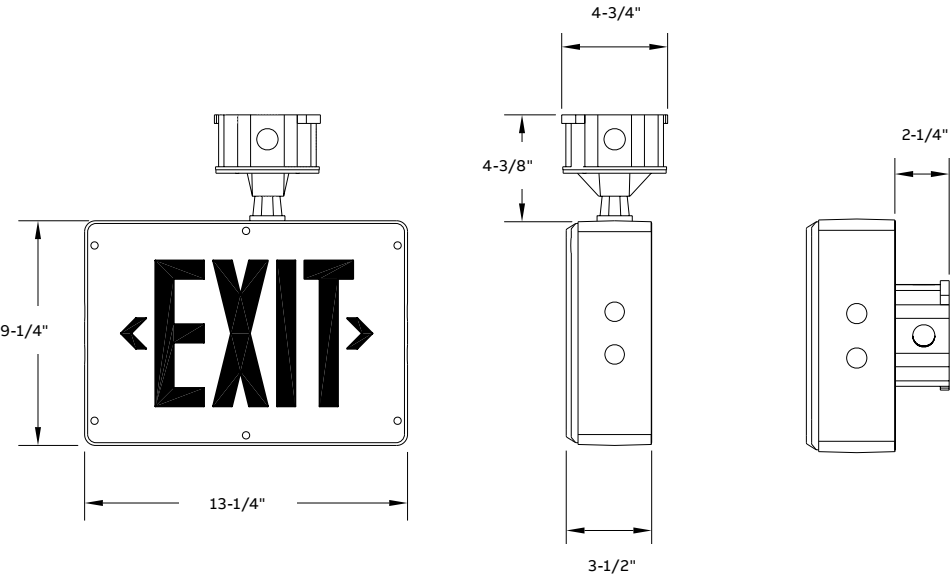

Accessories (order as a separate item)

Description	Part number
Tamper-proof bit (extra)	690.0454-E
Convert single to double face, red ¹	DFKR-GY
Convert single face to double face, green ¹	DFKG-GY

¹In the field

How to order

Color of body/face	Series	Face	Legend	Diagnostic	Options
GG= Gray/gray	SVXHZ= AC only SVXNHZ= Self-powered Ni-Cd	1= Single (ceiling/wall mount) 2= Double (ceiling mount only)	R= Red G= Green	-D= Diagnostic (self-powered only & non-audible) -NEX= NEXUS® wired -NEXRF= NEXUS® wireless	CW= Cold weather ¹

Example: GGSVXNHZ2R-DCW

¹Self-powered model

Survive-All™ EF41 Series

Class I Division 2, Groups A, B, C and D certified remote fixture



Description

- Available with single or double lamp heads
- Die-cast aluminum back plate with gasket
- Vandal-resistant UV stabilized polycarbonate lamp cover
- Comes standard with tamper-proof screws and bit
- Universal J-box mounting
- Extreme operational temperature range:
-40°F to +104°F (-40°C to +40°C)

Mounting

- Surface mount
- Conduit entry 1/2" NPT

Approval


- CSA-US (to UL 924 standards)
- Evaluated to the UL 844 Standard for Class I Division 2, Groups A, B, C and D

Warranty

- Five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Dimensions

Dimensions are approximate and subject to change.

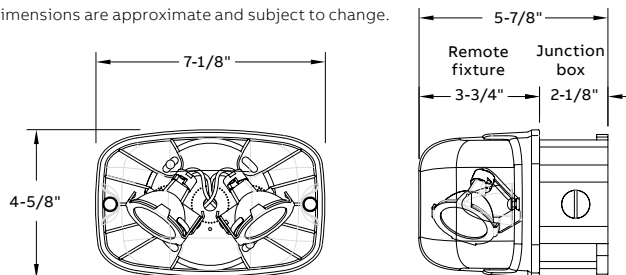


Lamp selection chart and temperature code

Lamp suffix	Voltage	Wattage	Lumens	Replacement #	Temperature code	Max temperature
LA	6	4	200	580.0097-E	T4A	120°C
LG	12	4	220	580.0093-E	T5	100°C
LI	12	5	340	580.0104-E	T4A	120°C
LJ	12	6	540	580.0106-E	T4	135°C
LL	24	4	220	580.0098-E	T5	100°C
LW	120	4	230	580.0113-E	T4A	120°C

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'
LL	51'	39'

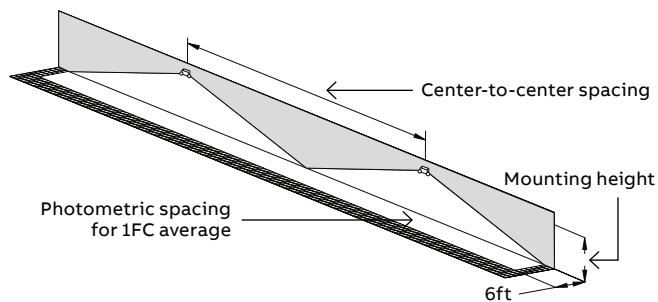

How to order

Series	Lamp type/wattage		Color
EF41= Single	(LA)= 6V-4W, MR16 LED	(LJ)= 12V-6W, MR16 LED	-GY= Gray
EF41D= Double	(LG)= 12V-4W, MR16 LED	(LL)= 24V-4W, MR16 LED	-BK= Black
	(LI)= 12V-5W, MR16 LED	(LW)= 120V-4W, MR16 LED	

Example: EF41(MJ)-GY

EverLite™ Series

Non-electric self luminous tritium exit sign for use in harsh environments



Construction

- Housing and frame are made of ABS molding
- Faceplate lens is .13 thick acrylic
- Legend is non-glare polycarbonate
- Tamper-proof assembly with no removable fasteners
- 6" EXIT lettering legend, background available in red or green

Mounting

- Surface mount
- Single face model includes (1) housing, (1) faceplate and (1) canopy
- Canopy included for wall, end or ceiling mount applications
- Double face model includes (2) housings, (2) faceplates and (1) canopy
- Canopy included for end or ceiling mount applications

Finishes – choice of white or black

Chevrons – two field-selectable direction chevrons

No power required

- Non-electric, uses no electrical power internally or externally to illuminate – No wiring needed to operate
- No need to be illuminated by absorbing light from another source
- Spark-free, no filament, suitable for use in humid, corrosive or explosive environments

Accessories (order as a separate item)

Description	Suffix
White pendant	P-WT ¹
Black pendant	P-BK ¹
Gray pendant	P-GY ¹
Wire guard-wall mount	WG13-E
Wire guard-ceiling mount	WG5-E
Wire guard-end mount	WG15-E

¹Specify length in inches (12, 24, 36, etc.)

How to order

Frame	Series	Sign life	# of faces	Legend	Options	New
W= Off white ABS frame	SLX= Series	-10= 10 years	61= Single face	R= Red	-PC= Polycarbonate shield	-N= NEW
B= Black ABS frame		-20= 20 years	62= Double face	G= Green		
G= Gray ABS frame						
A= Aluminum frame						

Illumination

- Provided by phosphor-coated borosilicate tubes filled with tritium gas
- Low energy beta emission of tritium striking the phosphor coating inside the glass tubes generates illumination for the life of the sign

Special wording panel – Not available

Approvals


- NFPA Life Safety Code 101 • UL 924
- City of Los Angeles • State of California
- Council of American Building Officials (ICBO, SBCCI)
- OSHA • USNRC • ISO 9001

Warranty (subject to proper installation and maintenance)

- Full warranty for life of sign
 - 10 year sign=10 year warranty
 - 20 year sign=20 year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Dimensions

Dimensions are approximate and subject to change.




Mounting

Single face signs

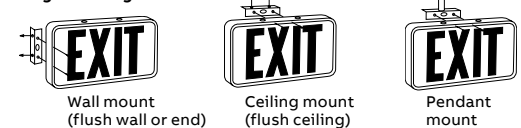

Double Face Signs

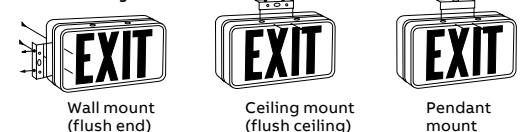

Example: WSLX-1061R-N

EXC LED Series

Class I, Division 1 & 2, Group C & D; Class II, Division 1 & 2, Group E, F & G; Class III remote fixture for hazardous locations



Housing

- One-piece heavy gauge, corrosion resistant, copper-free cast aluminum
- Consists of a housing with provisions for up to two lighting heads
- Spin-off gasketed cover prevents propagation of internally generated arcs
- Stainless steel vent/drain
- Lighting head fixtures are heavy cast aluminum with Pyrex® lens
- Exit faceplate: heavy-duty 20 gauge steel, baked enamel gray finish
- 6 inch EXIT lettering legend, available in red or green
- Field-selectable chevrons

Mounting

- Surface wall mount
- 3/4" NPT conduit entry on top and bottom of housing
- Single and double pendant mount heads include elbow swivel, conduit extension pipe (6" increments)

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- 120/277 60Hz

Lamp type

- Heads offer a choice of MR16 LED lamp wattages
- Exit sign uses a 3 watt LED lamp

Battery type

- 6V or 12V, nickel-cadmium battery

Approvals

- CSA-US (to UL 924 standards)
- Manufactured in accordance with UL844, UL1203
- Class I, Division 1 & 2, Groups C & D
- Class II, Division 1 & 2, Groups E, F & G
- Class III
- NEC, OSHA and NEMA compliant for above Classes and Groups
- Temperature code T6


Warranty

- Unit has five-year warranty
Detailed warranty terms located on **page 188** or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf




Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
2 x LA	43'	29'
2 x LG	55'	36'
2 x LI	67'	41'
2 x LJ	87'	62'

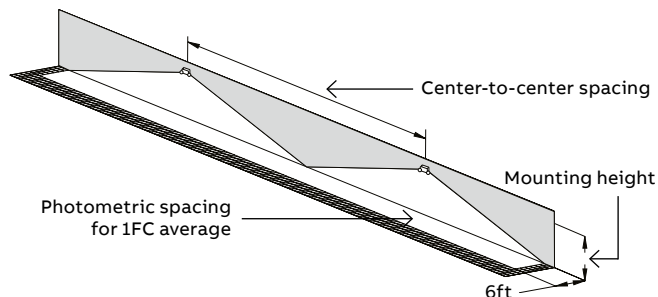

Dimensions

Dimensions are approximate and subject to change.





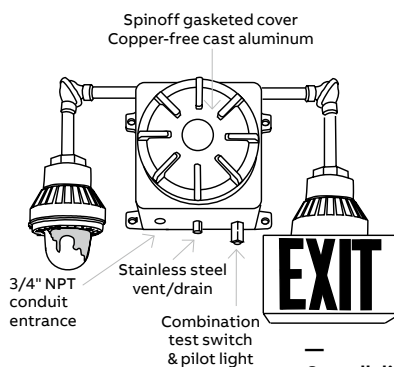


Housing:

12" X 12" X 9 1/2"
(4) Mounting Lugs:
10" and 13- 1/2" on center

Overall dimensions
(including fixtures):
38" X 38" X 10"

Standard configurations for EXC Series

Unit	Catalog number examples	Description
 (Remote capability)	6EXC1 6EXC1-TS	6 volt self contained hazardous location emergency battery unit 18 watts of remote capacity. 6 volt self contained hazardous location emergency battery unit 18 watts of remote capacity. Transfer switch included for use with remote exit signs (maximum 5 exit signs per TS).
	12EXC4-1LI 12EXC4-1LI-TS	12 volt self contained hazardous location emergency battery unit with one head containing 2 X 12V 5W MR16 LED lamps, 30 watts of remote capacity. 12 volt self contained hazardous location emergency battery unit with one head containing 2 X 12V 5W MR16 LED lamps, 30 watts of remote capacity. Transfer switch included for use with remote exit signs (maximum 5 exit signs per TS).
	6EXC3-2LA 6EXC3-2LA-TS	6 volt self contained hazardous location emergency battery unit with two heads, each containing 2 X 6V 4W MR16 LED lamps, 14 watts of remote. 6 volt self contained hazardous location emergency battery unit with two heads, each containing 2 X 6V 4W MR16 LED lamps, 14 watts of remote capacity. Transfer switch included for use with remote exit signs (maximum 5 exit signs per TS).
	6EXC1-TS-T1LR	6 volt self contained exit sign with 15 watts of remote capacity. Transfer switch included for use with integral exit sign and additional remote exit signs (maximum 5 exit signs per TS).
	12EXC4-1LJ-TS-T1LR	12 volt self contained combination unit with 25 watts of remote capacity. Transfer switch included for use with integral exit sign and additional remote exit signs (maximum 5 exit signs per TS).

Note: Exit signs utilize a 3 watt bayonet base LED bulb fabricated at our North American facility.

Unit rating – equipment with remote capability


Sealed maintenance-free battery type	D.C. voltage	Model number	Battery capacity in watts			
			1-1/2 hrs	2 hrs	4 hrs	8 hrs
Nickel-cadmium	6	EXC1	8	12	9	6
	6	EXC3	30	20	15	10
	12	EXC2	24	18	12	9
	12	EXC4	40	30	20	15

How to order

Series / capacity	# of heads and lamps	Lamp wattage/type	Battery unit option
6EXC1= 6Vdc battery unit/combo 18W (6V only)	-0= No emergency head	LA= 6V 4W MR16 LED	Blank= No transfer panel
6EXC3= 6Vdc battery unit/combo 30W (6V only)	-1= Single head,	LG= 12V 4W MR16 LED	-TS= Transfer panel
12EXC2= 12Vdc battery unit/combo 24W (12V only)	two lamps	LI= 12V 5W MR16 LED	(required to supply
12EXC4= 12Vdc battery unit/combo 40W (12V only)	-2= Two heads, two lamps each	LJ= 12V 6W MR16 LED	remote exit sign only)
Exit sign # of faces	Exit sign lamp	Exit sign letter color	
Blank= No exit sign	L= LED exit sign	Blank= No exit sign	
-T1= Single face exit sign		R= Red	
		G= Green	
Example: 12EXC4-1LG-T1LR			

EFEF Series

Explosion proof LED remote unit

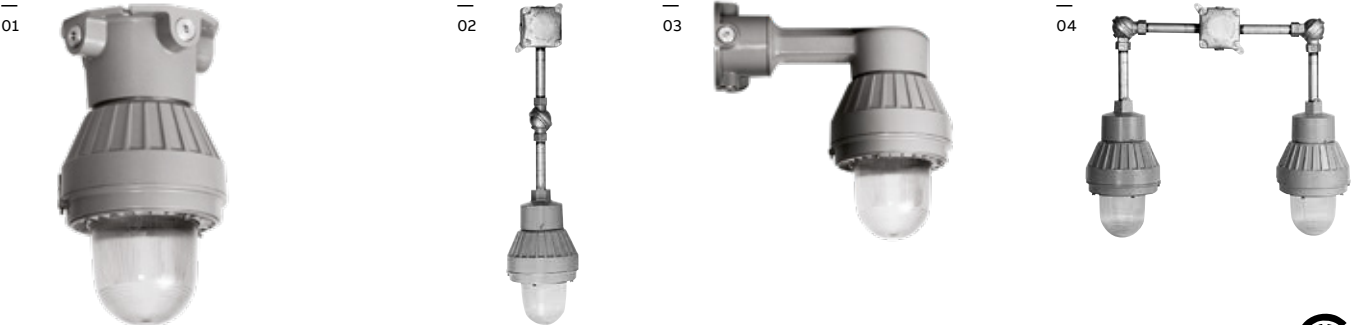

Description

- MR16 LED light source
- Available as wall ceiling or pendant mount
- Heavy cast aluminum
- Pyrex® lenses¹

Finish

- Painted grey

Mounting

- Surface mount: wall or ceiling
- Pendant mount: single head or double head
- Pendant mount including hazardous location elbows, swivels and conduit extension pipe (6" increments)
- Combination hazardous location junction box/mounting plate with 1/2" NPT conduit entry

Approvals

- CSA US (to UL 924 standards)
- Class I, Division 1&2, Groups C and D
- Class II, Division 1&2, Groups E, F and G
- Class III, Division 1&2, (150W max)
- Complies with NEC, OSHA and NEMA for above classes and groups
- Suitable for wet and damp location
- Temperature code T6


Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

¹Pyrex® is a registered trademark of Corning Glass.


Photometric performance - with two lamps

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
2 x LA	43'	29'
2 x LG	55'	36'
2 x LI	67'	41'
2 x LJ	87'	62'
2 x LL	56'	29'
2 x LV	58'	39'

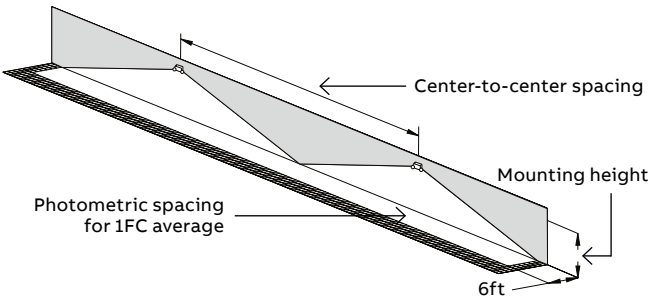




Dimensions

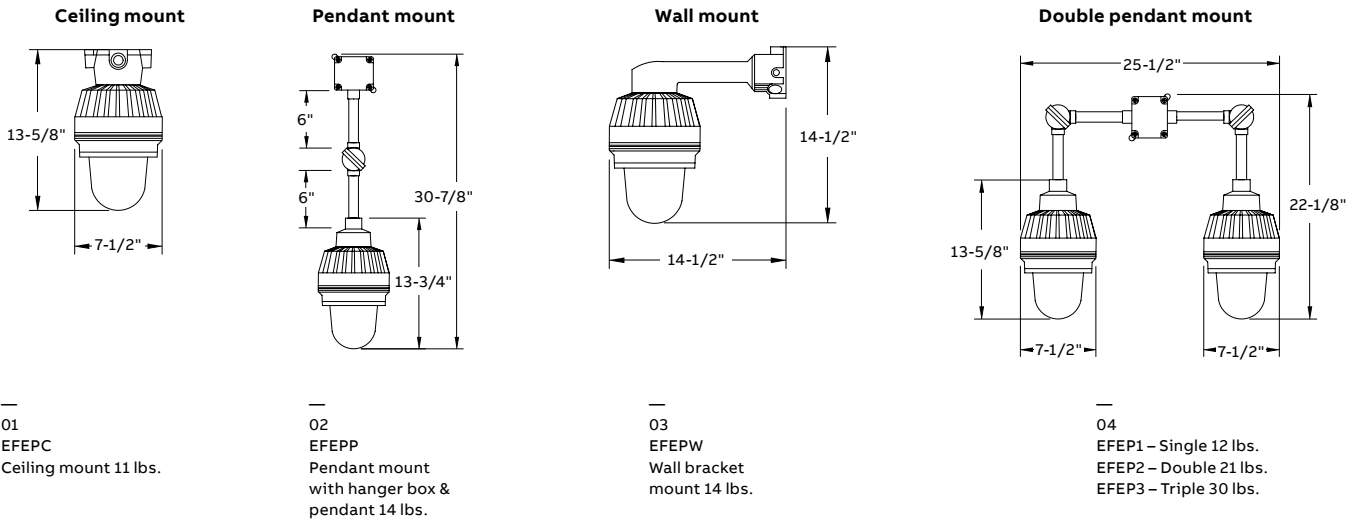Dimensions are approximate and subject to change.



Standard configurations for EXC Series

Unit	Description	Suffix
	Guard One-piece aluminum casting construction, attaches to globe holder ring with four screws	GXP
	Dome Reflector Highly reflective white finish inside and out, attaches to globe holder ring with four screws	RD
	Angle Reflector Highly reflective white finish inside and out, attaches to globe holder ring with four screws	RA

How to order

Series	Mounting	No. of lamps	Lamp type/wattage
EFEP= X-proof LED remote	C= Ceiling mount P= Pendant W= Wall mount D= Double pendant mount	2= 2 lamps per head	LA= 6V-4W, MR16 LED LG= 12V-4W, MR16 LED LI= 12V-5W, MR16 LED LJ= 12V-6W, MR16 LED LL= 24V-4W, MR16 LED LV= 120V-4W, GU10 LED

Example: EFEPC(HB)-GXP

EFXP Series

Explosion-proof exit signs



EFXPW – Wall mount



XPP – Adjustable pendant mount



EFXPC – Ceiling mount



Construction

- Heavy-duty 20 gauge steel, baked enamel grey finish
- 6 inch EXIT lettering legend, available in red or green
- Field-selectable chevrons

Mounting

- Ceiling, wall or pendant
- 3/4 inch conduit entry

Approvals


- CSA-US (to UL 924 standards)
- Class I, Division 1&2, Groups C and D
- Class II, Division 1&2, Groups E, F and G
- Class III
- Complies with NEC, OSHA and NEMA for above classes and groups
- Suitable for wet and damp location
- Temperature code T6

Warranty

- Unit has a five-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Transfer panel (to order separately with AC/DC exit signs)


- A transfer panel is only required for AC/DC hazardous location **EFXP** exit signs that are under constant operation as required by code. Transfer panels are not designed to be installed/mounted in a hazardous or explosive area. Transfer panels are to be mounted remotely from these types of areas.
- Transfer panel available for up to 100W
- To order a transfer panel the following information is required:
 - 1) AC input: 120V or 277V
 - 2) DC voltage
 - 3) The total load wattage of all EFXP lamp(s) to be supplied by transfer panel

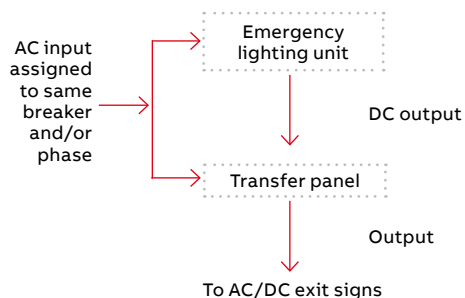

Dimensions

Dimensions are approximate and subject to change.

AC-only and AC/DC exit signs

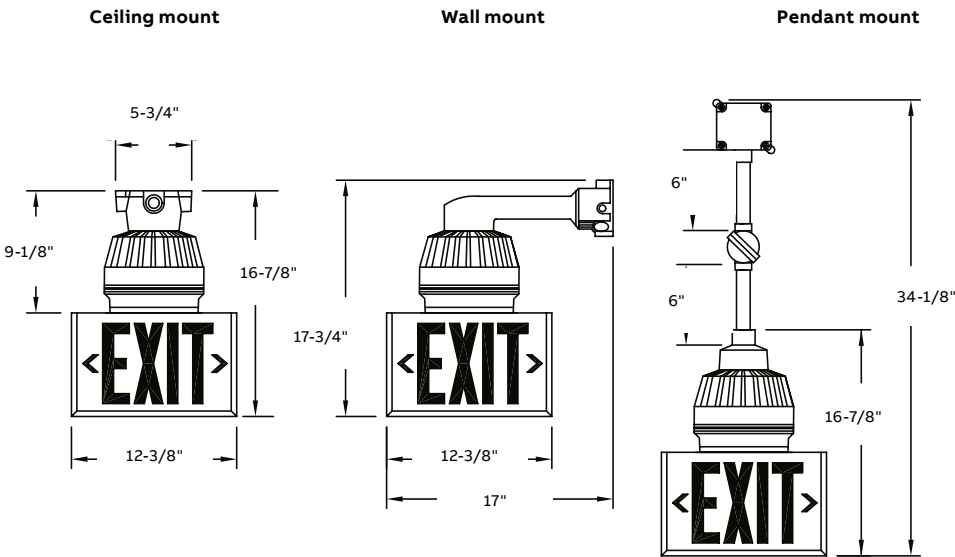

Power consumption

120/277VAC, 60Hz maximum 0.3/0.15A

How to order

Series	Mounting	Lamp	Faces	Legend color
EFXP= Exit series	C= Ceiling mount P= Pendant W= Wall	LED6= 6V-3 watt LED LED12= 12V-3 watt LED LED24= 24V-3 watt LED LED120= 120V-5 watt LED	1= Single face 2= Double face	R= Red G= Green

Example: EFXPCLED61R

How to order – Transfer panel (required for the operation of AC/DC exit sign)

AC voltage	DC voltage	Series	Watts
120= 120V AC	-6= 6V DC ¹	-TS	-25= 25W
277= 277V AC	-12= 12V DC		-50= 50W
	-24= 24V DC		-75= 75W
			-100= 100W

Example: Transfer panel (needed for AC/DC operation): 120-12-TS-25

¹50W maximum

Remote fixtures

Remote fixtures are ideal for architectural, commercial, and industrial locations with limited space or where subtle, code-compliant lighting is required.

- Provides a range of lamp types to suit illumination and spacing requirements
- Offers compatibility with battery units or inverters
- Complements decor with a selection of styles and mounting options

01 Revelation™ DC Series
Virtually invisible,
architecturally pleasing

See page 107 for
more information
about this product

01





Table of contents

Remote fixtures

			
Lux-Ray™ LED Series 104	Literay™ Series 106	Revelation™ DC Series 107	Distinction™ DC Series 108
			
Distinction™ EF150 Series 110	EF10 & EF10D Series 111	EF12D-LED Series 112	HPRL Series 113
			
	Survive-All™ EF39 & EF40 Series 114	HPHRL Series 116	Survive-All™ EF41 Series 117

Lux-Ray™ LED Series

Low-profile, sleek look light fixture



Description

- Die-cast aluminum housing
- UV resistant polycarbonate lens


Lamp type

- LED light engine with redundant connections
- Optional forward-throw light distribution, for applications of outdoor egress
- Optional dual-mode: normal and emergency LED lighting with separate AC inputs


Photometric performance

Table A – Spacing for minimum illumination = 1FC (1 foot-candle)

Model type	Mounting height	Lumen	Color temperature	Width X length (ft)	
				Single unit	Center-to-center
Standard	9'	400	5000K	4' x 28'	4' x 32'
With option -H	11'	550		4' x 32'	4' x 40'
With option -FT	12'	460		4' x 22'	–
With option -FTH	15'	640		4' x 27'	–

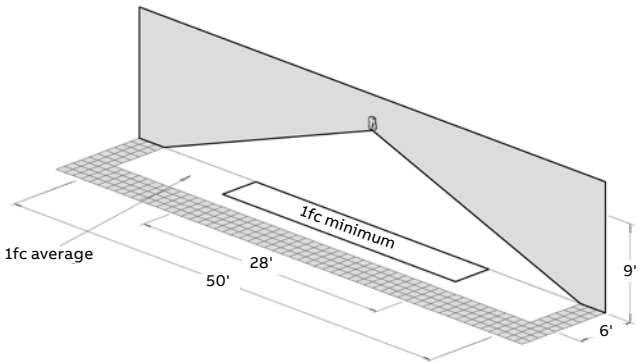

Housing color



- Optional high-lumen output
- Optional photo-switch: dusk-to-dawn control of normal lighting
- Optional remote test: infrared remote control
- 400-640 Lumens
- Color temperature: 5000K

Mounting

- Surface wall mount
- Universal J-box mounting

Approval

- UL listed
- NEMA-3R
- Damp and wet location listed (50°F to 104°F, 10°C to 40°C)


Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf




Table B – Spacing for NFPA101 – Average = 1FC (1 foot-candle)

Model type	Mounting height	Lumen	Color temperature	Width X length (ft)	
				Single unit	Center-to-center
Standard	9'	400	5000K	6' x 50'	4' x 32'
With option -H	11'	550		6' x 60'	4' x 40'
					3' x 70'
With option -FT	12'	460		6' x 40'	–
With option -FTH	15'	640		6' x 50'	–

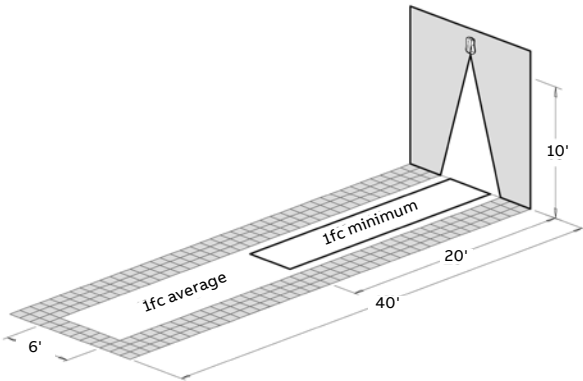

Dimensions

Dimensions are approximate and subject to change.

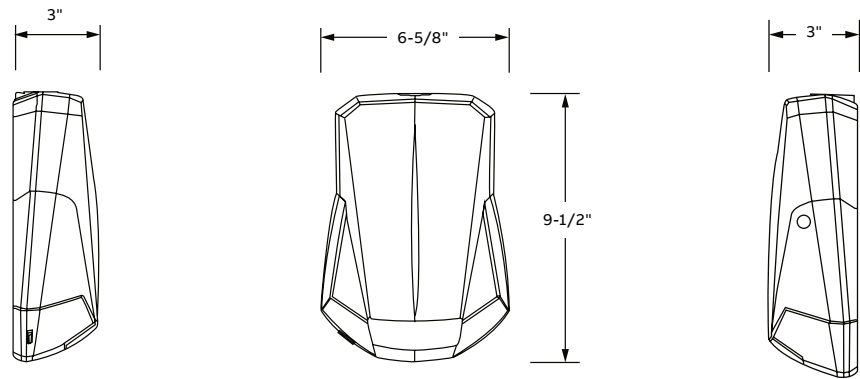

Power consumption chart

Model type	Normal lighting (120/277VAC)		Emergency lighting (120/277VAC)		6-12VDC remote
	Current (max)	Power (max)	Current (max)	Power (max)	Power (max)
AC, 2AC, ACDC, DC	0.12/0.08A	12W	0.12/0.08A	12W	8W
AC, 2AC, ACDC, DC, -H	0.18/0.11A	18W	0.18/0.11A	18W	14W

¹Note: only unswitched AC input; normal lighting with photocell or remote control

How to order

Color	Series	Model [(-40°F ... +122°F (-40°C ... +50°C))]	Options
B = Black	LUX = Lux-Ray LED	AC = AC-only	-FT = Forward throw lighting
BZ = Dark bronze		ACDC = AC/6-12VDC remote	-H = High lumen output (-40... 86°F/-40...30°C)
OW = Off-white		DC = 6-12VDC remote fixture	-P = Photocell (AC, ACDC only)
PG = Platinum gray		2AC = AC-only two circuits: 120/120 or 277/277V	-RC = Remote control test switch- infrared ¹ (AC, ACDC only)
<div>Example: BZLUXDC-FTH</div>			

¹Remote control keypad (TB-RC1-E) ordered separately

Literay™ Series

Wall mount remote head for damp and wet locations



Description

- Indoor or outdoor use
- Die-cast aluminum construction
- Fully gasketed cover
- Impact- and tamper-resistant polycarbonate lens

Mounting

- Surface wall mount
- Universal J-box mounting

Lamp type

- Choice of MR16 LED lamp wattages

Approval


- UL 924 listed
- NEMA-3R
- Damp and wet location listed (50°F to 104°F, 10°C to 40°C)

Warranty

- Unit has a three-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Dimensions

Dimensions are approximate and subject to change.

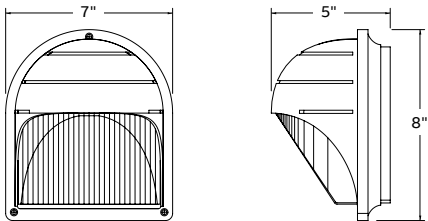


Photometric performance

Spacing center-to-center (feet)	
Lamp	7 ft. mounting height
LG frosted lens	16'
LG clear lens	28'

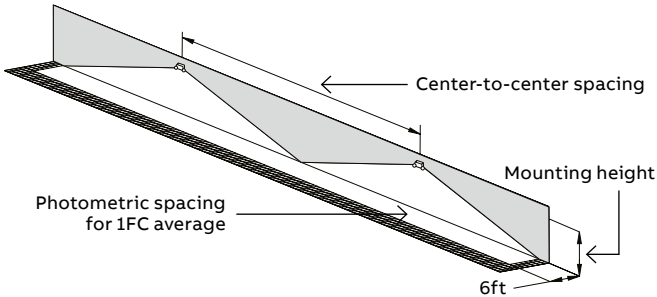

Housing color



How to order

Series	No. of lamps	Lamp type/ Wattage	Color	Options
LITE=	-2= 2 lamps	(LA)= 6V-4W,	-WT= White	Blank= No
Exterior	(standard)	MR16 LED	-BK= Black	options
remote		(LG)= 12V-4W,	-DG= Dark	-VR= Vandal-
		MR16 LED	gray	resistant
		(LI)= 12V-5W,	-BZ= Dark	screws
		MR16 LED	bronze	-N= Clear lens
		(LJ)= 12V-6W,		
		MR16 LED		
		(LL)= 24V-4W,		
		MR16 LED		
		(LV)=120V-4W,		
		MR16 LED		

Example: LITE-2(LA)-WT-VR

Revelation™ DC Series

Virtually invisible, architecturally pleasing



Description

- Indoor use
- One-piece all-metal module design
- Complete 360° door rotation
- Slip gear mechanism protects the unit from objects that would cause the door rotation to be forcibly stopped.

Finish


- Flat door and frame are covered with a high-quality, powder coated textured off-white finish
- Surface finish can be customized on site with paint, wallpaper or other coverings.

Mounting

- The module includes the electrical junction box and is installed on the wall stud or ceiling beam with the help of a simple, U-shape bracket.
- Key-hole slot for ease of installation

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7 ft. mounting height	15 ft. mounting height
LG	55'	43'
LI	71'	56'
LJ	100'	85'
LL	56'	44'

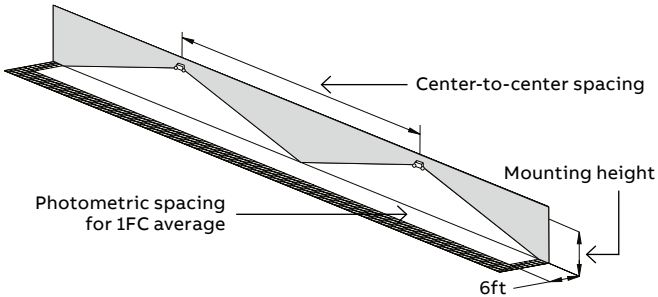

Lamp type

- Choice of MR16 LED lamp wattages

Approval


- CSA-US (to UL 924 standards)

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Dimensions

Dimensions are approximate and subject to change.

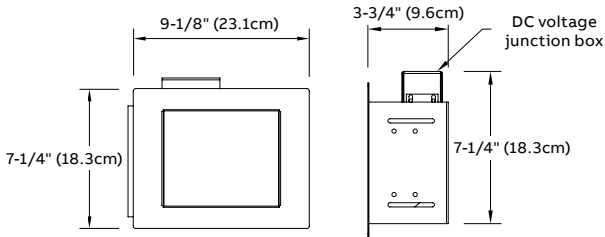

How to order

Input voltage	Series	# of lamps	Lamp type/ wattage	Options
12= 12VDC 24= 24VDC	RTR= Revelation remote	2= Two lamps standard	-LG= 12V-4W, MR16 LED -LI= 12V-5W, MR16 LED -LJ= 12V-6W, MR16 LED -LL= 24V-4W, MR16 LED	Blank= No options -DL= Damp location

Example: 12RTR2-LG-DL

Distinction™ DC Series

Remote recessed designer light fixtures



Description

- Indoor use
- Powder-coated die-cast aluminum construction

Finish

- Choice of white, black, brushed nickel

Mounting

- Recessed ceiling mount
- Must order appropriate housing with decorative head selection for installation into new construction ceiling (EL-GRHR03) or non-insulated ceiling (EL-GRHR05) GU10 or insulated ceiling (EL-GRHR06)

Approval


- UL listed

Warranty

- Unit has a three-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	43'	36'
LG	55'	43'
LI	71'	56'
LJ	100'	85'
LL	56'	44'
LM	100'	85'
LV	43'	39'

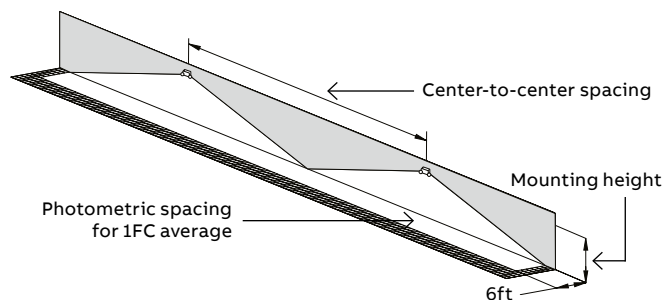


Housing


Suffix	Description
EL-GRHR03	New construction
EL-GRHR04	Renovation housing
EL-GRH05	Non-insulated ceiling
EL-GRHR06	Insulated ceilings

Dimensions

Dimensions are approximate and subject to change.

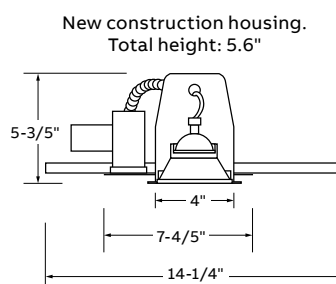


EL-GRHR03

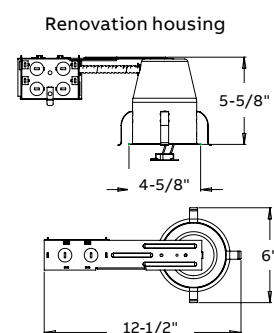


EL-GRHR04







New construction housing for GU10



EL-GRHR05

Insulated ceilings housing



Series		LED lamp suffix		
	EFR8R: concave (egress/regress)	Description: Decorative adjustable lighting head Dimensions: 4.0" diameter base Color suffix: -WH = White, -BN = Brushed nickel or -BK= Black Requires recessed housing	LA= 6V-4W, MR16 LED	LI= 12V-5W, MR16 LED
			LG= 12V-4W, MR16 LED	LJ= 12V-6W, MR16 LED
	EFR9: pop-out	Description: Decorative adjustable lighting head Dimensions: 4.0" diameter base Color suffix: -WH = White or -BK= Black Requires recessed housing	LL= 24V-4W, MR16 LED	LM= 24V-6W, MR16 LED
			LV= 120V-4W, MR16 LED	
	EL-GRHR03	Housing enclosure Description: New construction housing Dimensions: 5.6" x 14.2" New construction housing – MR16 6-24V		-
	EL-GRHR04	Housing enclosure Description: Renovating Housing Dimensions: 4.6" x 12.5" Renovation housing - MR16 6-24V		-
	EL-GRHR05	Housing enclosure Description: New construction housing Dimensions: 5.6" x 14.24" New construction housing – MR16 120V (GU10) Note: For MR16 halogen lamps, please consult lamp data p. 140-141		-
	EL-GRHR06	Housing enclosure Description: Insulated ceiling housing Dimensions: 7.25" x 14.24" Insulated ceilings housing – MR16 6-24V		-

How to order

Series	Color	Lamp type/ wattage
EFR8R	Choose color from the above table	-(L_)= LED MR16
EFR9WH		

Example: EFR8R-BK-(LA)

Distinction™ EF150 Series

Surface mounted designer light fixtures



Description

- Indoor use
- Available as a single, double or triple MR16 LED size lighting head
- Die-cast aluminum construction

Finish

- Powder-coated off-white or black

Mounting

- Surface mount
- Universal J-box mounting

Approval


- UL 924 listed

Warranty


- Unit has a three-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	43'	36'
LG	55'	43'
LI	71'	56'
LJ	100'	85'
LL	56'	44'
LV	53'	42'

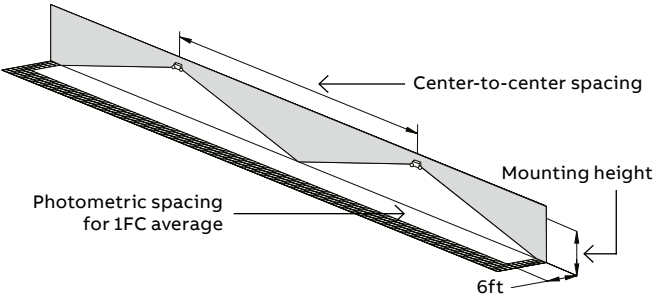


Housing color



Dimensions

Dimensions are approximate and subject to change.

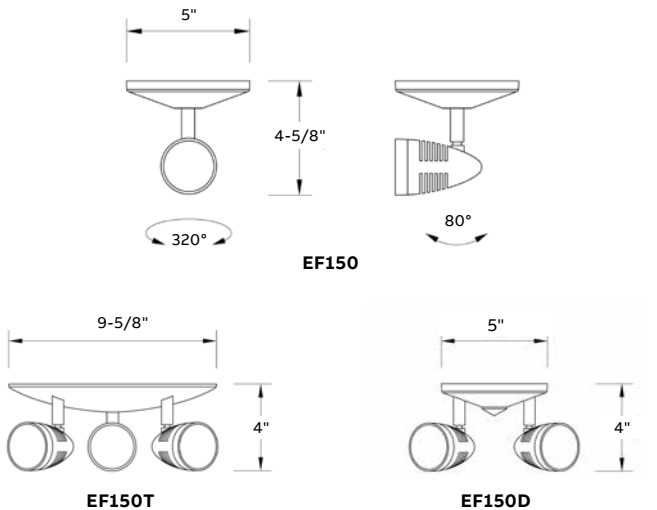

Accessories (order as a separate item)

Description	Suffix
Wire guard for EF150, EF150D	WG8-E
Wire guard for EF150T	WG2-E

How to order

Series	# of heads	Color	Lamp type/ wattage
EF150=	Blank= Single head	Blank= White	(LA)= 6V-4W, MR16 LED
Decorative		-B= Black	(LG)= 12V-4W, MR16 LED
MR16 remote head	D= Double head		(LL)= 24V-4W, MR16 LED
	T= Triple head		(LI)= 12V-5W, MR16 LED
			(LJ)= 12V-6W, MR16 LED
			(LV)= 120V-4W, MR16 LED

Example: EF150D-B(MK)

Surface Mounted EF10 & EF10D Series
Thermoplastic MR16 lamp head



Description

- Indoor use
- Available as a single, double or triple head
- Thermoplastic construction
- Snap-out lens for easy lamp replacement

Finish

- Off-white or black

Lamp type

- Choice of MR16 LED lamp wattages

Mounting

- Surface mount
- Universal J-box mounting

Approval


- UL 924 listed

Warranty

- Unit has a three-year limited warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	43'	36'
LG	55'	43'
LI	71'	56'
LJ	100'	85'
LL	56'	44'

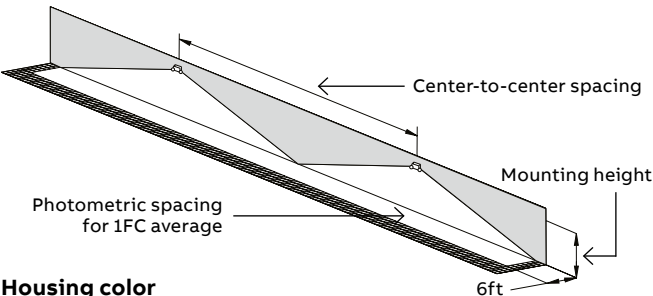


Housing color



Dimensions

Dimensions are approximate and subject to change.

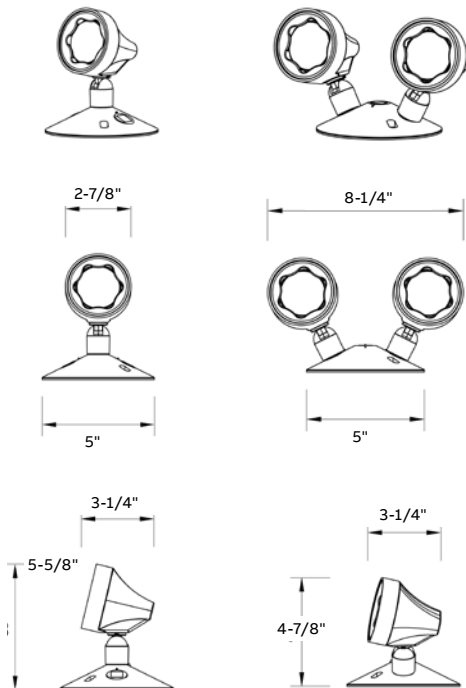

How to order

Series	# of heads	Lamp type/ wattage	Color
EF10= MR16 PAR18 remote head	Blank= Single head D= Double head T= Triple head	(LA)= 6V-4W, MR16 LED (LG)= 12V-4W, MR16 LED (LI)= 12V-5W, MR16 LED (LJ)= 12V-6W, MR16 LED (LL)= 24V-4W, MR16 LED	Blank= Off-white BK= Black

Example: EF150D-B(MK)

EF12D-LED Series

Thermoplastic square LED outdoor remote heads



Features

- Multi-volt 3.6, 6 or 12V, 3W in total
- Thermoplastic housing and aluminum canopy with fully adjustable LED heads
- Available only in gray 2-heads configuration
- Suitable for outdoor, wet location applications
- Wall or ceiling mount
- -4°F to 122°F (-20°C to 50°C)
- UL 924 Listed


Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty


Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Dimensions

Dimensions are approximate and subject to change.

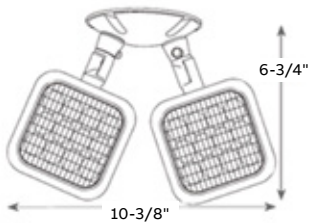


EF12D-LED Series



Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
EF12	13'	4'

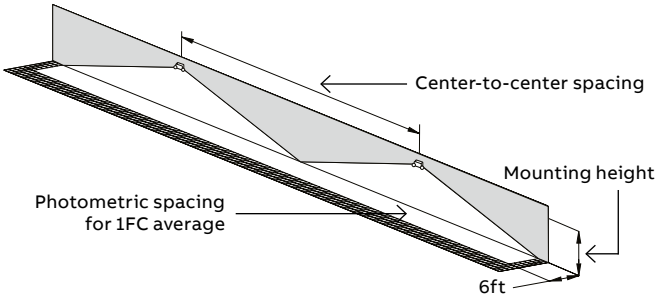

How to order

Series	# of lamp	Options
EF12	Blank= Single head D= Double head	-LED= Thermoplastic square LED head

Example: EF12D-LED

HPRL Series High-Performance Industrial Remote

NEMA-4X, high-performance industrial remote unit




Photometry performance

Capable of being installed indoors or outdoors, the **HP Series** of LED emergency lights deliver a stable and consistent illumination on the path of egress for a wide range of mounting heights. Depending on the required illumination levels need for the application, one choose between three level of lumen output using a 6W, 10W or 15W head. See cross reference to traditional MR16 halogen emergency lamp types.

Spacing center-to-center (feet)

Mounting height	Lamp L6/6W, 565Lm	Lamp L10/10W, 1000Lm	Lamp L15/15W, 1300Lm
10 ft	80	110	140
15 ft	70	105	135
20 ft	60	100	130
25 ft	50	95	120

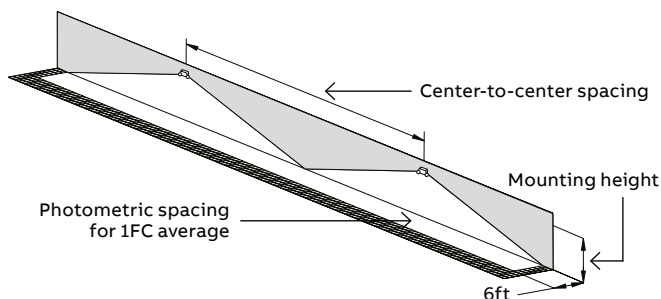

Industrial environment: wall mounted equipment, reflectances: 10/10/10; 6-ft wide illumination path. Illumination as per NFPA101; Average: 1fc; Min: 0.1fc; Max/ min < 40:1

LED head	Power	Total lumens	Out-perform spacing of MR16 halogen lamp types
L6	6W	565	37W PAR36, MR16 halogen (700 lumens)
L10	10W	1000	50W PAR36, MR16 halogen (950 lumens)
L15	15W	1300	50W MR16-IR halogen (1550 lumens)

Housing

- Lightweight polycarbonate gray housing with captive screws
- NEMA-4X protection grade
- All external fasteners and hardware are constructed of stainless steel

Mounting

- Simple and easy to install on walls, poles, columns, struts also on vertical
- Pole or column installation bracket sold separately (order catalog number: PMK1-E) 1/2 NPT conduit entry on top or side

Performance

- 6W, 10W and 15W high efficacy LED emergency heads outperform traditional 50W MR16-IR halogen
- Innovative head design: four-LED and dual- driver provide illumination even in case of unexpected component failure

Approvals

- UL 924 listed
- Can be installed in wide temperature range: -40°F to 131°F (-40°C to 55°C)



Warranty (subject to proper installation and maintenance)

- Unit has a five-year warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf



Dimensions

Dimensions are approximate and subject to change.

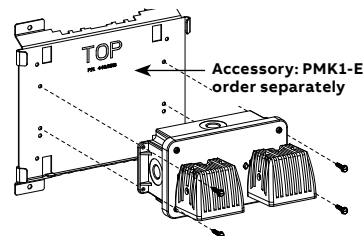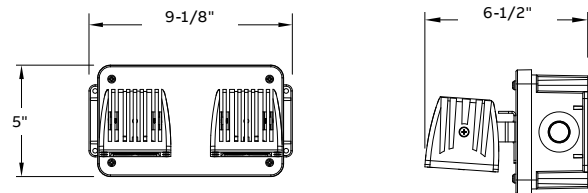

How to order

Series	# of heads	LED head
HPRL= High-performance remote	Blank= Single head D= Double head	L6= 12-24V – 6W (565 lumens) L10= 12-24V – 10W (1000 lumens) L15= 12-24V – 15W (1300 lumens)
Example: HPRLD6		

Survive-All™ EF39 Series and EF40 Series

EF39 NEMA-4X & NSF certified EF40 vandal resistant



Description


- EF39 and EF39P NEMA-4X and NSF certified indoor or outdoor use
- EF39 and EF39P NEMA-4X and NSF certified with choice of fully gasketed cast aluminum or plastic back plate¹
- EF40 and EF40P vandal resistant for Indoor USE with choice of fully gasketed cast aluminum or plastic back plate
- EF39 and EF39P NEMA-4X and NSF Certified comes standard with Phillips head screws and tamper proof screws
- Available as single or double MR16 LED lamp size remote lighting fixture Include clear polycarbonate UV and impact resistant cover
- Includes clear polycarbonate UV and impact resistant cover

Lamp type

- Choice of MR16 LED lamp wattages

Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'
LL	51'	39'

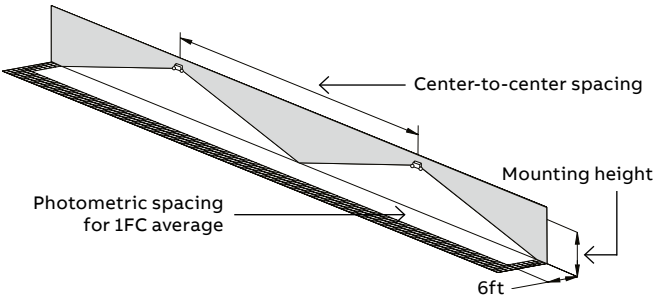

Mounting

- Surface mount
- Universal J-box mounting approval

Approval

- UL 924 listed
- Vandal resistant¹
- NEMA-4X¹
- NSF Rated


¹EF39P and EF39 units are NEMA-4X Certified when installed using a circular NEMA-4X rated junction box (sold separately by Thomas&Betts under product number 091647-E)

Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

Dimensions

Dimensions are approximate and subject to change.

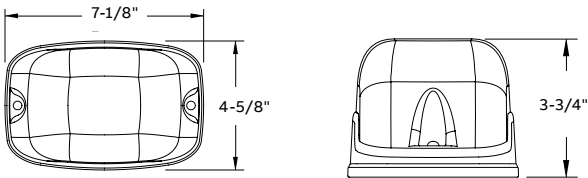

Accessories

Description	Suffix
Additional special bit for tamper-proof screws	690.0454-E

How to order EF39 Series

Series	Lamp type/ wattage	Lamp type	Option
EF39P = All polycarbonate single head NEMA-4X	(LA)= 6V-4W, MR16 LED	Blank = White	SM = Mounting plate
EF39PD = All polycarbonate double head NEMA-4X	(LG)= 12V-4W, MR16 LED	-BK = Black	
	(LI)= 12V-5W, MR16 LED	-GY = Gray	
	(LJ)= 12V-6W, MR16 LED		
	(LL)= 24V-4W, MR16 LED		

Example: EF39P(LG)-BK

Series	Lamp type/ wattage	Lamp type
EF39 = Die-cast back plate single head NEMA-4X	(LA)= 6V-4W, MR16 LED	Blank = White
EF39D = Die-cast back plate double head NEMA-4X	(LG)= 12V-4W, MR16 LED	-BK = Black
	(LI)= 12V-5W, MR16 LED	-GY = Gray
	(LJ)= 12V-6W, MR16 LED	
	(LL)= 24V-4W, MR16 LED	

Example: EF39P(LG)-BK

How to order EF40 Series

Series	Lamp type/ wattage	Lamp type	Options
EF40P = Die-cast back plate single head NEMA-4X	(LA)= 6V-4W, MR16 LED	Blank = White	Blank = No options
EF40PD = Die-cast back plate double head NEMA-4X	(LG)= 12V-4W, MR16 LED	-BK = Black	T = Tamper proof screws
	(LI)= 12V-5W, MR16 LED	-GY = Gray	SM = Mounting plate
	(LJ)= 12V-6W, MR16 LED		
	(LL)= 24V-4W, MR16 LED		

Example: EF40P(LG)

Series	Lamp type/ wattage	Lamp type	Options
EF40 = Die-cast back plate single head NEMA-4X	(LA)= 6V-4W, MR16 LED	Blank = White	Blank = No options
EF40D = Die-cast back plate double head NEMA-4X	(LG)= 12V-4W, MR16 LED	-BK = Black	T = Tamper proof screws
	(LI)= 12V-5W, MR16 LED	-GY = Gray	
	(LJ)= 12V-6W, MR16 LED		
	(LL)= 24V-4W, MR16 LED		

Example: EF40D(LJ)

HPHRL Series Hazardous Locations

Class I Division 2, Class II Division 2, Class III high-performance remote fixture



Photometry performance


Whether installed indoors or outdoors, the HP Series of LED emergency lights deliver a stable and consistent illumination on the path of egress for a wide range of mounting heights. Depending on the application, one may select and specify among three levels of lumen output. See cross reference to traditional incandescent emergency lights below.

—
Spacing center-to-center (feet)

Mounting height	Spacing center-to-center (feet) Lamp L15/15W, 1300Lm
10 ft	140
15 ft	135
20 ft	130
25 ft	120

Industrial environment: wall mounted equipment, reflectances: 10/10/10; 6-ft wide illumination path. Illumination as per NFPA101; Average: 1fc; Min: 0.1fc; Max/min < 40:1

LED head	Power	Total lumens	Out-perform spacing of incandescent lamps
L15	15W	1300	50W MR16-IR halogen

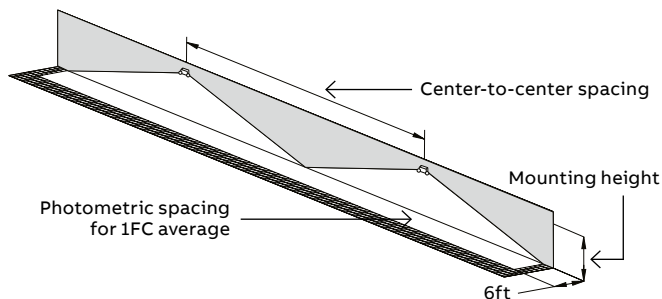

Description

- Lightweight polycarbonate gray housing and fully adjustable
Die-cast aluminum heads designed for Class I Division 2 Groups A, B, C and D, Class II Division 2, Groups F & G and Class III applications facilities
- Can be installed in varied temperature conditions: -40°F to 131°F (-40°C to 55°C)
- High-efficiency LED emergency heads outperform traditional 50W incandescent lamps
- Innovative head design: four-LED and dual-driver provide illumination even in case of unexpected component failure
- Simple and easy to install on building walls, columns, struts, etc. On vertical position for columns use mounting bracket (order separately catalog number: PMK1-E)

Approvals

- UL 924 listed
- Listed UL 844 Standard for Class I Division 2 Groups A, B, C & D, Class II Division 2, Groups F & G and Class III


Warranty

- Unit has a five-year limited warranty
Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf



Dimensions

Dimensions are approximate and subject to change.

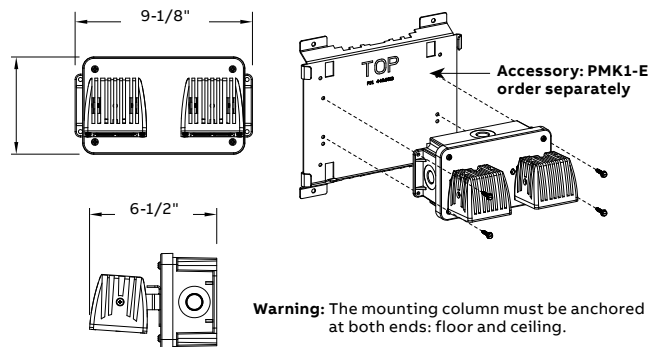

How to order

Series	# of heads	Lamp type/ wattage
HPHRL= High-performance hazardous location remote	Blank= Single head D= Double head	L15 = 12-24V – 15W (1300 lumens)

Example: HPHRLDL15

Survive-All™ EF41 Series

Class I division II certified remote fixture



Description

- Available with single or double lamp heads
- Die-cast aluminum back plate with gasket
- Vandal-resistant UV stabilized polycarbonate lamp cover
- Comes standard with tamper-proof screws and bit
- Universal J-box mounting
- Extreme operational temperature range:
-40°F to +104°F (-40°C to +40°C)

Mounting

- Surface mount
- Conduit entry 1/2" NPT

Approval

- CSA-US (To UL 924 standards)
- Evaluated to the UL 844 Standard for Class I Division 2, Groups A, B, C and D


Warranty

- Unit has a five-year limited warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf




Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
LA	39'	34'
LG	49'	39'
LI	68'	54'
LJ	89'	80'
LL	51'	39'
LW	43'	39'

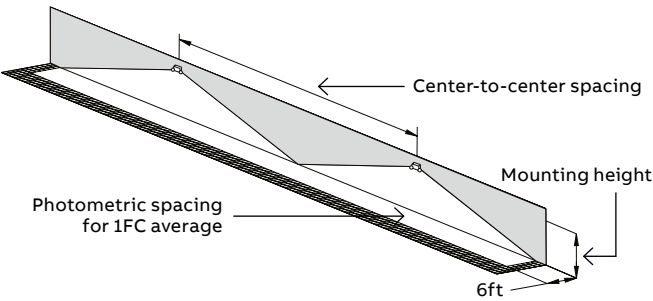

Dimensions

Dimensions are approximate and subject to change.

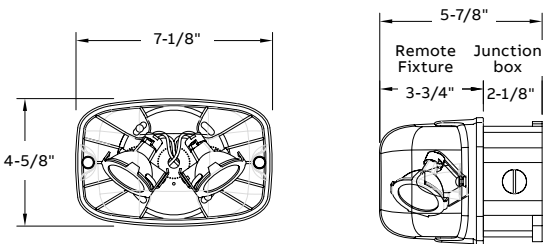

Lamp selection chart and temperature code

Lamp suffix	Voltage	Wattage	Lumens	Replacement number	Temp. code	Max. temp.
LA	6	4	200	580.0097-E	T4A	120°C
LG	12	4	220	580.0093-E	T5	100°C
LI	12	5	340	580.0104-E	T4A	120°C
LJ	12	6	540	580.0106-E	T4	135°C
LL	24	4	220	580.0098-E	T5	100°C
LW	120	4	230	580.0113-E	T4A	120°C

How to order

Series	Lamp type/ wattage	Color
EF41= Single lamp	(LA)= 6V-4W, MR16 LED (LG)= 12V-4W, MR16 LED	-GY= Gray
EF41D= Double lamp	(LI)= 12V-5W, MR16 LED (LJ)= 12V-6W, MR16 LED (LL)= 24V-4W, MR16 LED (LW)= 120V-4W, MR16 LED (C/W wires)	

Example: EF41(MJ)-GY

¹Wattage doubles for "D" 2-lamp version

Distributor Select products

Popular emergency lighting products are in stock and ready to ship from warehouses across North America for fast delivery.

- Deliver quickly with fast stock replenishment
- Easily specify the exact products you need from standard options
- Exceed your customers' expectations with a wide range of versatile emergency lighting solutions

01 Prestige™ Thin Series
die-cast aluminum
slim profile exit sign
with long-lasting
LED performance

See page 124 for
more information

01





Table of contents

Distributor Select

				
Radiance™ Series	EL-2RHL™ Series	Prestige™ Thin Die-Cast Series	Total™ Edge Series	EL-2LED Series
120	122	124	125	126
				
ELXN400 LED Series	EF43D Series	EF44D Series	EL-2SQL LED	ELX400 SQL LED Series
128	129	129	130	132
				
ELX Remote Capable Exit Series	EF47DSQL Series	EF12D-LED Series	DLM-2 Series	GS Series
134	135	135	136	137

Radiance Series

Low profile LED emergency lighting



Housing

- Indoor/outdoor suitable for wet location
- Die-cast aluminum housing
- UV-resistant (3" x 1.5") polycarbonate lens
- Photo cell standard

Mounting

- Wall mount
- 1/2" rigid conduit top entry
- Universal J-box mounting

Lamp type

- 1600 lumens in AC mode 600 Lumens in emergency mode
- Color temperature: 5000K
- Dual-mode operation: normal and emergency LED lighting with separate AC inputs

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- 120/277 60Hz
- AC unit rated for -13°F to 122°F (-25°C to 50°C)
- Dual mode unit rated for 5°F to 122°F (-15°C to 50°C)

Photometry performance


Spacing center-to-center (feet)		
Mounting height	Distance	
7.5'	50'	
10'	63'	

Approvals

- UL 924 Listed
- NEMA-3R rated for indoor/outdoors cold-weather wet and damp locations
- Meets all NFPA 70, NFPA 101 life safety codes


Warranty

- Unit has a three-year warranty
Detailed warranty terms located on page 188 of the catalog or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

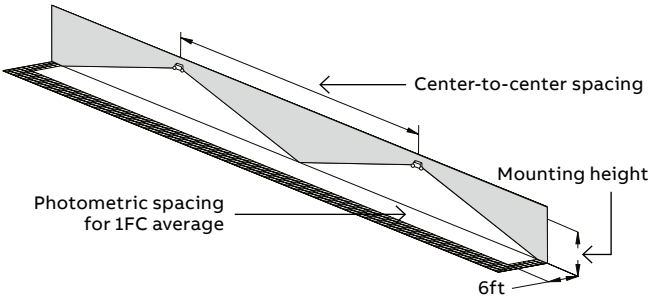

Dimensions

Dimensions are approximate and subject to change.

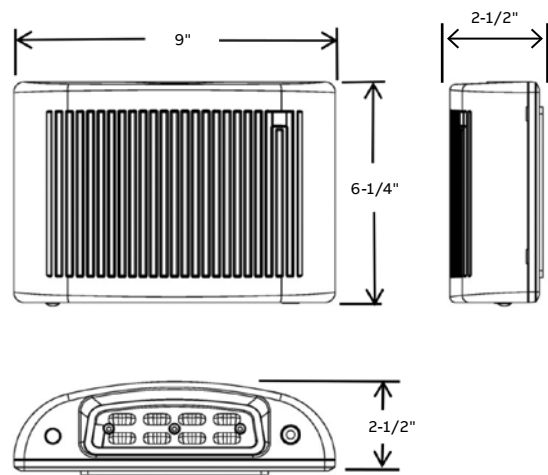

Power consumption and unit rating

Model	Battery type	DC specs	AC Specs
		Voltage	Units dual voltage
AC	-	-	120/277
ACSD	Nickel-cadmium	7.2V	

How to order

Color	Series	Model	Options
BZ= Dark bronze	RAD= Radiance	AC= AC only ACSD= Dual-mode	-CW= Cold weather ¹

Example: BZRADACSD-CW

¹ Available on the ACSD version only

EL-2RHL Series

High output lithium LED battery unit



Housing

- UV stabilized thermoplastic body
- Two adjustable high output LED lighting heads
- White finish

Mounting

- Wall or ceiling mount
- Universal J-box mounting

Lamp type

- Two 9.6V-5.4W LED heads, 550 lumens per head

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Standard Advanced Diagnostics
- 120/277 60Hz

Approvals


- UL 924 Listed
- Damp location (50°F to 104°F)
- UL 94, 5VA flame rated
- Circle BC meet CEC title 20

Warranty

- Unit has a three-year warranty
Detailed warranty terms located on page 188 of the catalog or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Photometry performance

Spacing center-to-center (feet)	
Mounting height	6 ft spacing distance
7.5'	90'
10'	78'

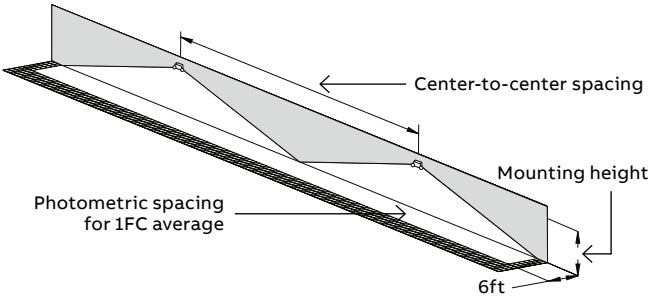

Dimensions

Dimensions are approximate and subject to change.

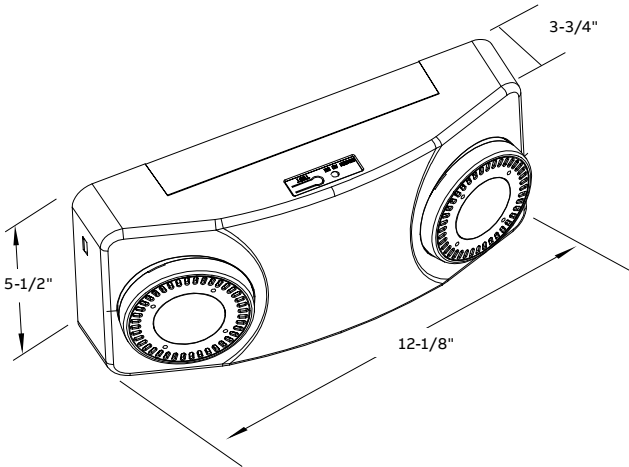

Power consumption and unit rating

Model	Battery type	DC specs	AC Specs
		Voltage	Units dual voltage
EL-2RHL-AD	Lithium-ion battery	9.6	120-277

How to order

Series	Heads
EL	-2RHL-AD= Two round high output LED heads with Advanced Diagnostics

Example: EL-2RHL-AD

Prestige™ Thin Die-Cast Series

Die-cast aluminum slim profile exit sign with long-lasting LED performance



Construction


- Die-cast aluminum
- 6 inch EXIT lettering legend, available in red or green
- Choice of finishes: all white or black with brushed aluminum faceplate: Field-selectable chevrons

Mounting


- Surface mount
- Canopy included for end or ceiling mount applications: Universal J-box mounting

Dimensions

Dimensions are approximate and subject to change.

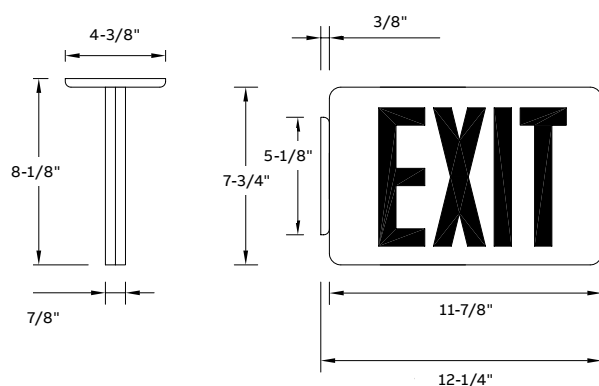

Faceplate



White



Brushed aluminum

Approvals

- UL 924 listed
- Damp location 50°F to 104°F (10°C to 40°F)
- Meets NFPA101 (Life Safety Code), NFPA 70-NEC and OSHA illumination standards

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Power consumption

Model	AC specs		DC specs	
AC-only	120/277 VAC, 60Hz	Typical 1W	Less than 1.5W	-
Self-powered	120/277VAC, 60Hz	Typical 1W	Less than 1.5W	Ni-Cd battery 90 minutes

Accessories (order as a separate item)

Description	Suffix
Wire guard (wall mount)	WG1-E
Wire guard (ceiling mount and end mount)	WG5-E

How to order

Frame color/ Face plate	Series	No. of lamps	Legend color
BA= Black body/brushed aluminum face	TX= AC only	1= Single face	R= Red
WW= White/white	TXN= Self-powered unit (90 min.)	2= Double face	G= Green

Example: BATXN1R

Total™ Edge Series

Single and double face, surface and recessed mount edge-lit exit sign



Construction

- Extruded aluminum housing
- High grade acrylic panel
- 6 inch EXIT lettering legend, available in red or green:
Field-selectable chevrons
- Satin aluminum housing

Mounting

Universal mount model

- Pivoting panel design allows for recessed, surface, wall or ceiling mount installation
- A ratcheting mechanism allows the panel to be set in place from 0° to 180° for wall or sloped ceiling mounting
- Canopy included for surface wall, end or ceiling mount application
- Trim plate, 27 inch adjustable T-bar hangers and a junction box included for recessed application¹

Approvals

- UL 924 listed
- Damp location 50°F to 104°F (10°C to 40°F)
- Meets NFPA101 (Life Safety Code)
NFPA 70-NEC and OSHA illumination standards

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

¹Not intended for closed ceilings such as plaster and sheetrock.


Accessories (order as a separate item)

Description	Suffix
Battery	850.0107-E
Pendant white	P*WT
Pendant black	P*BK
Pendant adapter ¹	081806-E

¹Required for use with pendant

Dimensions

Dimensions are approximate and subject to change.

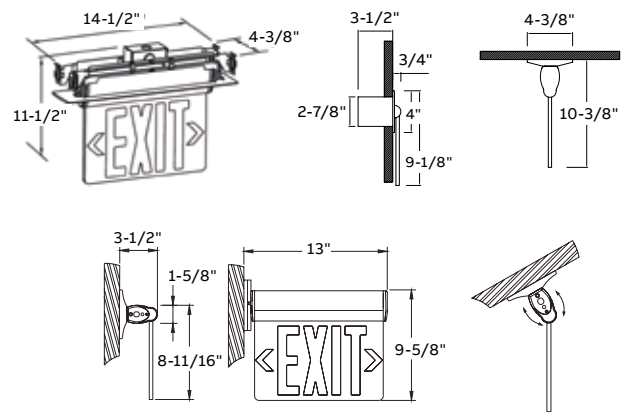

Power consumption

Model	AC specs		DC specs	
Red	AC only	120VAC, 60Hz	2.0-2.6W	—
		277VAC, 60Hz	2.6-3.1W	—
	Self-powered	120VAC, 60Hz	2.0-2.6W	Ni-Cd battery Min. 90 minutes
		277VAC, 60Hz	2.6-3.1W	Ni-Cd battery Min. 90 minutes
Green	AC only	120VAC, 60Hz	2.8-3.3W	—
		277VAC, 60Hz	3.5-4W	—
	Self-powered	120VAC, 60Hz	2.8-3.3W	Ni-Cd battery Min. 90 minutes
		277VAC, 60Hz	3.5-4W	Ni-Cd battery Min. 90 minutes

How to order

Series	Color	Legend
PA= AC Only	R= Red on mirror	6= 6" EXIT single and
PN= Self-powered	G= Green on mirror	double face with
PA2= AC only dual circuit		universal chevrons

Example: PAR6

EL-2LED Series

Low energy, low maintenance emergency lighting for moderate budget applications



Construction

- UV stabilized thermoplastic body
- Fully adjustable Cluster™ LED glare-free heads
- Choice of white or black housing

Mounting

- Ceiling or wall mount
- Universal J-box mounting

Lamp type

- White LED 3.6V-1.8W each, 70 lumens per head

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out installation
- Fused output circuit
- Optional Advanced Diagnostics
- 120/277 60Hz

Sealed maintenance-free battery

- 3.6V nickel-cadmium battery

Approvals


- UL 924 listed
- Damp location 50°F to 104°F (10°C to 40°F)
- UL 94, 5VA flame rated (68°F to 86°F, 20°C to 30°C)
- EL-2LED is circle BC to meet CEC. Title 20

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Photometric performance

Spacing center-to-center (feet)	
7' mounting height	15' mounting height
15'	4'

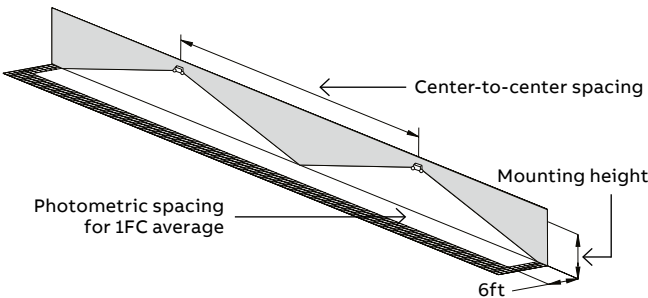

Dimensions

Dimensions are approximate and subject to change.

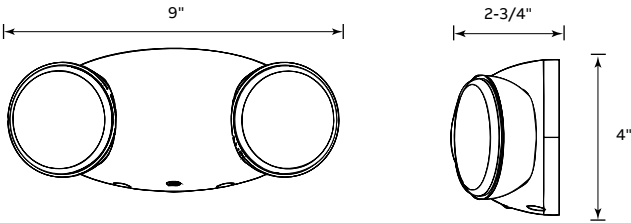

Power consumption

	Current (A) / Power (W)
Model	120/277VAC, 60Hz
EL-2LED	0.103/0.10A
EL-2LEDR	0.13/0.16A
EL-2LEDR-AD	0.058/0.029A

How to order

Color	Series	Lamp option	Options
Blank= White B= Black	EL	-2LED= round LED array	Blank= No option R= 3.6W remote capacity to power one double head remote ¹ R-AD= 3.6W remote capacity to power one double head dedicated remote with Advanced-Diagnostics ¹

Example: EL-2LEDR

¹Remote capacity can only be used to power the EF43D or EF44D remote fixtures or to extend the battery units emergency run time beyond the standard 90 minutes.

ELXN400 LED Series

Low energy and low maintenance for moderate budget application



Housing

- UV stabilized thermoplastic body
- Fully adjustable Cluster™ LED glare-free heads
- 6 inch EXIT lettering legend, available in red or green
- Field selectable chevrons

Mounting

- Surface mount
- Canopy included for ceiling mount applications
- Universal J-box mounting finishes

Type of battery

- 3.6V nickel-cadmium battery

Lamp head source

- White LED 3.6V-1.8W each

Electronics

- Optional Advanced Diagnostics
- 120/277 60Hz

Approvals


- UL 924 listed
- Damp location 50°F to 104°F (10°C to 40°F)
- UL 94, 5VA flame rated

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Photometric performance

Spacing center-to-center (feet)	
7' mounting height	15' mounting height
15'	4'

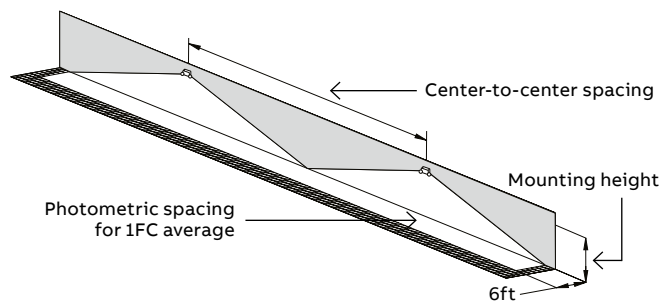

Dimensions

Dimensions are approximate and subject to change.

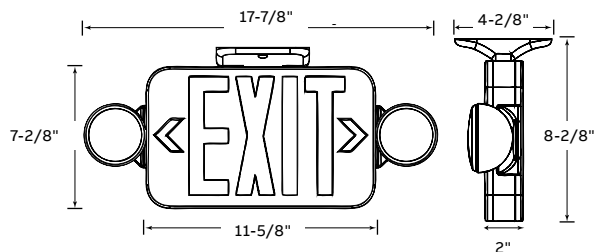

Power consumption

Model	Current (A) / Power (W) 120/277VAC, 60Hz
ELXN400R-2LED	0.044/0.017A
ELXN400G-2LED	0.032/0.015A
ELXN400R-2LEDR	0.037/4.06A
ELXN400G-2LEDR	0.036/3.8A
ELXN400R_2LEDR-AD	0.038/0.017A
ELXN400G_2LEDR-AD	0.038/0.017A

How to order


Series	Legend color	Lamp	Options	Color
ELXN400= ELX Combo Series	R= Red exit G= Green exit	-2LED= Round LED array	Blank= No option R= 3.6W remote capacity to power one double head remote ¹ R-AD= 3.6W remote capacity to power one double head dedicated remote with Advanced-Diagnostics ¹	Blank= White B= Black

Example: ELXN400R-2LED¹Remote capacity can only be used to power the EF43D or EF44D remote fixture or to extend the battery units emergency run time beyond the standard 90 minutes.**EF43D & EF44D Series**

Low energy and low maintenance for moderate budget application

**Photometric performance**


Spacing center-to-center (feet)	
7' mounting height	15' mounting height
15'	4'

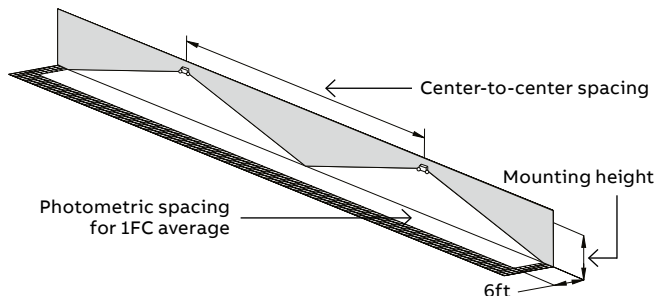**The Cluster™ LED EF43D-LED or EF44D-LEDWP**

The Cluster™ LED EF43D-LED or EF44D-LEDWP Remote head can ONLY be powered from the ELXN400 LED series combo or EL-2LED battery units of the same family. Used for internal or external applications, the indoor remote head draws 3.6V-3.6W and Weather-Proof head draws 3.6V-3.8W.

**Dimensions**

Dimensions are approximate and subject to change.

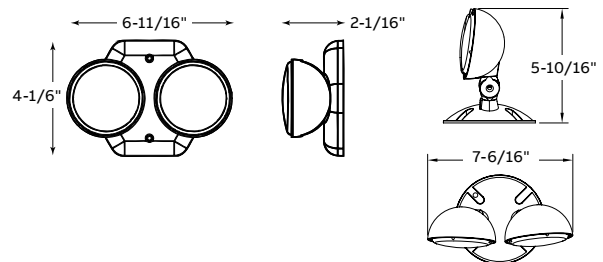**How to order**

Series	# of lamps	Lamp	Option
EF43= Indoor series	D= 2	-LED= round LED array	Blank= Indoor remote
EF44= Outdoor weather-proof series			WP= Outdoor weather proof remote

Example: EF43D-LED

EL-2SQL LED Series

1W LED heads, thermoplastic 3.6V nickel-cadmium battery unit



Housing

- UV stabilized thermoplastic body
- Two fully adjustable glare-free square lighting heads
- White finish

Mounting

- Ceiling or wall mount
- Universal J-box mounting

Lamp type

Two 3.6V-1W LED heads, 100 lumens per head

Options

- Remote capacity for EF12D-LED or EF47DSQL available with optional

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- Optional Advanced Diagnostics
- 120/277 60Hz

Battery type

- 3.6V maintenance free rechargeable nickel-cadmium battery

Approvals


- UL 924 listed
- Damp location (50°F to 104°F)
- UL 94, 5VA flame rated

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf


Photometric performance

Spacing center-to-center (feet)	
7' mounting height	15' mounting height
13'	4'

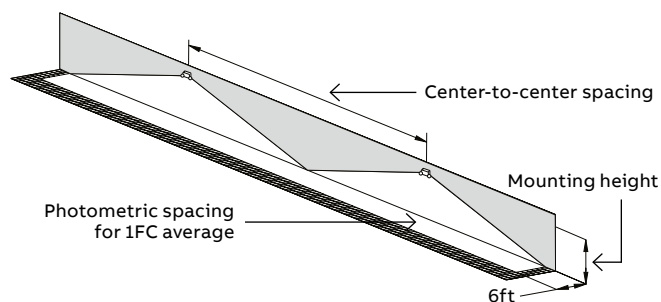

Dimensions

Dimensions are approximate and subject to change.

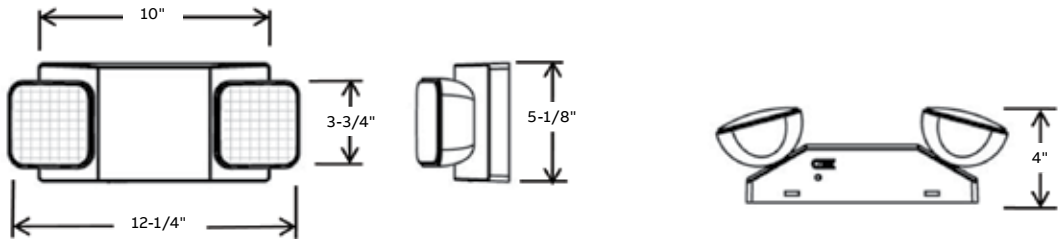

Power consumption

Series	AC specs		DC specs	
	Units dual voltage ¹		Battery	Voltage
EL-2SQL	120/277 VAC, 60Hz	0.024A	Nickel-cadmium battery	3.6V
EL-2SQLR	120/277 VAC, 60Hz	0.028A		
EL-2SQLRAD	120/277VAC, 60Hz	0.028A		

Accessories (order as a separate item)

Description	Suffix
Replacement battery for EL-2SQL	022433-E
Replacement battery for EL-2SQLR & EL-SSQLRAD	2 X 022433-E
Wire guard (heads in any position)	WG10-E
Pendant black	P*BK
Pendant white	P*WT

How to order

Series	Head style	Option
EL= Self-powered	-2SQL	Blank= No option R= Remote capacity to power one double head remote ¹ R-AD= Remote capacity to power one double head dedicated remote with Advanced-Diagnostics ¹

Example: EL-2SQLAD

¹To be used with EF47DSQL or EF12D-LED only

ELX400 SQL LED Series

Combination unit with tool-less field-adjustable heads to accommodate top mount requirements



Construction

- UV stabilized thermoplastic body
- Fully adjustable Square LED glare-free heads
- 6 inch EXIT lettering legend, available in red or green
- Field selectable chevrons

Mounting

- Surface mount
- Canopy included for ceiling mount applications / end mount
- Universal J-box mounting

Finishes

- White

Remote capacity/combination units

- ELXN400-2SQLR and ELXN400-2SQLRAD feature a 3.6V Ni-Cd battery with two 1W LED heads attached as well as 3W of remote capacity for EF12D-LED or EF47DSQL

Lamp head source

- 3.6V-1W LED head
- Lamp heads are fully adjustable to top or side with no tools required.
- 100 lumens per head

Electronics

- Optional Advanced Diagnostics
- 120/277 60Hz

Approvals


- UL 924 listed
- Damp location 50°F to 104°F (10°C to 40°F)
- UL 94, 5VA flame rated

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf


Photometric performance

Spacing center-to-center (feet)	
7 ft. mounting height	15 ft. mounting height
13'	4'

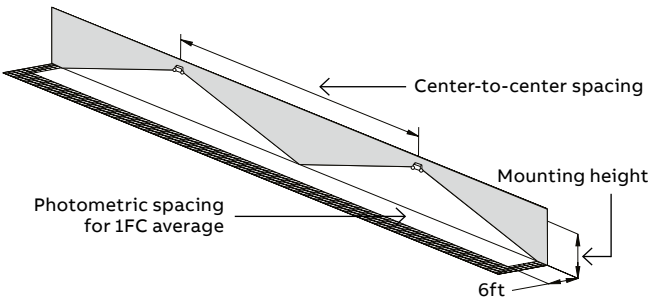

Dimensions

Dimensions are approximate and subject to change.

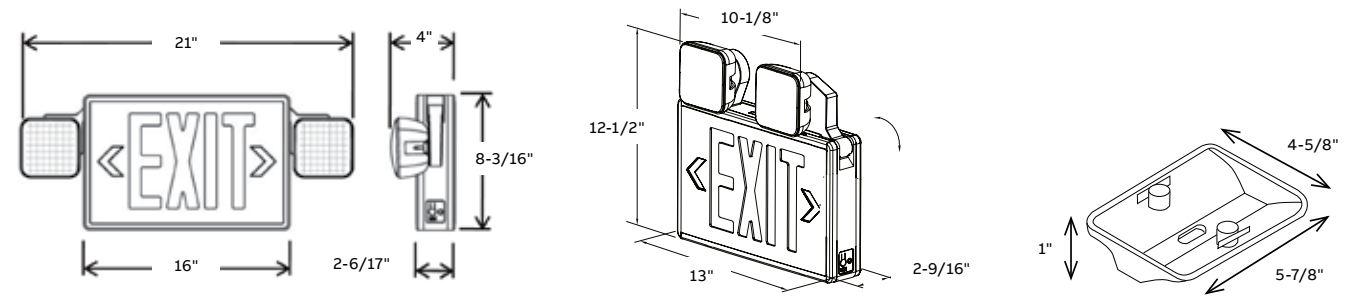

Power consumption

Description
120/277VAC, 60Hz, 0.048A

Accessories (order as a separate item)

Description	Suffix
Wire guard (heads in any position)	WG10-E
Replacement battery for ELXN400-2SQL	022434-E
Replacement battery ELXN400-2SQLR	022435-E
Replacement battery ELXN400-2SQLRAD	022435-E

How to order

Series	Legend	Heads	Options
ELXN400	R= Red G= Green	-2SQL= 1WLED	Blank= No option R= Remote capacity to power one double head remote ¹ R-AD= Remote capacity to power one double head dedicated remote with Advanced-Diagnostics ¹

Example: ELXN400R-2SQLR-AD

¹To be used with EF47DSQL or EF12D-LED only

ELX Remote Capable Exit Series
Economical, thermoplastic LED exit sign



Construction

- UV stabilized thermoplastic body
- 6 inch exit lettering legend, available in red or green
- Field selectable chevrons
- Standard universal faces

Mounting


- Surface mount
- Canopy included for end or ceiling mount applications
- Universal J-box mounting

Finishes

- White

Dimensions

Dimensions are approximate and subject to change.

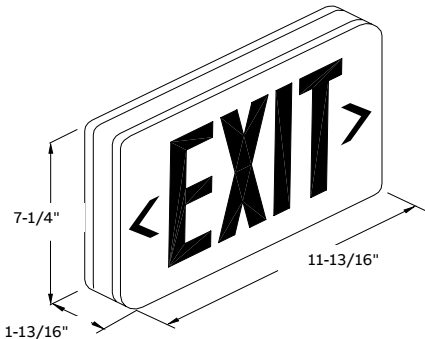

Electronics

- Optional Advanced Diagnostics
- 120/277 60Hz
- Sealed maintenance free Nickel-Cadmium battery for self-powered models

Approvals

- UL 924 listed
- Damp location 50°F to 104°F (10°C to 40°F)
- UL 94, 5VA flame rated

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Power consumption

Description
120/277VAC, 60Hz maximum 2.5W

Accessories (order as a separate item)

Description	Suffix
Wire guard (wall mount)	WG1-E
Wire guard (ceiling mount and end mount)	WG5-E
Battery	820.0106-E
Pendant white	P*WT
Pendant black	P*BK

How to order

Series	Legend color	Options
ELX400= AC only	RN= Red	Blank= No options
ELXN400= Self powered	GN= Green	-AD= Advanced Diagnostics
		-RAD= Advanced Diagnostics with 3.6V-3.6W remote capacity ¹

Example: ELXN400RN-RAD

¹Available with red legend only, compatible with EF47DSQL or EF12D-LED


EF47DSQL Series

Thermoplastic square LED
Indoor remote heads



Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
EF47	13'	4'

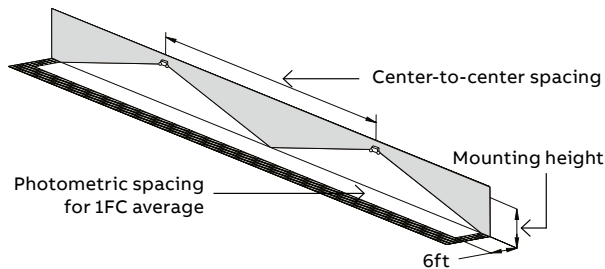

Features


- Thermoplastic dual head remote
- LED 3.6V, 2W total
- 6000K LED color
- Wall or ceiling mount
- Damp location 50°F to 104°F (10°C to 40°F)
- UL 924 listed

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Dimensions

Dimensions are approximate and subject to change.

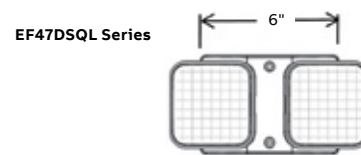

How to order – EF47DSQL Series

Series	No. of lamp	Options
EF47	D= Double head	SQL= Thermoplastic square LED head

Example: EF47DSQL


EF12D-LED Series

Thermoplastic square LED
Outdoor remote heads



Photometric performance

Lamp	Spacing center-to-center (feet)	
	7' mounting height	15' mounting height
EF12	13'	4'

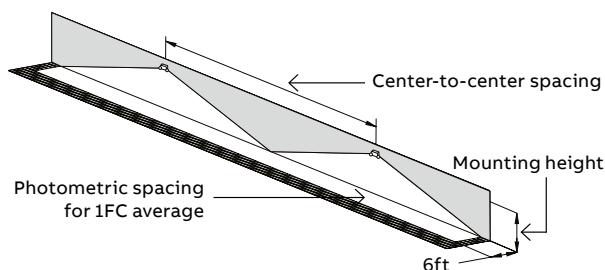

Features


- Multi-volt 3.6, 6 or 12V, 3W in total
- Thermoplastic housing and aluminum canopy with fully adjustable LED heads
- Available only in gray 2-heads configuration
- Suitable for outdoor, wet location applications
- Wall or ceiling mount
- -4°F to 122°F
- UL 924 Listed

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Dimensions

Dimensions are approximate and subject to change.

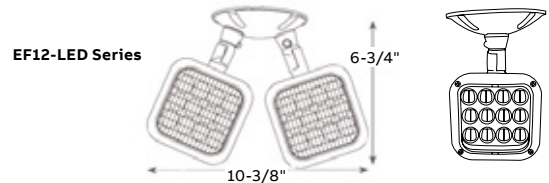

How to order – EF12D-LED Series

Series	# of lamp	Options
EF12	Blank= Single head D= Double head	-LED= Thermoplastic square LED head

Example: EF12D-LED

DLM-2 Series

Thermoplastic housing 6V-12W capacity lead-calcium battery unit



Housing

- UV stabilized thermoplastic body
- White housing

Mounting

- Ceiling or wall mount
- Universal J-box mounting

Lamp Type



- 5.4W high intensity wedge base incandescent lamps

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- 120/277 60Hz

Dimensions

Dimensions are approximate and subject to change.

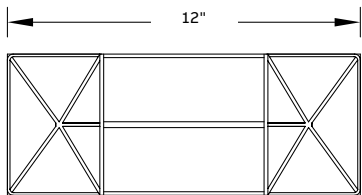

Sealed maintenance-free battery

- 6V lead calcium battery

Approvals

- UL 924 listed
- Damp location 50°F to 104°F (10°C to 40°F)
- UL 94, 5VA flame rated

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Power consumption

Series	Batt. type	DC voltage	Battery capacity in watts				Units dual current	
			1-1/2 hrs	2 hrs	3 hrs	4 hrs	Voltage ¹	Max.
DLM-2	Lead-calcium	6V	12	-	-	-	120VAC 277VAC	08A .04A

¹Stand-by power consumption is 50% lower for lead-calcium batteries.

Accessories (order as a separate item)

Description	Suffix
Wire guard	WG1-E

How to order

Series
DLM-2= DLM-2 battery-powered emergency lighting

Example: DLM-2

GS Series
6 Volt Recessed Down Light



Housing

- Low profile polycarbonate white trim
- Fully recessed steel backbox

Mounting

- Ceiling or wall recessed mount

Lamp Type


- 6V 10 watt wedge-base incandescent lamp

Electronics

- Pulse plus charger
- Low voltage disconnect
- Automatic brownout protection
- Battery lock-out
- Fused output circuit
- 120/277 60Hz

Dimensions

Dimensions are approximate and subject to change.

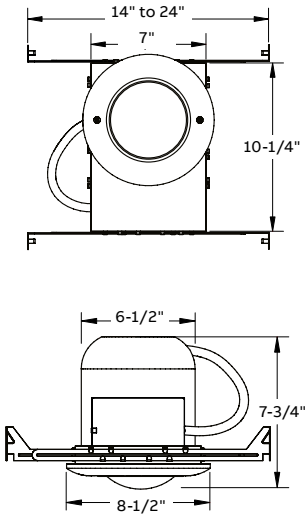

Sealed maintenance-free battery

- 6V lead-calcium battery

Approvals

- UL 924 listed

Warranty (subject to proper installation and maintenance)

- Unit has a three-year warranty
Detailed warranty terms located at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Power consumption

Sealed maintenance-free battery types	D.C. voltage	Model number	Battery capacity in watts				A.C. voltage	
			1-1/2 hrs	2 hrs	3 hrs	4 hrs	Units dual voltage ¹	Current max.
Lead-calcium	6	GSM10-BH	10	8	-	-	120VAC	.3A

¹ Stand-by power consumption is 50% lower for lead-calcium batteries.

Accessories (order as a separate item)

Description	Suffix
Remote test switch (metal face plate)	RTS
Remote test switch (plastic face plate)	RTS-1

How to order

Color	Series	Battery type	Lamp option	Mounting option
Blank= White	GS= Series	M10= 10W lead-calcium	Wedge base 9W standard	BH= Bar hanger (standard)
Example: GSM10BH				

Emergency

Self-contained battery-powered systems

Use emergency LED drivers or fluorescent ballasts to power new or existing fixtures as emergency lighting units. Emergency LED drivers and fluorescent ballasts are available in a range of lumen output capacities.

- Space-saving design mounts directly on or in a fixture
- Compact power source operates one or two lamps in a fixture
- Units do not interfere with the look of existing lighting

01 FPD Series
Convert new or existing
fluorescent fixtures
into emergency
lighting units with
emergency ballasts

See page 143 for
more information
about this product

01



02



02 LEDDR Series
Emergency LED driver
Convert new or existing
LED fixtures into
emergency lighting
units with constant
power emergency
LED drivers

See page 142 for
more information
about this product



Table of contents

Emergency self-contained battery-powered systems

Emergency LED drivers



LEDDR Series

142

Emergency ballast packs



About emergency ballasts

140



Ballast/lamp
reference chart

141



FPDL Series

143



FPDL 4 Pin Series

144

Generator transfer devices



EPC Series

145



EPC-FM Series

146



EPC-2 Series

148

About emergency fluorescent ballast packs

Emergency fluorescent ballast packs are completely self-contained battery-powered systems designed to invert DC battery current to AC current in order to operate AC lighting loads in the event of an emergency.

Under normal conditions: AC current flows into the ballast, keeping the DC batteries charged, and AC current continues to power the AC lighting fixture. In an Emergency situation: When AC current stops flowing into the ballast, the Inverter converts DC battery current into AC current to power the AC lighting fixture.

Lumens and wattage capacities

Emergency fluorescent ballasts come in various lumen output capacities and are designed to operate only 1 or 2 lamps in a fluorescent fixture type.

Emergency fluorescent ballasts

Designed to operate fluorescent lighting loads, these ballasts can be mounted directly on or in the existing fluorescent fixture and are meant to operate one or two lamps within that fixture.

Emergency fluorescent ballasts are selected based on the lumen output levels needed in an emergency situation and the lamp type being used in the fluorescent fixture during normal AC operation.



Ballast/lamp reference chart

Model #	FPDL32	FPDL-28	FPDL13-42-N	FPDL/U	FPDL-HL-N
Lumens	500	750	750	1350	3000
Lamp type (# of lamps)	Linear lamps				
2'-4' Rapid, Instant, Energy Saving, T8 thru T12 (1)					
2'-4' Rapid, Instant, Energy Saving, T8 thru T12, HO & VHO (2)					
2'-8' Rapid, Instant, Energy Saving, T8 thru T12, HO & VHO (1)					
F15 T8 (1)					X
F17 T8 (1)	X				X
F17 T8 (2)					X
F25 T8 (1)		X		X	
F25 T8 (2)					
F28 T8 (1)					X
F32 T8 (1)	X	X		X	X
F32 T8 (2)		X		X	X
F40 T8 (1)					
FO96 T8 59W (1)					X
14W T5 (1)		X		X	X
14W T5 (2)		X		X	X
21W T5 (1)		X		X	X
21W T5 (2)		X		X	X
24W T5 (1)		X		X	
28W T5 (1)	X	X		X	X
28W T5 (2)	X	X		X	X
39W T5 (1)		X		X	X
54W T5 HO (1)		X		X	X
54W T5 HO (2)		X			X
F20 T12 (1)	X				X
F20 T12 (2)					X
F40 T12 (1)	X				X
F40 T12 (2)					X
F48 T12 (1)					
F96 T12 60W (1)					
Lamp type (# of lamps)	Compact lamps – Biax lamps				
18W Long Compact (1)			X		X
18W Long Compact (2)			X		X
24W Long Compact (1)			X		X
24W Long Compact (2)			X		X
36W Long Compact (1)		X	X	X	X
36W Long Compact (2)		X	X	X	X
40W Long Compact (1)	X	X		X	X
40W Long Compact (2)				X	X
50W Long Compact (1)		X		X	X
50W Long Compact (2)		X		X	X
55W Long Compact (1)					X
7W PL CF 2-Pin (1)					
9W PL CF 2-Pin (1)					
13W PL CF 2-Pin (1)					
18W PL CF 2-Pin (1)					
26W PL CF 2-Pin (1)					
13W PL CF 4-Pin (1)			X		X
13W PL CF 4-Pin (2)			X		X
18W PL CF 4-Pin (1)			X		X
18W PL CF 4-Pin (2)			X		X
26W PL CF 4-Pin (1)			X		X
26W PL CF 4-Pin (2)			X		X
32W PL CF 4-Pin (1)		X	X	X	X
32W PL CF 4-Pin (2)		X	X	X	X
42W PL CF 4-Pin (1)			X		X
42W PL CF 4-Pin (2)					X
57W PL CF 4-Pin (1)					
57W PL CF 4-Pin (2)					
70W PL CF 4-Pin (1)					
20W Circline (1)					
22W Circline T9 (1)					
22W Circline T5 (1)					
40W Circline T8 (1)					
40W Circline T5 (1)					
55W Circline T5 (1)					
F28 2D (1)					
F28 2D (2)					
F38 2D (1)					
F38 2D (2)					

LEDDR Series Emergency LED driver

Convert new or existing LED fixtures into emergency lighting units with constant power emergency LED drivers



Calculate lumen output during emergency operation

- Lumen output = Efficacy (Lumen/watt) X emergency LED driver wattage
- In order to understand luminaire efficacy:
 - Access luminaire data by logging onto Design Lites Consortium
www.designlights.org
 - Select 'Search the DLC Qualified Product List' on the DLC homepage
 - Enter manufacturer name and P/N of luminaire under consideration in the 'search by keyword' text window
 - Select 'Search' tab to open the 'Qualified Products List'
 - Determine luminaire Lumens per Watt efficacy in 'Rated Data' specifications
 - Multiply luminaire lumens per watt by emergency output of the 'LED Driver' model under consideration

Electrical Information

Series	Output	Input
LEDDR-5	5W	3.9W
LEDDR-7	7W	4.8W
LEDDR11	11W	5.7W
LEDDR-14	14W	6.9W
LEDDR-17	17W	7.9W

Dimensions

Dimensions are approximate and subject to change.

Series	Length	Width	Height
LEDDR-5	11.46"	2.63"	1.48"
LEDDR-7	15.35"	2.63"	1.48"
LEDDR11	15.35"	2.63"	1.48"
LEDDR-14	19.19"	2.63"	1.48"
LEDDR-17	19.19"	2.63"	1.48"

Housing

- High impact thermoplastic enclosure, 5VA flame retardant in black finish
- LED illuminated remote test switch

Mounting

- Suitable for installation on top or remotely

Lamp types

- LED lamps with 20VDC to 50VDC operating voltage
- Can be wired for normally-on, normally off or switched loads
- Lumen output depends on LED light source efficacy (Lumens/watts)

Electronics

- Universal 120/277, 50/60Hz input
- Provides 90 minutes of emergency operation
- Surge protection
- Output classification: Class 2 compliant
- Output and input overcurrent protection
- Constant power supply in emergency mode

Battery

- Long-life maintenance free rechargeable nickel-cadmium battery
- 24 hour battery recharge time

Approvals

- Damp location listed
- UL classified for field or factory installation
- UL 924 approved, NFPA 101 life safety code, NEC, and OSHA

Warranty (subject to proper installation and maintenance)

- Unit has a five-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf



How to order

Series	Wattage
LEDDR-	5
	7
	11
	14
	17
Example: LEDDR-7	

FPDL Linear Emergency Fluorescent Battery pack

Convert new or existing fluorescent fixtures into emergency lighting units with emergency ballasts



Housing

- Low profile steel housing contains, battery, battery charger, transfer circuit and high frequency inverter
- Optional end caps available
- Operating temperature 68°F to 122°F (20°C to 50°C)

Mounting

- Internal or external mounting to a fluorescent fixture

Lamp type operation

- Refer to ballast/lamp reference chart for specific lamp type page 141

Electronics


- Can be wired to operate switched, un-switched or normally off fixtures without affecting normal operation
- Will cold start and illuminate lamps
- Dual voltage 120/277VAC, 2.5W

Controls

- Momentary test switch allows for quick operational check of entire system

Dimensions

Dimensions are approximate and subject to change.

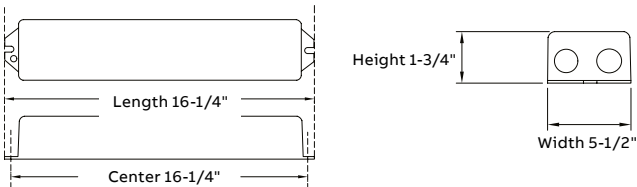

Sealed maintenance-free battery

- Nickel-cadmium battery
- Provides 90 minutes of emergency operation



Approvals

- UL 924 listed damp location (50°F to 104°F)
- Damp location listed

Warranty (subject to proper installation and maintenance)

- Unit has a five-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Accessories (order as a separate item)

Description	Suffix
 External mounting kit includes wire bundle cover	071139-E
Remote test switch (metal faceplate)	RTS
Remote test switch (plastic faceplate)	RTS-1
Recommended for inaccessible locations. Test switch and charging indicator on a single mounting plate.	<div>Charging Indicator light Push button test switch</div> 
Replacement test switch	TBTSP-E

How to order

Series
FPDL-28
FPDL-U
FPDL32
FPDL-HL-N

Example: FPDL-HL-N

FPDL 4 Pin Series

Convert new or existing fluorescent fixtures into emergency lighting units
750 lumen emergency ballast



Housing

- Steel housing contains, battery, battery charger, transfer circuit and high frequency inverter
- Operating temperature 32°F to 122°F(0°C to 50°C)

Mounting

- Internal or external mounting to a fluorescent fixture

Lamp type operation

- Refer to ballast/lamp reference chart for specific lamp type page 135

Lumen output

- (1) Lamp 350-750 lumens
- (2) Lamps 425-750 lumens

Electronics

- Can be wired to operate switched, un-switched or normally off fixtures without affecting normal operation
- Will cold start and illuminate lamps
- High capacity, automatic, dust-tight instantaneous transfer relay
- Low voltage disconnect prevents over discharge of battery
- Automatic brownout protection
- Battery connector prevents battery discharge during installation

Controls

- Red charger monitor LED indicates charging of the battery and AC present
- Momentary test switch allows for quick operational check of entire system

Sealed maintenance-free battery

- Nickel-cadmium battery
- Provides 90 minutes of emergency operation

Power requirements

- Dual voltage 120/277VAC, 60Hz, 1.8W

Approvals


- UL 924 standards
- Damp location listed

Warranty (subject to proper installation and maintenance)

- Unit has a five-year warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Dimensions

Dimensions are approximate and subject to change.

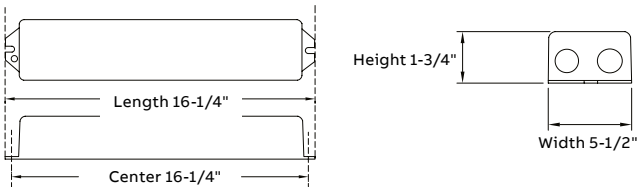

Accessories (order as a separate item)

Description	Suffix
Remote test switch (metal faceplate)	RTS
Remote test switch (plastic faceplate)	RTS-1
Replacement test switch	TBTSP-E

How to order

Series
FPDL-13-42-N

Example: FPDL-13-42-N

EPC Series

Emergency transfer switch for generator and mini inverters. Supplies power to switched lighting fixtures.



Mechanical specifications

- Mounts in 4-11/16" Junction box with single gang plaster ring
- UL94-5VA rating
- Shipping weight: 8 oz
- Temperature: 32°F - 140°F (0°C - 60°C)
- Color: White
- Flush mounted size: 4-3/4" x 2-3/4" x 1/4"
- Body size: 2-7/8" x 1-3/4" x 1-3/4"

Emergency Operation:

- The EPC-1-E & EPC-1-D-E will operate any lamp type in the designated fixture for the duration of the generator supply.

Initial illumination:

- The EPC-1-E & EPC-1-D-E will operate the designated lamp at full light output

Approval:

- UL924 Listed

Wiring diagrams:

- Visit our website: <http://www.emergi-lite.com>

Housing

- Thermoplastic UL94-5VA suitable for plenum installations
- Compatible with LED, fluorescent and incandescent lamp types including standard, energy-saving, and electronic AC drivers and ballasts¹

Mounting

- Wall and ceiling mount

Options

- 0-10V Dimming standard on the EPC-1-D-E model
- Advanced Diagnostics standard on the EPC-1-E model

Lamp types

- During utility power interruption, automatically connects generator or inverter circuit to emergency fixture and bypasses switching control to full light output for duration of inverter or generator supply

Lumen output

- Allows switching control of emergency fixtures during normal operation
- Allows auxiliary generator power on a switched lighting fixture

Power requirements

- Dual voltage 120/277V 60Hz

Approvals

- Meets or exceeds all National Electrical Code and Life Safety Code Emergency Lighting Requirements

Warranty (subject to proper installation and maintenance)


- Unit has a five-year warranty
Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

¹When using EPC-1-E & EPC-1-D-E to control more than 10 emergency ballasts with a high corrective power factor capacitor, consult factory for more information regarding inrush currents.



Dimensions

Dimensions are approximate and subject to change.

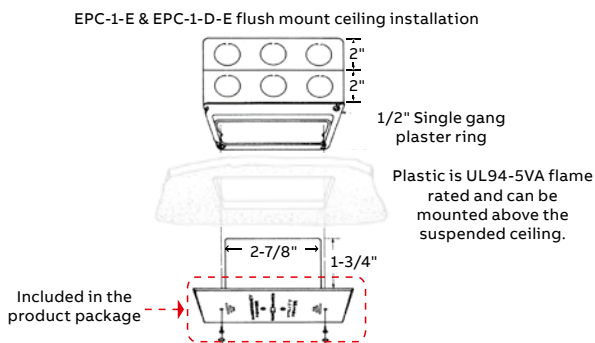

How to order

Series

EPC-1-E= Emergency transfer switch

EPC-1-D-E= Emergency transfer switch with Advanced Diagnostics and 0-10 dimming

Example: EPC-1-E

EPC Fixture Mounted Series

Emergency power control for generator and mini inverters. Supplies power to switched lighting fixtures.



Mechanical specifications

- UL94-5VA rating
- Shipping weight: 8 oz
- Damp location
- Temperature: 32°F - 140°F (0°C - 60°C)
- Color: Black
- Body size: 4.9" x 0.9" x 1.2"

Emergency Operation:

- The EPC-2-FM-E & EPC-2-FM-D-E will operate any lamp type in the designated fixture for the duration of the generator or mini inverter supply.

Initial illumination:

- The EPC-2-FM-E & EPC-2-FM-D-E will operate the designated lamp at full light output


Approval:

- UL924 Listed

Wiring diagrams:

- Visit our website: <http://www.emergi-lite.com>

Mounting

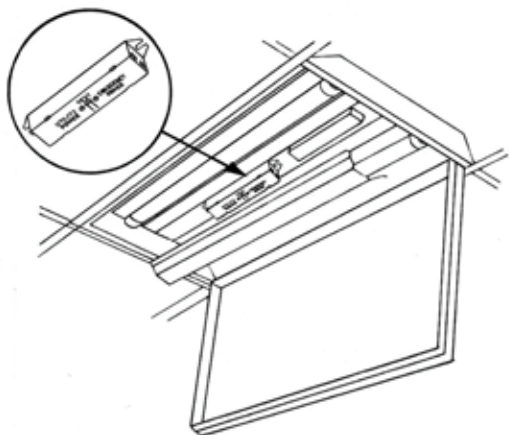

Housing

- Compatible with LED, fluorescent and incandescent lamp types including standard, energy-saving, and electronic AC drivers and ballasts¹

Mounting

- Mounts directly to fixture or panel mount

Options

- 0-10V Dimming standard on the EPC-FM-2-D-E model
- Advanced Diagnostics standard EPC-2-FM-E and EPC-2-FM-D-E

Lamp types

- During utility power interruption, automatically connects generator or inverter circuit to emergency fixture and bypasses switching control to full light output for duration of inverter or generator supply

Lumen output

- Allows switching control of emergency fixtures during normal operation
- Allows auxiliary generator power on a switched lighting fixture

Power requirements

- Dual voltage 120/277V 60Hz

Approvals

- Meets or exceeds all National Electrical Code and Life Safety Code Emergency Lighting Requirements

Warranty (subject to proper installation and maintenance)

- Unit has a five-year warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

¹When using EPC-FM-2-E and EPC-FM-2-D-E to control more than 10 emergency ballasts with a high corrective power factor capacitor, consult factory for more information regarding inrush currents.



How to order


Series

EPC-2-FM-E= Emergency transfer switch fixture mounted with Advanced Diagnostics


EPC-2-FM-D-E= Emergency transfer switch fixture mounted with Advanced Diagnostics and 0-10 dimming

Example: EPC-2-FM-E

Single line drawing

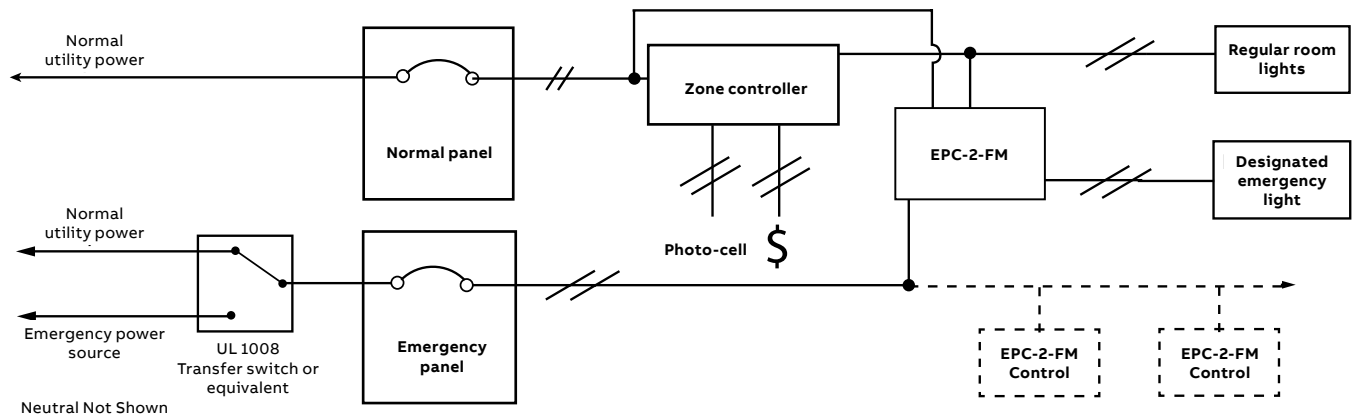

Wiring diagram

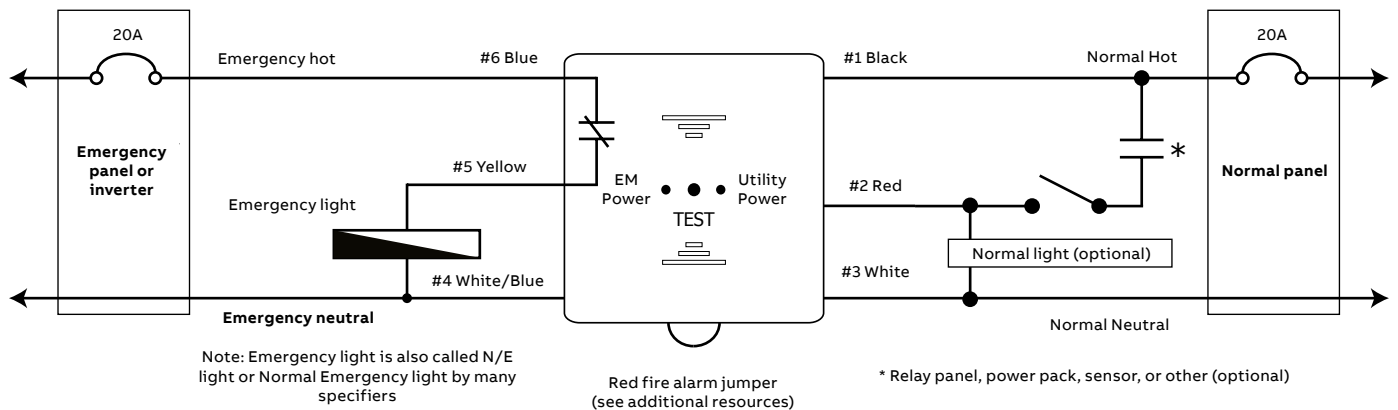

Specifications

Electrical	
Model number	EPC-2-FM
Sensing input	120V-277V
LED load rating	1A (120-277V)
Ballast load rating	5A (120-277V)
Incandescent load	360W (120V)/600W (277V)
Warranty	Five-year replacement warranty

Mechanical	
Mounting	Fixture mount, panel mount
Rating	UL94-5VA, Damp location rated
Shipping weight/Color	8 oz./Black
Temperature	32°F - 32°F (0°C - 60°C)
-	-
Body size	125mm X 25.4 mm X 30mm (L X H X W)

EPC 2 Series

Emergency power control for generator and mini inverters. Supplies power to switched lighting fixtures.



Mechanical specifications

- Mounts in 4-11/16" Junction box with single gang plaster ring
- UL94-5VA rating
- Shipping weight: 12oz
- Temperature: 32°F - 140°F (0°C - 60°C)
- Color: White
- Flush mounted single gang
- Body size: 3" x .7" x 1.2"

Emergency Operation:

- The EPC-2-E & EPC-2-D-E will operate any lamp type in the designated fixture for the duration of the generator or mini inverter supply.

Initial illumination:

- The EPC-2-E & EPC-2-D-E will operate the designated lamp at full light output


Approval:

- UL924 Listed

Wiring diagrams:

- Visit our website: <http://www.emergi-lite.com>

Mounting

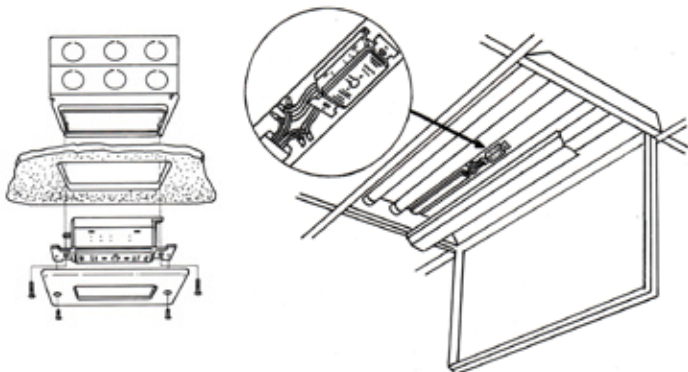

Housing

- Thermoplastic UL94-5VA suitable for plenum installations
- Compatible with LED, fluorescent and incandescent lamp types including standard, energy-saving, and electronic AC drivers and ballasts¹

Mounting

- Wall and ceiling mount

Options

- 0-10V Dimming standard on the EPC-2-D-E model
- Advanced Diagnostics standard on the EPC-2-E and EPC-2-D-E models

Lamp types

- During utility power interruption, automatically connects generator or inverter circuit to emergency fixture and bypasses switching control to full light output for duration of inverter or generator supply

Lumen output

- Allows switching control of emergency fixtures during normal operation
- Allows auxiliary generator power on a switched lighting fixture

Power requirements

- Dual voltage 120/277V 60Hz

Approvals

- Meets or exceeds all National Electrical Code and Life Safety Code Emergency Lighting Requirements

Warranty (subject to proper installation and maintenance)

- Unit has a five-year warranty
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

¹When using EPC-2-E & EPC-2-D-E to control more than 10 emergency ballasts with a high corrective power factor capacitor, consult factory for more information regarding inrush currents.



How to order


Series

EPC-2-E= Emergency transfer switch


EPC-2-D-E= Emergency transfer switch with Advanced Diagnostics and 0-10 dimming

Example: EPC-2-E

Single line drawing

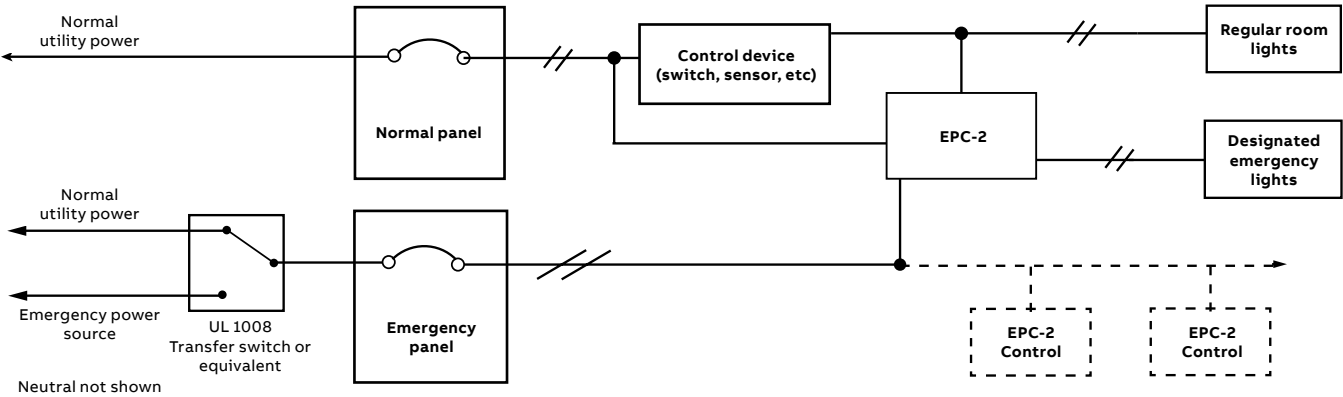

Wiring diagram

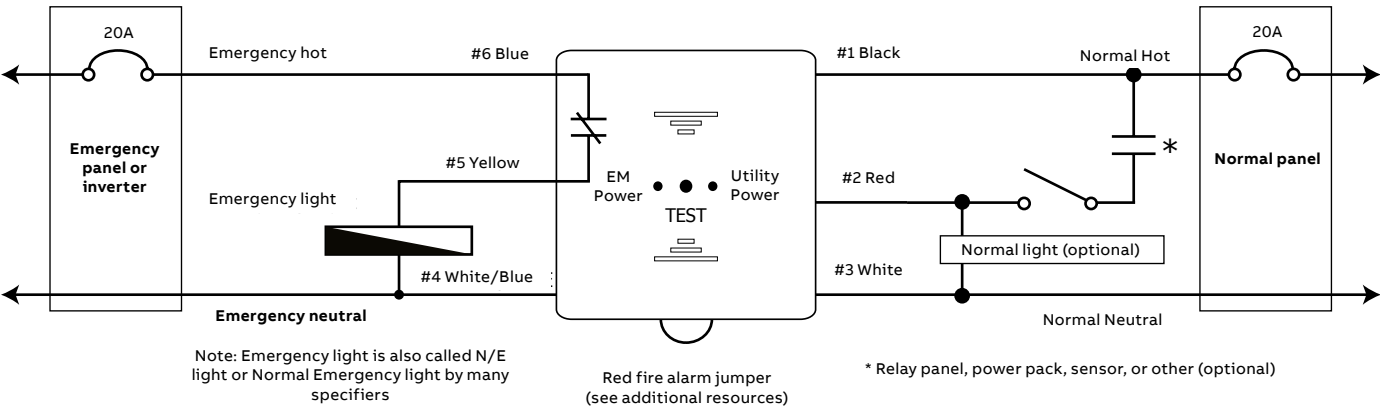

Specifications

Electrical	
Model number	EPC-2
Sensing input	120V-277V
LED load rating	120V-277V (20A)
Ballast load rating	20A (120-277V)
Incandescent load	1200W (120V)/1500W (277V)
Warranty	Five-year replacement warranty

Mechanical	
Mounting	4-11/16" Junction box with single gang plaster
Rating	UL94-5VA
Shipping weight/Color	12 oz. / White
Temperature	32°F - 140°F (0°C - 60°C)
Flush mounted size	Single gang size
Body size	1.7" X 3" X 1.2" (W X H X D body)

Central & inverter systems

Self-contained inverter systems are designed to meet the unique needs of emergency lighting loads. Inverters provide power to existing lighting to function as emergency lighting when main power fails.

- Minimizes maintenance required for testing
- Compact Mini Inverters are ideal for LED, incandescent, and fluorescent lighting, and are available in up to 1000W models
- Interruptible Power Systems (IPS) are available in single phase from 1500VA to 16700VA
- Uninterruptible Power Systems (UPS) are available in single phase models from 1500VA to 16700VA, and in three phase models from 4800VA to 50,000VA

—
01 Interruptible Unit
Equipment 125W,
250W, 400W, 720W
or 1000W Standard
with Non Audible
Advanced Diagnostics
Circuitry & Lighting
Control Override













See page 154 for
more information

—
01



Table of contents

Central & inverter systems

				
Low Capacity Mini Inverter Series 152	Mini Inverter Series 154	1000W High Capacity Mini Inverter Series 156	Emerg-Power Systems Features & Benefits 158	Emerg-Power Systems Compact Series 160
				
	Emerg-Power Systems IPS Single Phase Series 162	Emerg-Power Systems FTC Single Phase Series 164	Emerg-Power Systems 3FTC Three Phase Series 166	Emerg-Power Systems FTC3R & 3FTC3R Series 168
				
		Emerg-Power Systems Options Details 169	Emerg-Power Systems Control Panel & Display 170	Emerg-Power Systems Central Systems Request Data 171

Low Capacity Mini Inverter Series

Interruptible unit equipment



Housing

- Heavy-duty steel cabinet
- White baked on powder paint coating provides scratch and corrosion resistance

Mounting

- Surface mount
- Recessed T-bar (plenum rated)

Lamp types operated

- LED
- Incandescent
- Fluorescent
- Operates switched, normally-on or normally-off fixture types, incandescent,
- LED, fluorescent and ballast combinations, including triac dimmable ballasts

Load capacity

- 32W, 55W
- Allows for remote mounting of the emergency fixtures at distances of up to 1000 feet
- May accept load when load feature power factor range from 0.44 lead to 0.44 lag

Electronics

- Pure sine wave inverter
- Temperature compensated charger
- Low battery voltage disconnect
- Unit comes standard with electronic lockout and brownout circuits

Controls

- Control panel with momentary test switch, AC-On, Charger-On and
- Inverter-On LED indicators
- Sealed maintenance-free battery
- 12V oversized valve regulated lead-calcium (VRLA) battery
- Provides 90 minutes of emergency operation

Power requirements

- Choice of voltage: 120V in/120V out or 277V in/277V out operation, 60Hz

Approvals

- UL 924 Standard
- Meets or exceeds all National Electric Codes and Life Safety Code
- Emergency lighting requirements

Warranty (subject to proper installation and maintenance)

- Unit has a three year full warranty (excluding lamps and fuses).
 - Battery has a three-year full, plus an additional three year pro-rata warranty
- Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

All Emergi-Lite® inverter products receive 100% quality inspection before shipment to insure proper and satisfactory operation.

Specifications

Transfer time	Voltage regulation on emergency	Frequency regulation on emergency	Load power factor range	Operating temperature
Less than 1 second	+/- 5%	60 Hz +/- 0.5%	0.44 lead to 0.44 lag	68° to 86°F (20° to 30°C)

Electrical characteristics and dimensions

System type	Power rating	Sine wave	Installation	Width	Cabinet dimensions		No. of battery	Weight
					Height	Depth		120V & 277V
EMILC32-S	32W/VA	Yes	Surface mount	14-3/4"	6-7/8"	3-1/8"	1	14 lbs
EMILC32-T	32W/VA	Yes	T-grid mount	23-7/8"	6-1/4"	4"	1	15 lbs
EMILC55-S	55W/VA	Yes	Surface mount	14-3/4"	6-7/8"	4-3/8"	1	18 lbs
EMILC55-T	55W/VA	Yes	T-grid mount	23-7/8"	6-1/4"	4"	1	19 lbs

NOTE: For wiring diagram, please refer to the specification sheets

Power consumption and unit rating

Model number	Input rating	Emergency power available for load (90min)
EMILC32	41VA	32W
EMILC55	64VA	55W

How to order

Series	Capacity	Voltage	Battery type	Mounting
EMILC	32= 32W/VA 55= 55W/VA	Blank= 120/277VAC	Blank= Lead-calcium	-S= Surface mount housing -T= Plenum rated ceiling T-grid mount housing

Example: EMILC32-S

Mini Inverter Series

Interruptible unit equipment 125W, 250W, 400W or 720W



Housing

- 14-gauge steel
- White semi-gloss powered-coat paint finish

Mounting

- Surface mount
- Optional recessed T-bar (125W unit only)

Lamp types operated

- LED
- Incandescent
- Fluorescent
- Operating switched, normally-on or normally-off fixture types
- Incandescent, LED, fluorescent lamps and ballast combinations, including triac dimmable ballasts (consult factory if DALI dimming)

Load capacity

- 125W, 250W, 400W or 720W
- Line voltage allows for remote mounting of the emergency fixtures at distances up to 1000 feet
- May accept load to it's full capacity when load feature power factor of 0.9 for 250W model and 0.8 for 125, 400 and 720W model

Electronics

- High-efficiency pure sine wave inverter at 250W capacity or higher
- Temperature compensated charger
- Replaceable output fuse protection
- Low battery voltage disconnect
- Unit comes standard with electronic lockout and brownout circuits

Controls

- Standard with a non-audible self diagnostic/charger is fully self-contained, fully automatic microcontroller-based system
- Optional audible auto diagnostic available
- Standard lighting control override for 0-10V dimming systems

Nexus® Option

- Units equipped with Nexus® self-testing monitoring system circuitry shall selftest, in accordance with NFPA101, Life Safety Code minimum 30 seconds every 30 days, 30 minutes every six months and 90 minutes annually as well as keep a history of all testing logs, plus feature a real-time diagnoses, as well as, be able to locate exact fixture location while notifying service personnel to the status of the fixture via email notification. Nexus® system interface with an improved minimum load lost detection of 10%

Sealed maintenance-free battery

- 12V oversized valve regulated lead-calcium (VRLA) battery
- Provides 90 minutes of emergency operation

Power requirements

- Choice of voltage 120V in/120V out or 277V in/277V out operation, 60Hz

Approvals

- UL 924 Standard
- Meets or exceeds all National Electric Code and Life Safety Code Emergency Lighting Requirements

Warranty (subject to proper installation and maintenance)

- Battery has a 3-year full, plus 7-year pro-rata warranty
 - Unit has a three-year warranty (excluding lamps and fuses)
- Detailed warranty terms located on page 188 or online at: www.emergi-lite.com/usa/files/EL_Warranty.pdf

All Emergi-Lite® inverter products receive 100% quality inspection before shipment to insure proper and satisfactory operation.



Specifications

Transfer time	Voltage regulation on emergency	Frequency regulation on emergency	Load power factor range	Operating temperature
Less than 1 second	+/- 5%	60 Hz +/- 1%	250W model: .9 leading to .9 lagging	68° to 86°F (20° to 30°C)
-	-	-	125, 400 & 720W models: 8 leading to .8 lagging	-

Replacement battery

Description	Suffix
EMIU-125	860.0024-E
EMIU-250	2X 860.0024-E
EMIU-400	2X 860.0043-E
EMIU-720	2X 860.0096-E

Electrical characteristics and dimensions

Power rating	Sine wave	Installation	Cabinet dimensions			No. of battery	Total weight	Weight w/o battery
			Width	Height	Depth		120V & 277V	120V & 277V
125W	Modified	T-bar	24"	6.5"	8"	1	50 lbs	22 lbs
125W	Modified	Wall	16.5"	12.2"	7.3"	1	50 lbs	22 lbs
250W	Pure	Wall	27"	12.2"	7.3"	2	100 lbs	45 lbs
400W	Pure	Wall	24"	20"	10.5"	2	150 lbs	65 lbs
720W	Pure	Wall	24"	20"	14.5"	2	220 lbs	95 lbs

Note: For wiring diagram, please refer to the specification sheets

Power consumption and unit rating

Model number	AC specs	Emergency power available for load			
		90 Min	2H	3H	4H
EMIU-125	120/277VAC	1.15 / 0.70 Amps	125W	83W	62W
EMIU-250		2.75 / 1.20 Amps	250W	167W	125W
EMIU-400		4.60 / 2.00 Amps	400W	300W	200W
EMIU-720		9.60 / 4.00 Amps	720W	480W	360W

How to order

Series	Capacity	Voltage	Diagnostic feature	Options
EMIU	-125= 125W -250= 250W -400= 400W -720= 720W	Blank= 120/120VAC or 277/277VAC	-Blank= Advanced Diagnostic, non-audible ¹ -AD= Advanced Diagnostic, audible ¹ -NAD= No auto test/ Advanced Diagnostics -NEX= Nexus® wired -NEXRF= Nexus® wireless	-D3= Time delay (15 minutes) -SAC= Service alarm contact ² -T= Recessed T-bar mounting (125W unit only)

Example: EMIU-720

¹ Minimum load required: 10% of unit capacity

² Service alarm contact (SAC) shall provide a 24V signal, the charger board will indicate a fault by choosing a contact. Not available with 720 capacity

1000W High Capacity Mini Inverter Series

Interruptible unit equipment 1000W



Housing

- 14-gauge steel
- White semi-gloss powered-coat paint finish

Mounting

- Surface mount

Compatible loads

- LED
- Incandescent
- Fluorescent
- Operating switched, normally-on or normally-off fixture types
- Triac dimming
- DALI dimming – consult factory

Load capacity

- 1000W
- Line voltage allows for remote mounting of the emergency fixtures at distances up to 1000 feet

Electronics

- High-efficiency pure sine wave inverter
- Temperature compensated charger
- Replaceable output fuse protection
- Low battery voltage disconnect
- Unit comes standard with electronic lockout and brownout circuits

Controls

- Standard with a non-audible self diagnostic/charger is fully self-contained, fully automatic microcontroller- based system
- Optional audible auto diagnostic available
- Optional no Advanced Diagnostics available
- No Advanced Diagnostics option must be selected in conjunction with transfer switches
- Standard lighting control override for 0-10V dimming systems
- Optional 4 output circuits allow for multiple switch compatibility

Sealed maintenance-free battery

- 12V valve regulated lead-calcium (VRLA) batteries
- Provides 90 minutes of emergency operation power requirements
- Choice of voltage 120V input/120V output or 277V input/277V output operation, 60Hz

Approvals

- UL 924 Standard
- Meets or exceeds all National Electric Code and Life Safety Code Emergency Lighting Requirements

Warranty

- Unit has a three-year warranty
Detailed warranty terms located on page 188 or online at:
www.emergi-lite.com/usa/files/EL_Warranty.pdf

Specifications

Transfer time	Voltage regulation on emergency	Frequency regulation on emergency	Load power factor range	Operating temperature
Less than 1 second	+/- 3%	60 Hz +/- 1%	0.8 at 120V 1 at 277V	68° to 86°F (20° to 30°C)

Replacement battery

Description	Part number
EMIU-1000	4X 860.0043-E

Electrical characteristics and dimensions

Power rating	Sine wave	Installation	Cabinet dimensions			No. of batteries	Total weight	Weight w/o battery
			Width	Height	Depth		120V & 277V	120V & 277V
1000W	Pure	Wall / floor	24"	40.75"	10.5"	4	266 lbs	114 lbs
1000W-4C	Pure	Wall/ floor	24"	40.75"	14.5"	4	350 lbs	198 lbs

Power consumption and unit rating

Model number	AC specs	Emergency power available for load			
		90 Min	2H	3H	4H
EMIU-1000	120/277VAC 12.8 / 5.3 Amps	1000W	807W	604W	489W

How to order

Series	Capacity	Voltage	Diagnostic feature	Options
EMIU	-1000= 1000W	Blank= 120/120VAC or 277/277VAC	-Blank= Advanced-diagnostic, non-audible ¹ -AD= Advanced-diagnostic, audible ¹ -NAD= No auto test/ No advanced-diagnostics -NEX= Nexus® wired -NEXRF= Nexus® wireless	-D3= Time delay (15 minutes) -SAC= Service alarm contact ² -4C= 4 output circuits

Example: EMIU-1000

¹ Minimum load required: 10% of unit capacity

² Service alarm contact (SAC) shall be provided a 24V signal, the charger board will indicate a fault by closing a contact.

Emerg-Power systems

Features and benefits

Highlights

Performance

Emerg-Power Systems work with any type of lighting load to provide full light output for a minimum of 90 min. They are designed to support incandescent, fluorescent, HID*, quartz re-strike, LED or halogen lamps. They will work to power into these loads at cold starts for all normally off circuits or normally on circuits¹.

¹Except IPS systems

True Sine Waveform

Using a solid-state, pulse width modulation (PWM) inverter the systems produce pure sinusoidal output waveform with less than 3% maximum Total Harmonic Distortion (THD) for linear loads. Microprocessor and crystal controlled.

Reliability

Emerg-Power Systems use third generation inverter technology. The proven solid design and double ratings of all critical components. LVD (Low Voltage Disconnect) for long power outages eliminates battery drain.

Batteries

Front access connections for easy installation significantly reduce the footprint, installation and maintenance time while increasing safety. Automatic restart and recharge upon restoration of utility.

Applications


Emerg-Power Systems can be used in almost every type of building, and are well-suited for architecturally sensitive applications or areas where maintenance costs and individual testing of unit equipment becomes significant. Emerg-Power Systems are designed to work with power factor corrected as well as the most recent T5 and T5-HO electronic ballasts.

Options

The full range of options available, such as integrated output circuit breakers, bypass relays, dry contacts, etc., makes Emerg-Power Systems an industry leader in emergency lighting central systems.

Approvals

UL listed to UL 924. Meets UL 924 Listed, NFPA101, NFPA70, NFPA 110, OSHA, UBC, SBCCI.
New York City approved.

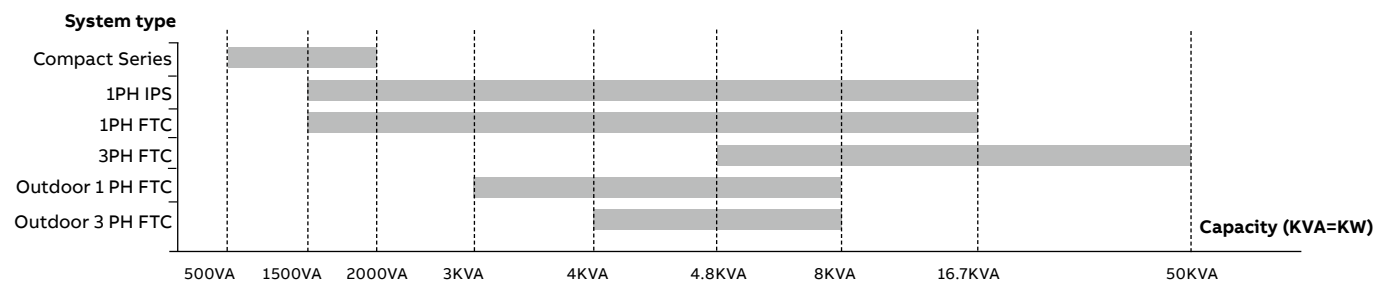

Features

Self-diagnostic / self-testing

- Programmable monthly and annual self-testing. Proven self-diagnostic with over 120 parameters stored in separate memory logs for Test, Event and Alarm.
- Microprocessor monitoring and control.

Low heat dissipation

- Very low heat loss technology in normal operating mode (see specifications for exact values). Convection cooling in normal mode with forced air during emergency mode.
- Battery cabinets: convection cooling only

Maximum efficiency

- Highest efficiency in the industry, 98% at 100% load with no requirement for cooling in normal operating mode.
- Low input harmonic distortion <10%

Versatile installation

- Modular design, easy front access freestanding cabinets, fasten together when more than one cabinet is required.
- Optional seismic kit available.
- All wiring provided is pre-cut and terminated, along with the necessary hardware and electrical fittings, for proper installation.

Complete protection

- Input circuit breaker and fused battery circuit are standard.
- Systems offer overload capacity, short-circuit protection, current-limiting, low-battery disconnect, reverse polarity and brownout protection as standard.

Thermal performance

- Bonded fin heat sink technology for maximum thermal performance.
- Cooling fans are energized only in inverter mode.

Monitoring and control

- User-friendly programmable interface with LED indicators and LCD display provides full metering values, easy program and control functions and a wide range of visual and audible alarms.

Benefits

Compliance with NFPA101

- Self-testing meets the requirements of NFPA and UL. User programmable time of testing.
- Test results, events and alarms can be downloaded from history logs. Load monitoring. Reduced testing/service time.

Less air-conditioning

- Reduced costs for air-conditioning required to ensure the optimum operating temperature when compared with equivalent systems that dissipate much more heat.
- Higher reliability of fans and the electronic components.

Lower energy bills

- Low consumption of the system itself will result in lower energy bills paid over the system life time. Comparative analysis available on request.

Easy to install

- Quick installation and connection through flexible cable entries and fast access terminal blocks.
- Reduced footprint for systems with stackable cabinets.
- Low MTTR (<15 min.) due to modular design, quick disconnect means and frontal access.

Reduced damage risks

- Full system protection eliminates damage created by external events and increases the lifetime of the electronics and batteries. Also will provide safety during maintenance

Increase MTBF

- Increased reliability and reduced preventative maintenance.
- No air filters needed.

Easy maintenance

- Easier diagnostic, troubleshooting, preventative maintenance and service through the indicators and display or by using the history logs.
- Remote versions available.

Emerg-Power Systems Compact Series

Uninterruptible emergency lighting, 1PH, inverter system 500VA – 2000VA



Features

- 98% efficient at full load
- PWM/MOSFET technology
- Self-testing/self-diagnostic
- User programmable with password protection
- Standard input circuit breaker
- Standard output circuit breaker
- Micro-processor controlled
- Floor or wall mountable
- Field upgradeable (500VA steps)
- 90 min. standard run time
- Electronic and magnetic ballast compatible
- Automatic event, test and alarm log
- LCD display
- Small footprint (stackable cabinets)
- Maintenance-free standard batteries
- Forced air cooling during emergency mode only

UL listed to UL 924. Meets NFPA101, NFPA70, NFPA 110, OSHA, UBC, SBCCI. N.Y City approved.



Electrical/mechanical characteristics⁴ (data provided for standard lead calcium batteries)^{1,4}

Power rating ¹ VA= W	Effic. at full load %	Max. input current (A)		Heat loss in normal mode (BTU/HR)	Batt. VDC	Batt. A	No. of Batt.	UPS cabinet dimensions			Battery cabinet dimensions ^{2,3}			No. of batt. cab.	Batt. cab. weight lbs	UPS cab. weight lbs	Batt weight lbs	Total system weight lbs
		120V	277V					W"	H"	D"	W"	H"	D"					
500	98	5.2	2.3	34	48	13.5	4	26	10	10	26	10	10	1	22 lbs	77 lbs	107 lbs	206 lbs
1000	98	10.5	4.5	68	48	26.5	8	26	10	10	26	10	10	2	22 lbs	77 lbs	214 lbs	335 lbs
1500	98	15.6	6.8	102	48	40	12	26	10	10	26	10	10	3	22 lbs	77 lbs	321 lbs	464 lbs
2000	98	20.8	9	136	48	52	16	26	10	10	26	10	10	4	22 lbs	77 lbs	428 lbs	592 lbs

¹System capacity can be upgraded in the field up to 2000VA by adding more battery cabinets. Re-programming required by factory service technician.

²Batteries are installed in separate modular cabinets

³Battery cabinets are stackable. Must be installed under the electronics cabinet

⁴Special voltages can change the size, weight or number of cabinets

How to order

Input voltage ¹	Battery type	VA/W	System type	Output voltage ²	Run time ³	Input breaker	Output breakers ⁴	Options ⁵
120	SG= Lead-calcium	500	-FTCM	-120	-90	-ICB	-OCBxxx=	-NOFF= Normally OFF output
277		1000		-277			No trip alarm ⁴	-WB= Wall mount bracket
		1500					-OCAxxx=	-DCS= Dry summary alarm contacts
		2000					With trip alarm ⁴	-INVO= Inverter on dry contact
								-VTD= Variable time delay
								-BPR= Bypass relay
								-RMP= Remote metering panel
								-RSAP= Remote summary alarm panel
								-RS232= Communication interface
								-MOD= Modem
								-FLR= Floor bracket

Example: 120SG1500-FTCM-120-90-ICB-OCB0420-WB

¹Special voltages may change the size, weight or number of cabinets

²Special voltages may change the size, weight or number of cabinets

³Other run times available

⁴Max. 3 more additional output breakers for a total of 4. See page 169 for output breaker details

⁵See page 169 for options description

Specifications

General

Design

- Stand-by no break. PWM inverter type utilizing MOSFET technology with 2ms transfer time

Control

- Microprocessor controlled, 2 x 20-character display with touch pad controls & functions
- 5 LED indicators & alarm with ring-back feature

Metering

- Input and output voltage, battery voltage, battery and output current, output VA, temperature, inverter wattage

Communications Optional RS-232 port (DB9)

Electrical input

Voltage

120 or 277VAC, 1-phase 2-wire, +10%/ -15%
Contact factory for all other voltage.

Input power walk-in

Limiting inrush current to less than 125%,
10 times for 1 line cycle

Input frequency 60Hz, +/-3Hz

Protection Standard input circuit breaker

Harmonic distortion <10%

Power factor 0.5 lag/lead

Electrical output

Voltage 120 or 277VAC, 1-phase 2-wire
Contact factory for all other voltage

Static voltage

- Load current change +/-2%, battery discharge +/-12.5%

Dynamic voltage

- +/-2% for +/-25% load step change, +/-3% for a 50% load step change, recovery within 3 cycles

Harmonic distortion <3% THD for linear load

Output frequency 60Hz +/- 0.05Hz during emergency mode

Load power factor 0.5 lag to 0.5 lead

Inverter overload 115% for 5 minutes

Protection Standard output circuit breaker (normally on)

Crest factor 2.8

Environmental conditions

Storage/transport

- -4°F to 158°F (-20°C to 70°C) without batteries
- 0°F to 104°F (-18°C to 40°C) with batteries
(max. 3 months at 104° F (40° C))

Operating temperature

System operates safely from 32°F to 104°F (0°C to 40°C) but optimum operation is between 68° F and 86°F (20°C to 30°C). Battery performance can be affected by temperature

Altitude <10,000 feet (above sea level) without de-rating

Relative humidity 0 to 95% non-condensing

Audible noise 45 dBA @ 1m from surface in emergency mode

Cabinets

Modular design, freestanding or wall mount NEMA Type 1 steel cabinets powder coated for corrosion and scratch resistance. Front access design. Cabinets are stackable. Top and left side conduit entry with knockouts.

Inverter

Using MOSFET/PWM technology the inverter converts the DC voltage supplied by the batteries to AC voltage of a precise stabilized amplitude and frequency, suitable for most sophisticated electrical equipment. True sinusoidal output waveform with very low distortion (less than 3% for linear loads). Overload capability of up to 150% for 12 line cycles.

Charger

Fully automatic, temperature compensated, microprocessor controlled charger recharges fully discharged batteries in maximum 24 hours at nominal AC input voltage. AC input current limiting and over-voltage protection included.

Battery

System is provided with 10 year, maintenance free, sealed valve regulated lead calcium batteries. 90 min. standard discharge time at full load under normal operating temperature. Low voltage disconnect protection included. No special ventilation required.

Self-diagnostic

Automatic self-test consists of a 5-minute monthly and 90-minute annual function. The front-mounted control panel includes 5 LED indicators, a 2-line 20-character LCD display, a keypad to control and monitor the internal operation of the system. This allows the operator to easily "watch" system functions as they occur and check on virtually any aspect of the system's operation. Self-diagnostic function monitors, controls, generates alarms and memorizes events.

Alarms

High/low battery charger voltage, high/low AC input voltage, near low battery, low battery, load reduction fault, output overload, high ambient temperature, inverter fault, output fault, optional output circuit breaker trip

Optional features

Normally off output, output circuit breakers, output trip alarm, RS232 communication port, 12 Hours fast recharge, remote meter panel, remote summary alarm panel, summary alarm dry form C contact, inverter on dry contacts, variable time delay, modem, bypass relays, wall mount bracket


Factory start-up

Includes one additional year of warranty. See warranty conditions

Warranty (full limited warranty conditions available upon request)

Limited manufacturer warranty is one-year, parts and labor, for system electronics or two-year with factory start-up program. Battery warranty is one year full plus 9 years pro-rata for a total of 10 years, under normal operating conditions. System must be put in service within 180 days from ship date in order to validate warranty.

Single line diagram

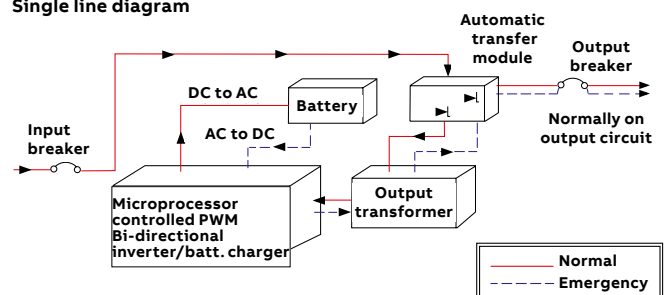

Characteristics, specifications or dimensions subject to change without notice.

Emerg-Power Systems IPS

Single phase series



Features

- 98% efficient at full load
- PWM/IGBT technology
- Self-testing/Self-diagnostic
- User programmable with password protection
- Standard input circuit breaker
- Standard normally off and on output
- RS232 communication port
- Micro-processor controlled
- Automatic event and alarm log
- 90 min. standard run time
- Generator compatibility

- Electronic and magnetic ballast compatible
- Custom voltages available
- Automatic event, test and alarm log
- LCD display
- Reduced footprint (stackable cabinets)
- Maintenance free standard batteries
- Forced air cooling during emergency mode only

UL listed to UL 924. Meets NFPA101, NFPA70, NFPA 110, OSHA, UBC, SBCCI. N.Y City approved.



Electrical/mechanical characteristics⁴ (data provided for standard lead calcium batteries)^{1,4}

Power rating ¹ VA= W	Effic. at full load %	Max. input current (A)		Heat loss in normal mode (BTU/HR)				UPS cabinet dimensions			Battery cabinet dimensions ^{2,3}			No. of batt. cab.	Batt. cab. weight lbs	UPS cab. weight lbs	Batt weight lbs	Total system weight lbs
		120V	277V		Batt. VDC	Batt. A	No. of Batt.	W"	H"	D"	W"	H"	D"					
1.5	98	16	7	102	48	39	4	30	47	25	N/A	N/A	N/A	N/A	N/A	250 lbs	296 lbs	546 lbs
2.25	98	24	11	153	72	38	6	30	47	25	N/A	N/A	N/A	N/A	N/A	265 lbs	444 lbs	709 lbs
3	98	32	14	204	96	38	8	30	47	25	N/A	N/A	N/A	N/A	N/A	295 lbs	592 lbs	887 lbs
3.75	98	39	17	255	120	37	10	30	47	25	N/A	N/A	N/A	N/A	N/A	305 lbs	740 lbs	1045 lbs
5	98	50	22	340	144	40	12	30	47	25	N/A	N/A	N/A	N/A	N/A	315 lbs	888 lbs	1203 lbs
6	98	63	27	408	180	40	15	30	47	25	30	47	25	1	210 lbs	350 lbs	1110 lbs	1670 lbs
8	98	84	36	544	240	39	20	30	47	25	30	47	25	1	232 lbs	375 lbs	1480 lbs	2087 lbs
10	98	105	45	680	144	82	24	30	47	25	30	47	25	2	420 lbs	435 lbs	1776 lbs	2631 lbs
12.5	98	131	57	850	180	82	30	30	47	25	30	47	25	2	420 lbs	465 lbs	2220 lbs	3105 lbs
16.7	98	174	76	1136	240	80	40	30	47	25	30	47	25	2	464 lbs	530 lbs	2960 lbs	3954 lbs

¹System capacity can be upgraded in the field up to 2000VA by adding more battery cabinets. Re-programming required by factory service technician.

²Batteries are installed in separate modular cabinets

³Battery cabinets are stackable. Must be installed under the electronics cabinet

⁴Special voltages can change the size, weight or number of cabinets

How to order

Input voltage ¹	Battery type	VA/W rating	System type	Output voltage ²	Run time ³	Input breaker	RS232 port	Output breakers ⁴	Options ⁵
120	SG= Sealed	1500	-IPS	-120	-90	-ICB	RS232	-OCBxxxx= No trip	-20Y= 20 yr sealed batteries
208	lead-	2250		-277				alarm ⁴	-12HR= 12 hr fast recharge
240	calcium	3000		-208				-OCAxxxx= With trip	-MBYP= Internal bypass switch
277		3750		-120/140				alarm ⁴	-EMBP= External bypass switch ⁶
		5000		-120/277					-RMP= Remote metering panel
		6000							-RSAP= Remote summary alarm panel
		8000							-DCS= Dry summary alarm contacts
		10000							
		12500							
		16700							

Example: 277SG6000-IPS-277-90-ICB-RS232-OCB0420-DCS-20Y

¹Special voltages may change the size, weight or number of cabinets

²Special voltages may change the size, weight or number of cabinets

³Other run times available

⁴Max. 12 unsupervised single pole positions or 8 with trip alarm. For more output breakers please consult factory.. See page 169 for output breaker details

⁵See page 169 for options description

⁶External bypass switch is not compatible with integrated output circuit breakers.

Input/output voltage has to be the same

Specifications

General

Design

- Stand-by, PWM inverter type utilizing IGBT technology with 50ms transfer time.

Control

- Microprocessor controlled, 2 x 20-character display with touch pad controls & functions
- 5 LED indicators & alarm with ring-back feature

Metering

- Input and output voltage, battery voltage, battery and output current, output VA, temperature, inverter wattage

Communications Optional RS-232 port (DB9)

Electrical input

Voltage

120 or 277VAC, 1-phase 2-wire, +10%/-15%
Contact factory for all other voltage.

Input power walk-in

Limiting inrush current to less than 125%,
10 times for 1 line cycle

Input frequency 60Hz, +/-3Hz, available upon request

Protection Input circuit breaker

Harmonic distortion <10%

Power factor 0.5 lag/lead

Electrical output

Voltage 120 or 277VAC, 1-phase 2-wire
Contact factory for all other voltage

Static voltage

- Load current change +/-2%, battery discharge +/-12.5%

Dynamic voltage

- +/-2% for +/-25% load step change
- +/-3% for a 50% load step change, recovery within 3 cycles

Harmonic distortion <3% THD for linear load

Output frequency 60Hz +/- 0.05Hz during emergency mode

Load power factor 0.5 lag to 0.5 lead

Inverter overload 115% for 10 minutes, 150% for 16 line cycles

Protection Optional distribution circuit breaker

Crest factor 2.8

Environmental conditions

Storage/transport

- 4°F to 158°F (-20°C to 70°C) without batteries
- 0°F to 104°F (-18°C to 40°C) with batteries
(max. 3 months at 104°F (40°C))

Operating temperature

System operates safely from 32°F to 104°F (0°C to 40°C) but optimum operation is between 68°F and 86°F (20°C to 30°C). Battery performance can be affected by temperature

Altitude <10,000 feet (above sea level) without de-rating

Relative humidity 0 to 95% non-condensing

Audible noise Audible noise 45 dBA @ 1m from surface
in emergency mode

Cabinets

Modular design, freestanding NEMA Type 1 steel cabinets powder coated for corrosion and scratch resistance. Front access design through hinged lockable doors requires only 39" front clearance and 12" top clearance. Cabinets are stackable if required to further reduce the footprint. Top and left side conduit entry with knockouts.

Inverter

Using IGBT/PWM technology the inverter converts DC voltage supplied by the batteries to AC voltage of a precise stabilized amplitude and frequency, suitable for most sophisticated electrical equipment. True sinusoidal output waveform with very low distortion (less than 3% for linear loads). Overload capability of up to 150% for 12 line cycles.

Charger

Fully automatic, temperature compensated, microprocessor controlled charger recharges fully discharged batteries in maximum 24 hours at nominal AC input voltage. AC input current limiting and over-voltage protection included.

Battery

System is provided standard with 10 year, maintenance free, sealed valve regulated, front terminals Lead-Calcium batteries. 20 year sealed Lead-Calcium battery also available. 90 min. standard discharge time at full load under normal operating temperature. Low voltage disconnect protection included. No special ventilation required.

Self-diagnostics

Automatic self tests consist of a 5-minute monthly and 90-minute annual function. The front-mounted control panel includes 5 LED indicators, a 2-line 20-character LCD display, a keypad to control and monitor the internal operation of the system. This allows the operator to easily "watch" system functions as they occur and check on virtually any aspect of the system's operation. Standard RS232 diagnostic interface

Alarms

High/low battery charger voltage, high/low AC Input Voltage, Near low battery, low battery, load reduction fault, output overload, high ambient temperature, inverter fault, output fault, optional output circuit breaker trip

Optional features

Output circuit breakers, output trip alarms, 20 years sealed batteries, 12 hours fast recharge, internal/external maintenance bypass switch, remote meter panel, remote summary alarm panel, summary alarm dry form C contact, inverter on dry contacts, fax modem, bypass relays, auto dialer, seismic mounting.

Factory start-up


Includes one additional year of warranty. See warranty conditions

Warranty (full limited warranty conditions available upon request)

Limited manufacturer warranty is one-year, parts and labor, for system electronics or two-year with factory start-up program. Battery warranty is one year full plus 9 years pro-rata for a total of 10 years, under normal operating conditions. System must be put in service within 6 months from ship date in order to validate warranty

2-Consult factory for other type batteries than the standard one.

Single line diagram

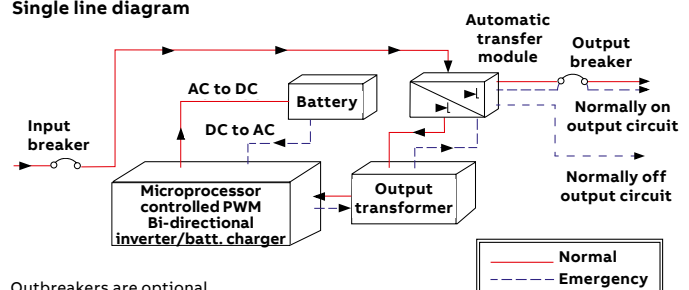

Emerg-Power Systems FTC Single Phase Series

Uninterruptible emergency lighting inverter system 1.5KVA –16.7KVA



Features

- 98% efficient at full load
- PWM/IGBT technology
- Self-testing/Self-diagnostic
- User programmable with password protection
- Standard input circuit breaker
- Standard normally off and on output
- RS232 communication port
- Micro-processor controlled
- Automatic event and alarm log
- 90 min. standard run time
- Generator compatibility

- Electronic and magnetic ballast compatible
- Custom voltages available
- Automatic event, test and alarm log
- LCD display
- Reduced footprint (stackable cabinets)
- Maintenance free standard batteries
- Forced air cooling during emergency mode only

UL listed to UL 924. Meets NFPA101, NFPA70, NFPA 110, OSHA, UBC, SBCCI. N.Y City approved.



Electrical/mechanical characteristics⁴ (data provided for standard lead calcium batteries)^{1,4}

Power rating ¹ VA= W	Effic. at full load %	Max. input current (A)		Heat loss in normal mode (BTU/HR)				UPS cabinet dimensions			Battery cabinet dimensions ^{2,3}			No. of batt. cab.	Batt. cab. weight lbs	UPS cab. weight lbs	Batt weight lbs	Total system weight lbs
		120V	277V		Batt. VDC	Batt. A	No. of Batt.	W"	H"	D"	W"	H"	D"					
1.5	98	16	7	102	48	39	4	30	47	25	N/A	N/A	N/A	N/A	N/A	250 lbs	296 lbs	546 lbs
2.25	98	24	11	153	72	38	6	30	47	25	N/A	N/A	N/A	N/A	N/A	265 lbs	444 lbs	709 lbs
3	98	32	14	204	96	38	8	30	47	25	N/A	N/A	N/A	N/A	N/A	295 lbs	592 lbs	887 lbs
3.75	98	39	17	255	120	37	10	30	47	25	N/A	N/A	N/A	N/A	N/A	305 lbs	740 lbs	1045 lbs
5	98	50	22	340	144	40	12	30	47	25	N/A	N/A	N/A	N/A	N/A	315 lbs	888 lbs	1203 lbs
6	98	63	27	408	180	40	15	30	47	25	30	47	25	1	210 lbs	350 lbs	1110 lbs	1670 lbs
8	98	84	36	544	240	39	20	30	47	25	30	47	25	1	232 lbs	375 lbs	1480 lbs	2087 lbs
10	98	105	45	680	144	82	24	30	47	25	30	47	25	2	420 lbs	435 lbs	1776 lbs	2631 lbs
12.5	98	131	57	850	180	82	30	30	47	25	30	47	25	2	420 lbs	465 lbs	2220 lbs	3105 lbs
16.7	98	174	76	1136	240	80	40	30	47	25	30	47	25	2	464 lbs	530 lbs	2960 lbs	3954 lbs

¹System capacity can be upgraded in the field up to 2000VA by adding more battery cabinets. Re-programming required by factory service technician.

³Battery cabinets are stackable. Must be installed under the electronics cabinet

²Batteries are installed in separate modular cabinets ⁴Special voltages can change the size, weight or number of cabinets

How to order

Input voltage ¹	Battery type	VA/W rating	System type	Output voltage ²	Run time ³	Input breaker	RS232 Port	Output breakers ⁴	Options ⁵
120	SG= Sealed	1500	-FTC	-120	-90	-ICB	-RS232	-OCBxxxx=	-20Y= 20 yr sealed batteries
208	Lead-	2250		-277				No trip alarm ⁴	-12HR= 12 hr fast recharge
240	Calcium	3000		-208				-OCAxxxx=	-MBYP= Internal bypass switch
277		3750		-120/140				With trip alarm ⁴	-EMBP= External bypass switch ⁷
		5000		-120/277					-RMP= Remote metering panel
		6000							-RSAP= Remote summary alarm panel
		8000							-DCS= Dry summary alarm contacts
		10000							
		12500							
		16700							

Example: 277SG6000-FTC-277-90-ICB-RS232-OCB0420-DCS-20Y

¹Special voltages may change the size, weight or number of cabinets

²Special voltages may change the size, weight or number of cabinets

³Other run times available

⁴Max. 12 unsupervised single pole positions or 8 with trip alarm. For more output breakers please consult factory.. See page 169 for output breaker details

⁵See page 169 for options description

⁶External bypass switch is not compatible with integrated output circuit breakers. Input/output voltage has to be the same

⁷Normally off loads cannot exceed 20% of total KVA rating with any combination of H.I.D. loads

Specifications

General

Design

- Stand-by, PWM inverter type utilizing IGBT technology with 2ms transfer time

Control

- Microprocessor controlled , 2 x 20-character display with touch pad controls & functions
- 5 LED indicators & alarm with ring-back feature

Metering

- Input and output voltage, battery voltage, battery and output current, output VA, temperature, inverter wattage

Communications RS-232 port (DB9)

Electrical input

Voltage

- 120 or 277VAC 1-phase 2-wire +10% - 15%.
Contact factory for all other voltages

Input power walk-in

- Limiting inrush current to less than 125%, 10 times for 1 line cycle

Input frequency 60Hz, +/-3%, 50Hz available upon request

Protection Input circuit breaker

Harmonic distortion <10%

Power Factor 0.5 lag/lead

Electrical output

Voltage 120 or 277VAC, 1-phase 2-wire

Contact factory for all other voltage

Static voltage

- Load current change +/-2%, battery discharge +/-12.5%

Dynamic voltage

- +/-2% for +/-25% load step change
- +/-3% for a 50% load step change, recovery within 3 cycles

Harmonic distortion <3% THD for linear load

Output frequency 60Hz +/- 0.05Hz during emergency mode

Load power factor 0.5 lag to 0.5 lead

Inverter overload 115% for 10 minutes, 125% for 5 minutes, 150% for 12 cycles

Protection Optional distribution circuit breaker

Crest factor 2.8

Environmental conditions

Storage/transport

- -4°F to 158°F (-20°C to 70°C) without batteries
- 0°F to 104°F (-18°C to 40°C) with batteries
(max. 3 months at 104° F (40° C))

Operating temperature

System operates safely from 32°F to 104°F (0°C to 40°C) but optimum operation is between 68° F and 86°F (20°C to 30°C). Battery performance can be affected by temperature

Altitude <10,000 feet (above sea level) without de-rating

Relative humidity 0 to 95% non-condensing

Audible noise Audible noise 45 dBA @ 1m from surface
in emergency mode

Cabinets

Modular design, freestanding NEMA Type 1 steel cabinets powder coated for corrosion and scratch resistance. Front access design through hinged lockable doors requires only 39" front clearance and 12" top clearance. Cabinets are stackable if required to further reduce the footprint. Top and left side conduit entry with knockouts.

Inverter

Using IGBT/PWM technology the inverter converts the DC voltage supplied by the batteries to AC voltage of a precise stabilized amplitude and frequency, suitable for most sophisticated electrical equipment. True sinusoidal output waveform with very low distortion (less than 3% for linear loads). Overload capability of up to 150% for 12 line cycles.

Charger

Fully automatic, temperature compensated, microprocessor controlled charger recharges fully discharged batteries in maximum 24 hours at nominal AC input voltage. AC input current limiting and over-voltage protection included.

Battery

System is provided standard with 10 year, maintenance free, sealed valve regulated, front terminals Lead Calcium batteries. 20 year sealed Lead Calcium battery also available. 90 min. standard discharge time at full load under normal operating temperature. Low Voltage Disconnect protection included. No special ventilation required.

Self-diagnostics

Automatic self tests consist of a 5-minute monthly and 90-minute annual function. The front-mounted control panel includes 5 LED indicators, a 2-line 20-character LCD display, and a keypad to control and monitor the internal operation of the system. This control panel allows the operator to easily "watch" system functions as they occur and check on virtually any aspect of the system's operation. Standard RS232 diagnostic interface.

Alarms

High/low battery charger voltage, high/low AC input voltage, near Low battery, low battery, load reduction fault, output overload, high ambient temperature, inverter fault, output fault, optional output circuit breaker trip

Optional features

Output circuit breakers, output trip alarms, 20 years sealed batteries, 12 hours fast recharge, internal/external maintenance bypass switch, remote meter panel, remote summary alarm panel, summary alarm dry Form C contact, inverter on dry contacts, normally off output, fax/modem, bypass relays, auto dialer, seismic mounting.

Factory start-up


Includes one additional year of warranty. See warranty conditions

Warranty (full limited warranty conditions available upon request)

Limited manufacturer warranty is one-year, parts and labor, for system electronics or two-year with factory start-up program. Battery warranty is one year full plus 9 years pro-rata for a total of 10 years, under normal operating conditions. System must be put in service within 6 months from ship date in order to validate warranty.

2-Consult factory for other type batteries than the standard one.

Single line diagram - Normally on Output circuit

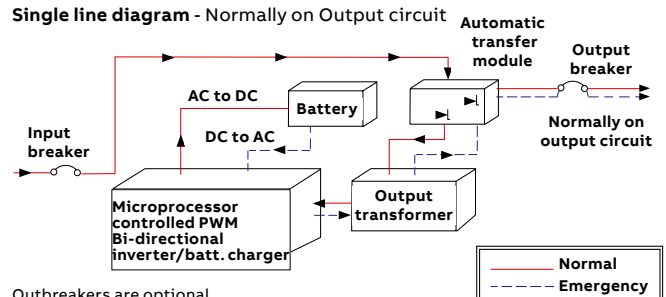

Emerg-Power Systems 3FTC Three Phase Series

Uninterruptible emergency lighting inverter system 4.8KVA – 50KVA



Features

- 98% efficient at full load
- PWM/IGBT technology
- Self-testing/self-diagnostic
- User programmable with password protection
- Standard input circuit breaker
- Standard normally off and on output
- RS232 communication port
- Micro-processor controlled
- Automatic event and alarm log
- 90 min. standard run time
- Generator compatibility
- Available in Y or Δ input configuration
- Custom voltages available
- Automatic event, test and alarm log
- LCD display
- Reduced footprint
- Maintenance free standard batteries
- Forced air cooling during emergency mode only

UL listed to UL 924. Meets NFPA101, NFPA70, NFPA 110, OSHA, UBC, SBCCI. N.Y City approved.



Electrical/mechanical characteristics⁴ (data provided for standard lead calcium batteries)^{1,4}

Power rating ¹ VA= W	Effic. at full load %	Max. input current (A)		Heat loss in normal mode (BTU/HR)	Batt. VDC	Batt. A	No. of Batt.	UPS cabinet dimensions			Battery cabinet dimensions ^{2,3}			No. of batt. cab.	Batt. cab. weight lbs	UPS cab. weight lbs	Batt weight lbs	Total system weight lbs
		120V/ 208V	277V/ 480V					W"	H"	D"	W"	H"	D"					
4.8	98	17	7	326	144	39	12	30	47	25	30	47	25	1	N/A	535 lbs	888 lbs	1633 lbs
6	98	21	9	408	180	39	15	30	47	25	30	47	25	1	N/A	535 lbs	1110 lbs	1855 lbs
8	98	28	12	544	240	39	20	30	47	25	30	47	25	1	N/A	535 lbs	1480 lbs	2247 lbs
10	98	35	15	680	144	81	24	30	47	25	30	47	25	2	N/A	639 lbs	1776 lbs	2835 lbs
12.5	98	43	19	850	180	81	30	30	47	25	30	47	25	2	N/A	639 lbs	2220 lbs	3279 lbs
16.7	98	58	25	1136	240	81	40	30	47	25	30	47	25	2	210 lbs	639 lbs	2960 lbs	4063 lbs
24	98	84	36	1632	240	117	60	30	47	31	48	72	31	1	232 lbs	1250 lbs	4440 lbs	6390 lbs
33	98	115	50	2244	240	160	40	30	47	31	48	72	31	2	420 lbs	1250 lbs	6080 lbs	8630 lbs
40	98	139	60	2720	240	194	100	30	47	31	48	72	31	2	420 lbs	1450 lbs	7400 lbs	10150 lbs
50	98	174	75	3400	240	243	60	30	47	31	48	72	31	2	464 lbs	1450 lbs	9120 lbs	11980 lbs

¹Consult factory for 20 year type batteries.

²KVA=KW

³Battery cabinets are stackable. Must be installed under the electronics cabinet

⁴Special voltages can change the size, weight or number of cabinets

How to order

Input voltage ¹	Battery type	VA/W rating	System type	Output voltage ²	Run time ³	Input breaker	RS232 Port	Output breakers ⁴	Options ⁵
120/208 277/480	SG= Sealed lead-calcium	4800 6000 8000 10000 12500 16700 24000 33000 40000 50000	-3FTC	120/208 277/480	-90	-ICB	-RS232	-OCBxxxx= No trip alarm ⁴ -OCAxxxx= With trip alarm ⁴	-20Y= 20 yr sealed batteries -12HR= 12 hr fast recharge -MBYP= Internal bypass switch -EMBP= External bypass switch ⁷ -RMP= Remote metering panel -RSAP= Remote summary alarm panel -DCS= Dry summary alarm contacts -INNON= Inverter on dry contacts -NOFF3= normally OFF output 3PH ⁶ -NOFF= normally off output 1PH ⁶ -MOD= External modem -FAX= Fax modem -BPR= Bypass relays -SEIS= Seismic mounting -ZONEM= Zone monitoring -BATM= Battery cycle warranty monitor

Example: 277/480SG6000-3FTC277/480-90-ICB-RS232

¹Special voltages may change the size, weight or number of cabinets

²Special voltages may change the size, weight or number of cabinets

³Other run times available

⁴Max. 12 unsupervised single pole positions or 8 with trip alarm 16.7kVA systems.

24 unsupervised or 16 with trip alarm for systems 24kVA to 50kVA.

For more output breakers please consult factory.

See page 169 for output breaker details

⁵See page 169 for options description

⁶External bypass switch is not compatible with integrated output circuit breakers.

Input/output voltage has to be the same

⁷Normally off loads cannot exceed 20% of total KVA rating with any combination of H.I.D. loads

Specifications

General

Design

- Stand-by, PWM inverter type utilizing IGBT technology with 2ms transfer time

Control

- Microprocessor controlled, 2 x 20-character display with touch pad controls & functions
- 5 LED indicators & alarm with ring-back feature

Metering

- Input and output voltage, battery voltage, battery and output current, output VA, temperature, inverter wattage

Communications RS-232 port (DB9)

Electrical input

Voltage

- 120/208 or 277/480 3 phase 4-wire +10% - 15%.
Contact factory for all other voltages

Input power walk-in

- Limiting inrush current to less than 125%, 10 times for 1 line cycle

Input frequency 60Hz, +/-3%, 50Hz available upon request

Protection Input circuit breaker

Harmonic distortion <10%

Power factor 0.5 lag/lead

Electrical output

Voltage 120/208 or 277/480VAC, 3-phase 4-wire Contact factory for all other voltage

Static voltage

- Load current change +/-4%, battery discharge +/-4%

Dynamic voltage

- +/-3% for +/-25% load step change
- +/-6% load step change, recovery within 3 cycles

Harmonic distortion <3% THD for linear load

Output frequency 60Hz +/- 0.05Hz during emergency mode

Load power factor 0.5 lag to 0.5 lead

Inverter overload 115% for 5 minutes, 125% for 10 minutes, 280% for line cycles

Protection Optional Distribution Circuit Breaker

Crest factor 2.8

Environmental conditions

Storage/transport

- -4°F to 158°F (-20°C to 70°C) without batteries
(max. 3 months at 104°F (40°C))
- -0°F to 104°F (-18°C to 40°C) with batteries

Operating temperature

System operates safely from 32°F to 104°F (0°C to 40°C) but optimum operation is between 68°F and 86°F (20°C to 30°C). Battery performance can be affected by temperature

Altitude <10,000 feet (above sea level) without de-rating

Relative humidity 0 to 95% non-condensing

Audible noise 45 dBA @ 1m from surface in emergency mode

Cabinets

Modular design, freestanding NEMA type 1 steel cabinets powder coated for corrosion and scratch resistance. Front access design through hinged lockable doors requires only 39" front clearance and 12" top clearance. Cabinets are stackable up to 16.7kVA, if required to further reduce the footprint. Top and left side conduit entry with knockouts up to 16.7kVA. Left side only for 24kVA and up.

Inverter

Using IGBT/PWM technology the inverter converts the DC voltage supplied by the batteries to AC voltage of a precise stabilized amplitude and frequency, suitable for most sophisticated electrical equipment. True sinusoidal output waveform with very low distortion (less than 3% for linear loads). Overload capability of up to 150% for 12 line cycles

Charger

Fully automatic, temperature compensated, microprocessor controlled charger recharges fully discharged batteries in maximum 24 hours at nominal AC input voltage. AC input current limiting and over-voltage protection included.

Battery

System is provided standard with 10 year, maintenance free, sealed valve regulated, front terminals Lead Calcium batteries. 20 year sealed Lead Calcium battery also available. 90 min. standard discharge time at full load under normal operating temperature. Low Voltage Disconnect protection included. No special ventilation required.

Supervision

Automatic self tests consist of a 5-minute monthly and 90-minute annual function. The front-mounted control panel includes 5 LED indicators, a 2-line 20-character LCD display, a keypad to control and monitor the internal operation of the system. This allows the operator to easily "watch" system functions as they occur and check on virtually any aspect of the system's operation. Standard RS232 diagnostic interface.

Alarms

High/low battery charger voltage, high/low AC input voltage, near low battery, low battery, load reduction fault, output overload, high ambient temperature, inverter fault, output fault, optional output circuit breaker trip

Optional features

Output circuit breakers, output trip alarms, 20 years sealed batteries, 12 hours fast recharge, external maintenance bypass switch, remote meter panel, remote summary alarm panel, summary alarm dry form C contact, inverter on dry contacts, normally off output, fax/modem, bypass relays, auto dialer, seismic mounting.


Factory start-up Includes one additional year of warranty. See warranty conditions

Warranty (full limited warranty conditions available upon request)

Limited manufacturer warranty is one-year, parts and labor, for system electronics or two-year with factory start-up program. Battery warranty is one year full plus 9 years pro-rata for a total of 10 years, under normal operating conditions. System must be put in service within 6 months from ship date in order to validate warranty.

2-Consult factory for other type batteries than the standard one.

Single line diagram

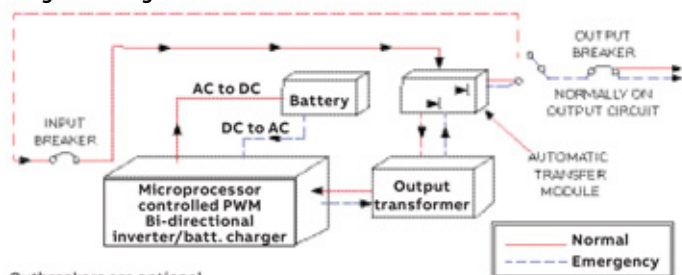

Emerg-Power Systems FTC3R and 3FTC3R

Outdoor uninterruptible emergency lighting inverter system 3KVA-8KVA



Features

- 98% efficient at full load
- PWM/IGBT technology
- Self-testing/self-diagnostic
- Standard input circuit breaker
- Standard internal bypass switch
- RS232 communication port
- Standard seismic zone 4 brackets
- Standard summary dry contacts
- Automatic event and alarm log
- NEMA 3R cabinet for outdoors
- 90 min. standard run time
- Generator compatibility
- Available in Y or Δ input configuration
- Custom voltages available
- Automatic event, test and alarm log
- LCD display
- One size cabinet
- Maintenance free standard 5 year batteries
- Temperature controlled cooling fans

UL listed to UL 924. Meets NFPA101, NFPA70, NFPA 110, OSHA, UBC, SBCCI. N.Y City approved.

Electrical/ Mechanical characteristics⁴ - (data provided for standard Lead Calcium batteries)^{1,4}



Power rating ¹ KVA= W	Effic. at full load %	Heat loss (BTU)	Batt. VDC	Batt. A	No. of Batt. ²	UPS cabinet dimensions			UPS cab. weight lbs	Batt. cab. weight lbs	Total system weight lbs
						W"	H"	D"			
3 (1PH)	98	255	120	37	10	48	76	30	535 lbs	888 lbs	1633 lbs
4 (1PH)	98	340	144	40	12	48	76	30	535 lbs	1110 lbs	1855 lbs
5 (1PH)	98	408	180	40	15	48	76	30	535 lbs	1480 lbs	2247 lbs
6.5 (1PH)	98	544	240	39	20	48	76	30	639 lbs	1776 lbs	2835 lbs
8 (1PH)	98	680	144	82	24	48	76	30	639 lbs	2220 lbs	3279 lbs
4 (3PH)	98	326	144	39	12	48	76	30	639 lbs	2960 lbs	4063 lbs
5 (3PH)	98	408	180	39	15	48	76	30	1250 lbs	4440 lbs	6390 lbs
6.5 (3PH)	98	544	240	39	20	48	76	30	1250 lbs	6080 lbs	8630 lbs
8 (3PH)	98	680	144	81	24	48	76	30	1450 lbs	7400 lbs	10150 lbs

¹Factory installed floor mount brackets; add 2.5" to each side (total 53")

²Standard batteries are 5 year life expectancy. Batteries are installed in the same cabinet with electronics

³UL rated for 90 min. run time for temperatures: 50°F to 104°F (10°C to 40°C) or -4°F to 104°F (-20°C to 40°C) with optional heater

⁴NEMA type 3R, freestanding, two-door powder coat cold rolled steel cabinet standard. Stainless steel enclosure is optional

How to order

Input voltage ¹	Battery type	VA/W rating ²	System type	Output voltage ³	Run time ⁴	Input breaker	RS232 Port	Internal bypass switch	Output breakers ⁵	Options ⁶
120, 1PH	SG= Sealed	3000	FTC3R=	120	90	ICB	RS232	MBYB	-OCBxxxx=	10Y= 10 yr sealed batteries
208, 1PH	lead-	4000	single	208					No trip	12HR= 12 hr fast
240, 1PH	calcium	5000	phase	277					alarm ⁵	recharge
277, 1PH		6500		120/208					-OCAxxxx=	NOFF= normally off output ⁷
120/208, 3PH		8000	3FTC3R=	277/480					With trip alarm ⁵	EMBP= external bypass switch ⁸
277/480, 3PH			3 phase							RMP= remote metering panel
										RSAP= remote summary alarm panel
										HTR= heater
										INVON= inverter on dry contacts
										MOD= external modem
										FAX= fax modem
										BPR= bypass relays
										SS= stainless steel enclosure

Example: 120SG4000-FTC3R-120-90-ICB-RS232-MBYB-OCB0420-10Y

¹1PH are input voltages available for 1 phase systems. 3PH are input voltages available for 3 phase systems.

²Not available in 3 phase version

³1PH are input voltages available for 1 phase systems. 3PH are input voltages available for 3 phase systems.

⁴Other run times available

⁵Max. 14 unsupervised single pole positions or 8 with trip alarm. For more output breakers please consult factory. See page 169 for output breaker option details

⁶See page 169 for options description Summary alarm dry contacts and seismic brackets are standard.

⁷Normally off loads cannot exceed 20% of total KVA rating with any combination of H.I.D. loads

⁸Not available in 3 phase version.

Emerg-Power Systems

Options details

Integrated output circuit breakers:

-OCB	12	20			
Trip alarm OCB - No breaker trip alarm	Number of circuit breakers Combination of 1 pole, 2 pole and 3 pole breakers available.	Breaker rating (Amps) *Various ratings available	Number of poles Blank - 1 pole -2P - 2 poles -3P - 3poles	Breaker voltage Blank- matches system output voltage -120VAC -208VAC -240VAC -277VAC -480VAC	Operation mode Blank: Normally-on -NOFF: Normally-off
OCA - With breaker trip alarm	*For max. number of circuit breakers available please consult factory				

Distribution circuit breakers are for output load protection. Protection for the normally on and/or for the normally off loads. All circuit breakers are rated for 10,000 AIC. If ordered, an audible and visual alarm activates when an output distribution circuit breaker is open or has tripped

(-20YR) 20 year old sealed lead calcium batteries

Maintenance free battery requires no addition of water over the life of the battery. The battery cells are housed in protective, modular steel trays. Life expectancy is designed for 20-years at 77°F (25°C).

(-12HR) 12 hour fast recharge

Battery charger upgrade option which decreases the time required to return a fully discharged battery to the fully charged state. The normal 24 hour recharge cycle is reduced to a 12 hour period.

(-MBYP) Internal maintenance bypass switch

Internally mounted device permits maintenance personnel to easily bypass the protected equipment directly to the AC utility power. The manual make beforebreak switch isolates the system to perform routine maintenance or servicing without interruption of utility power to the connected load.

(-EMBP) External maintenance bypass switch

The external maintenance bypass switch is mounted in a 20"H x 16"W x 9"D NEMA 1 separate enclosure, used to completely isolate the inverter system from the connected load and AC utility input. This option allows the system to be safely powered down for maintenance or service. The option may not be used on systems with more than one single pole output circuit breaker which must be sized for the total system output current.

(-RMP) Remote meter panel

The panel allows monitoring of parameters and control from remote locations up to 150 feet away from the inverter system. Also, the remote panel provides a complete touch pad interface allowing the user to monitor, control and program the inverter system.

(-RSAP) Remote summary alarm panel

Wall mountable box provides visual and audible alarms with silent switch. The panel consists of LED indicators and built-in audible alarm and may be located up to 1,000 feet away from the inverter system.

(-DCS) Summary alarm dry contacts

Form C dry contacts for remote monitoring purposes. Rated at 5 amps max. (250VAC/30VDC), the contacts will change state when any of the following alarms: are tripped High/Low Battery Charger Voltage, High/Low AC Input Voltage, Near Low Battery Voltage, Low Battery Voltage, Load Reduction Fault, High Ambient Temperature, Inverter Fault, Output Fault, Output Overload or Optional circuit breaker.

(-INVON) Inverter on dry contacts

Form C dry contacts that will change state when the system transfers to battery operation

(-VTD) Time delay, 15 minutes (for normally off circuits)

After a return of AC utility power, delays retransfer of the inverter for up to 15 min. and continues to supply emergency power to the normally off circuits.

(-NOFF) Normally off output

This output circuit is dedicated for the "emergency only" equipment. Emergency only equipment operates during power outages and when the system is on battery back up. This option leaves the normally off load circuits off during normal utility power conditions. A 1-pole circuit breaker is provided. For 3 phase systems, 3 pole normally off circuits are available as well.

(-MOD) External modem

External modem device is designed to boost the signal level of the RS-232 diagnostic interface to remote monitoring locations located more than 100 feet away from the system.

(-FAX) Internal fax modem

The internal fax modem enables the system to send a fax automatically to several pre-programmed numbers when one of the following conditions occurs: utility failure, output failure or any alarm. The Fax Modem option requires a user supplied dedicated phone line.

(-BPR) Bypass relays

Internal bypass relays will allow overriding circuits that can be switched on/off, so in case of a power failure the emergency circuits will be supplied from the inverter system whatever the position of the switching device. Please consult factory for more details.

(-SEIS) Seismic mounting kit

The seismic mounting kit option is designed to prevent system movement during seismic events. Heavy-duty brackets are provided to secure system cabinetry to floor surfaces. Meets Zone 4 requirements.

(-ZONEM) Zone monitoring

Allows voltage monitoring of different circuits than the standard AC utility input. When the voltage of one of these circuits drops, the inverter system will go into battery back-up operation mode. Number and voltage of the monitored circuits to be specified.

(-RS232) Diagnostic interface

A microprocessor-based data acquisition system designed to monitor all the system parameters remotely. Monitors alarm log, event log and automatic test log. User can command the system to perform a battery test and review all system parameters. Access is through a DB9 connector and transmits at 9600 baud.

(-BATM) Battery cycle warranty monitor

Device providing battery monitoring at string level or cell level. Please consult factory for more details.

Emerg-Power Systems

Control panel & display

Meter function

- AC voltage input
- AC voltage output
- AC current output
- Battery voltage
- Battery current
- VA output
- Inverter watts
- Ambient temperature
- System days (cumulative)
- Inverter minutes (cumulative)

Program functions

- Set date
- Set time
- Set monthly test date and time
- Set annual test date and time
- Set load fault reduction setting
- Set low battery alarm
- Set near low battery alarm
- Set low AC voltage alarm
- Set high AC alarm
- Set ambient temperature alarm

Alarms

- High battery charger voltage
- Low battery charger voltage
- High AC Input voltage
- Low AC input voltage
- Near low battery voltage
- Low battery voltage
- Load reduction fault
- High ambient temperature
- Inverter fault
- Output fault
- Output overload

Control functions

- Test and event logs
(75 logs stored) logs record the following data: date, time, duration, output voltage, output current, ambient temperature and alarms present.
- Alarm logs (50 logs stored) logs record the following data: Date, Time and Alarm type
- Buzzer On/Off (toggle)
- 5 LED Indicators and alarms with ringback feature



System testing

Manual tests of system may be performed at any time using the control panel test key. Automatic self-diagnostic tests consist of a 5-minute monthly and 90-minute annual function (the user can program the date and time of day the test is to take place). The microprocessor automatically records the last 75 test events in its own separate test result log. t result log.

Emerg-Power Systems

Central systems request data

1) Input voltage

Single phase (2 wire + ground)	120VAC <input type="checkbox"/>	208VAC <input type="checkbox"/>	240VAC <input type="checkbox"/>	277VAC <input type="checkbox"/>
Three phase (4 wire + ground, Y)	120/208VAC <input type="checkbox"/>	277/480V <input type="checkbox"/>		
Three phase (3 wire + ground, Δ)	208VAC <input type="checkbox"/>	480VAC <input type="checkbox"/>		

2) Output voltage

Single phase (2 wire + ground)	120VAC <input type="checkbox"/>	208VAC <input type="checkbox"/>	277VAC <input type="checkbox"/>
Single phase (3 wire + ground)	120/240V <input type="checkbox"/>	120/277 <input type="checkbox"/>	
Three phase (4 wire + ground, Y)	120/208VAC <input type="checkbox"/>	277/480V <input type="checkbox"/>	

3) System capacity

KVA rating: _____ System series type _____

- a) Please consider power consumption and maximum current of the complete lamp fixture not just the lamp wattage (ie: ballasts consumption)
- b) Please consider loads power factor
- c) Even if the systems can run with 100% load, it is recommended as standard practice to use a system with a capacity at least 10% over maximum connected load

4) Type of loads

Incandescent ☐ Fluorescent ☐ H.I.D (metal halide, high pressure sodium, etc.) ☐

☐ Other _____

5) Mode of operation

Normally ON (24/7) ☐ Normally OFF (emergency only) ☐ Switched loads ON/OFF ☐

- a) Please consider internal bypass relays or external override relays for switched On/Off loads. Each switched output circuit will require a bypass relay. Maximum 20 A per circuit.

6) Integrated output circuit breakers

of CB _____ Amps _____ Voltage _____ # of poles _____ NON ☐ NOFF ☐ Trip alarm ☐

of CB _____ Amps _____ Voltage _____ # of poles _____ NON ☐ NOFF ☐ Trip alarm ☐

7) Type of batteries (check availability for each type system)

10 yr sealed lead calcium ☐ 20 yr sealed lead calcium ☐ Wet nickel cadmium ☐

8) Options (refer to available options for each type system)

- | | |
|--|--|
| <input type="checkbox"/> 12HR- 12 hr fast recharge | <input type="checkbox"/> NOFF – normally OFF output |
| <input type="checkbox"/> MBYP- internal bypass switch | <input type="checkbox"/> MOD- external modem |
| <input type="checkbox"/> EMBP- external bypass switch | <input type="checkbox"/> FAX- fax modem |
| <input type="checkbox"/> RMP- remote metering panel | <input type="checkbox"/> BPR- bypass relays How many _____ |
| <input type="checkbox"/> RSAP- remote summary alarm panel | <input type="checkbox"/> SEIS- seismic mounting |
| <input type="checkbox"/> DCS- dry summary alarm contacts | <input type="checkbox"/> ZONEM- zone monitoring |
| <input type="checkbox"/> INVON- inverter on dry contacts | <input type="checkbox"/> VTD- Time delay, 15 minutes |
| <input type="checkbox"/> RS232- diagnostic interface | |
| <input type="checkbox"/> BATM – battery cycle warranty monitor | |

Accessories & general information

We provide everything you need for complete emergency lighting solutions, including wire guards, mounting plates, remote test switches and more. To specify alternate lamps, lamp data includes part numbers and catalog suffixes. National Electrical Code and Life Safety Code requirements related to emergency lighting are also provided for your reference.

01 EPC Series
Emergency transfer
switch for generator and
mini inverters. Supplies
power to switched
lighting fixtures.

See page 145 for
more information






01





Table of contents

Accessories & general information


			
Wire guards 174	Accessories 176	Lamp Data 178	National Electrical Code 180
<hr/>			
			
	Life Safety Code 184	Limited warranty 188	Product index 190

Wire guards

Catalog number WG1-E

Application


- JS Series (small cabinet)
- Premier™ Battery Unit
- Premier™ Exit Sign (wall mount)
- Prestige™ DX Series
- Preceptor™ Die-Cast Series
- Prestige™ Thin Die-Cast Series

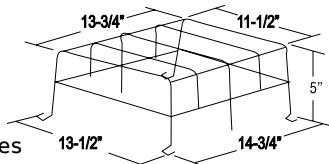

Catalog number WG5-E

Application


- X10 (end or ceiling mounted)
- AC and AC/DC or self-powered exit with no mounted heads
- Preceptor™ Series LED (AC and AC/DC or self-powered) (end or ceiling mounted)
- Prestige™ DX Series LED and Thin Die-Cast Series (end or ceiling mount)
- Premier™ Exit Sign (end or ceiling mount)



Catalog number WG2-E

Application


- JS Series (large cabinet)
- All A cabinets
- Premier™ Combo Series (wall mount)

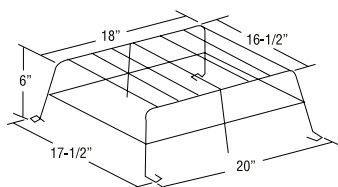

Catalog number WG6-E

Application


- X10 mini systems (wall mounted)
- with front mounted EF9 head(s) (wall mounted)

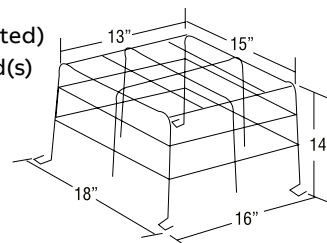


Catalog number WG3-E

Application

- All B and C cabinets

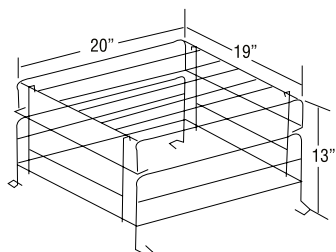


Catalog number WG7-E

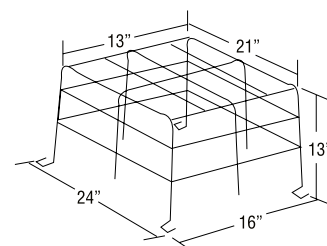

Catalog number WG4-E

Application


- All D cabinets

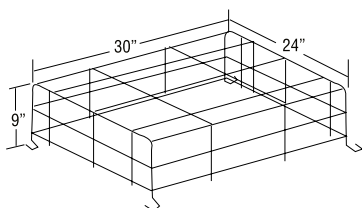

Catalog number WG8-E


Application

- Single remote EF10

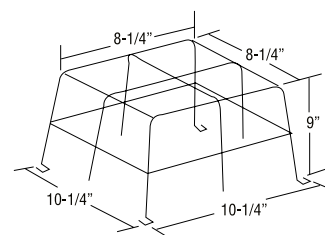


Catalog number**WG9-E****Application**


- Double or triple remote EF10, lighting heads

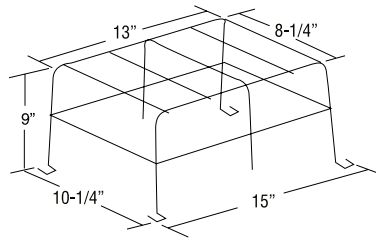**Catalog number WG13-E****Application**


- PRO-2N Series
- Preceptor™ Series Self-Powered (wall mount)

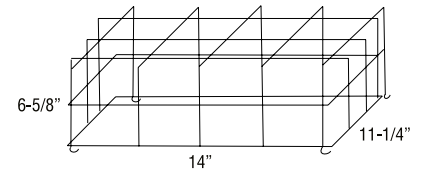**Catalog number WG10-E****Application**


- JS Series with front mounted heads

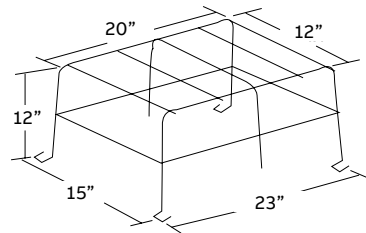**Catalog number WG14-E****Application****Exit signs****(ceiling mount)**


- Prestige™ Floor Proximity Series (6" & 8");
- Preceptor™ Die-Cast Series;
- Prestige™ Thin Die-Cast Series;
- X10 LED Series,
- Premier™ Exit Series;

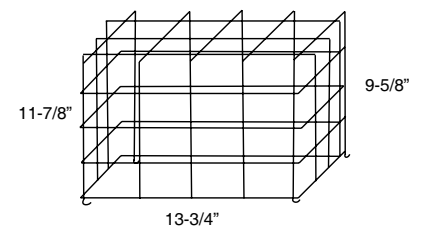**Catalog number WG11-E****Application**


- GS Series
- Fully recessed Preceptor™ Series
- Prestige™ Thin Die Cast Exit Sign (wall mounted)

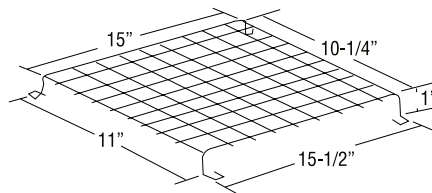**Catalog number WG12-E****Application**

- X10 Series LED (AC and AC/DC or Self-Powered) (wall mount)
- Preceptor™ Series LED (AC and AC/DC or Self-Powered) (wall mount)
- Prestige™ DX Series LED AC and AC/DC or Self-Powered (wall mount)

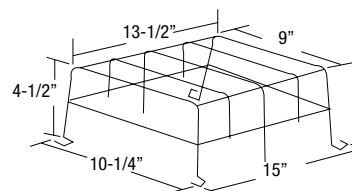**Catalog number WG15-E****Application****Exit signs****(ceiling mount)**

- Prestige™ Floor Proximity Series (6" & 8");
- Preceptor™ Die-Cast Series;
- Prestige™ Thin Die-Cast Series;
- X10 LED Series,
- Premier™ Exit Series;

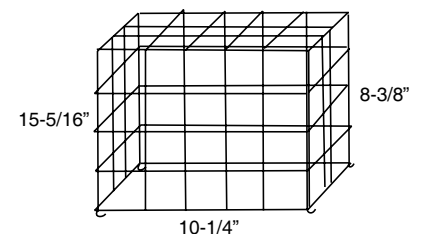


Accessories

Catalog number VRS or VRS-4X

Application


- ME Series with top mounted heads
- PS Series all mountings
- X10 LED, (wall mounted) AC and AC/DC or self-powered exit with no mounted heads
- ECL Series LED (wall mounted) AC and AC/DC or self-powered
- Preceptor™ Series LED, (wall mounted) AC and AC/DC

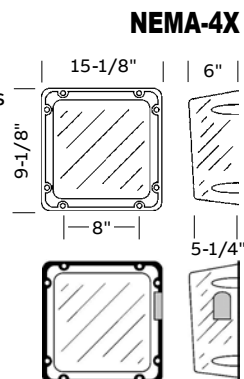

Catalog number VRS-BB or VRSBB-4X

Application

- JS Series (small cabinet) top or front mounted heads
- ECC & ECM Series (small cabinet)

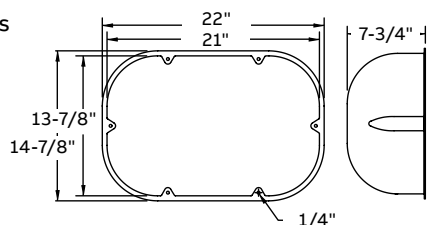

Remote test switch

Make testing your ceiling mounted equipment easier with the remote test switch. Compatible with 120 or 277 VAC circuits, the remote test switch will interrupt the line voltage to your equipment by means of a momentary push button switch. AC on/Charge status indicator lamp assures that power is going to your emergency lighting.


How to order

Metal faceplate, chrome

RTS

Plastic Faceplate plastic, off white

RTS-1



B1 and B12 mounting brackets

Constructed of 16 gauge. steel, the B1 and B2 mounting bracket will accommodate our unit equipment in our 'A' and 'B' cabinets respectively.


How to order

Mounting bracket (off white)

B1

Mounting bracket (off white)

B2

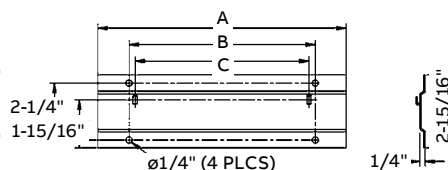

Dimensions (inches)

Part #	A	B	B
B1	10"	7"	7-1/2"
B2	14-1/4"	11-3/4"	12-5/8"

MP3 mounting platform

Constructed of 18 gauge. steel, the MP3 mounting platform will accommodate all our unit equipment in our 'B' cabinet.


How To Order

Mounting platform

Mounting platform, gray

MP3-EG

MP3-GY

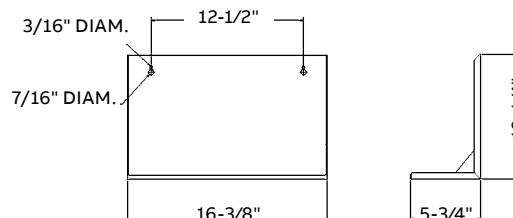

MP6, MP12, MP24 mounting platform

Constructed of 18 gauge. steel, the MP6, MP12, and MP24 mounting platform will accommodate our unit equipment in our 'C', 'D', and 'E' cabinets respectively.

How to order

Mounting platform (off white)

Mounting platform (off white)


Mounting platform (off white)

MP6-EG

MP12

MP24

Optional colors available, contact your sales representative

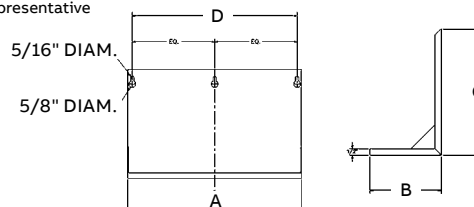

Dimensions (inches)

Part #	A	B	B	D
MP6	17"	7.75"	12.25"	16"
MP12	27.5"	7.75"	12.25"	16"
MP24	27.5"	11.63"	12.25"	16"

230.1238-E & 230.1239-E

- Single, double or triple round
- Thermoplastic construction
- Off-white or black finish only
- Mount direct to 4" octagonal box

Dimensions:

5" diameter - slotted mounting holes
3 to 3-9/16" mounting center

Standard: EF18, EF18D; and EF9, EF9D

Off-White - 230.1238-E



Black - 230.1239-E

**450.0129-E, 450.0397-E & 450.0398-E**

- Single, double or triple rectangular
- Single, triple or 4-gang steel construction
- Chrome plated finish only
- Mount direct to standard outlet box

Dimensions:

Single - 2-3/4" X 4-1/2" (for 1 fixture)

3-gang - 6-7/16" X 4-1/2" (for 2 fixtures)

4-gang - 8-3/8" X 4-1/2" (for 3 fixtures)

Standard: EF28, EF28D; EF18T and EF28T


450.0129-E
No square hole
450.0194-E - 1/2"
Square hole



450.0397-E
No square hole
450.1153-E - 1/2"
Square hole



450.0398-E
No square hole
450.1155-E - 1/2"
Square hole

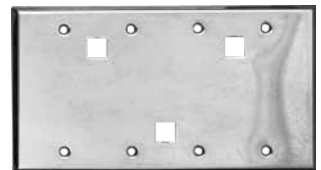**330.7583-E & 330.7584-E**

- Single or double round
- Die-cast aluminum construction
- Gasketed weatherproof
- Off-white or black powder paint finish only
- Mount direct to 4" octagonal box

Dimensions:

4-1/8" diameter

3-9/16" mounting center

Standard: EF11 and EF11D

Off-white single
330.7583-E



Black single
330.7577-E



Off-white double
330.7584-E



Black double
330.7578-E



Gasket - 245.0100-E

12804-E & 12805-E

- Single or double rectangular
- Die-cast aluminum construction
- Gasketed weatherproof
- Silver gray enamel finish only
- Mount direct to standard outlet box

Dimensions:

4-5/8" X 2-7/8"

3-1/4" mounting center

Standard: Non standard mounting plate

12804-E



12805-E




Lamp Data

Emergency Lighting is required to provide illumination for a minimum of 90 minutes or an hour and a half during an emergency situation. Emergency Lighting lamps powered from a DC battery source must be powered by a battery that has the capacity to power all the lamps using that battery source for a minimum of 90 minutes. It is important to choose the correct lumen output lamp to meet the required illumination at the floor level on a path of egress. It is equally important to match the lamp and the battery voltages. If you do not have a battery that is the same voltage as the lamp and with enough wattage capacity to illuminate all the lamps, then the lamps will not provide adequate lumen output for 90 minutes to meet the required illumination at floor level along the path of egress.

First, match voltage. The voltage of the lamp must exactly match the voltage of the battery powering that lamp. If the voltage of the battery is lower than the voltage of the lamp, the lamp may not illuminate. If the voltage of the battery is higher than the voltage of the lamp, the lamp may “pop”.

Second, consider total wattage. The wattage of each individual lamp drawing from a battery during emergency operation, including the lamps mounted on the unit as well as all remote lamps wired to that unit, added together, CAN NOT EXCEED the total wattage capacity of that battery within 90 minutes of operation. A unit’s battery wattage capacities are shown in the Unit Rating Chart of each particular unit.

Available lamp types are shown on the Lamp Selection Chart on the catalog page for each head style or fixture type. Lamp Selection Chart information refers to a single lamp. If you are using a double or triple lamp type head or fixture, the wattage draw of that head or fixture will be the total number of lamps used. For example, if you are using a double lamp fixture with a 12W lamp, that fixture will have a 24W draw (two lamps of 12W each, 12W + 12W = 24W total).

Lamp type	Part number	Lamp suffix	Voltage	Watts	Average lumen	Total candle power (CP)	Lamp #	Bulb type
<div>MR16 LED Lamps</div> <div></div>	580.0097	LA	6	4	199	600	24	MR16
	580.0093	LG	12	4	222	440	30	MR16
	580.0104	LI	12	5	340	900	24	MR16
	580.0106	LJ	12	6	540	1800	25	MR16
	580.0098	LL	24	4	223	900	24	MR16
	580.0100	LM	24	6	590	1939	24	MR16
	580.0113	LW	120	4	235	110	22	MR16
	580.0095	LV	120	4	204	900	24	MR16

Explosion-proof incandescent lamps

Item P/N	Catalog suffix	Voltage	Watts	Lumen	Lamp #
580.0086	XX6	6	15	225	JC-6V15W
570.0071	XX12	12	25	378	–
570.0118	XX24	24	25	345	–
570.0136	AC	120	25	215	–
540.0180	XX120	120	5	–	Red LED

Emergency lighting is a vital and effective life safety tool, providing reassurance and guidance to people at critical times when they need to escape quickly and safely from a building.



National Electrical Code

ARTICLE 700 – EMERGENCY SYSTEMS

I. General

700.1. Scope

The provisions of this article apply to the electrical safety of the installation, operation, and maintenance of emergency systems consisting of circuits and equipment intended to supply, distribute, and control electricity for illumination or power, or both, to required facilities when the normal electrical supply or system is interrupted.

(FPN No. 1): For further information regarding wiring and installation of emergency systems in health care facilities, see Article 517.

(FPN No. 2): For further information regarding performance and maintenance of emergency systems in health care facilities, see Standard for Health Care Facilities, NFPA 99-2012.

(FPN No. 3): Emergency systems are generally installed in places of assembly where artificial illumination is required for safe exiting and for panic control in buildings subject to occupancy by large numbers of persons, such as hotels, theaters, sports arenas, health care facilities, and similar institutions. Emergency systems may also provide power for such functions as ventilation where essential to maintain life, fire detection and alarm systems, elevators, fire pumps, public safety communications systems, industrial processes where current interruption would produce serious life safety or health hazards, and similar functions.

(FPN No. 4): For specification of locations where emergency lighting is considered essential to life safety, see Life Safety Code, NFPA 101-2012.

(FPN No. 5): For further information regarding performance of emergency and standby power systems, see Standard for Emergency and Standby Power Systems, NFPA 110-1999.

700.2. Definitions

Emergency Systems. Those systems legally required and classed as emergency by municipal, state, federal or other codes, or by any governmental agency having jurisdiction. These systems are intended to automatically supply illumination, power or both, to designated areas and equipment in the event of failure of the normal supply or in the event of accident to elements of a system intended to supply, distribute, and control power and illumination essential for safety to human life.

Informational Note: Emergency systems are generally installed in places of assembly where artificial illumination is required for safe exiting and for panic control in buildings subject to occupancy by large numbers of persons, such as hotels, theatres, sports, arenas, health care facilities, and similar institutions. Emergency systems may also provide power for such functions as ventilation where essential to maintain life, fire detection and alarm systems, elevators, fire pumps, public safety communications systems, industrial processes where current interruption would produce serious life safety or health hazards, and similar functions.

Relay automatic Load Control. A device used to set normally dimmed or normally-off switched emergency lighting equipment to full power illumination levels in the event of a loss of the normal supply by bypassing the dimming/switching controls, and to return the emergency lighting equipment to normal status when the device senses the normal supply has been restored.

Informational Note: See ANSI/UL 924, Emergency Lighting and Power Equipment, for the requirements covering automatic load control relays.

700.3. Tests and Maintenance

(A) Conduct or Witness Test. The authority having jurisdiction shall conduct or witness a test of the complete system upon installation and periodically afterward.

(B) Tested Periodically. Systems shall be tested periodically on a schedule acceptable to the authority having jurisdiction to ensure the systems are maintained in proper operating condition.

(C) Battery Systems Maintenance. Where battery systems or unit equipment are involved, including batteries used for starting, control, or ignition in auxiliary engines, the authority having jurisdiction shall require periodic maintenance.

(D) Written Record. A written record shall be kept of such tests and maintenance.

(E) Testing Under Load. Means for testing all emergency lighting and power systems during maximum anticipated load conditions shall be provided.

Informational Note: For information on testing and maintenance of emergency power supply systems (EPSSs), see NFPA 110-2013, Standard for Emergency and Standby Power Systems.

700.4. Capacity

(A) Capacity and Rating. An emergency system shall have adequate capacity and rating for all loads to be operated simultaneously. The emergency system equipment shall be suitable for the maximum available fault current at its terminals.

(B) Selective Load Pickup, Load Shedding, and Peak Load Shaving. The alternate power source shall be permitted to supply emergency, legally required standby, and optional standby system loads where the source has adequate capacity or where automatic selective load pickup and load shedding is provided as needed to ensure adequate power to (1) the emergency circuits; (2) the legally required standby circuits; and (3) the optional standby circuits, in that order of priority. The alternate power source shall be permitted to be used for peak load shaving, provided the above conditions are met.

Peak load shaving operation shall be permitted for satisfying the test requirement of Section 700.3(B), provided all other conditions of Section 700.3 are met. A portable or temporary alternate source shall be available whenever the emergency generator is out of service for major maintenance or repair.

700.5. Transfer Equipment

(A) General. Transfer equipment, including automatic transfer switches, shall be automatic and identified for emergency use and approved by the authority having jurisdiction. Transfer equipment shall be designed and installed to prevent the inadvertent interconnection of normal and emergency sources of supply in any operation of the transfer equipment. Transfer equipment and electric power production systems installed to permit operation in parallel with the normal source shall meet the requirements of article 705.

(B) Bypass Isolation Switches. Means shall be permitted to bypass and isolate the transfer equipment. Where bypass isolation switches are used, inadvertent parallel operation shall be avoided.

(C) Automatic transfer switches shall be electrically operated and mechanically held. Automatic transfer switches, rated 1000 VAC and below, shall be listed for emergency system use.

(D) Use. Transfer equipment shall supply only emergency loads.

700-6. Signals.

Audible and visual signal devices shall be provided, where practicable, for the following purposes described in 700.6(A) through (D).

(A) Derangement. To indicate derangement of the emergency source.

(B) Carrying Load. To indicate that the battery is carrying load.

(C) Not Functioning. To indicate that the battery charger is not functioning.

(D) Ground Fault. To indicate a ground fault in solidly grounded wye emergency systems of more than 150 volts to ground and circuit protective devices rated 1000 amperes or more. The sensor for the ground-fault signal devices shall be located at, or ahead of, the main system disconnecting means for the emergency source, and the maximum setting of the signal devices shall be for a ground-fault current of 1200 amperes. Instructions on the course of action to be taken in event of indicated ground fault shall be located at or near the sensor location.

Informational Note: For signals for generator sets, see NFPA 110-2013, Standard for Emergency and Standby Power Systems

700.7. Signs

(A) Emergency Sources. A sign shall be placed at the service entrance equipment indicating type and location of on-site emergency power sources.

Exception: A sign shall not be required for individual unit equipment as specified in Section 700-12(F).

(B) Grounding. Where removal of a grounding or bonding connection in the normal power source equipment interrupts the grounding electrode conductor connection to the alternate power source(s) grounded conductor, a warning sign shall be installed at the normal power source equipment stating:

WARNING

SHOCK HAZARD EXISTS IF GROUNDING ELECTRODE CONDUCTOR OR BONDING JUMPER CONNECTION IN THIS EQUIPMENT IS REMOVED WHILE ALTERNATE SOURCE(S) IS ENERGIZED.

The warning sign(s) or label(s) shall comply with 110.21(B).

700.8 Emergency Sources

A listed SPD shall be installed in or on all emergency systems switchboards and panelboards.

II. Circuit Wiring

700-10. Wiring, Emergency System.

(A) Identification. All boxes and enclosures (including transfer switches, generators, and power panels) for emergency circuits shall be permanently marked so they will be readily identified as a component of an emergency circuit or system.

(B) Wiring. Wiring of two or more emergency circuits supplied from the same source shall be permitted in the same raceway, cable, box, or cabinet. Wiring from an emergency source distribution overcurrent protection to emergency loads shall be kept entirely independent of all other wiring and equipment, unless otherwise permitted in 700.10(B) (1) through (5):

- (1) Wiring from the normal power source located in transfer equipment enclosures.
- (2) Wiring supplied from two sources in exit or emergency luminaires
- (3) Wiring from two sources in a listed load control relay supplying exit or emergency luminaires, or in a common junction box, attached to exit or emergency luminaires
- (4) Wiring within a common junction box attached to unit equipment, containing only the branch circuit supplying the unit equipment and the emergency circuit supplied by the unit equipment.
- (5) Wiring from an emergency source to supply emergency and other loads in accordance with 700.10(B)(5)a, b, c, and d as follows:
 - a. Separate vertical switchgear sections or separate vertical switchboard sections, with or without a common bus, or individual disconnects mounted in separate enclosures shall be used to separate emergency loads from all other loads.
 - b. The common bus of separate sections of the switchgear, separate sections of the switchboard, or the individual enclosures shall be permitted to be supplied by single or multiple feeders without overcurrent protection at the source.

Exception to (5)b: Overcurrent protection shall be permitted at the source or for the equipment, provided the overcurrent protection complies with the requirements of 700.28.

- c. Legally required and optional standby circuits shall not originate from the same vertical switchboard section, panel board enclosure, or individual disconnect enclosure as emergency circuits.
- d. It shall be permissible to utilize single or multiple feeders to supply distribution equipment between an emergency source and the point where the combination of emergency, legally required, or optional loads are separated.

(C) Wiring Design and Location. Emergency wiring circuits shall be designed and located to minimize the hazards that might cause failure due to flooding, fire, icing, vandalism, and other adverse conditions.

(D) Fire Protection. Emergency systems shall meet the following additional requirements (D)(1) through (D)(3) in assembly occupancies for not less than 1000 persons or in buildings above 23 m (75 ft) in height.

Informational Note: For the definition of Occupancy Classification, see Section 6.1 of NFPA 101-2009, Life Safety Code

(1) Feeder-circuit wiring shall meet one of the following conditions:

- (1) Be installed in spaces or areas that are fully protected by an approved automatic fire suppression system.
- (2) Be listed electrical circuit protective system with a minimum 2-hour fire rating. Informational note: UL guide information for electrical circuit protective systems (FHIT) contains information on proper installation requirements to maintain the fire rating
- (3) Be protected by a listed thermal barrier system for electrical system components with a minimum 2-hour fire rating.
- (4) Be protected by a listed fire-rated assembly that has a minimum fire rating of 2 hours and contains only emergency wiring circuits
- (5) Be encased in a minimum of 50 mm (2 in) of concrete

(2) Feeder-Circuit Equipment. Equipment for feeder circuits (including transfer switches, transformers, panel boards) shall be either located in spaces fully protected by approved automatic fire suppression systems (including sprinklers and carbon dioxide systems) or in spaces with a 2-hour fire resistance rating.

(3) Generator Control Wiring. Control conductors installed between the transfer equipment and the emergency generator shall be kept entirely independent of all other wiring and shall meet the conditions of 700.10(D)(1)

III. Sources of Power

700.12. General Requirements. Current supply shall be such that, in the event of failure of the normal supply to, or within, the building or group of buildings concerned, emergency lighting, emergency power, or both will be available within the time required for the application but not to exceed 10 seconds. The supply system for emergency purposes, in addition to the normal services to the building and meeting the general requirements of this section, shall be one or more of the types of systems described in 700.12(A) through (D) below. Unit equipment in accordance with Section 700.12(E) shall satisfy the applicable requirements of this article.

In selecting an emergency source of power, consideration shall be given to the occupancy and the type of service to be rendered, whether of minimum duration, as for evacuation of a theater, or longer duration, as for supplying emergency power and lighting due to an indefinite period of current failure from trouble either inside or outside the building. Equipment shall be designed and located to minimize the hazards that might cause complete failure due to flooding, fires, icing, and vandalism. Equipment for sources of power as described in Sections 700.12(A) through (E) where located within assembly occupancies for greater than 1000 persons or in buildings above 23 m (75 ft) in height with any of the following occupancy classes: assembly, educational, residential, detention and correctional, business, and mercantile, shall be installed either in spaces fully protected by approved automatic fire suppression systems (sprinklers, carbon dioxide systems, and so forth), or in spaces with a 1-hour fire rating.

Informational note No. 1: For definition of Occupancy Classification, see Section 6.1 of NFPA 101-2012, Life Safety Code.

National Electrical Code

Informational note No. 2: For further information, see ANSI/IEEE 493-2007, Recommended Practice for the Design of Reliable Industrial and Commercial Power Systems.

(A) Storage Battery.

Storage batteries used as source of power for emergency systems shall be of suitable rating and capacity to supply and maintain the total load for a period of 1-1/2 hours minimum, without the voltage applied to the load falling below 87-1/2 percent of normal.

Batteries, whether of the acid or alkali type, shall be designed and constructed to meet the requirements of emergency service and shall be compatible with the charger for that particular installation.

For a sealed battery, the container shall not be required to be transparent. However, for the lead acid battery that requires water additions, transparent or translucent containers shall be furnished. Automotive-type batteries shall not be used.

An automatic battery charging means shall be provided.

(B) Generator Set.

(1) Prime Mover-Driven. For a generator set driven by a prime mover acceptable to the authority having jurisdiction and sized in accordance with Section 700-4. Means shall be provided for automatically starting the prime mover on failure of the normal service and for automatic transfer and operation of all required electrical circuits. A time-delay feature permitting a 15-minute setting shall be provided to avoid retransfer in case of short-time reestablishment of the normal source.

(2) Internal Combustion Engines as Prime Movers. Where internal combustion engines are used as the prime mover an on-site fuel supply shall be provided with an on-premise fuel supply sufficient for not less than 2 hours full-demand operation of the system. Where power is needed for the operation of the fuel transfer pumps to deliver fuel to a generator set dry tank, this pump shall be connected to the emergency power system.

(3) Dual Supplies. Prime movers shall not be solely dependent upon a public utility gas system for their fuel supply or municipal water supply for their cooling systems. Means shall be provided for automatically transferring from one fuel supply to another where dual fuel supplies are used.

Exception: Where acceptable to the authority having jurisdiction, the use of other than on-site fuels shall be permitted where there is a low probability of a simultaneous failure of both the off-site fuel delivery system and power from the outside electrical utility company.

(4) Where a storage battery is used for control or signal power, or as the means of starting the prime mover, it shall be suitable for the purpose and shall be equipped with an automatic charging means independent of the generator set. Where the battery charger is required for the operation of the generator set, it shall be connected to the emergency system. Where power is required for the operation of dampers used to ventilate the generator set, the dampers shall be connected to the emergency system.

(5) Auxiliary Power Supply. Generator sets that require more than 10 seconds to develop power shall be permitted is an auxiliary power supply energizes the emergency system until the generator can pick up the load.

(6) Outdoor Generator Sets. Where an outdoor housed generator set is equipped with a readily accessible disconnecting means in accordance with 445.18, and the disconnecting means is located within sight of the building or structure supplied, an additional disconnecting means shall not be required where ungrounded conductors serve or pass through the building or structure. Where the generator supply conductors terminate at a disconnecting means in or on a building or structure, the disconnecting means shall meet the requirements of 225.36.

Exception: For installations under single management where conditions of maintenance and supervision ensure that only qualified persons will monitor and service the installation and where documented safe switching procedures are established and maintained for disconnection, the generator set disconnecting means shall not be required to be located within sight of the building of structure served.

(C) Uninterruptible Power Supplies. Uninterruptible power supplies used to provide power for emergency systems shall comply with the applicable provisions of Sections 700-12(A) and (B).

(D) Separate Service. Where acceptable to the authority having jurisdiction as suitable for use as an emergency source of power, an additional service shall be permitted. This service shall be in accordance with the applicable provisions of Article 230 and following additional requirements.

(1) Separate overhead service conductors, service drops, underground service conductors, or service laterals shall be installed

(2) The service conductors for the separate service shall be installed sufficiently remote electrically and physically from any other service conductors to minimize the possibility of simultaneous interruption of supply

(E) Fuel Cell System. Fuel Cell Systems used as a source of power for emergency systems shall be of suitable rating and capacity to supply and maintain the total load for not less than 2 hours of full demand operation.

Installation of a fuel cell system shall meet the requirements of Parts II through VIII of Article 692. Where a single fuel cell system serves as the normal supply for the building or group of buildings concerned, it shall not serve as the sole source of power for the emergency standby system.

(F) Unit Equipment.

(1) Components of Unit Equipment. Individual unit equipment for emergency illumination shall consist of the following:

(1) A rechargeable battery

(2) A battery charging means

(3) Provisions for one or more lamps mounted on the equipment, or shall be permitted to have terminals for remote lamps, or both and

(4) A relaying device arranged to energize the lamps automatically upon failure of the supply to the unit equipment.

(2) Installation of Unit Equipment. Unit equipment shall be installed in accordance with 700.12(F)(2)(1) through (6).

(1) The batteries shall be of suitable rating and capacity to supply and maintain at not less than 87-1/2 percent of the nominal battery voltage for the total lamp load associated with the unit for a period of at least 1-1/2 hours, or the unit equipment shall supply and maintain not less than 60 percent of the initial emergency illumination for a period of at least 1-1/2 hours. Storage batteries, whether of the acid or alkali type, shall be designed and constructed to meet the requirements of emergency service.

(2) Unit equipment shall be permanently fixed in place (i.e., not portable) and shall have all wiring to each unit installed in accordance with the requirements of any of the wiring methods in Chapter 3. Flexible cord and plug connection shall be permitted, provided that the cord does not exceed 900 mm (3 ft) in length.

(3) The branch circuit feeding the unit equipment shall be the same branch circuit as that serving the normal lighting in the area and connected ahead of any local switches.

Exception : In a separate and uninterrupted area supplied by a minimum of three normal lighting circuits, a separate branch circuit for unit equipment shall be permitted if it

originates from the same panelboard as that of the normal lighting circuits and is provided with a lock-on feature.

- (4) The branch circuit that feeds unit equipment shall be clearly identified at the distribution panel.
- (5) Emergency luminaire's (illumination fixtures) that obtain power from a unit equipment and are not part of the unit equipment shall be wired to the unit equipment as required by Section 700-10 and by one of the wiring methods of Chapter 3.
- (6) Remote heads providing lighting for the exterior of an exit door shall be permitted to be supplied by the unit equipment serving the area immediately inside the exit door

IV. Emergency System Circuits for Lighting and Power

700.15.

Loads on Emergency Branch Circuits. No appliances and no lamps, other than those specified as required for emergency use, shall be supplied by emergency lighting circuits.

700.16.

Emergency illumination. Emergency illumination shall include all required means of egress lighting, illuminated exit signs, and all other lights specified as necessary to provide required illumination.

Emergency lighting systems shall be designed and installed so that the failure of any individual lighting element, such as the burning out of a light bulb, cannot leave in total darkness any space that requires emergency illumination.

Where high-intensity discharge lighting such as high- and low-pressure sodium mercury vapor, and metal halide is used as the sole source of normal illumination, the emergency lighting system shall be required to operate until normal illumination has been restored. Where an emergency system is installed, emergency illumination shall be provided in the area of the disconnecting means required by 225.31 and 230.70, as applicable, where the disconnecting means are installed indoors.

Exception: Where alternative means that ensure the emergency lighting illumination level is maintained shall be permitted.

700.17. Branch Circuits for Emergency Lighting. Branch circuits that supply emergency lighting shall be installed to provide service from a source complying with Section 700-12 when the normal supply for lighting is interrupted. Such installations shall provide either one of the following:

- (1) An emergency lighting supply, independent of the normal lighting supply, with provisions for automatically transferring the emergency lights upon the event of failure of the normal lighting branch circuit
- (2) Two or more branch circuits supplied from separate and complete systems with independent power sources. One of the two power sources and systems shall be part of the emergency system and the other shall be permitted to be part of the normal power source and system. Each system shall provide sufficient power for emergency lighting purposes.

Unless both systems are used for regular lighting purposes and are both kept lighted, means shall be provided for automatically energizing either system upon failure of the other. Either or both systems shall be permitted to be a part of the general lighting of the protected occupancy if circuits supplying lights for emergency illumination are installed in accordance with other sections of this article.

700.18. Circuits for Emergency Power. For branch circuits that supply equipment classed as emergency, there shall be an emergency supply source to which the load will be transferred automatically upon the failure of the normal supply.

V. Control—Emergency Lighting Circuits

700.19. Multiwire Branch Circuits. The branch circuit serving emergency lighting and power circuits shall not be part of a multiwire branch circuit.

700.20. Switch Requirements. The switch or switches installed in emergency lighting circuits shall be arranged so that only authorized persons will have control of emergency lighting.

Exception No. 1: Where two or more single-throw switches are connected in parallel to control a single circuit, at least one of these switches shall be accessible only to authorized persons.

Exception No. 2: Additional switches that act only to put emergency lights into operation but not disconnect them shall be permissible. Switches connected in series or 3- and 4-way switches shall not be used.

700.21. Switch Location. All manual switches for controlling emergency circuits shall be in locations convenient to authorized persons responsible for their actuation. In facilities covered by Articles 518 and 520, a switch for controlling emergency lighting systems shall be located in the lobby or at a place conveniently accessible thereto. In no case shall a control switch for emergency lighting be placed in a motion-picture projection booth or on a stage or platform. Exception: Where multiple switches are provided, one such switch shall be permitted in such locations where arranged so that it can energize the circuit only, but cannot deenergize the circuit.

700.22. Exterior Lights. Those lights on the exterior of a building that are not required for illumination when there is sufficient daylight shall be permitted to be controlled by an automatic light-actuated device.

700.23 Dimmer Systems. A dimmer or relay system containing more than one dimmer or relay and listed for use in emergency systems shall be permitted to be used as a control device for energizing emergency lighting circuits. Upon failure of normal power, the dimmer or relay system shall be permitted to selectively energize only those branch circuits required to provide minimum emergency illumination. All branch circuits supplied by the dimmer or relay system cabinet shall comply with the wiring methods of Article 700.

700.24 Automatic Load Control Relay. Where emergency illumination is provided by one or more directly controlled luminaires that respond to an external control input to bypass normal control upon loss of normal power, such luminaires and external bypass controls shall be individually listed for use in emergency systems.

700.25 Automatic Load Control Relay. If an emergency lighting load is automatically energized upon loss of the normal supply, a listed automatic load control relay shall be permitted to energize the load. The load control relay shall not be used as transfer equipment.

VI. Overcurrent Protection

700-26. Accessibility. The branch-circuit overcurrent devices in emergency circuits shall be accessible to authorized persons only.

700-27. Ground-Fault Protection of Equipment. The alternate source for emergency systems shall not be required to have ground-fault protection of equipment with automatic disconnecting means. Ground-fault indication of the emergency source shall be provided in accordance with 700.6(D) if ground-fault protection of equipment with automatic disconnecting means is not provided. Exception: Selective coordination shall not be required between two overcurrent devices located in series if no loads are connected in parallel with the downstream device.

National Electrical Code© 2014 National Electrical Code® is a registered trademark of the National Fire Protection Association.

Life Safety Code

7.8 Illumination of Means of Egress.

7.8.1 General.

7.8.1.1* Illumination of means of egress shall be provided in accordance with Section 7.8 for every building and structure where required in Chapters 11 through 43. For the purposes of this requirement, exit access shall include only designated stairs, aisles, corridors, ramps, escalators, and passageways leading to an exit. For the purposes of this requirement, exit discharge shall include only designated stairs, aisles, corridors, ramps, escalators, walkways, and exit passageways leading to a public way.

7.8.1.2 Illumination of means of egress shall be continuous during the time that the conditions of occupancy require that the means of egress be available for use, unless otherwise provided in 7.8.1.2.2.

7.8.1.2.1 Artificial lighting shall be employed at such locations and for such periods of time as are necessary to maintain the illumination to the minimum criteria values herein specified.

7.8.1.2.2 Unless prohibited by Chapters 11 through 43, automatic lighting control devices shall be permitted to temporarily turn off the illumination within the means of egress, provided that each lighting control device complies with all of the following:

- (1) In new installations, the lighting control device is listed.
- (2) The lighting control device is equipped to automatically energize the controlled lights upon loss of normal power and is evaluated for this purpose.
- (3) Illumination timers are provided and are set for a minimum 15-minute duration.
- (4) The lighting control device is activated by any occupant movement in the area served by the lighting units.
- (5) In new installations, the lighting control device is activated by activation of the building fire alarm system, if provided.
- (6) The lighting control device does not turn off any lights relied upon for activation of photoluminescent exit signs or path markers.
- (7) The lighting control device does not turn off any battery equipped emergency luminaires, unit equipment, or exit signs.

7.8.1.2.3* Energy-saving sensors, switches, timers, or controllers shall be approved and shall not compromise the continuity of illumination of the means of egress required by 7.8.1.2.

7.8.1.3* The floors and other walking surfaces within an exit and within the portions of the exit access and exit discharge designated in 7.8.1.1 shall be illuminated as follows:

- (1) During conditions of stair use, the minimum illumination for new stairs shall be at least 10 ft-candle (108 lux), measured at the walking surfaces.
- (2) The minimum illumination for floors and other walking surfaces, other than new stairs during conditions of stair use, shall be to values of at least 1 ft-candle (10.8 lux), measured at the floor.
- (3) In assembly occupancies, the illumination of the walking surfaces of exit access shall be at least 0.2 ft-candle (2.2 lux) during periods of performances or projections involving directed light.
- (4)*The minimum illumination requirements shall not apply where operations or processes require low lighting levels.

7.8.1.4* Required illumination shall be arranged so that the failure of any single lighting unit does not result in an illumination level of less than 0.2 ft-candle (2.2 lux) in any designated area.

7.8.1.5 The equipment or units installed to meet the requirements of Section 7.10 also shall be permitted to serve the function of illumination of means of egress, provided that all requirements of Section 7.8 for such illumination are met.

7.8.2 Sources of Illumination.

7.8.2.1* Illumination of means of egress shall be from a source considered reliable by the authority having jurisdiction.

7.8.2.2 Battery-operated electric lights and other types of portable lamps or lanterns shall not be used for primary illumination of means of egress. Battery-operated electric lights shall be permitted to be used as an emergency source to the extent permitted under Section 7.9.

7.9 Emergency Lighting.

7.9.1 General.

7.9.1.1* Emergency lighting facilities for means of egress shall be provided in accordance with Section 7.9 for the following:

- (1) Buildings or structures where required in Chapters 11 through 43
- (2) Underground and limited access structures as addressed in Section 11.7
- (3) High-rise buildings as required by other sections of this Code
- (4) Doors equipped with delayed-egress locks
- (5) Stair shafts and vestibules of smokeproof enclosures, for which the following also apply:
 - (a) The stair shaft and vestibule shall be permitted to include a standby generator that is installed for the smokeproof enclosure mechanical ventilation equipment.
 - (b) The standby generator shall be permitted to be used for the stair shaft and vestibule emergency lighting power supply.
- (6) New access-controlled egress doors in accordance with 7.2.1.6.2.

7.9.1.2 For the purposes of 7.9.1.1, exit access shall include only designated stairs, aisles, corridors, ramps, escalators, and passageways leading to an exit. For the purposes of 7.9.1.1, exit discharge shall include only designated stairs, ramps, aisles, walkways, and escalators leading to a public way.

7.9.1.3 Where maintenance of illumination depends on changing from one energy source to another, a delay of not more than 10 seconds shall be permitted.

7.9.2 Performance of System.

7.9.2.1 Emergency illumination shall be provided for a minimum of 1-1/2 hours in the event of failure of normal lighting.

7.9.2.1.1 Emergency lighting facilities shall be arranged to provide initial illumination that is not less than an average of 1 ft-candle (10.8 lux) and, at any point, not less than 0.1 ft-candle (1.1 lux), measured along the path of egress at floor level.

7.9.2.1.2 Illumination levels shall be permitted to decline to not less than an average of 0.6 ft-candle (6.5 lux) and, at any point, not less than 0.06 ft-candle (0.65 lux) at the end of 1-1/2 hours.

7.9.2.1.3 The maximum-to-minimum illumination shall not exceed a ratio of 40 to 1.

7.9.2.2 New emergency power systems for emergency lighting shall be at least Type 10, Class 1.5, Level 1, in accordance with NFPA110, Standard for Emergency and Standby Power Systems.

7.9.2.3* The emergency lighting system shall be arranged to provide the required illumination automatically in the event of any interruption of normal lighting due to any of the following:

- (1) Failure of a public utility or other outside electrical power supply
- (2) Opening of a circuit breaker or fuse
- (3) Manual act(s), including accidental opening of a switch controlling normal lighting facilities

7.9.2.4 Emergency generators providing power to emergency lighting systems shall be installed, tested, and maintained in accordance with NFPA 110, Standard for Emergency and Standby Power Systems. Stored electrical energy systems, where required in this Code, other than battery systems for emergency luminaires in accordance with 7.9.2.5, shall be installed and tested in accordance with NFPA 111, Standard on Stored Electrical Energy Emergency and Standby Power Systems.

7.9.2.5 Unit equipment and battery systems for emergency luminaires shall be listed to ANSI/UL 924, Standard for Emergency Lighting and Power Equipment.

7.9.2.6* Existing battery-operated emergency lights shall use only reliable types of rechargeable batteries provided with suitable facilities for maintaining them in properly charged condition. Batteries used in such lights or units shall be approved for their intended use and shall comply with NFPA 70, National Electrical Code.

7.9.2.7 The emergency lighting system shall be either continuously in operation or shall be capable of repeated automatic operation without manual intervention.

7.9.3 Periodic Testing of Emergency Lighting Equipment.

7.9.3.1 Required emergency lighting systems shall be tested in accordance with one of the three options offered by 7.9.3.1.1, 7.9.3.1.2, or 7.9.3.1.3.

7.9.3.1.1 Testing of required emergency lighting systems shall be permitted to be conducted as follows:

- (1) Functional testing shall be conducted monthly, with a minimum of 3 weeks and a maximum of 5 weeks between tests, for not less than 30 seconds, except as otherwise permitted by 7.9.3.1.1(2).
- (2)* The test interval shall be permitted to be extended beyond 30 days with the approval of the authority having jurisdiction.
- (3) Functional testing shall be conducted annually for a minimum of 11/2 hours if the emergency lighting system is battery powered.
- (4) The emergency lighting equipment shall be fully operational for the duration of the tests required by 7.9.3.1.1(1) and (3).
- (5) Written records of visual inspections and tests shall be kept by the owner for inspection by the authority having jurisdiction.

7.9.3.1.2 Testing of required emergency lighting systems shall be permitted to be conducted as follows:

- (1) Self-testing/self-diagnostic battery-operated emergency lighting equipment shall be provided.
- (2) Not less than once every 30 days, self-testing/self-diagnostic battery-operated emergency lighting equipment shall automatically perform a test with a duration of a minimum of 30 seconds and a diagnostic routine.
- (3) Self-testing/self-diagnostic battery-operated emergency lighting equipment shall indicate failures by a status indicator.
- (4) A visual inspection shall be performed at intervals not exceeding 30 days.
- (5) Functional testing shall be conducted annually for a minimum of 1-1/2 hours.
- (6) Self-testing/self-diagnostic battery-operated emergency lighting equipment shall be fully operational for the duration of the 11/2-hour test.
- (7) Written records of visual inspections and tests shall be kept by the owner for inspection by the authority having jurisdiction.

7.9.3.1.3 Testing of required emergency lighting systems shall be permitted to be conducted as follows:

- (1) Computer-based, self-testing/self-diagnostic battery-operated emergency lighting equipment shall be provided.
- (2) Not less than once every 30 days, emergency lighting equipment shall automatically perform a test with a duration of a minimum of 30 seconds and a diagnostic routine.
- (3) The emergency lighting equipment shall automatically perform annually a test for a minimum of 11/2 hours.
- (4) The emergency lighting equipment shall be fully operational for the duration of the tests required by 7.9.3.1.3(2) and (3).
- (5) The computer-based system shall be capable of providing a report of the history of tests and failures at all times.

7.10 Marking of Means of Egress.

7.10.1 General.

7.10.1.1 Where Required. Means of egress shall be marked in accordance with Section 7.10 where required in Chapters 11 through 43.

7.10.1.2 Exits.

7.10.1.2.1* Exits, other than main exterior exit doors that obviously and clearly are identifiable as exits, shall be marked by an approved sign that is readily visible from any direction of exit access.

7.10.1.2.2*

Horizontal components of the egress path within an exit enclosure shall be marked by approved exit or directional exit signs where the continuation of the egress path is not obvious.

7.10.1.3 Exit Door Tactile Signage. Tactile signage shall be provided to meet all of the following criteria, unless otherwise provided in 7.10.1.4:

- (1) Tactile signage shall be located at each exit door requiring an exit sign.
- (2) Tactile signage shall read as follows: EXIT.
- (3) Tactile signage shall comply with ICC/ANSI A117.1, American National Standard for Accessible and Usable Buildings and Facilities.

7.10.1.4 Existing Exemption. The requirements of 7.10.1.3 shall not apply to existing buildings, provided that the occupancy classification does not change.

7.10.1.5 Exit Access.

7.10.1.5.1 Access to exits shall be marked by approved, readily visible signs in all cases where the exit or way to reach the exit is not readily apparent to the occupants.

7.10.1.5.2* New sign placement shall be such that no point in an exit access corridor is in excess of the rated viewing distance or 100 ft (30 m), whichever is less, from the nearest sign.

7.10.1.6* Floor Proximity Exit Signs. Where floor proximity exit signs are required in Chapters 11 through 43, such signs shall comply with 7.10.3, 7.10.4, 7.10.5, and 7.10.6 for externally illuminated signs and 7.10.7 for internally illuminated signs. Such signs shall be located near the floor level in addition to those signs required for doors or corridors. The bottom of the sign shall be not less than 6 in. (150 mm), but not more than 18 in. (455 mm), above the floor. For exit doors, the sign shall be mounted on the door or adjacent to the door, with the nearest edge of the sign within 4 in. (100 mm) of the door frame.

7.10.1.7* Floor Proximity Egress Path Marking. Where floor proximity egress path marking is required in Chapters 11 through 43, an approved floor proximity egress path marking system that is internally illuminated shall be installed within 18 in. (455 mm) of the floor. Floor proximity egress path marking systems shall be listed in accordance with ANSI/UL 1994, Standard for Luminous Egress Path Marking Systems. The system shall provide a visible delineation of the path of travel along the designated exit access and shall be

Life Safety Code

essentially continuous, except as interrupted by doorways, hallways, corridors, or other such architectural features. The system shall operate continuously or at any time the building fire alarm system is activated. The activation, duration, and continuity of operation of the system shall be in accordance with 7.9.2. The system shall be maintained in accordance with the product manufacturing listing.

7.10.1.8* Visibility. Every sign required in Section 7.10 shall be located and of such size, distinctive color, and design that it is readily visible and shall provide contrast with decorations, interior finish, or other signs. No decorations, furnishings, or equipment that impairs visibility of a sign shall be permitted. No brightly illuminated sign (for other than exit purposes), display, or object in or near the line of vision of the required exit sign that could detract attention from the exit sign shall be permitted.

7.10.1.9 Mounting Location. The bottom of new egress markings shall be located at a vertical distance of not more than 6 ft 8 in. (2030 mm) above the top edge of the egress opening intended for designation by that marking. Egress markings shall be located at a horizontal distance of not more than the required width of the egress opening, as measured from the edge of the egress opening intended for designation by that marking to the nearest edge of the marking.

7.10.2 Directional Signs.

7.10.2.1* A sign complying with 7.10.3, with a directional indicator showing the direction of travel, shall be placed in every location where the direction of travel to reach the nearest exit is not apparent.

7.10.2.2 Directional exit signs shall be provided within horizontal components of the egress path within exit enclosures as required by 7.10.1.2.2.

7.10.3* Sign Legend.

7.10.3.1 Signs required by 7.10.1 and 7.10.2 shall read as follows in plainly legible letters, or other appropriate wording shall be used: EXIT

7.10.3.2* Where approved by the authority having jurisdiction, pictograms in compliance with NFPA 170, Standard for Fire Safety and Emergency Symbols, shall be permitted.

7.10.4* Power Source. Where emergency lighting facilities are required by the applicable provisions of Chapters 11 through 43 for individual occupancies, the signs, other than approved self-luminous signs and listed photoluminescent signs in accordance with 7.10.7.2, shall be illuminated by the emergency lighting facilities. The level of illumination of the signs shall be in accordance with 7.10.6.3 or 7.10.7 for the required emergency lighting duration as specified in 7.9.2.1. However, the level of illumination shall be permitted to decline to 60 percent at the end of the emergency lighting duration.

7.10.5 Illumination of Signs.

7.10.5.1* General. Every sign required by 7.10.1.2, 7.10.1.5, or 7.10.8.1, other than where operations or processes require low lighting levels, shall be suitably illuminated by a reliable light source. Externally and internally illuminated signs shall be legible in both the normal and emergency lighting mode.

7.10.5.2* Continuous Illumination.

7.10.5.2.1 Every sign required to be illuminated by 7.10.6.3, 7.10.7, and 7.10.8.1 shall be continuously illuminated as required under the provisions of Section 7.8, unless otherwise provided in 7.10.5.2.2.

7.10.5.2.2* Illumination for signs shall be permitted to flash on and off upon activation of the fire alarm system.

7.10.6 Externally Illuminated Signs.

7.10.6.1* Size of Signs.

7.10.6.1.1 Externally illuminated signs required by 7.10.1 and 7.10.2, other than approved existing signs, unless otherwise provided in 7.10.6.1.2, shall read EXIT or shall use other appropriate wording in plainly legible letters sized as follows:

- (1) For new signs, the letters shall be not less than 6 in. (150 mm) high, with the principal strokes of letters not less than 3/4 in. (19 mm) wide.
- (2) For existing signs, the required wording shall be permitted to be in plainly legible letters not less than 4 in. (100 mm) high.
- (3) The word EXIT shall be in letters of a width not less than 2 in. (51 mm), except the letter I, and the minimum spacing between letters shall be not less than 3/8 in. (9.5 mm).
- (4) Sign legend elements larger than the minimum established in 7.10.6.1.1(1) through (3) shall use letter widths, strokes, and spacing in proportion to their height.

7.10.6.1.2 The requirements of 7.10.6.1.1 shall not apply to marking required by 7.10.1.3 and 7.10.1.7.

7.10.6.2* Size and Location of Directional Indicator.

7.10.6.2.1 Directional indicators, unless otherwise provided in 7.10.6.2.2, shall comply with all of the following:

- (1) The directional indicator shall be located outside of the EXIT legend, not less than 3/8 in. (9.5 mm) from any letter.
- (2) The directional indicator shall be of a chevron type, as shown in Figure 7.10.6.2.1.
- (3) The directional indicator shall be identifiable as a directional indicator at a distance of 40 ft (12 m).
- (4) A directional indicator larger than the minimum established for compliance with 7.10.6.2.1(3) shall be proportionately increased in height, width, and stroke.
- (5) The directional indicator shall be located at the end of the sign for the direction indicated.



7.10.6.2.1 Chevron Type Indicator.

7.10.6.2.2 The requirements of 7.10.6.2.1 shall not apply to approved existing signs.

7.10.6.3* Level of Illumination. Externally illuminated signs shall be illuminated by not less than 5 ft-candles (54 lux) at the illuminated surface and shall have a contrast ratio of not less than 0.5.

7.10.7 Internally Illuminated Signs.

7.10.7.1 Listing. Internally illuminated signs shall be listed in accordance with ANSI/UL 924, Standard for Emergency Lighting and Power Equipment, unless they meet one of the following criteria:

- (1) They are approved existing signs.
- (2) They are existing signs having the required wording in legible letters not less than 4 in. (100 mm) high.
- (3) They are signs that are in accordance with 7.10.1.3 and 7.10.1.6.

7.10.7.2* Photoluminescent Signs. The face of a photoluminescent sign shall be continually illuminated while the building is occupied. The illumination levels on the face of the photoluminescent sign shall be in accordance with its listing. The charging illumination shall be a reliable light source, as determined by the authority having jurisdiction. The charging light source, shall be of a type specified in the product markings.

7.10.8 Special Signs.**7.10.8.1 Sign Illumination.**

7.10.8.1.1 Where required by other provisions of this Code, special signs shall be illuminated in accordance with 7.10.5, 7.10.6.3, and 7.10.7.

7.10.8.1.2 Where emergency lighting facilities are required by the applicable provisions of Chapters 11 through 43, the required illumination of special signs shall additionally be provided under emergency lighting conditions.

7.10.8.2 Characters. Special signs, where required by other provisions of this Code, shall comply with the visual character requirements of ICC/ANSI A117.1, American National Standard for Accessible and Usable Buildings and Facilities.

7.10.8.3* No Exit.

7.10.8.3.1 Any door, passage, or stairway that is neither an exit nor a way of exit access and that is located or arranged so that it is likely to be mistaken for an exit shall be identified by a sign that reads as follows:

NO EXIT

7.10.8.3.2 The NO EXIT sign shall have the word NO in letters 2 in. (51 mm) high, with a stroke width of 3/8 in. (9.5 mm), and the word EXIT in letters 1 in. (25 mm) high, with the word EXIT below the word NO, unless such sign is an approved existing sign.

7.10.8.4 Elevator Signs. Elevators that are a part of a means of egress (see 7.2.13.1) shall have both of the following signs with a minimum letter height of 5/8 in. (16 mm) posted in every elevator lobby:

- (1) *Signs that indicate that the elevator can be used for egress, including any restrictions on use
- (2) *Signs that indicate the operational status of elevators

7.10.8.5* Evacuation Diagram. Where a posted floor evacuation diagram is required in Chapters 11 through 43, floor evacuation diagrams reflecting the actual floor arrangement and exit locations shall be posted and oriented in a location and manner acceptable to the authority having jurisdiction.

7.10.9 Testing and Maintenance.

7.10.9.1 Inspection. Exit signs shall be visually inspected for operation of the illumination sources at intervals not to exceed 30 days or shall be periodically monitored in accordance with 7.9.3.1.3.

7.10.9.2 Testing. Exit signs connected to, or provided with, a battery-operated emergency illumination source, where required in 7.10.4, shall be tested and maintained in accordance with 7.9.3. NFPA 101® Life Safety Code® 2015 Edition

©2015, NFPA, All Right Reserved
Life Safety Code® and NFPA 101® are registered trademarks of the National Fire Protection Association, Inc.

Limited warranty

- 1.1 **EMERGI-LITE®** 6, 12 and 24 volt Emergency Lighting Unit Equipment (excluding lamps and fuses) and Exit Signs are fully warranted to be free of defects in material and workmanship under normal use for a period of three years from date of installation (see Paragraph 2.1).
(For MR16 LED light source, see Paragraph 3.3)
- 1.2 **EMERGI-LITE®** 6, 12 and 24 volt Emergency Lighting Unit Equipment (excluding lamps and fuses) and Exit Signs listed below are fully warranted to be free of defects in material and workmanship under normal use for a period of five years from date of installation (see Paragraph 2.1).
(For MR16 LED light source, see Paragraph 3.3)

Spec Grade Architectural	Spec Grade Commercial	Spec Grade Industrial	Remote
Lux-Ray™ LED Series	Premier™ Battery Series	Survive-All™ SVX Combo Series	Lux-Ray™ LED Series
Revelation™ Series	Premier™ Combo Series	Survive-All™ SVX Exit Series	Revelation™ Series
Mini-Revelation Series	Premier™ Exit Series	Survive-All™ SVH Series	Mini-Revelation Series
Prestige™ Series Edge-Lit	Preceptor™ Die-Cast Series	Survive-All™ SVXH Series	HP High Performance Series
Prestige™ Series X40	Preceptor™ Recessed Series	Survive-All SVXHZ Series	HPRL Remote Series
Prestige™ DX Series	Preceptor™ Remote Capacity Series	HP High Performance Series	EF39 Remote Series
Prestige™ Floor Proximity Series	Premier Compact	HPH Battery Series	
RS Battery Series	Economiser Edge-Lit	HPHRL Remote Series	
TS Battery Series		EXC Battery/ Combo Series	
		EFEP Remote Series	
		EFXP Exit Series	

- 1.3 **EMERGI-LITE®** 3.6 volt Emergency Lighting Unit Equipment (excluding lamps, and fuses) are fully warranted to be free of defects in material and workmanship under normal use for a period of three year from date of installation (see Paragraph 2.1).
- 1.4 **EMERGI-LITE®** 6, 12 and 24 volt Unit Equipment Batteries are warranted as follows
(Warrant below includes the full warranty on entire unit as called out in Paragraph 1.1–1.3).

Battery type	Life expectancy	Shelf life ¹	Full warranty	Pro rata warranty
Sealed lead-calcium	8 years	6 months	3 years	3 years
High temperature lead-calcium	8 years	6 months	5 years	3 years
Sealed nickel-cadmium	10 years	1 year	5 years	5 years
Nickel-metal hydride	10 years	1 year	5 years	5 years

¹Maximum storage life. Must be recharged if not placed in service or battery warranty void.

- 2.1 The full warranty period begins on the date of installation or 90 days from date of shipment, whichever date is earlier.
- 2.2 Should a defect appear in the equipment or batteries listed in Paragraphs 1.1–1.4 above within the specified full warranty period, **EMERGI-LITE®** will repair or replace equipment without charge (see Paragraph 3.3). Such repair or replacement shall be the purchaser's exclusive remedy.
- 2.3 The Pro Rata Warranty Period for batteries begins on the date the full warranty period ends.
- 2.4 A battery determined to be defective during the Pro Rata Warranty Period shall be repaired or replaced at a cost equal to the net price in effect at the time, reduced by the percentage obtained in multiplying 10% by the number of full years remaining in the total warranty period. Such repair or replacement at this adjusted price shall be the purchaser's exclusive remedy.
- 3.1 All warranties are subject to proper installation and maintenance in accordance with the instructions supplied.
- 3.2 Any material deemed defective must be returned, freight prepaid, to the factory for evaluation (see Paragraph 5.1–5.3). Any changes in circuitry or components by other than authorized **EMERGI-LITE®** personnel or its service companies will void the warranty.
- 3.3 All warranties are limited to the repair and/or replacement or parts or equipment, which, upon examination at our plant, are determined to be defective and in our judgement are subject to repair or replacement under warranty. Replacement of lamps and fuses is not included in the warranty except for MR16 LED lamps are warranted to be free of defects in material and workmanship under normal use for a period of five (5) years when purchased and used with **EMERGI-LITE®** Battery Units, Combination Units or Remotes. The full warranty period begins on the date of installation or ninety (90) days from the date of shipment, whichever date is earlier.
- 3.4 If new replacement parts are shipped before defective goods are received for evaluation, the replacement parts will be invoiced at the net price in effect at that time. These charges will be credited if, upon receipt and evaluation of goods, a defect is determined. Only replacement parts will be shipped under these circumstances, if field replacement is possible. **EMERGI-LITE®** FACTORY ONLY RESERVES THE RIGHT TO SHIP NEW UNIT EQUIPMENT FOR REPLACEMENT PURPOSES. Units returned after installation cannot be restored to 100% saleable condition.
- 4.1 In no event shall **EMERGI-LITE®** be liable for backcharges of any kind, including, without limitation, labor charges for field repair or late penalties.

- 4.2 This warranty does not cover damages caused by improper maintenance of installation or damage due to installation in areas with other than normal temperatures and environmental conditions per application specifications. **EMERGI-LITE®** assumes no responsibility for any damage to people, property, apparatus or otherwise resulting from improper installation or maintenance of its Emergency Lighting Unit Equipment.
- 4.3 This warranty does not cover damages caused by abuse, fire or Act of God.
- 4.4 In no event shall **EMERGI-LITE®** be liable for incidental or consequential damages.
- 4.5 The foregoing warranty is in lieu of all other warranties, expressed or implied, or merchantability, fitness for a particular purpose or any other thing. Except as stated in this warranty, **EMERGI-LITE®** shall not be liable for any defects in, or breach of any contract relating to, the quality of performance of **EMERGI-LITE®** Equipment under any theory of law including, without limitation, contract, negligence, strict liability or misrepresentation.
- 4.6 **EMERGI-LITE®** warranty coverage shall not apply to any equipment of another manufacturer used in conjunction with **EMERGI-LITE®** Equipment.
- 4.7 Some states do not allow limitation on how long an implied warranty lasts, so the above limitation may not apply to you. Some states do not allow the exclusion or limitation of incidental or consequential damages, so the above limitation or exclusion may not apply to you. This written warranty gives you specific legal rights and you may also have other rights which vary from state to state.
- 5.1 No returned defective materials will be accepted without a Returned Goods Authorization issued in writing by an authorized **EMERGI-LITE®** employee.
- 5.2 Purchaser is responsible for secure packing of returned materials to provide best possible assurance against damage in shipment.
- 5.3 Defective batteries of any kind must not be returned to **EMERGI-LITE®** factory without strict adherence to special instructions for handling and shipping. **WARNING** Never ship a refillable wet battery in any type of emergency lighting equipment. Failure to adhere to this policy will void warranty.
- 5.4 Defective goods returned to the factory must be shipped prepaid. **COLLECT RETURNED SHIPMENT WILL BE REFUSED.** Freight charges to return repaired equipment or ship replacement equipment to the purchaser to be paid by **EMERGI-LITE®**. Factory will return repaired goods via same shipping method as received.

FAILURE TO COMPLY WITH ANY OF THE STIPULATIONS SET FORTH WILL VOID THE WARRANTY. ANY EXCEPTIONS TO THE FOREGOING WARRANTY MUST BE REQUESTED AND ACCEPTED IN WRITING PRIOR TO SHIPMENT. EMERGI-LITE® EQUIPMENT NOT LISTED IN PARAGRAPHS 1.1–1.4 IS WAR-RANTED AS DESCRIBED ON ITS INDIVIDUAL DATA SHEET WITH THE STIPULATIONS AS STATED IN PARAGRAPHS 2.1–5.4.

Product index

Series	Page	Series	Page	Series	Page	Series	Page
12804-E	177	330.7584-E	177	JSM27	51	RSC18	23
12805-E	177	450.0129-E	177	JSM36	51	RSC25	23
12EXC2	97	450.0194-E	177	JSM54	51	RSM18	23
12EXC4	97	450.0397-E	177	JSM9	51	RSM27	23
12HP	73	450.0398-E	177	L	57	RSM36	23
12HPH	85	450.1153-E	177	LC100	53	RT	19
12JSC30	49	450.1155-E	177	LC175	53	RTG	19
12JSC36	51	6EXC1	97	LC200	53	RTR	107
12JSC40	49	6EXC3	97	LC87	53	RTS	176
12JSC50	51	B1	176	LEDDR11	142	RTS-1	176
12JSM20	51	B2	176	LEDDR-14	142	SLX	95
12JSM36	49, 51	DLM-2	136	LEDDR-17	142	SV18M	77
12JSM54	51	DX	31, 33	LEDDR-5	142	SVX	81
12LC150	53	DXN	31, 33	LEDDR-7	142	SVX12N	79
12LC175	53	EF10	111	LEDP	63	SVX24N	79
12LC300	53	EF12	112, 135	LEDPXN	63	SVXH	91
12LC350	53	EF150	110	LITE	106	SVXH12N	91
12LC400	53	EF39	83, 115	LL	33	SVXHZ	93
12LSC36	55	EF39D	83, 115	LSC18	55	SVXN	81
12LSC50	55	EF39P	83, 115	LSC25	55	SVXNHZ	93
12LSC72	55	EF39PD	83, 115	LSM	55	TSC18	25
12LSM110	55	EF40	115	LSM110	55	TSC25	25
12LSM162	55	EF40D	115	LSM162	55	TSM110	25
12LSM220	55	EF40P	115	LSM18	55	TSM18	25
12LSM36	55	EF40PD	115	LSM200	55	TSM27	25
12LSM54	55	EF41	94, 117	LSM27	55	TSM36	25
12MPR12H	39	EF41D	94, 117	LSM36	55	TSM54	25
12MPR12M	39	EF43	129	LSM54	55	TSM81	25
12MPR20M	39	EF44	129	LSM81	55	TX	124
12MPR24H	39	EF47	135	LSNX	29	TXN	124
12PR40M	41	EFEP	99	LUX	17, 105	VRS	176
12PR40NC	41	EFR8R	109	LX	27, 29	VRS-4X	176
12PR72M	41	EFR9	109	LXN	27	VRS-BB	176
12RSC36	23	EFR9WH	109	MP12	176	VRSBB-4X	176
12RSC50	23	EFXP	101	MP24	176	WG10-E	175
12RSM36	23	EL	123, 127, 131	MP3-EG	176	WG11-E	175
12SV24M	77	EL-2SQL	131	MP3-GY	176	WG12-E	175
12SV24N	77	EL-2SQLR	131	MP6	176	WG13-E	175
12SV36M	77	EL-2SQLRAD	131	MPR10M	39	WG14-E	175
12SV40N	77	EL-GRHR03	109	MPR12H	39	WG15-E	175
12SV54M	77	EL-GRHR04	109	NEX	62	WG1-E	174
12SV60H	77	EL-GRHR05	109	NEXRF	62	WG2-E	174
12TSC36	25	EL-GRHR06	109	P	62, 65	WG3-E	174
12TSC50	25	ELX400	134	P2C1	62	WG4-E	174
12TSM110	25	ELXN400	129, 133, 134	P2C2	62	WG5-E	174
12TSM36	25	EMILC	153	PA	125	WG6-E	174
12TSM54	25	EMIU	155, 157	PA2	125	WG7-E	174
230.1238-E	177	EPC-1-D-E	145	PDN	62	WG8-E	174
230.1239-E	177	EPC-1-E	145	PE	58-59, 61	WG9-E	175
245.0100-E	177	EPC-2-D-E	148	PEN	58-59, 61		
24HP	73	EPC-2-E	148	PES	58-59, 61		
24HPH	85	EPC-2-FM-D-E	146	PN	125		
24LC300	53	EPC-2-FM-E	146	PR	43		
24LC350	53	FPDL-13-42-N	144	PR20NC	41		
24LC400	53	FPDL-28	143	PR60M	41		
24LSC100	55	FPDL32	143	PREM	45		
24LSC72	55	FPDL-HL-N	143	PRO-2N	47		
24LSM110	55	FPDL-U	143	PRO-3N	47		
24LSM220	55	GS	137	PU	62		
24TSC100	25	HPHRL	87, 116	PXN	62		
24TSM110	25	HPRL	75, 113	RAD	121		
330.7577-E	177	JSC18	51	RCL	64		
330.7578-E	177	JSC25	51	RCN	64		
330.7583-E	177	JSM18	51	RCX	64		

Additional information

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB AG does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB AG.



US

ABB Installation Products
Electrification Products division
860 Ridge Lake Blvd.
Memphis, TN 38120
+1 901-252-5000

emergi-lite.com