
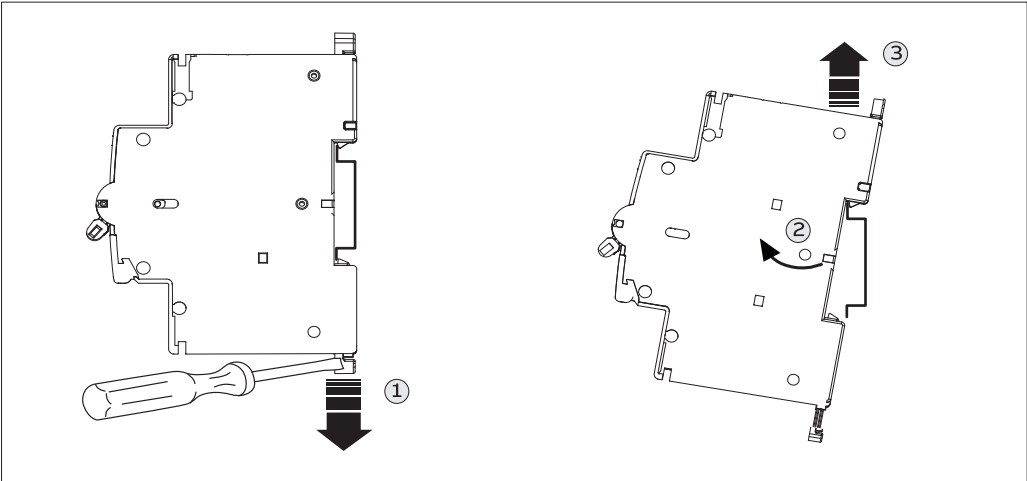


RCBO

Residual
Current Circuit
Breaker with
Overcurrent
Protection

2TXA410086A1001

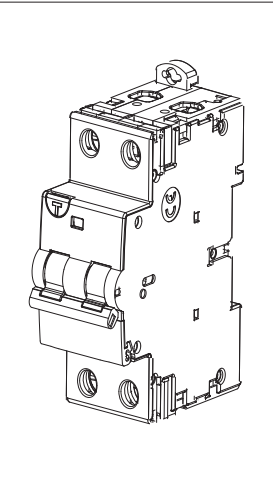

TEST

Minimum every six months

