



产品认证证书

证书编号: CQC2005010302159163

II 型自愿认证

申请人名称及地址

ABB Oy

Muottitie 2A FI-65320 VAASA, Finland

制造商名称及地址

ABB Oy

Muottitie 2A FI-65320 VAASA, Finland

生产企业名称及地址

ABB Oy (V054902)

Muottitie 2A FI-65320 VAASA, Finland

产品名称和系列、规格、型号

隔离器熔断器组

OESL630V32D, OEVA630D32D;详见附件

产品标准和技术要求

GB/T 14048.3-2017

认证模式

型式试验+初始工厂检查+获证后监督

上述产品符合 CQC12-000001-2020 认证规则的要求, 特发此证。

发证日期: 2020 年 12 月 04 日 有效期至: 2030 年 12 月 04 日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书, 证书首次颁发日期: 2020 年 09 月 02 日

主任: _____

陆杨



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

C 0433964



PRODUCT CERTIFICATE

CERTIFICATE NO.: CQC2005010302159163

Type II CQC Certification

NAME AND ADDRESS OF THE APPLICANT

ABB Oy
Muottitie 2A FI-65320 VAASA, Finland

NAME AND ADDRESS OF THE MANUFACTURER

ABB Oy
Muottitie 2A FI-65320 VAASA, Finland

NAME AND ADDRESS OF THE FACTORY

ABB Oy (V054902)
Muottitie 2A FI-65320 VAASA, Finland

PRODUCT NAME, MODEL AND SPECIFICATION

Disconnecter-Fuse
OESL630V32D, OEVA630D32D; See the appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 14048.3-2017

TYPE OF CERTIFICATION SCHEMES

Type testing of product + initial factory inspection + follow up factory inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC12-000001-2020.

Valid from: Dec.04,2020

Valid until: Dec.04,2030

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Date of original issued: Sep.02,2020

President:

Lu Mei



CHINA QUALITY CERTIFICATION CENTRE

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China
<http://www.cqc.com.cn>

C 0433964



产品认证证书

附 录

第 1 页 共 5 页

证书编号: CQC2005010302159163

纸 号: 433964

OESL630V32D, OEVA630D32D

Uimp: 12kV;

Ui: 1000V;

Ith: 600A;

Ue: DC690V, DC1000V;

Ie: 600A;

Iq: 65kA (DC1000V), 100kA (DC690V);

使用类别: DC-20B;

IP20 (仅正面)

直流接线图如下:

注: 此附录与证书同时使用时有效。

主任: _____

陆 楠



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>




产品认证证书

附录

第 2 页 共 5 页

证书编号: CQC2005010302159163

纸号: 433964

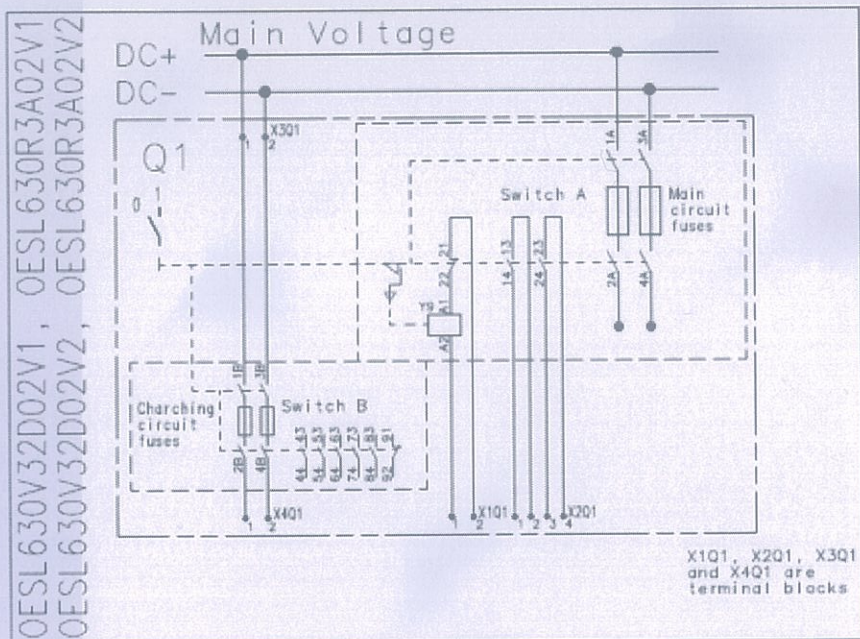

注: 此附录与证书同时使用时有效。

主任:

陆梅

中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>






产品认证证书

附录

第 3 页 共 5 页

证书编号: CQC2005010302159163

纸 号: 433964

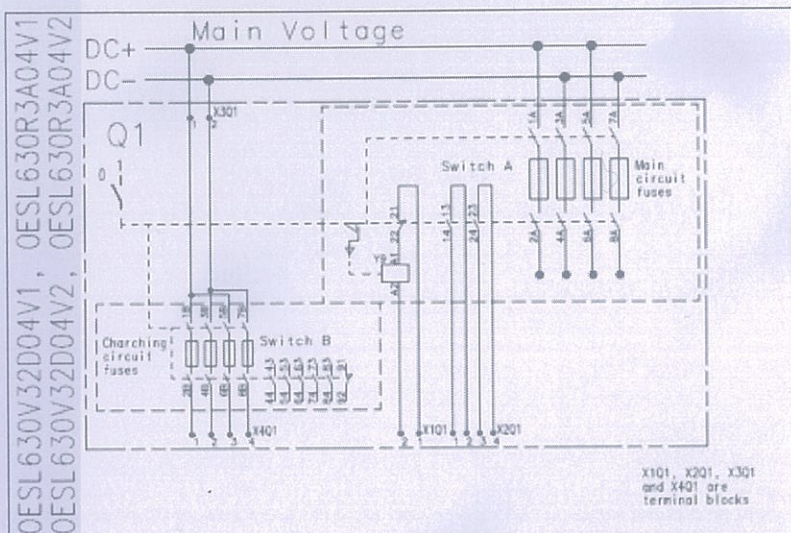

注: 此附录与证书同时使用时有效。

主任:

陆梅

中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070


<http://www.cqc.com.cn>





第 4 页 共 5 页

纸 号: 433964



注：此附录与证书同时使用时有效。

主任：

陈楠

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>





产品认证证书

附录

第 5 页 共 5 页

证书编号: CQC2005010302159163

纸 号: 433964

OESL	630	V	32	D	24	V2
						Rated voltage for trip coil 脱扣线圈额定电压 V1=110VAC V2=230VAC
						Number of poles 极数 02 - 2poles 2 极 04 - 4poles 4 极 24 - parallel connection by 2poles and 4poles fuse switches 2 极和 4 极隔离开关熔断器组并联
						Fuse holder DIN43620 熔断器座 DIN43620
						Size of intermediate switch 中间开关规格
						Code V for OESL and D for OEVA 代号 V 用在 OESL and D 用在 OEVA
						Size of main switch 主开关规格
						Series Designation 系列号 OESL,OEVA

注: 此附录与证书同时使用时有效。

主任:

陆梅



中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>